



**CROSS SECTION LOOKING EAST**  
AT CHAINAGE 125  
SCALE: 1" = 5'-0"

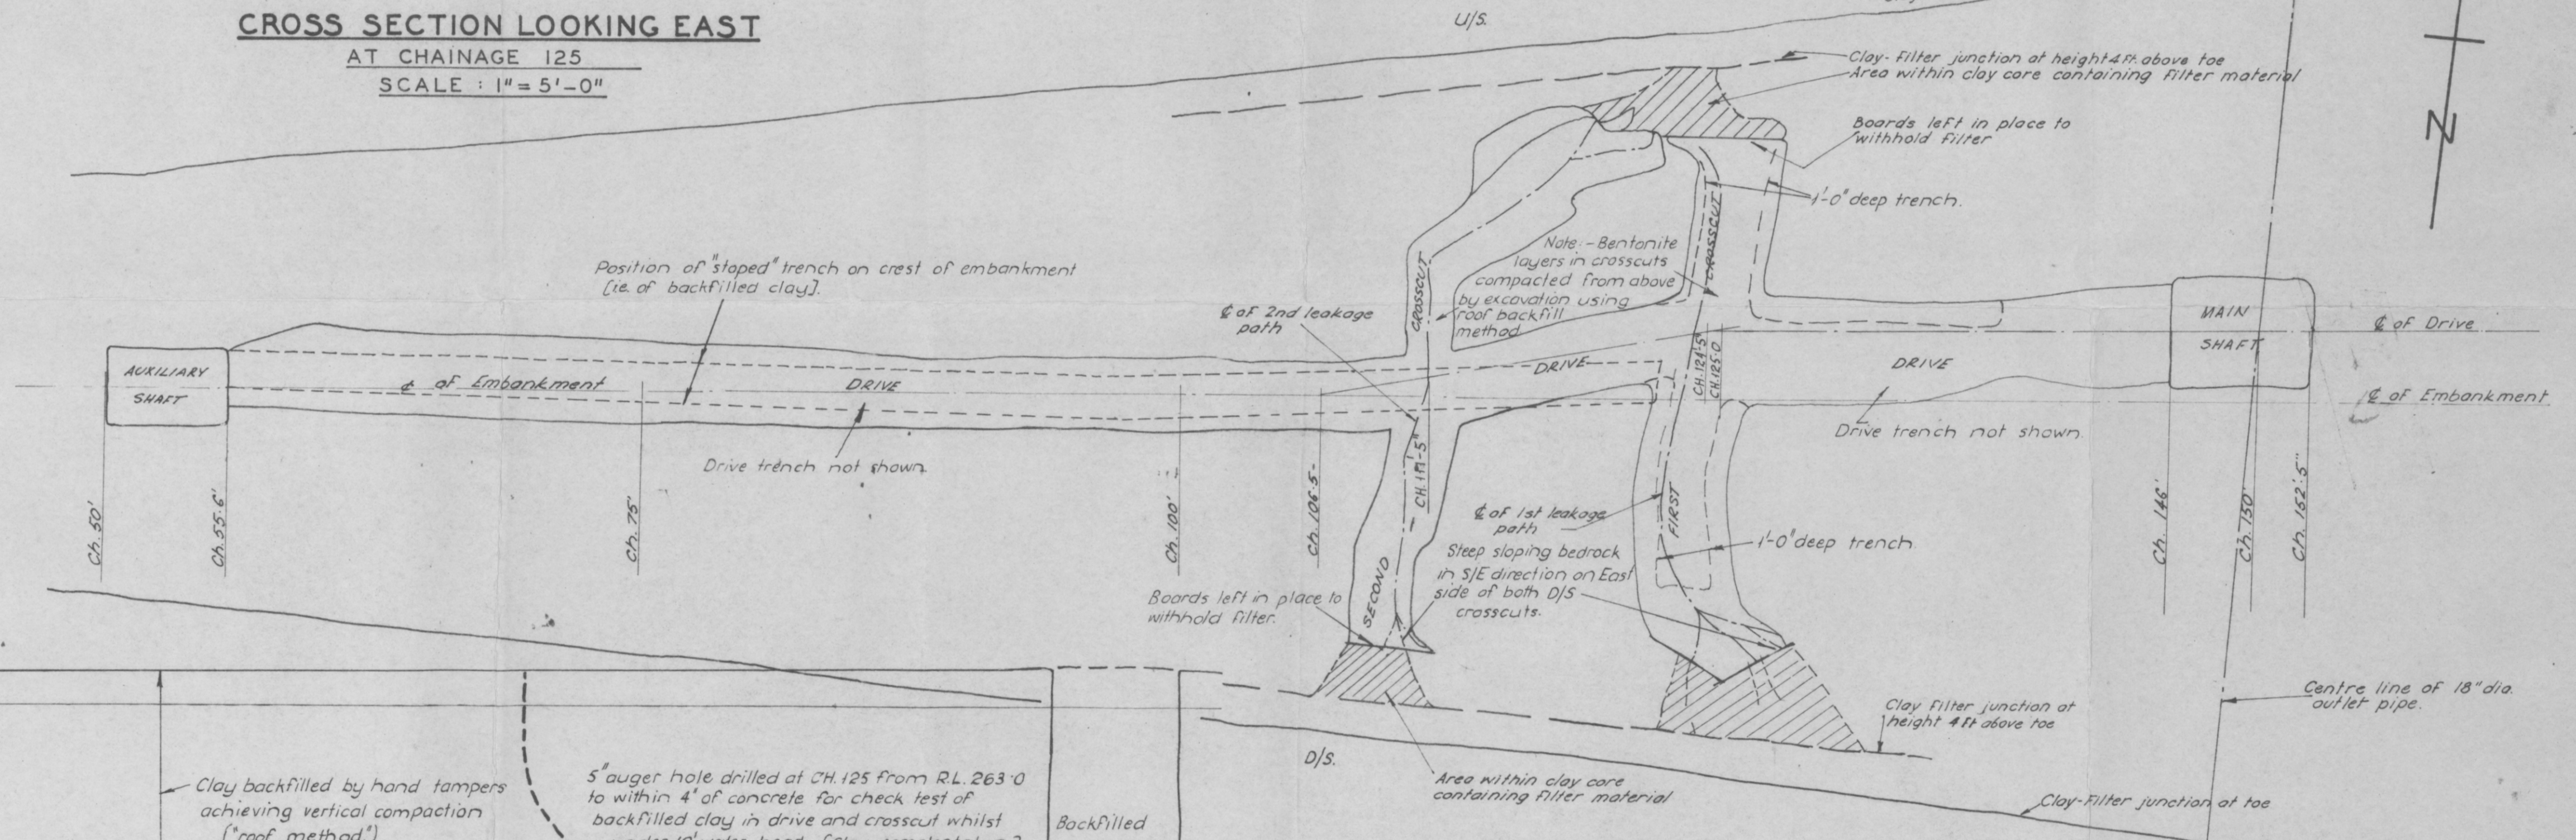

**PLAN OF SHAFTS, DRIVE & CROSSCUTS**  
SCALE: 1" = 5'-0"

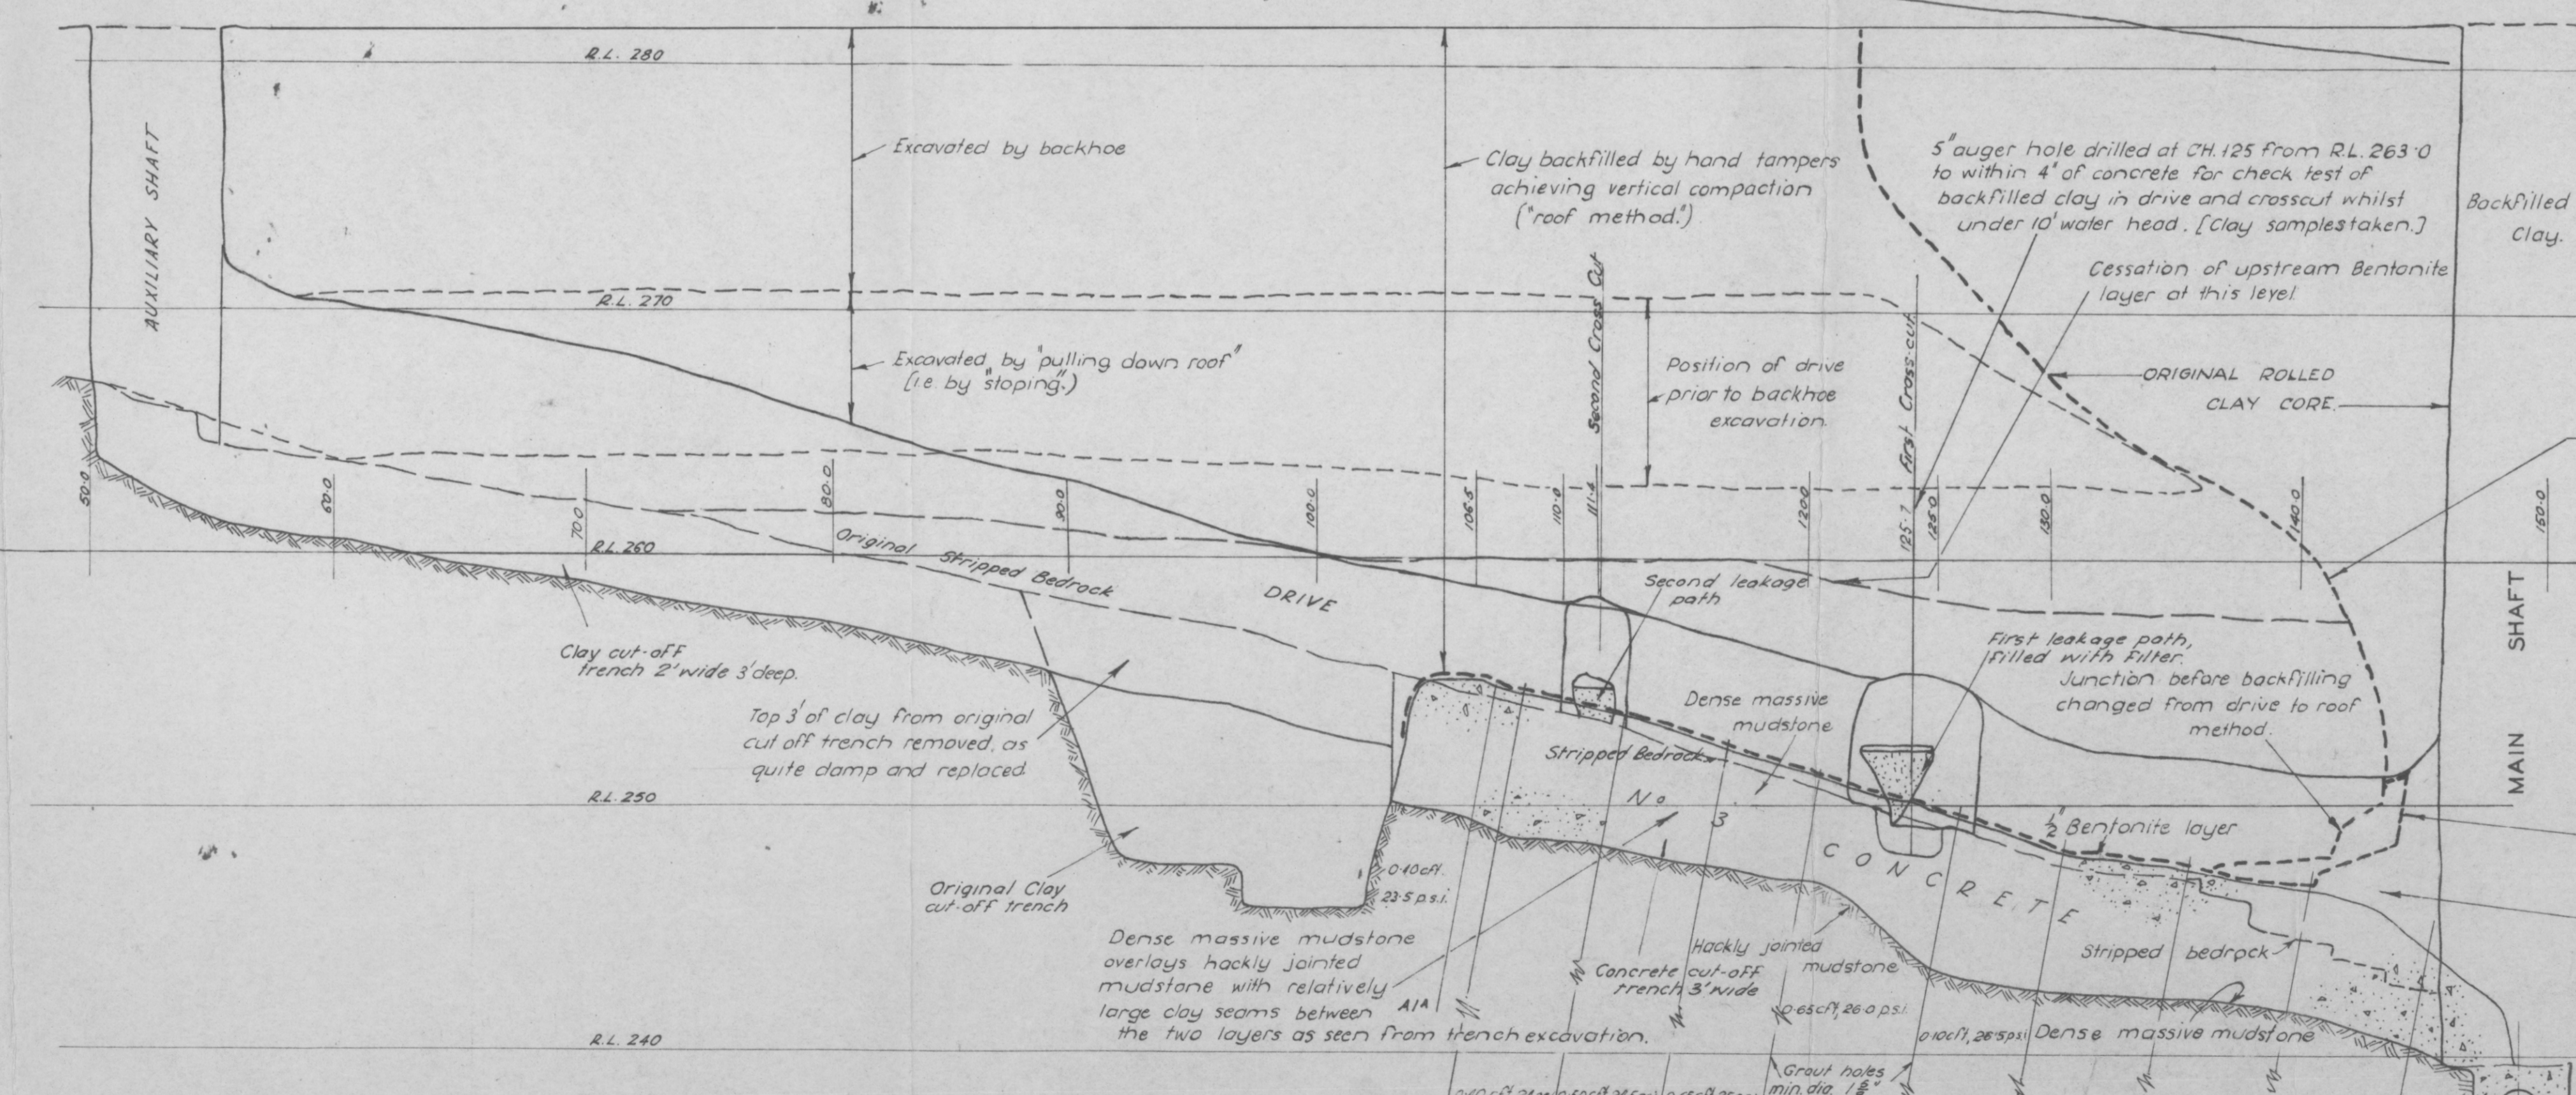

**LONGITUDINAL SECTION**  
THROUGH C OF DRIVE  
SCALE: 1" = 5'-0"

N.B. 1. Grout W/C ratio + 5:1, except when filling holes due to shrinkage where a maximum of 0.20 cfm of 2 1/2:1 grout was required.  
2. Maximum Water Test of 0.20 cfm/min under 20 p.s.i. secured on hole A12.

Note -  
For other details of investigation, preventative and repair work, see drawing No 1521-30-1B.

Revision A - Grout quantities and pressures shown.

© GUTTERIDGE HASKINS & DAVEY CONSULTING ENGINEERS		HOBART MELBOURNE LAUNCESTON	
		MUNICIPALITY OF CLARENCE FLAGSTAFF GULLY DAM	
GENERAL SECTIONS & PLANS OF REPAIR WORK			
SCALE	AS SHOWN		
DESIGNED	A. J. H.		
DRAWN	H. M. B.		
CHECKED	A. J. H.		
APPROVED	[Signature] Dec 63		
		REVISION A 13-2-64	