


4799

575

5 cm

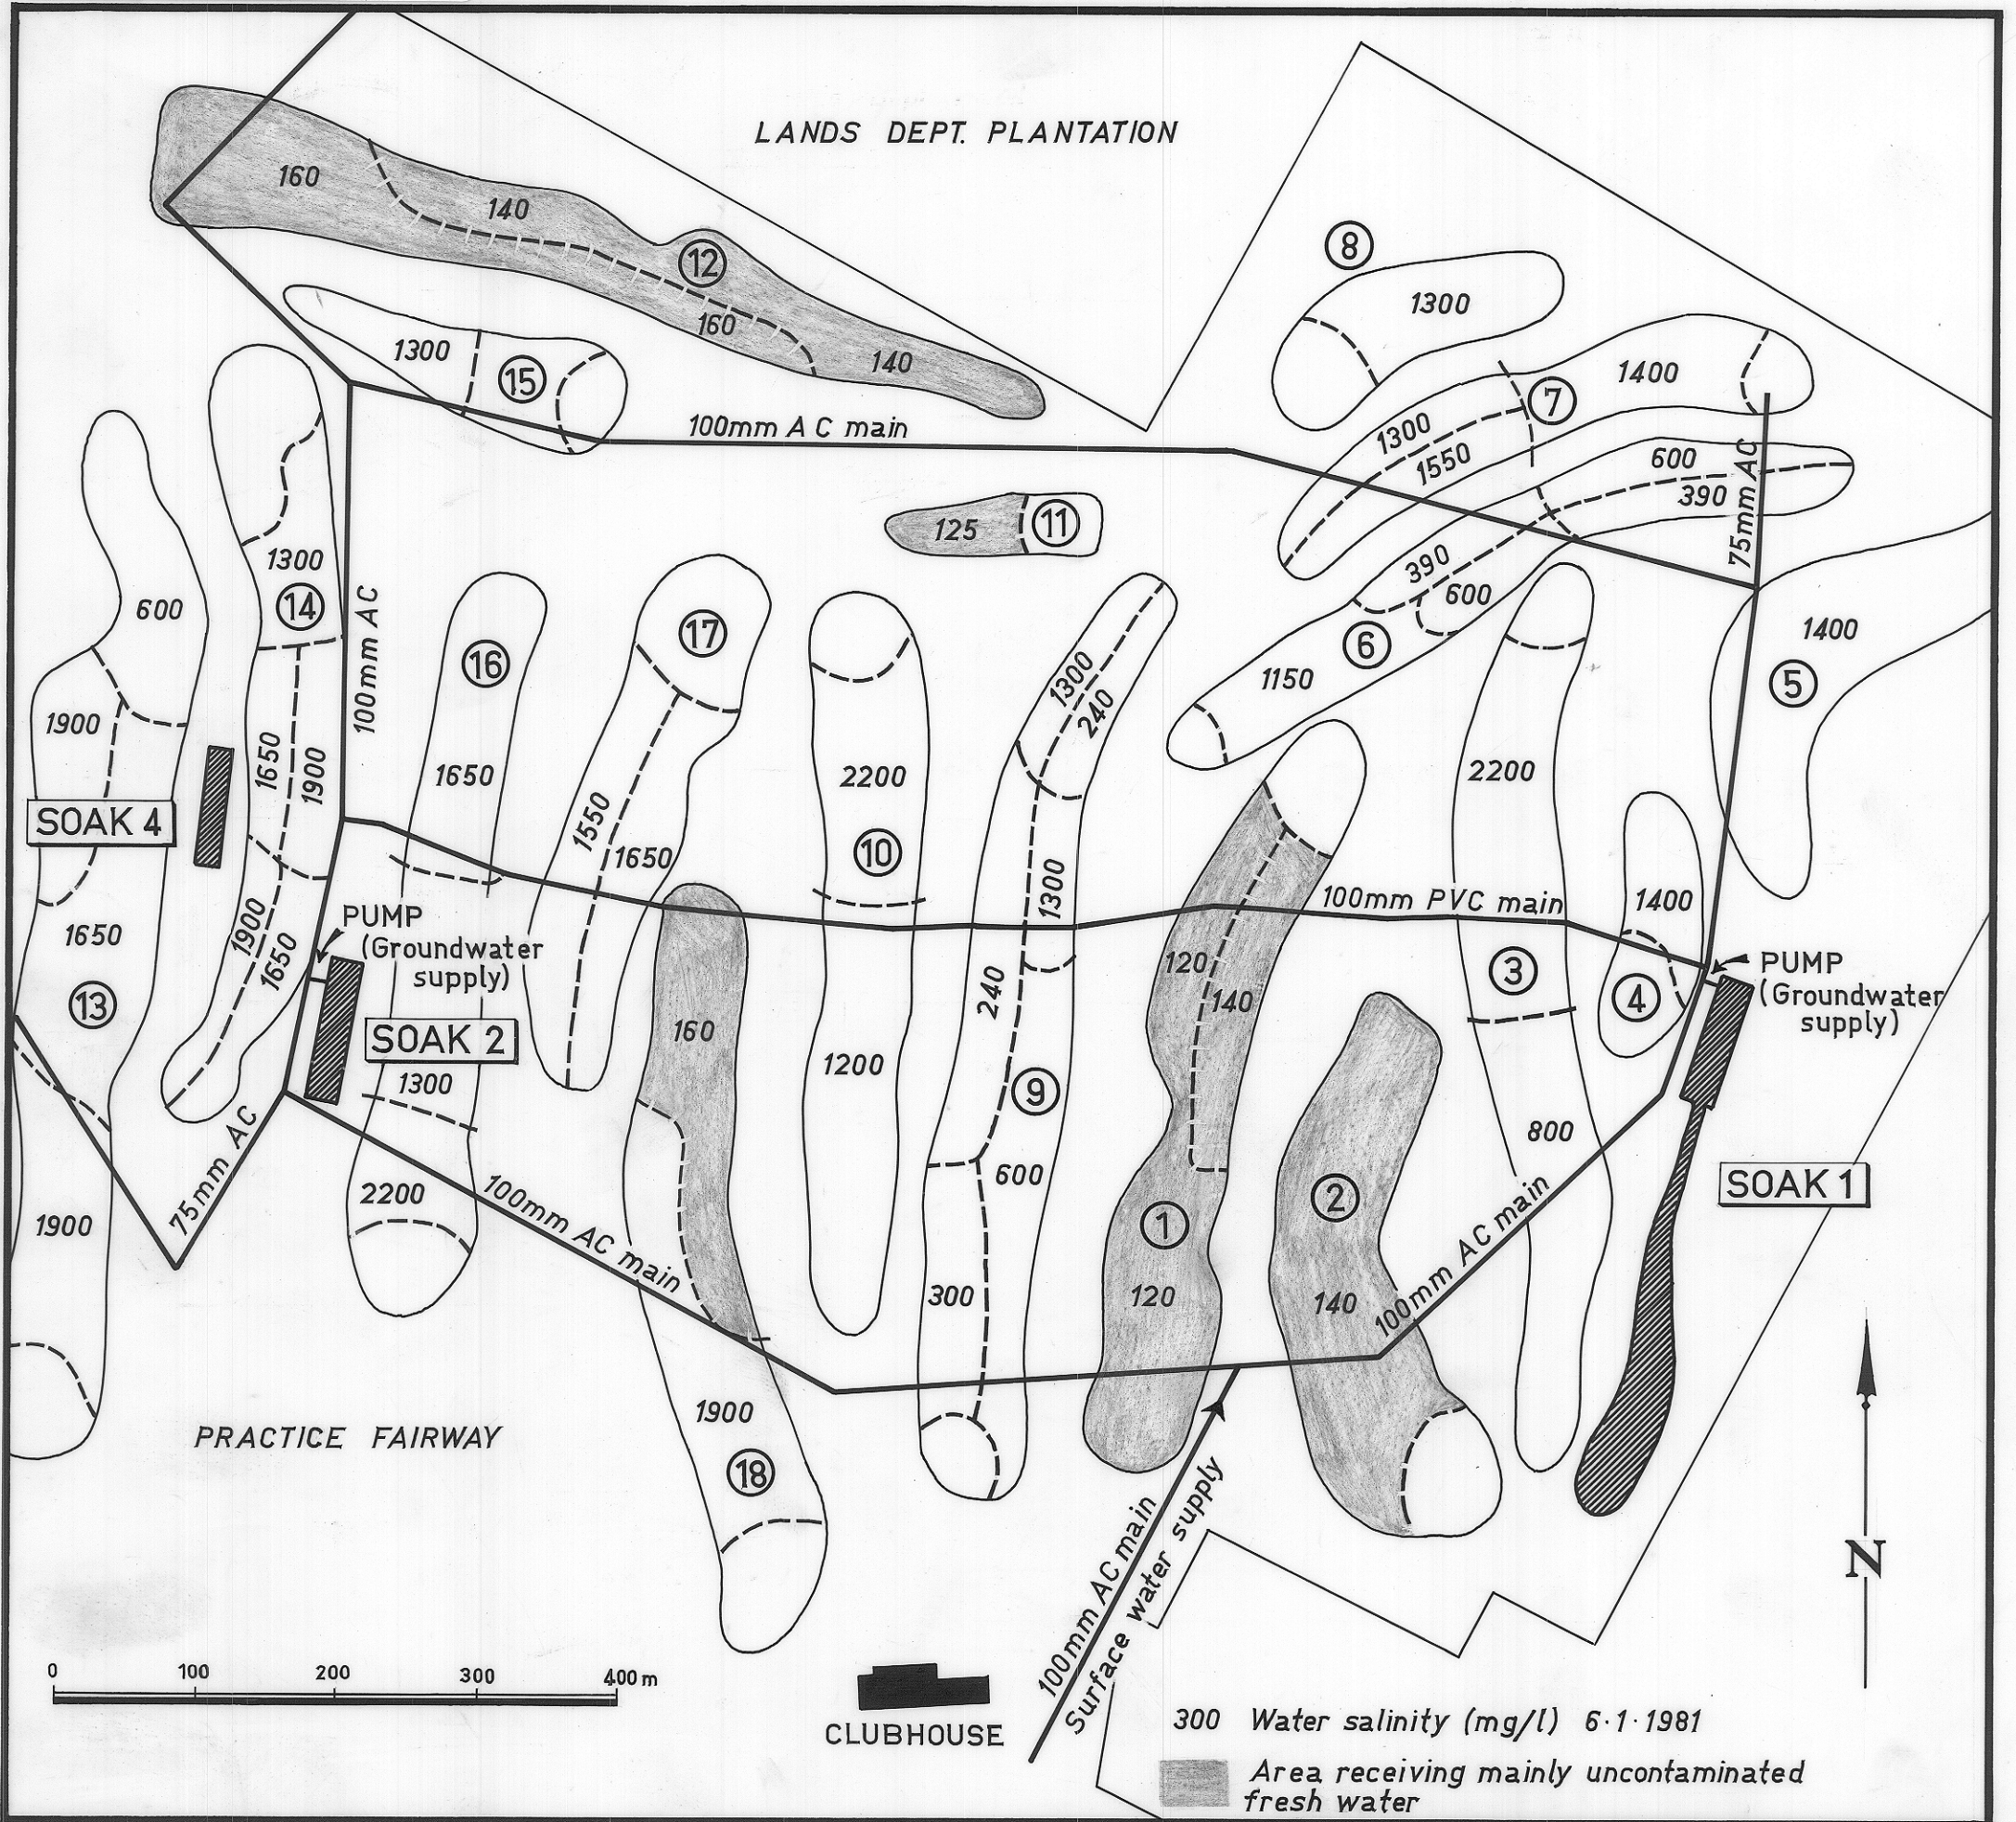

LANDS DEPT. PLANTATION

100mm A C main

100mm PVC main

PUMP (Groundwater supply)

PUMP (Groundwater supply)

SOAK 4

SOAK 2

SOAK 1

PRACTICE FAIRWAY

CLUBHOUSE

300 Water salinity (mg/l) 6.1.1981

Area receiving mainly uncontaminated fresh water

0 100 200 300 400 m

N