750 D

102

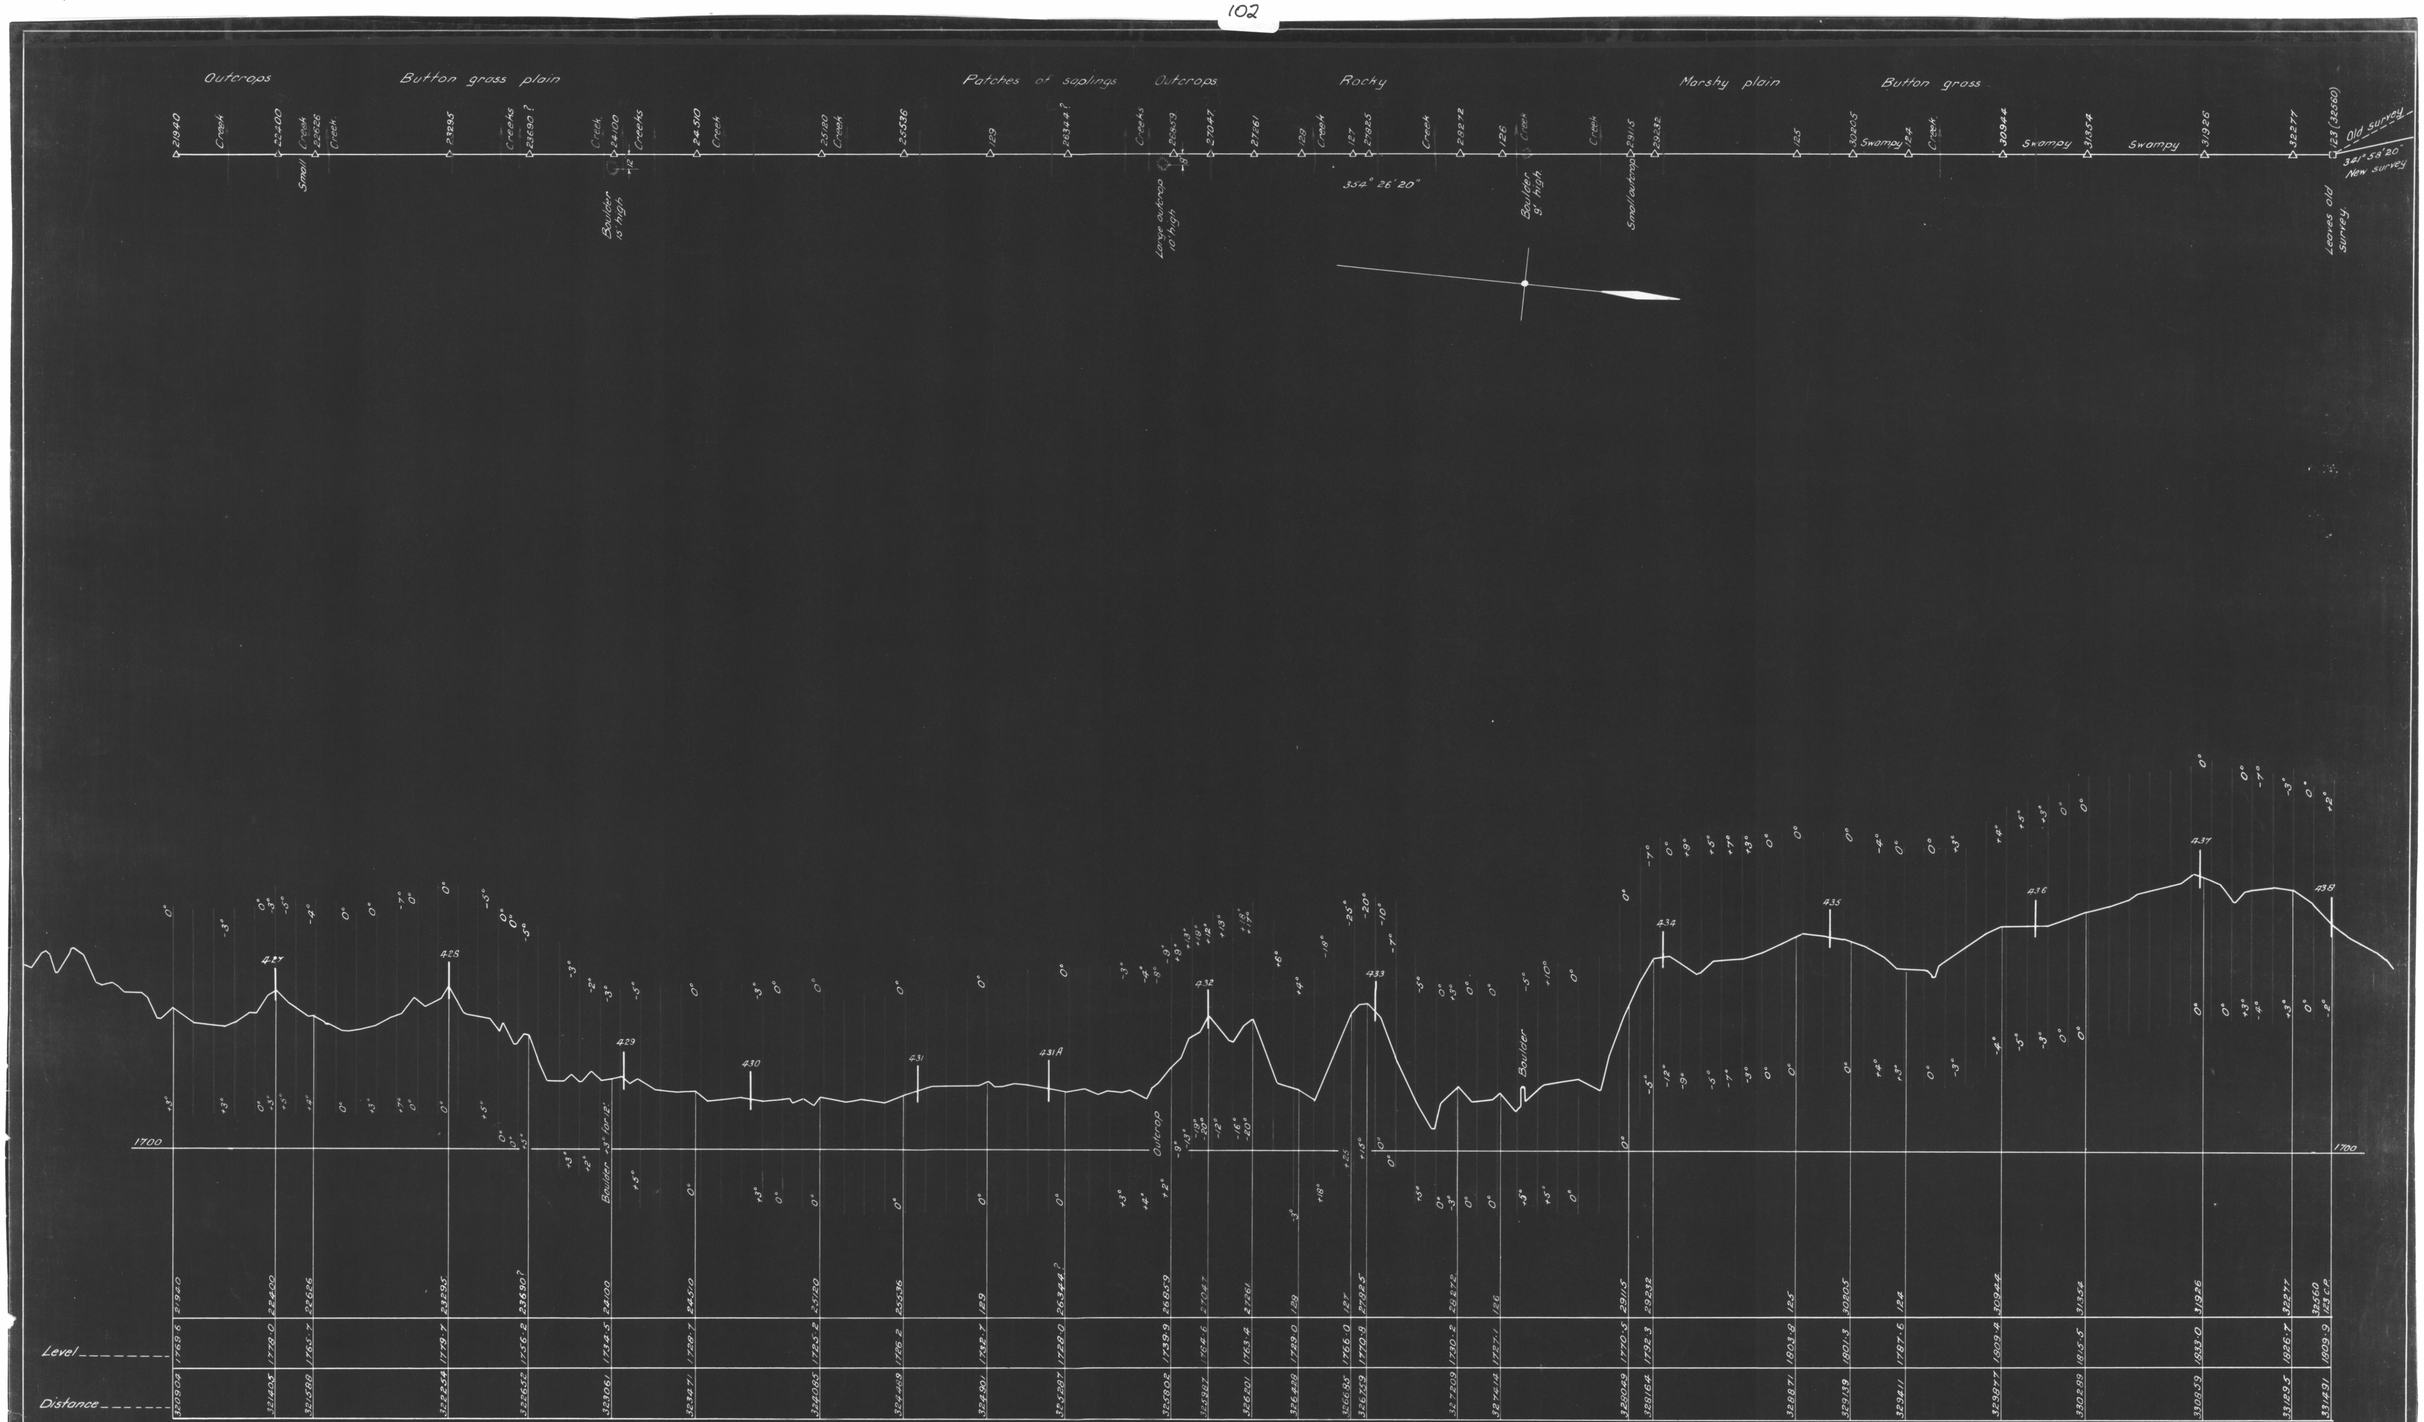

Subtract 140' from distances for Nive datum.
Peg numbers on old survey are as deciphered but not reliable.

NOTE
From Station 6' (sheet "27) actual distances are 450 ft. shorter than shown.
From Point D (sheet "23) levels are 19 ft lower than shown.

Commissioner.
11-1-35

GOVERNMENT OF TASMANIA
HYDRO-ELECTRIC DEPT.

NIVE-ROSEBERY TRANSMISSION LINE
PLAN AND LONGITUDINAL SECTION

Horizontal 1" = 400'
Vertical 1" = 40'

Level Book "216.

10/1/35

SHEET "32.

4491

38 SHEETS.

750D/51