750 G

105

5 cm

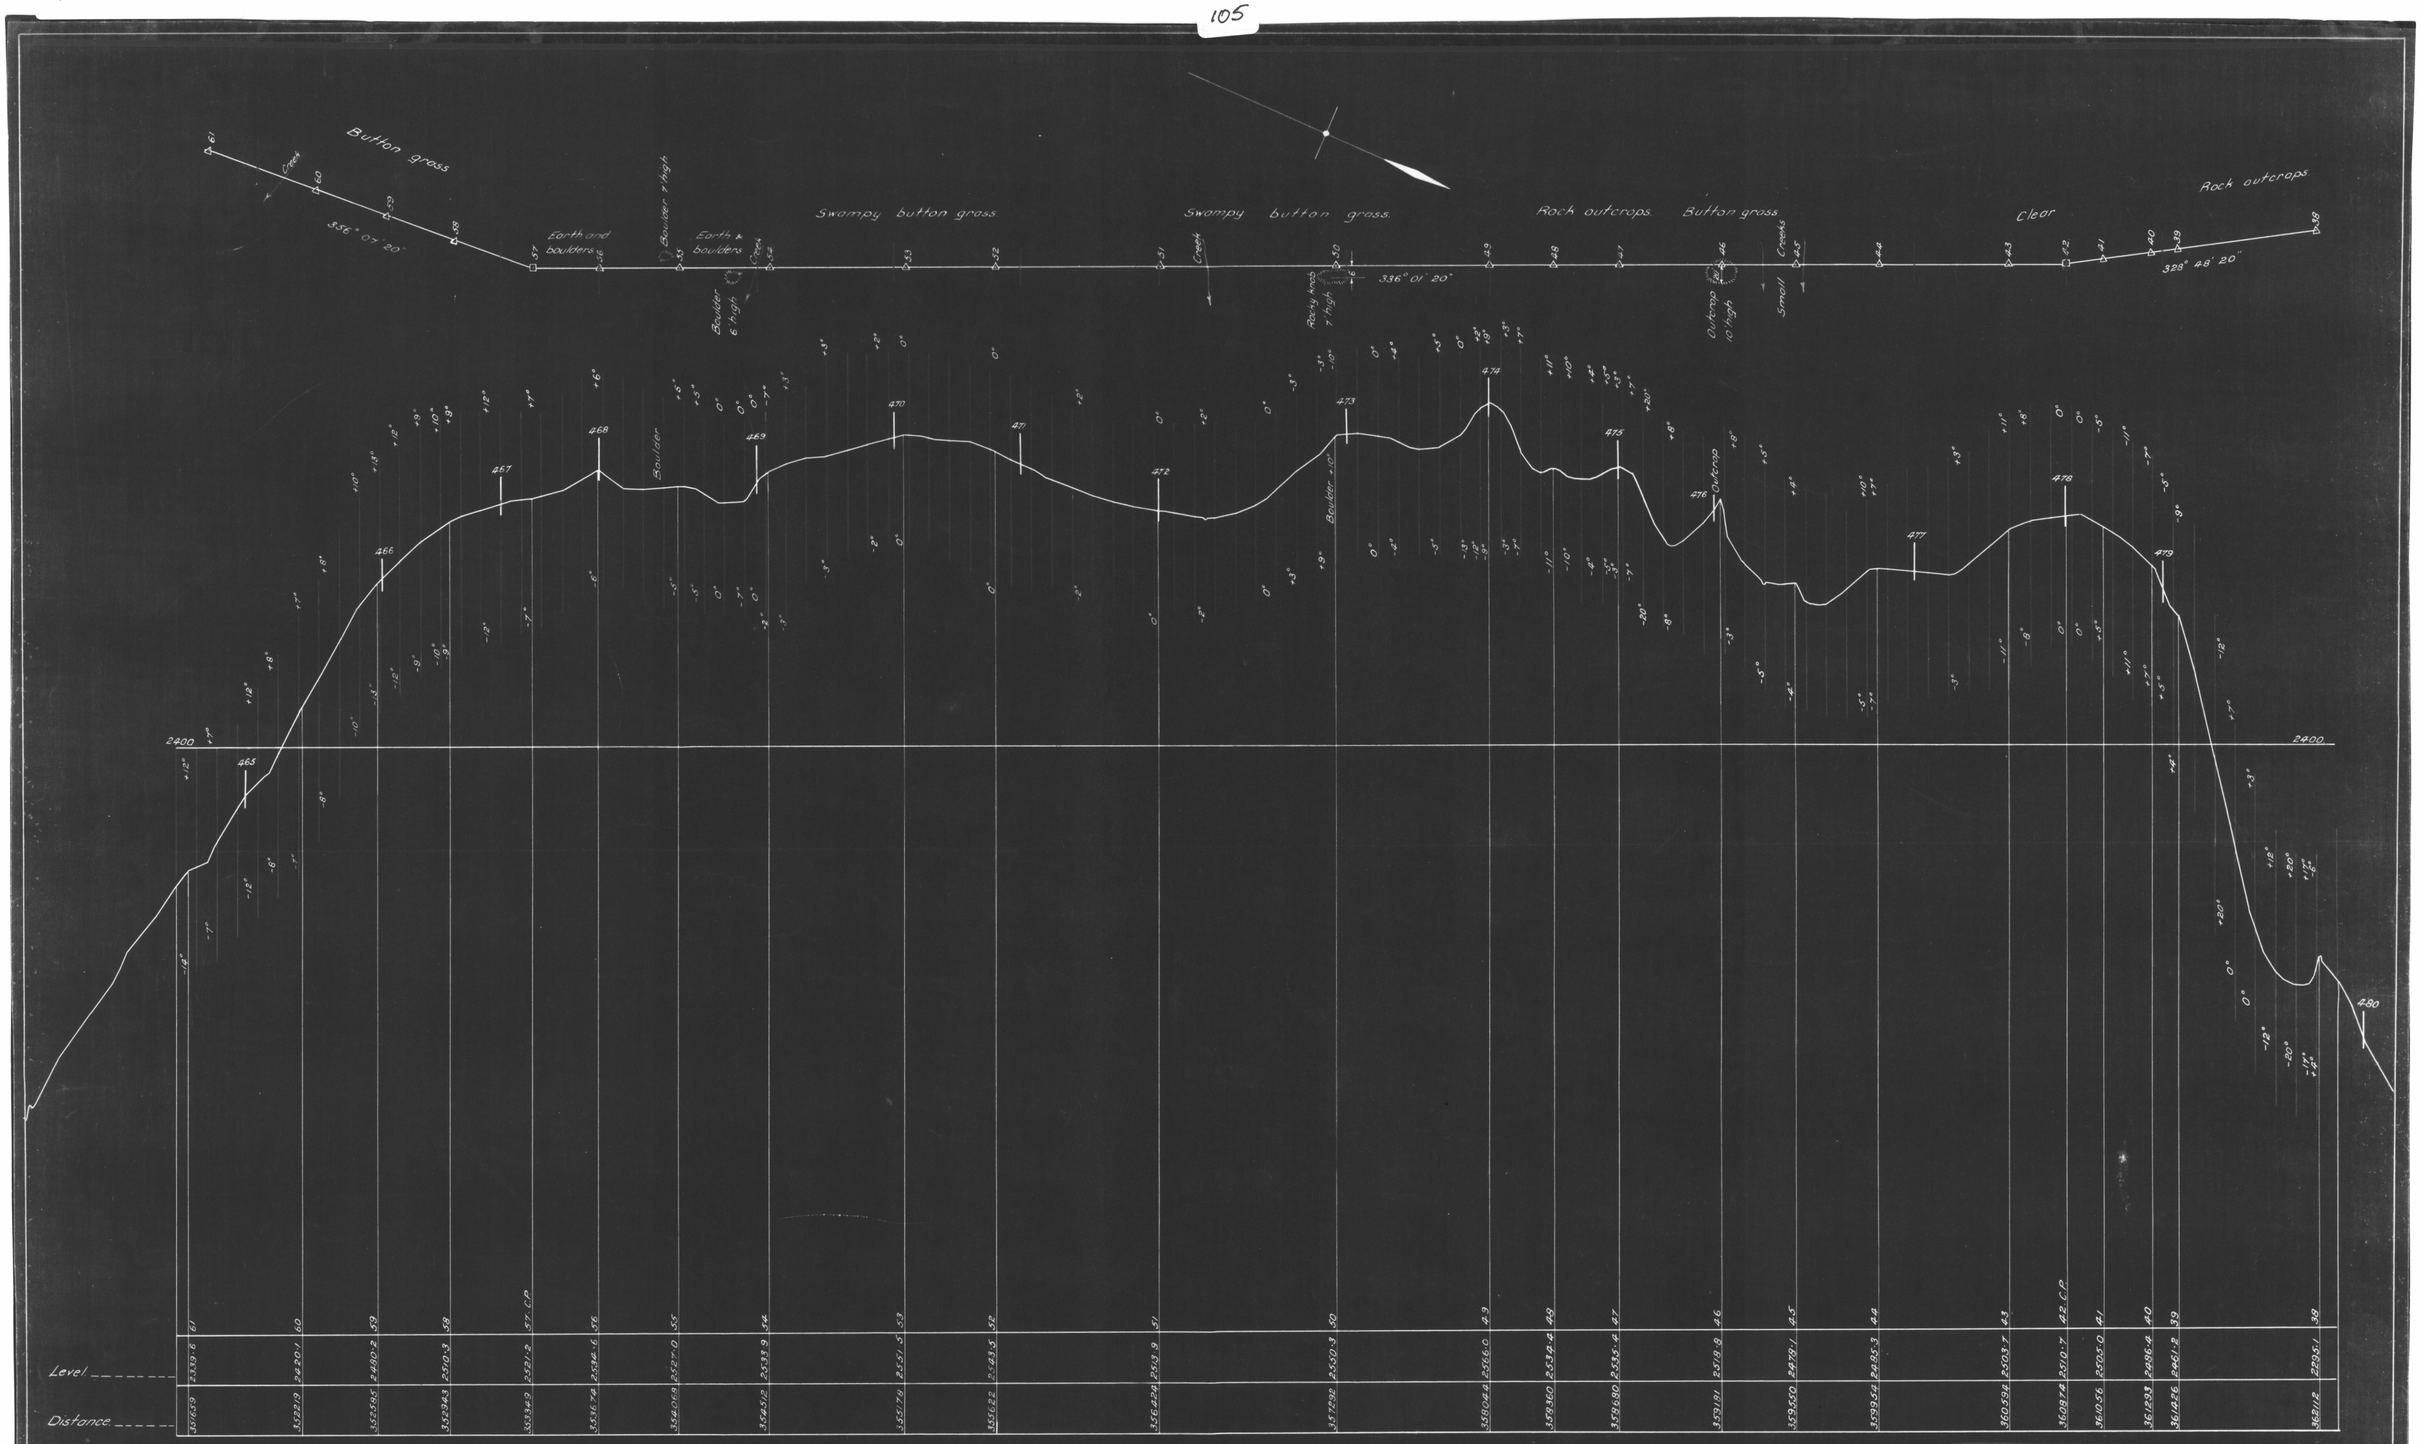

NOTE

From Station 6 (sheet #27) actual distances are 2.50ft shorter than shown.
From Point 'D' (sheet #23) levels are 1.0ft lower than shown.

Fred. M. Nicholls
for COMMISSIONER
12/10/34.

GOVERNMENT OF TASMANIA
HYDRO-ELECTRIC DEPT.

NIVE-ROSEBERY TRANSMISSION LINE.

PLAN AND LONGITUDINAL SECTION.

SCALE	Horizontal 1" = 400' Vertical 1" = 40'		SHEET #35.
DRAWN	E.W.J.	DRAWING REFERENCE	4494
TRACED	R.E.J.		
CHECKED	E.W.J.		
APPROVED	E.W.J.		
DATE	12/10/34		38 SHEETS.

750 G/51