

803 A

249

5 cm

DRUM-STORAGE COMPOUND

PLAN SHOWING COMPOUND, C.G.I FENCE & BARBED-WIRE BARRICADE.

CONDITIONS RELATING TO STORAGE

Modifications and/or additions to be made only with the approval of the Chief Inspector of Explosives.

Size of Compound and dimensions of walls will be prescribed when storage requirements are furnished to the Chief Inspector of Explosives.

Details of proposed sites must be submitted to the Chief Inspector of Explosives for approval.

Minimum location from buildings, fires etc. For Petrol:-100feet. For Kerosene:-50feet.


Drainage sump and petroleum trap to be provided as directed. Details of trap may be obtained on application.

Additional arrangements necessary for double-tier storage are required to prevent escape of drums from Compound in case of fall.




Where Compound may be accessible to the public it must be surrounded by a fence of corrugated iron with super-guards of barbed wire as shown on plan.

In isolated areas suitable arrangements for fencing may be approved of.

All empty drums must be stored under safe conditions.

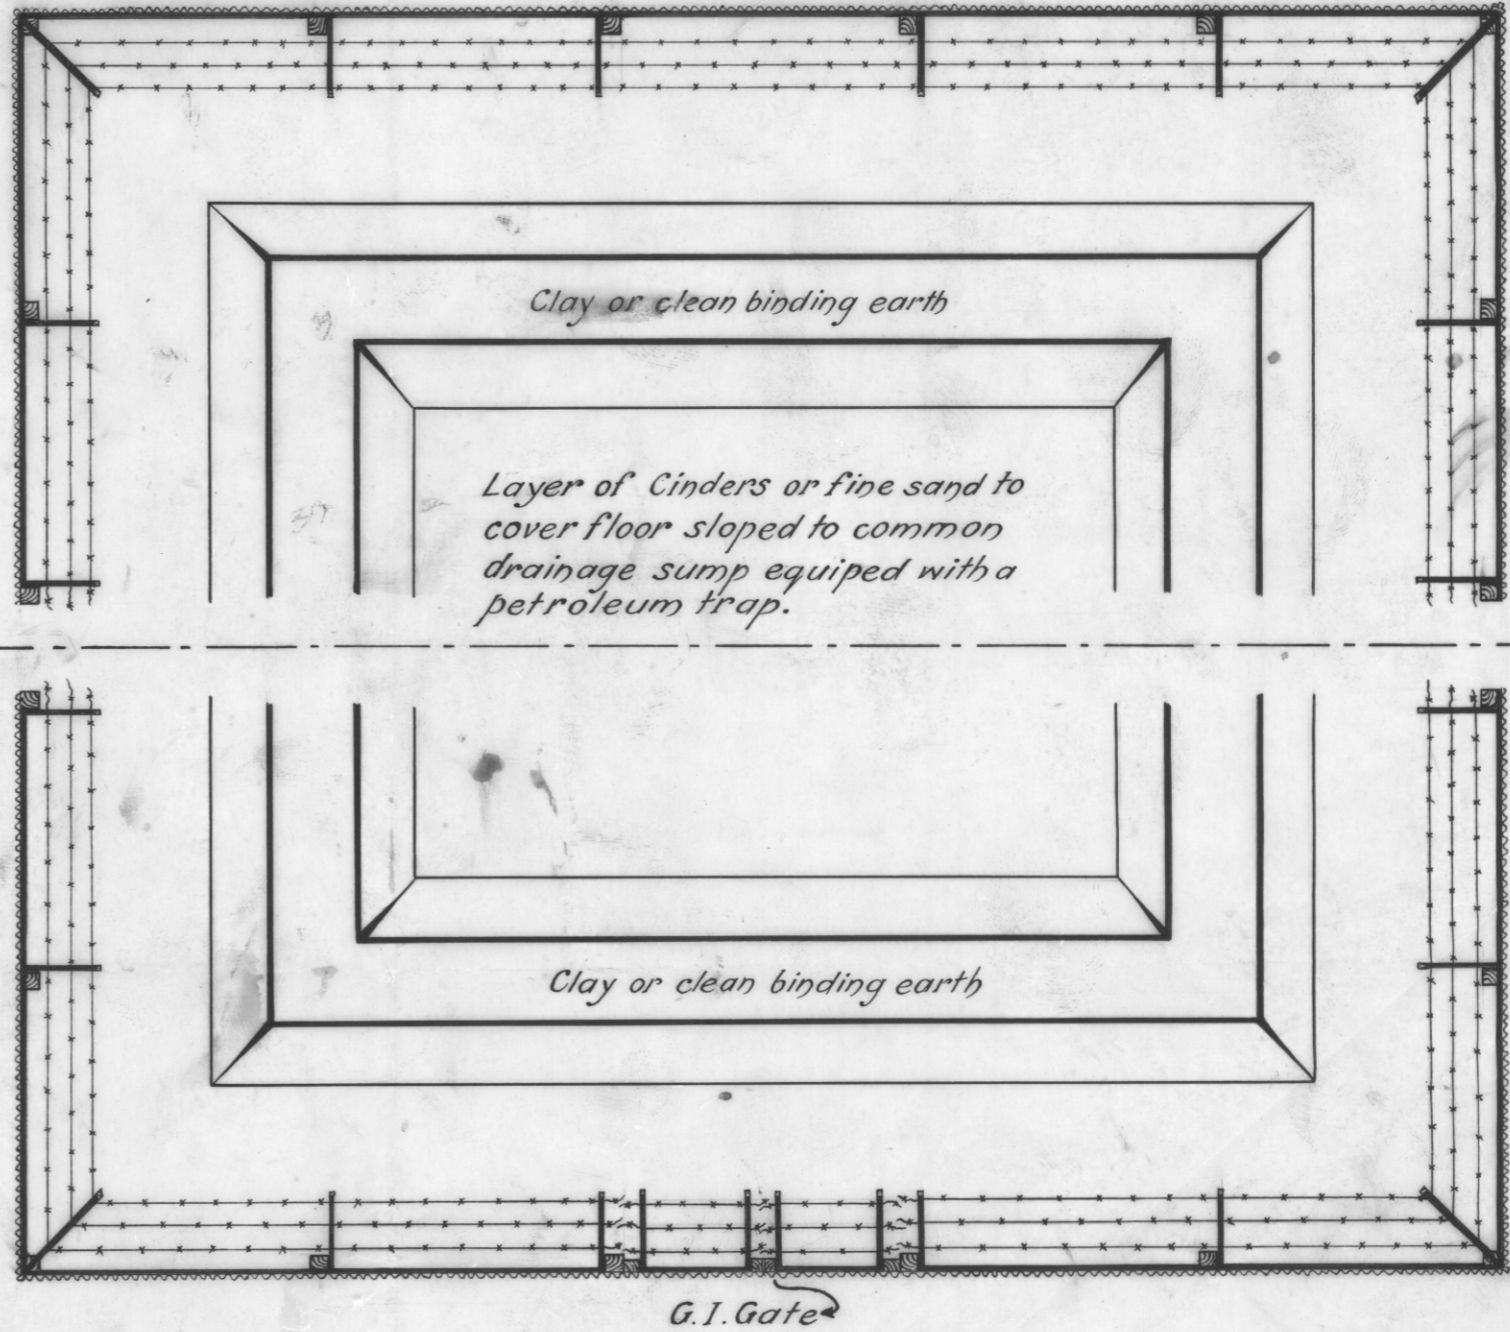

SECTION OF CONSTRUCTION SHOWING ALTERNATE STANDING OF DRUMS

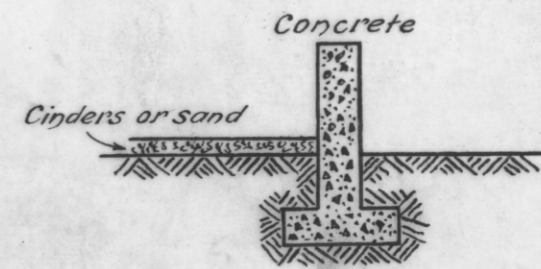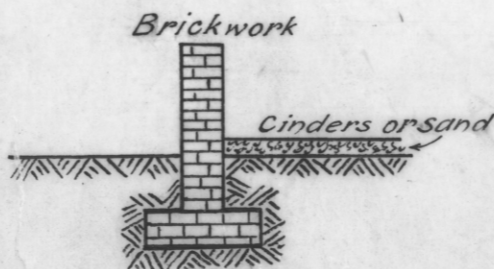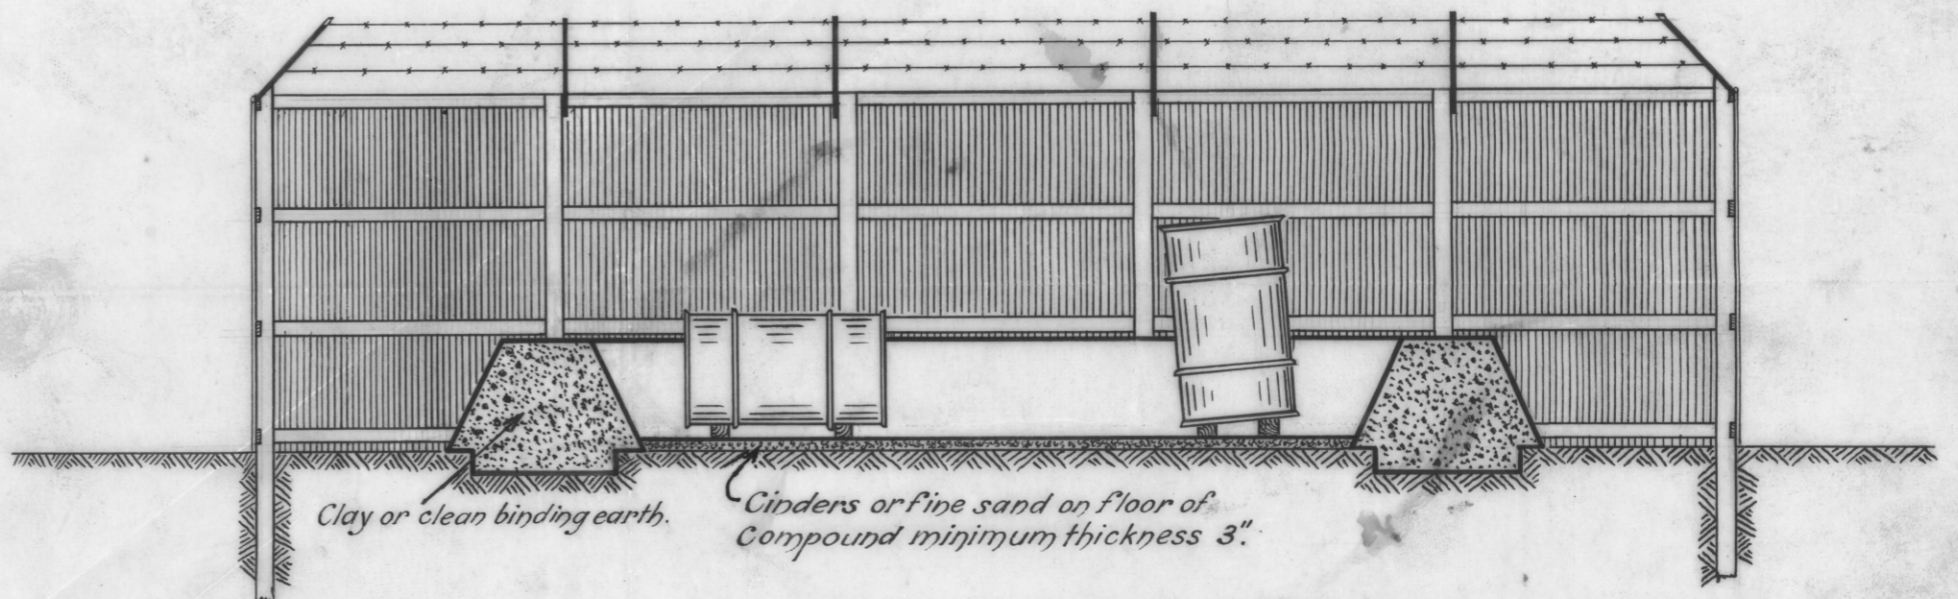

Chief Inspector of Explosives
Date 16 - 7 - 1941.

Draughtsman M.H.P.

9-803