


5 cm

- DEPARTMENT OF MINES - INFLAMMABLE LIQUIDS ACT -  
**DRUM STORAGE COMPOUND**

PLAN SHOWING COMPOUND, C.G.I. FENCE & BARBED WIRE BARRICADE

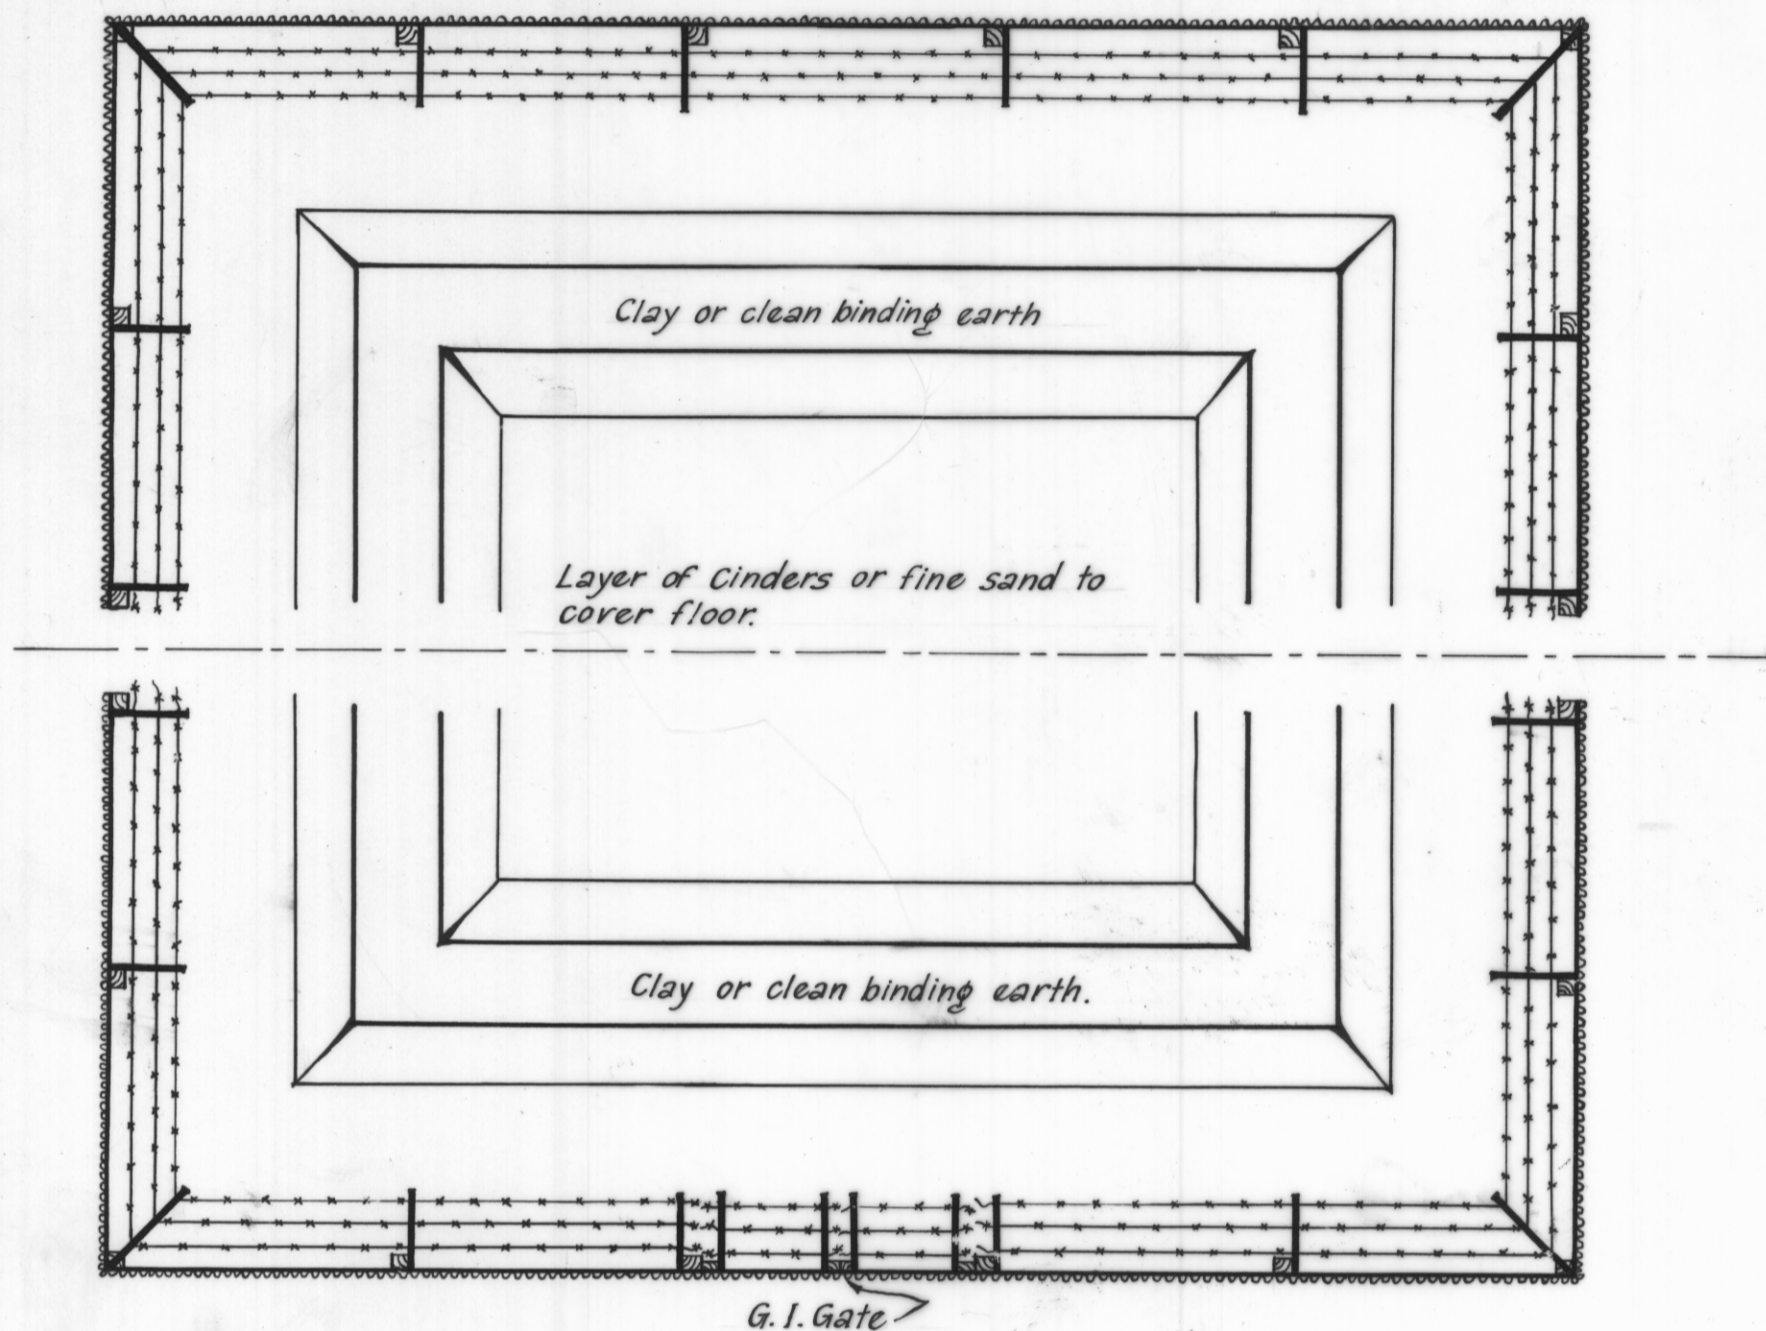

CONDITIONS RELATING TO STORAGE

Modifications and/or additions to be made only with the approval of the Chief Inspector of Explosives.

Details of proposed sites must be submitted to the Chief Inspector of Explosives for approval.

Minimum distances from buildings: 20 ft.

Minimum distances from boundaries or protected works: 50 ft. for Petrol etc. 20 ft. for Kerosene etc.

An area of 13 square ft. shall be allowed for each drum inside the bund walls. The drums are to be stored in double rows, leaving a space of about 4 ft. between such double rows.

If a stand is constructed inside the compound, the platform area of the stand must be a minimum of 10 square ft. per drum and the tracks must be so arranged as to leave a minimum of 4 inches between rows of drums. Such stand must be constructed in accordance with the sketch, and the compound must be large enough to leave a minimum of 3ft. 6in. between bund wall and platform all around.

Where compound may be accessible to the public it must be surrounded by a fence of corrugated iron with super-guards or barbed wire as shown on plan.

In isolated areas suitable arrangements for fencing may be approved of.

All empty drums must be stored under safe conditions.

No fire of any kind and no light except an approved electric light may be within 50 ft.

The bund wall shall be capable of retaining 100% of the contents stored therein. This may be reduced to 25% if the wall is of brick or concrete.



*J. J. J.*

CHIEF INSPECTOR OF EXPLOSIVES

DATE 28.10.1955

OPTIONAL STAND FOR DRUM STORAGE COMPOUND

SECTION SHOWING ALTERNATE STANDING OF DRUMS

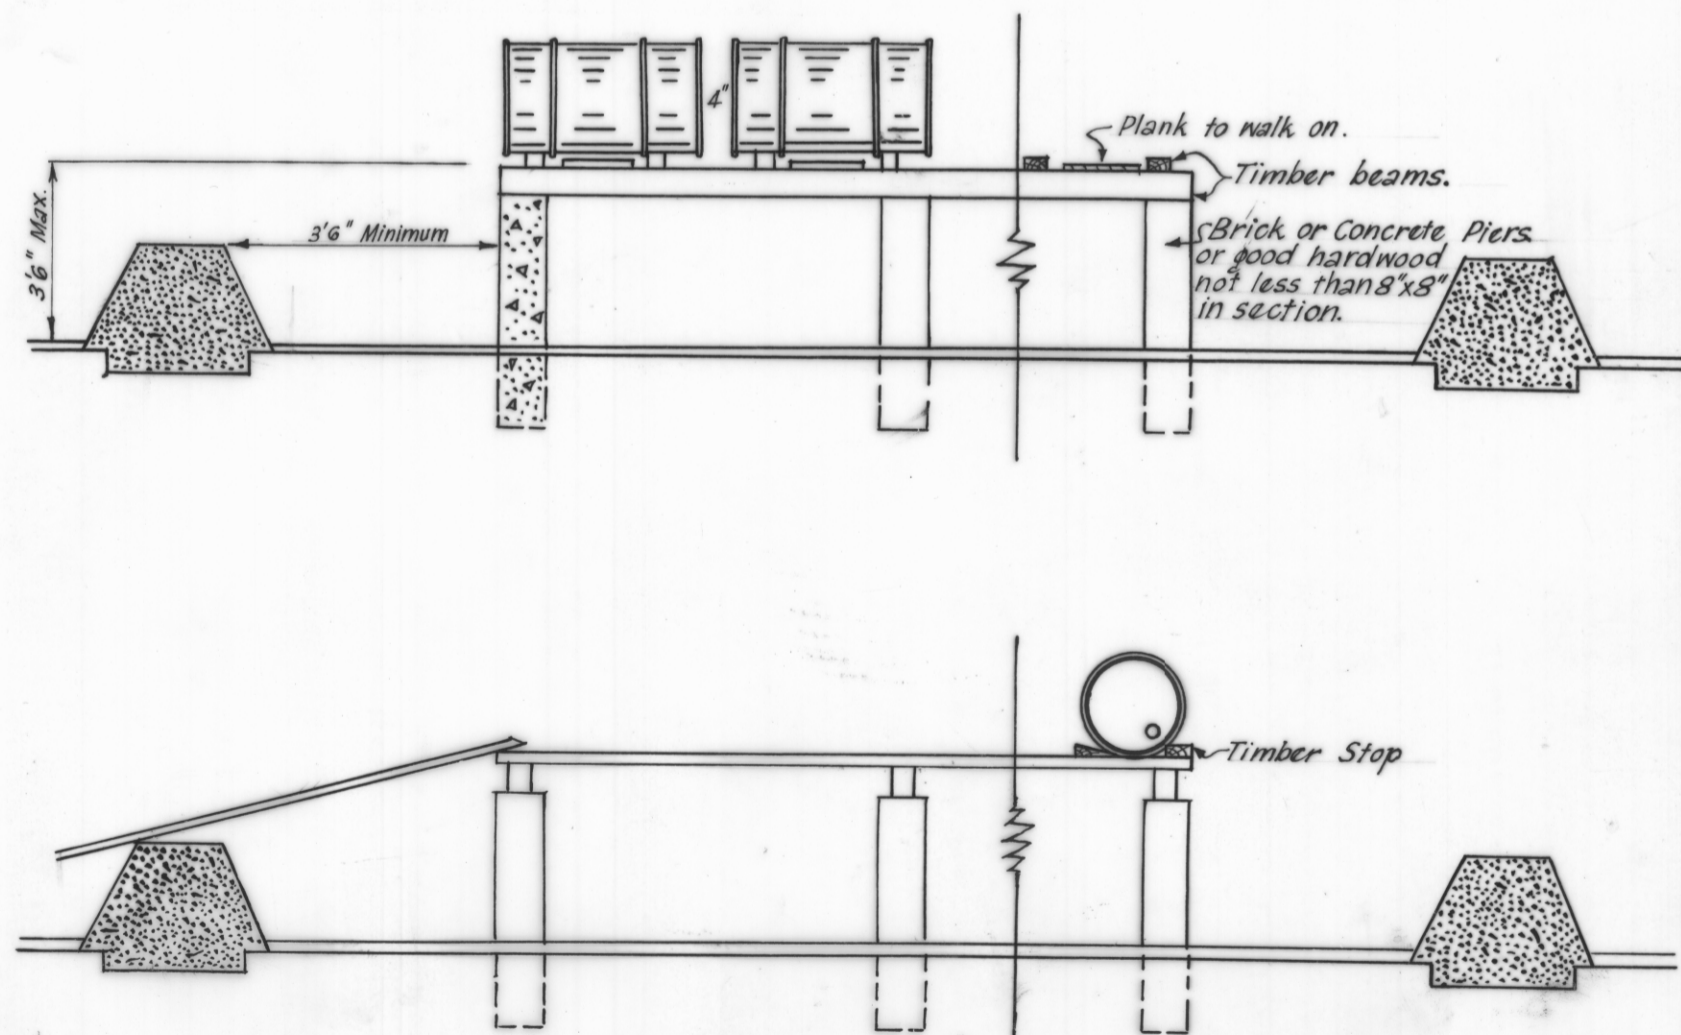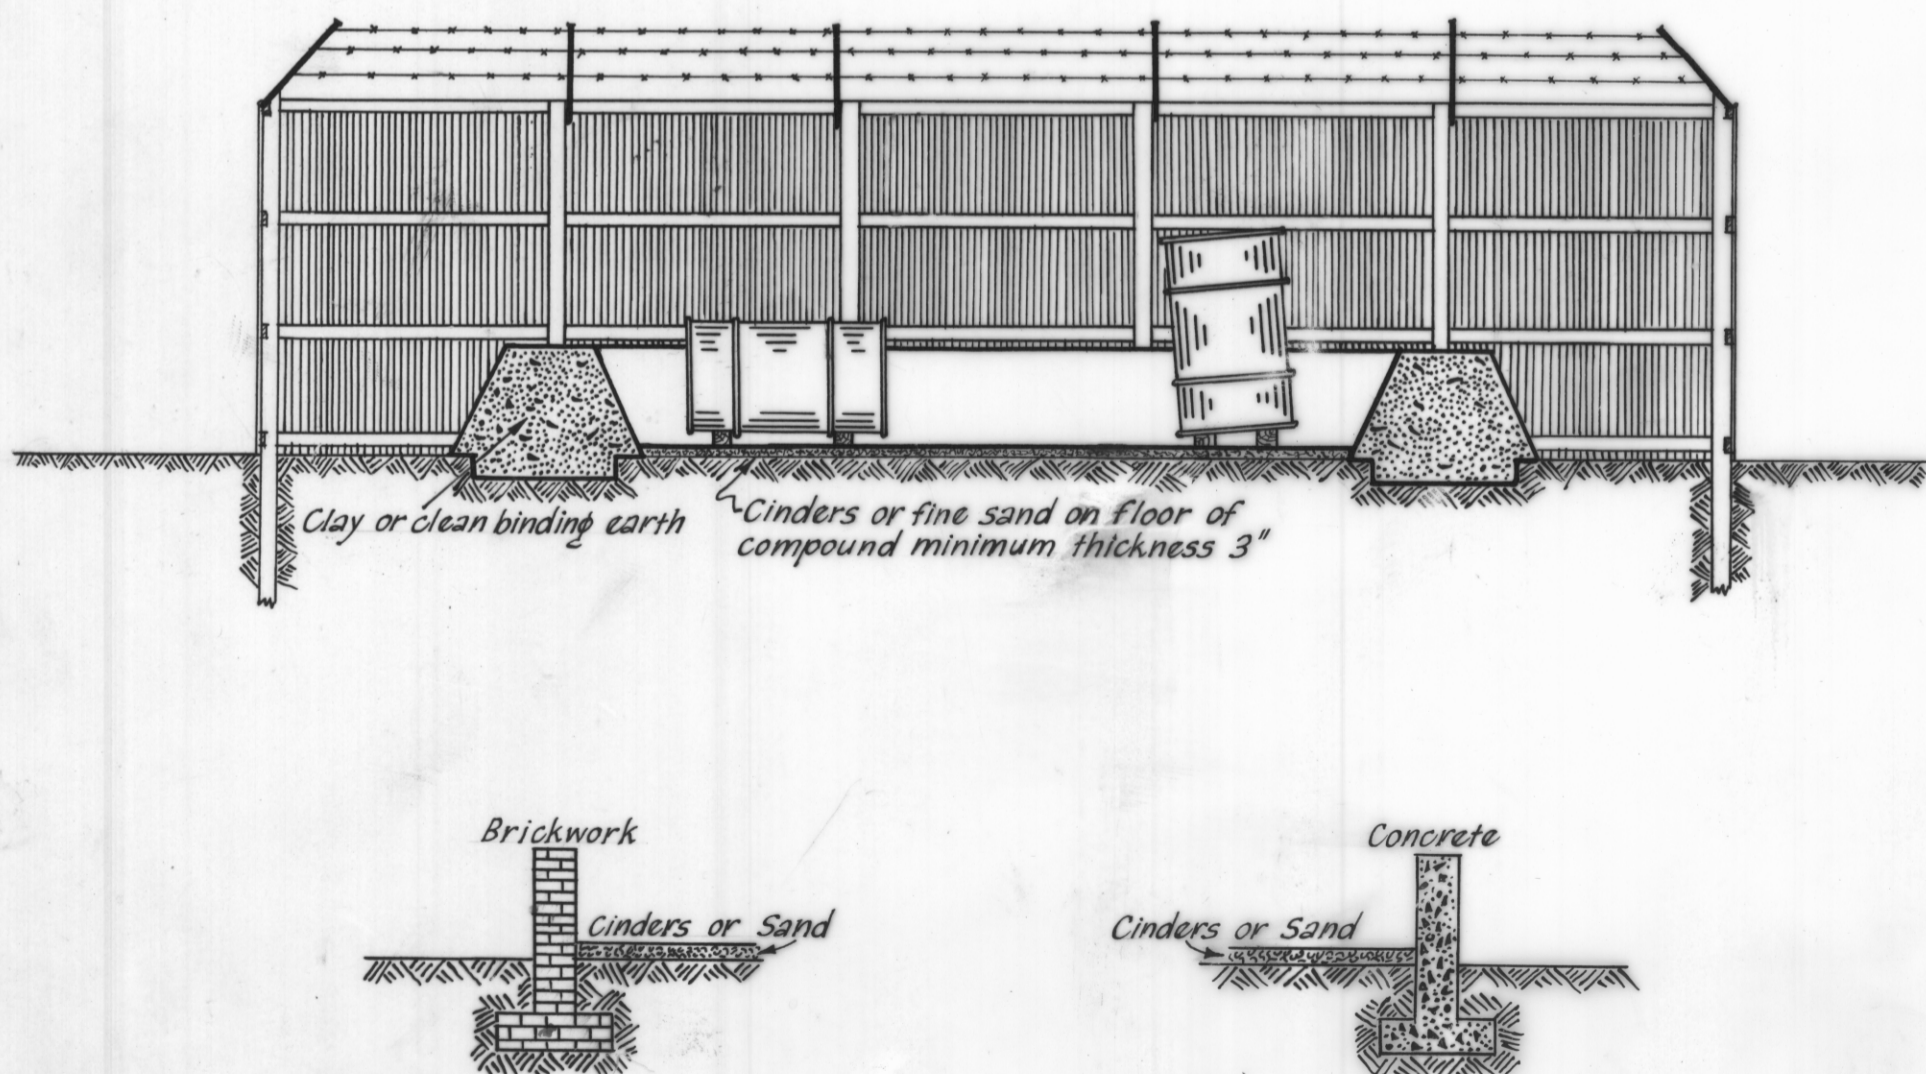

ALL NAILS & BOLTS TO BE COUNTERSUNK BELOW SURFACE OF TIMBER.  
 NO EXPOSED IRON OR STEEL ON DECK OF STAND.