



5 cm

GLENORCHY DISTRICT

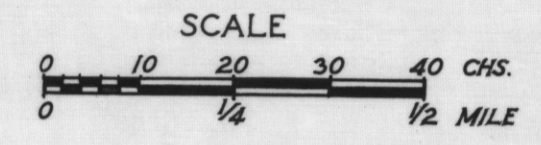

TO ACCOMPANY PRELIMINARY REPORT ON THE POSSIBILITY
OF UNDERGROUND WATER SUPPLY AT GLENORCHY. BY
DR. S.W. CAREY GOVT GEOLOGIST 15.8.46

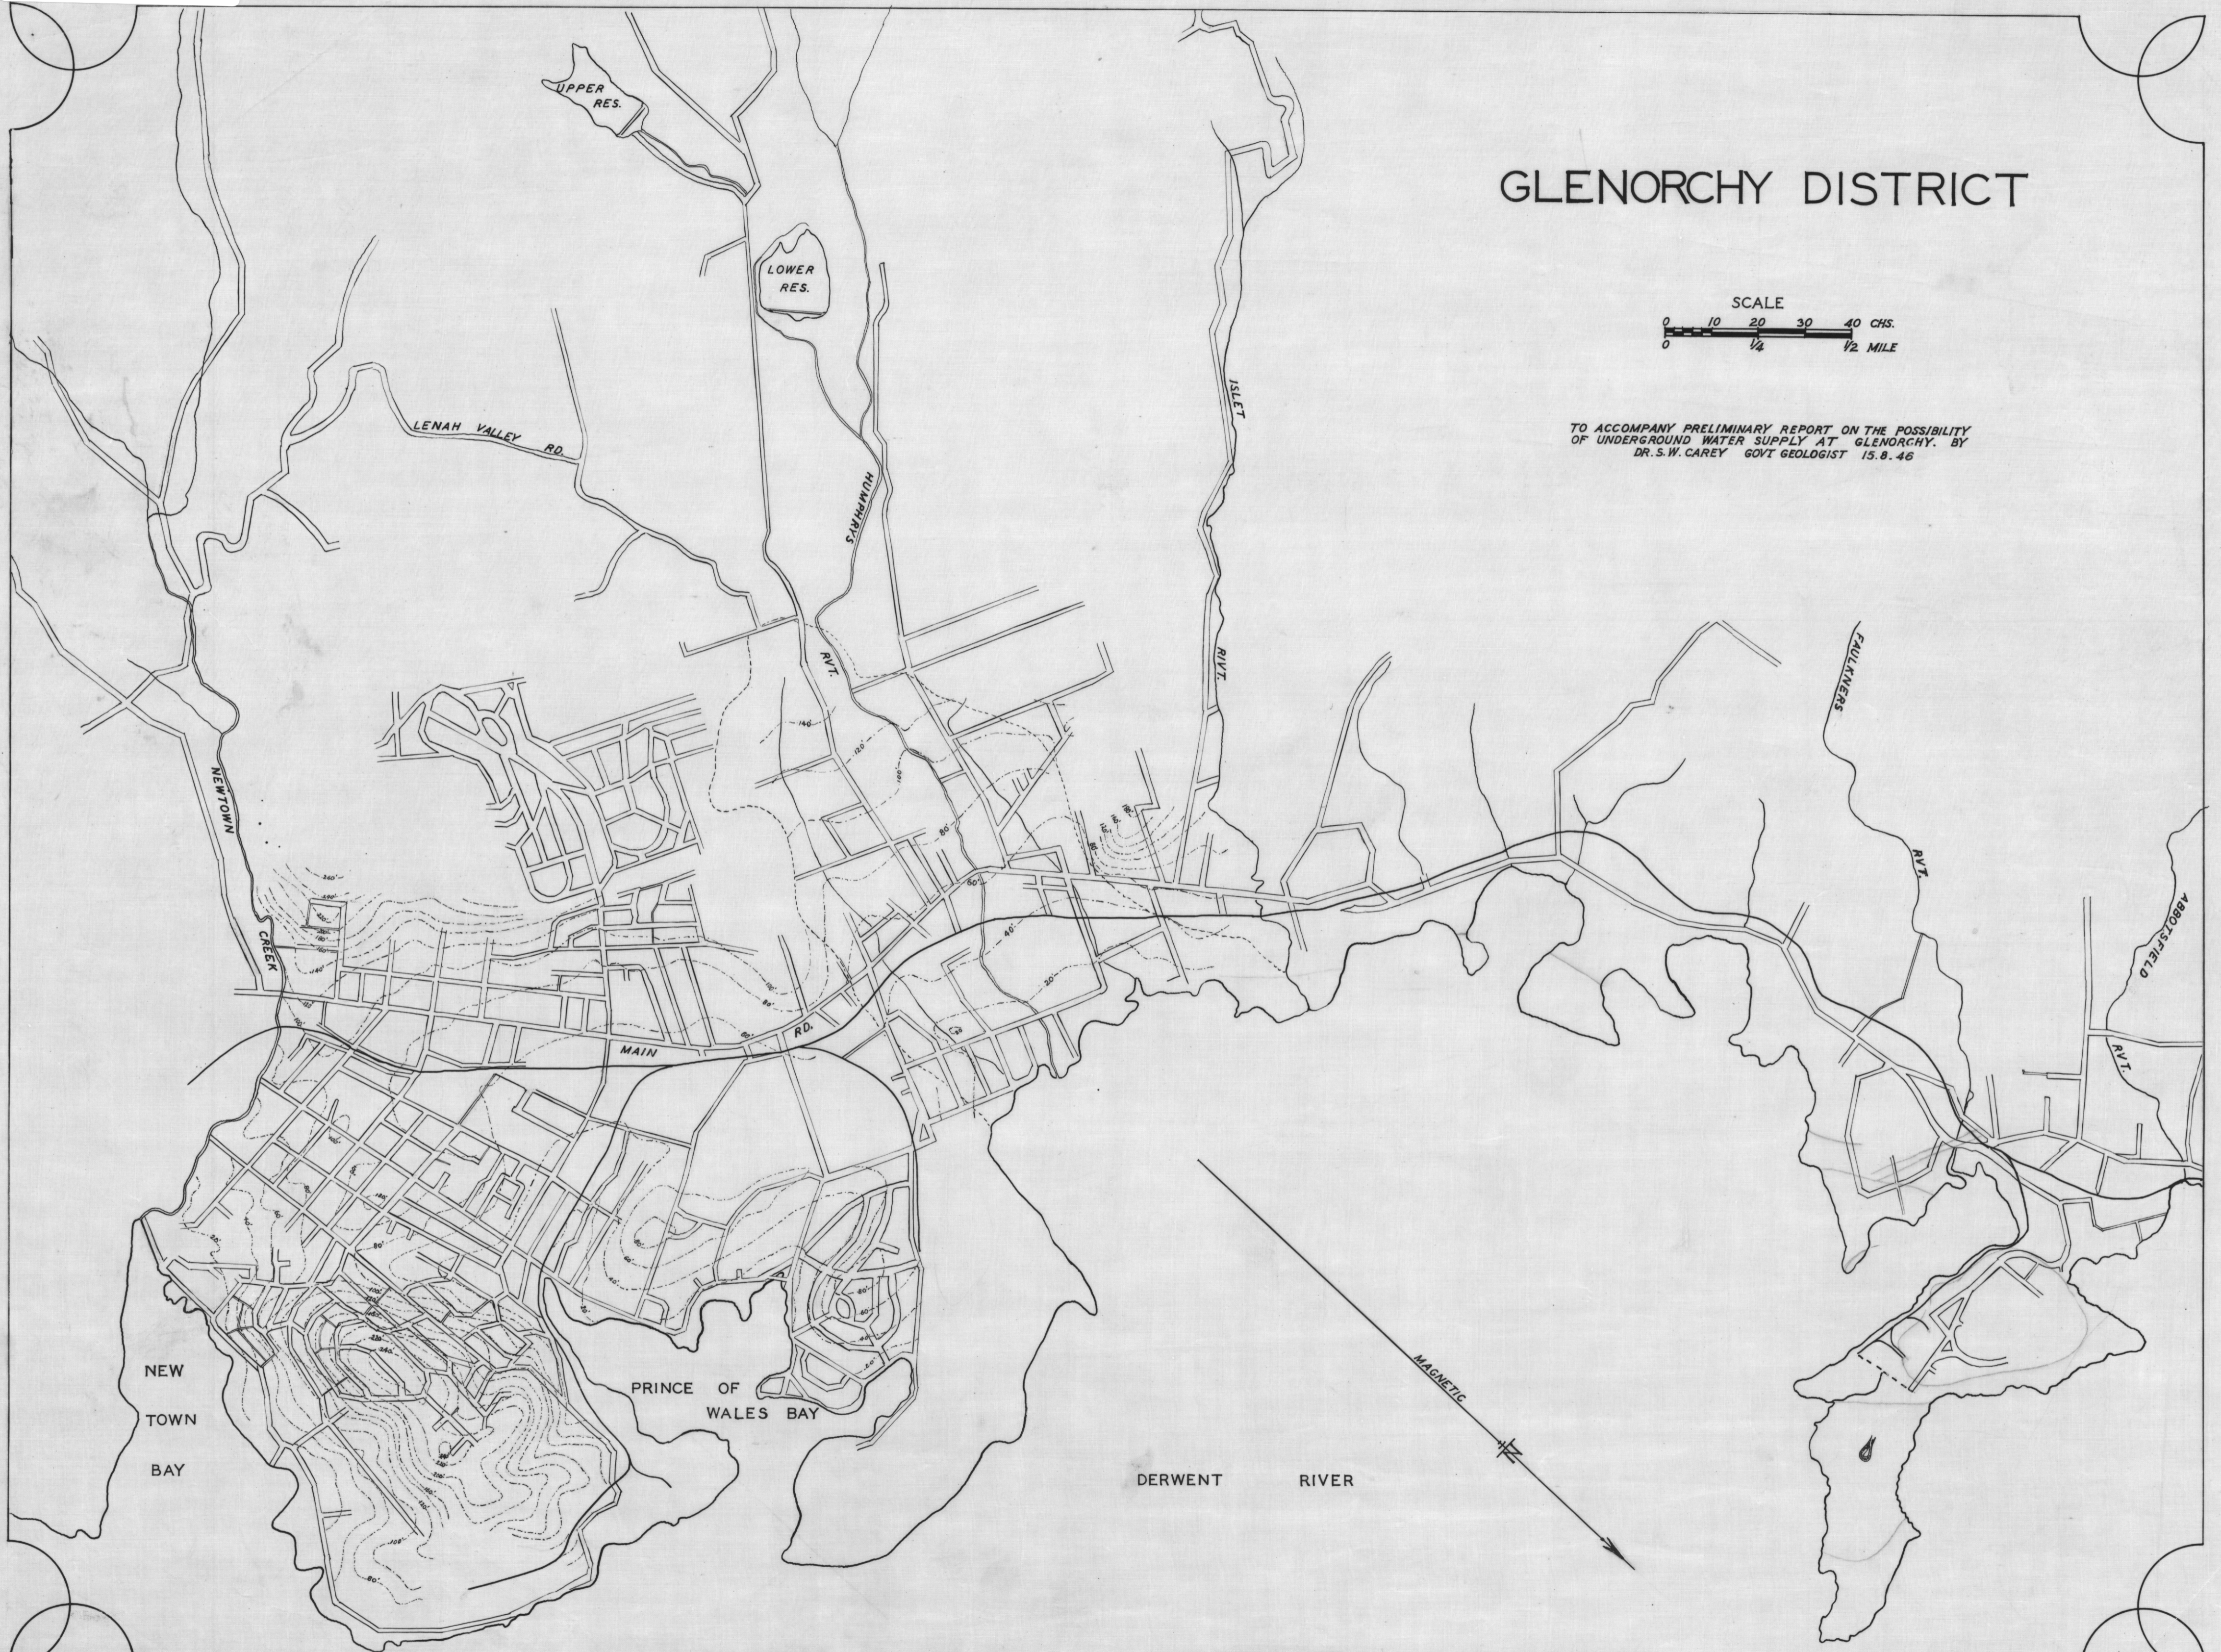

— UPPER TERTIARY SANDS, CLAYS & GRAVELS

RTR