


ALTERATIONS

S.L. of walkway Miens Dam and Shannon Power Station floor added. S.L. 16-3-42

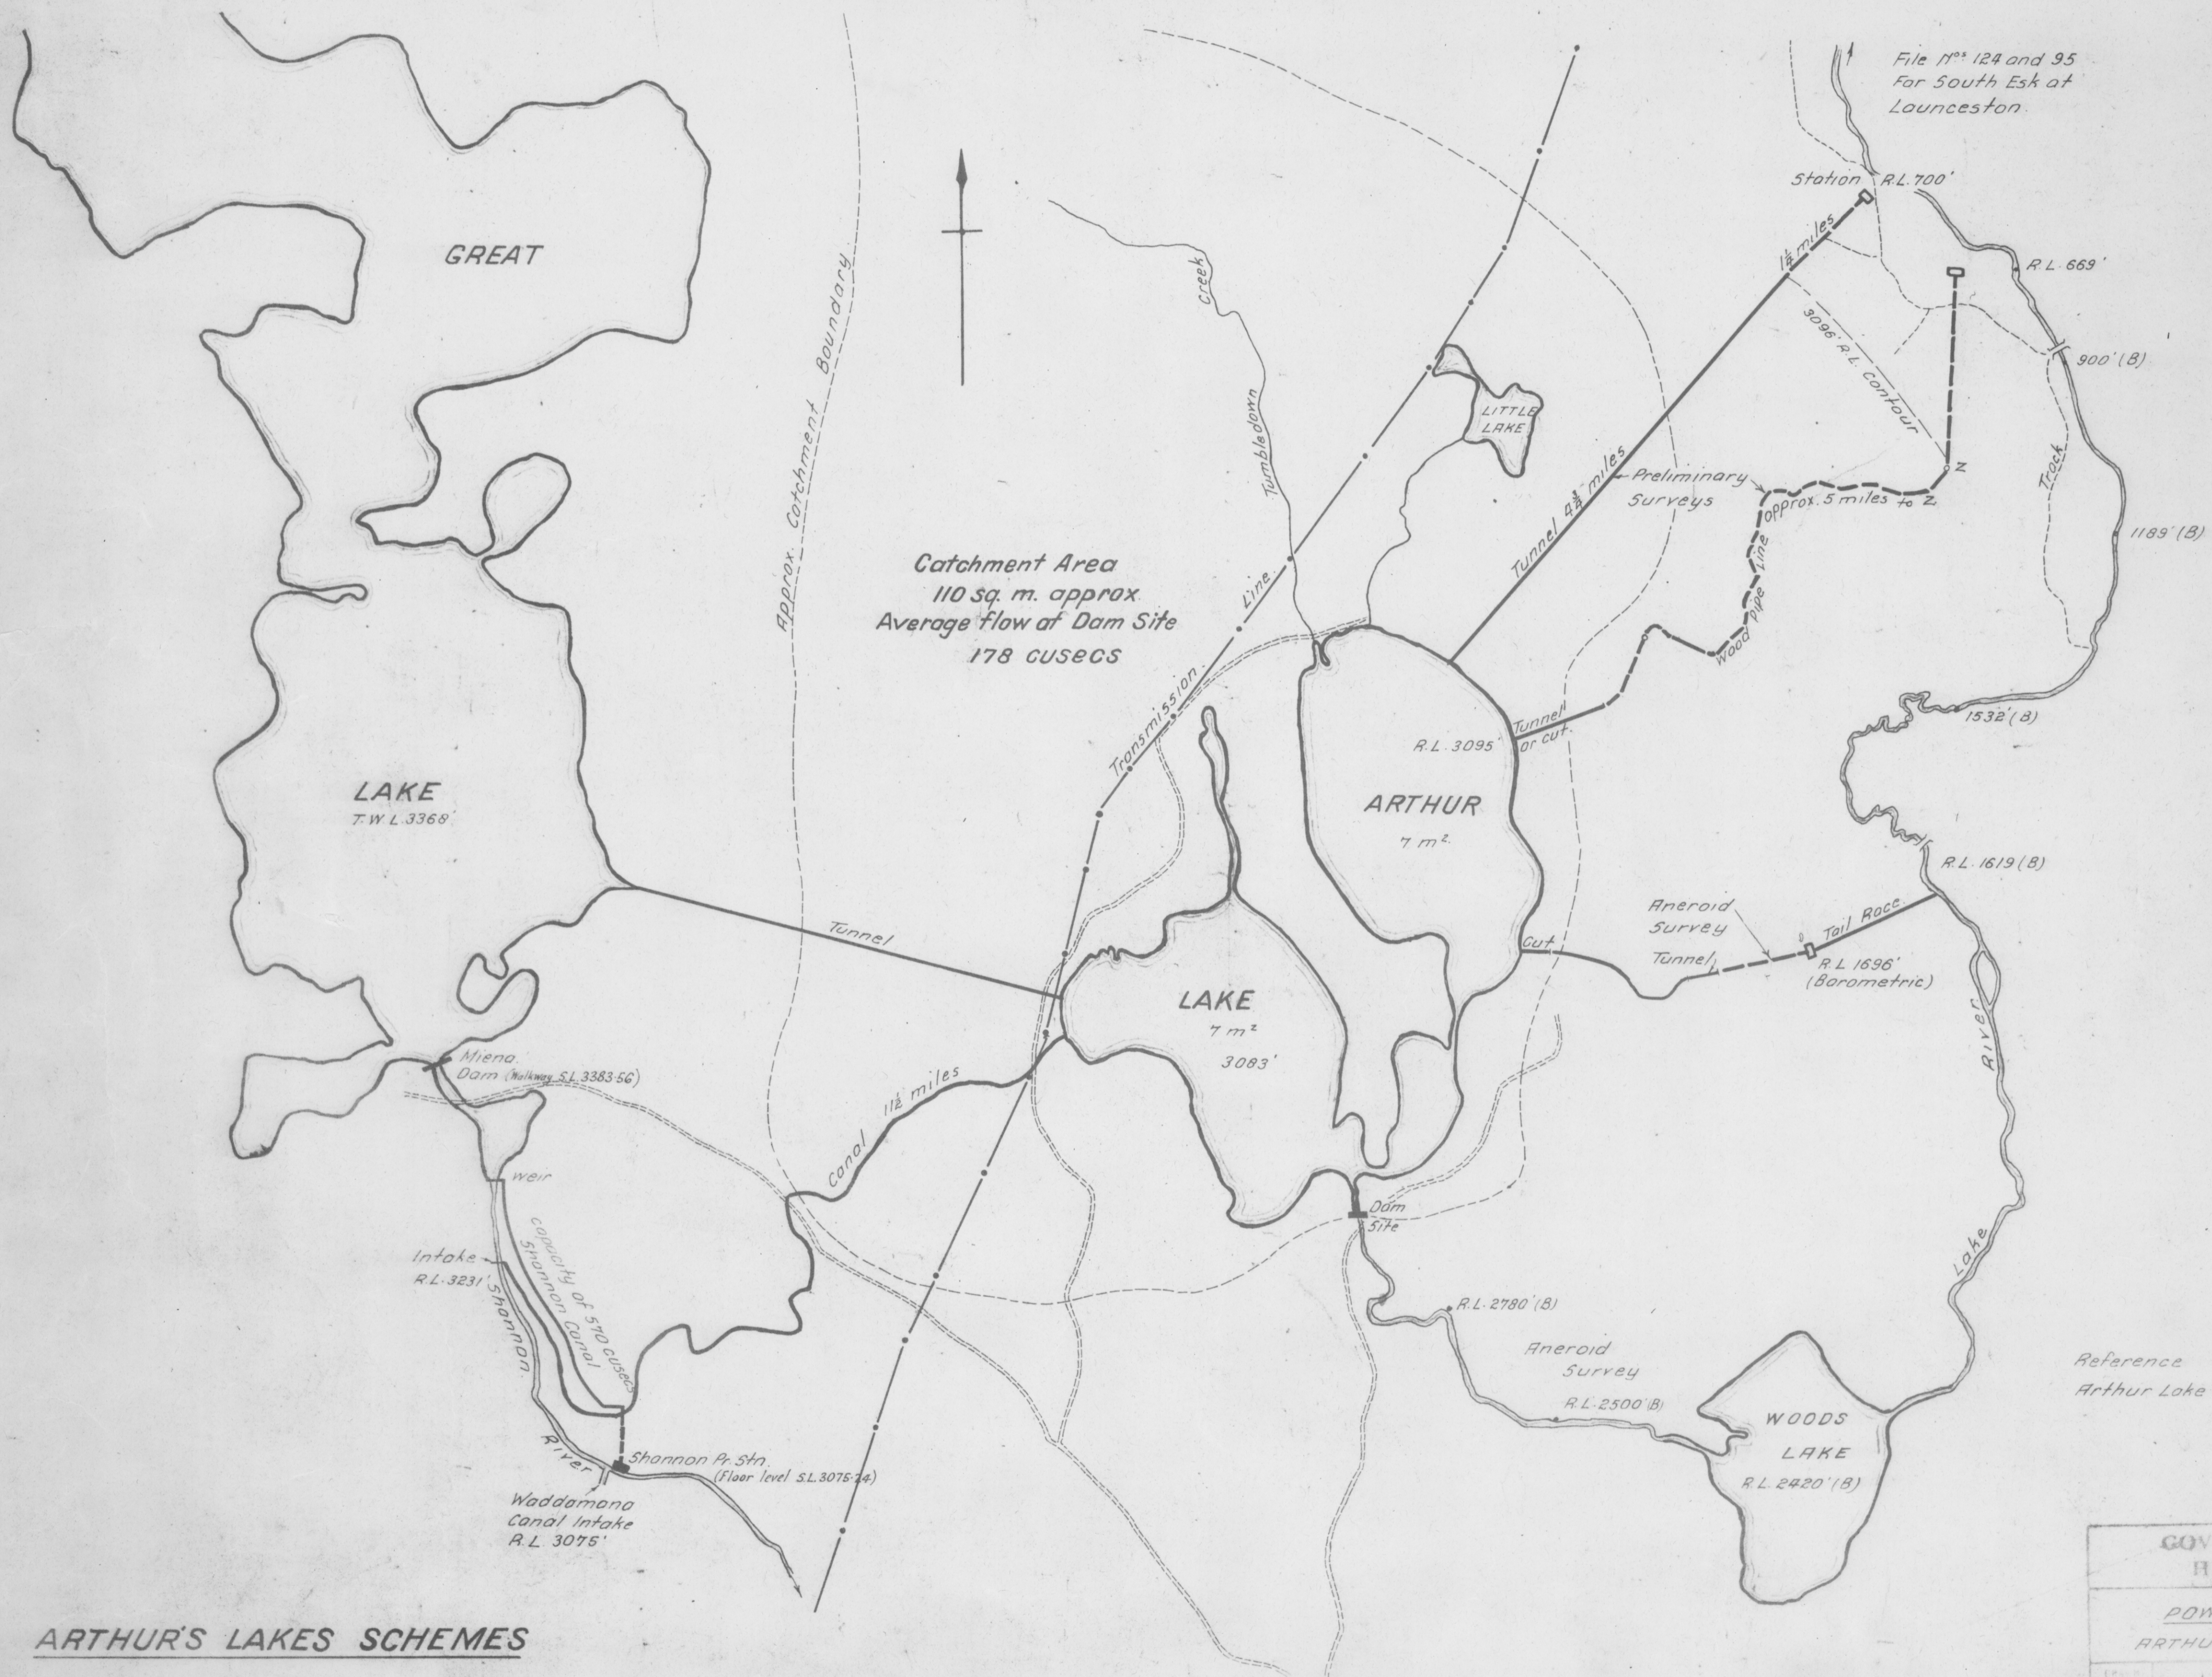

File N<sup>o</sup> 124 and 95 For South Esk at Lounceston.

Catchment Area 110 sq. m. approx Average flow of Dam Site 178 cusecs

LAKE T.W.L. 3369'

ARTHUR 7 m<sup>2</sup>

LAKE 7 m<sup>2</sup> 3083'

WOODS LAKE R.L. 2420' (B)

Reference Arthur Lake Files

ARTHUR'S LAKES SCHEMES

GOVERNMENT OF TASMANIA, HYDRO-ELECTRIC DEPT. POWER INVESTIGATION ARTHUR'S LAKES SCHEMES

PREPARED BY	di.B.	Compiled from Office Records 12-8-41.	1" = 1 mile
REVISIONS			
DATE			

COMMISSIONER