


Mable Flats Grid5

Line= 11

TxLen= 7345. Line= 5914. Stn= -1.

	Block	Freq
A	2925	.125
B	2926	.125

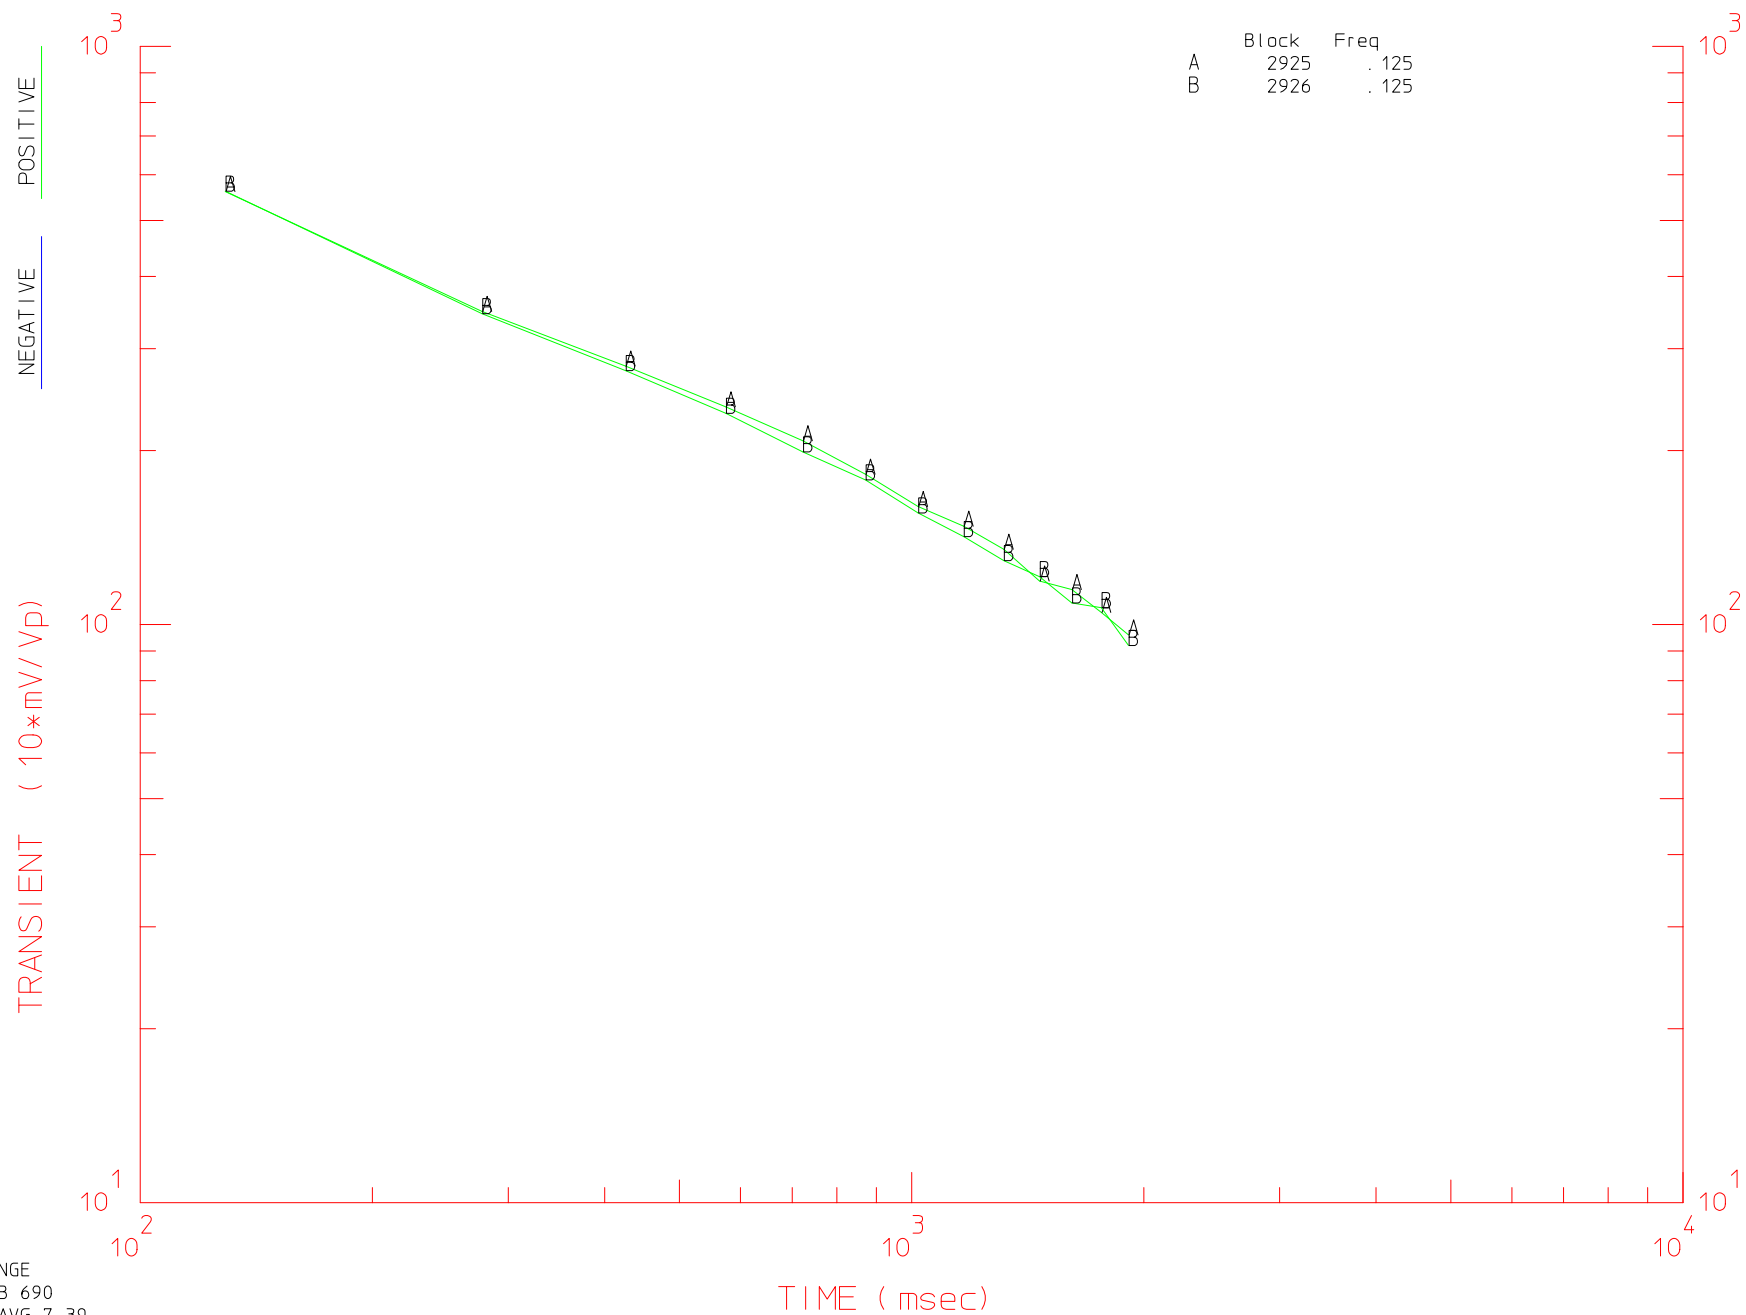

Mable Flats Grid5

Line= 11

TxLen= 7345. Line= 5889. Stn= -2.

	Block	Freq
C	2925	.125
D	2926	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

10¹

10²

10³

TIME (msec)

10³

10¹

10²

10³




Mable Flats Grid5

Line= 11

TxLen= 7345. Line= 5864. Stn= -3.

	Block	Freq
E	2925	.125
F	2926	.125

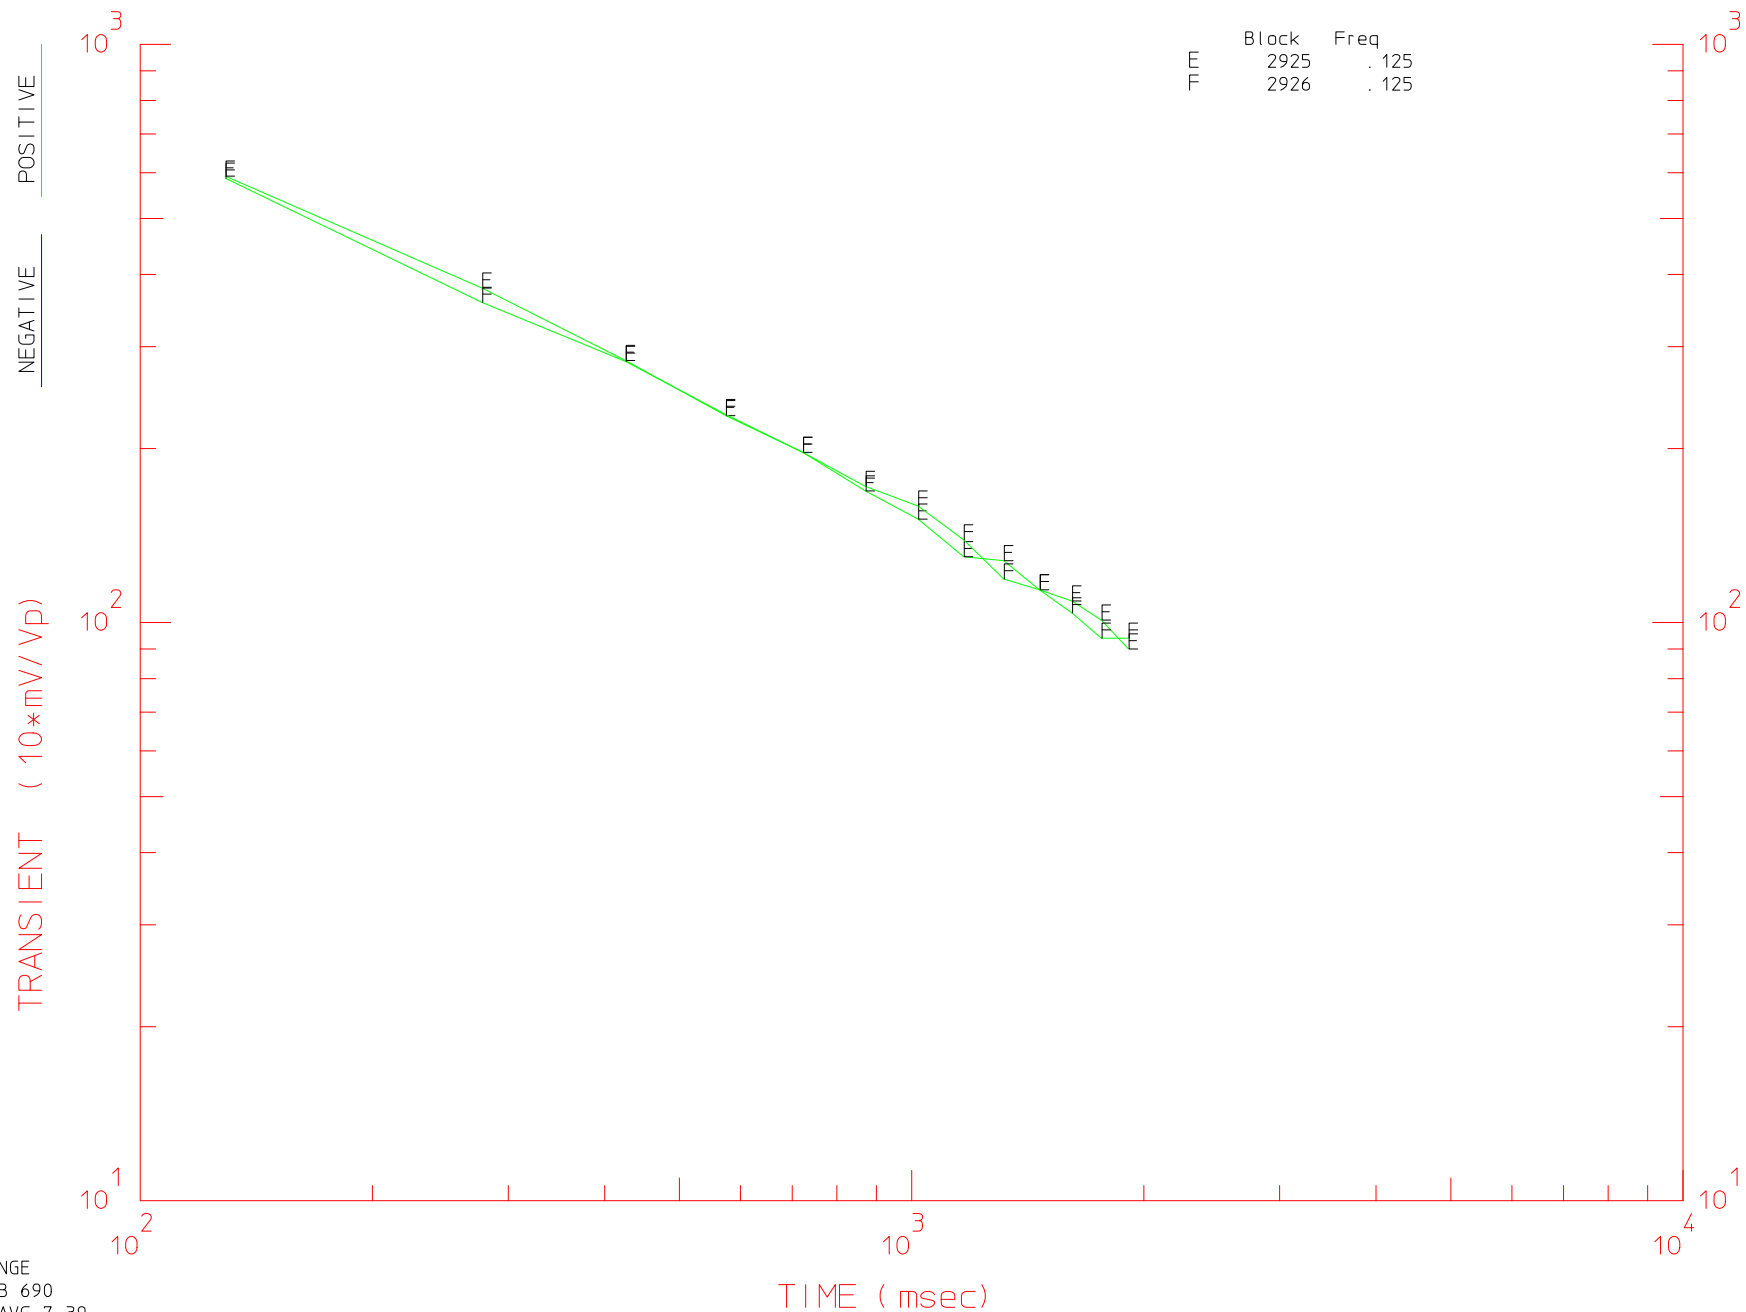

Mable Flats Grid5

Line= 11


TxLen= 7345. Line= 5839. Stn= -4.

	Block	Freq
G	2925	.125
H	2926	.125

POSITIVE

NEGATIVE


TRANSIENT (10*mV/Vp)

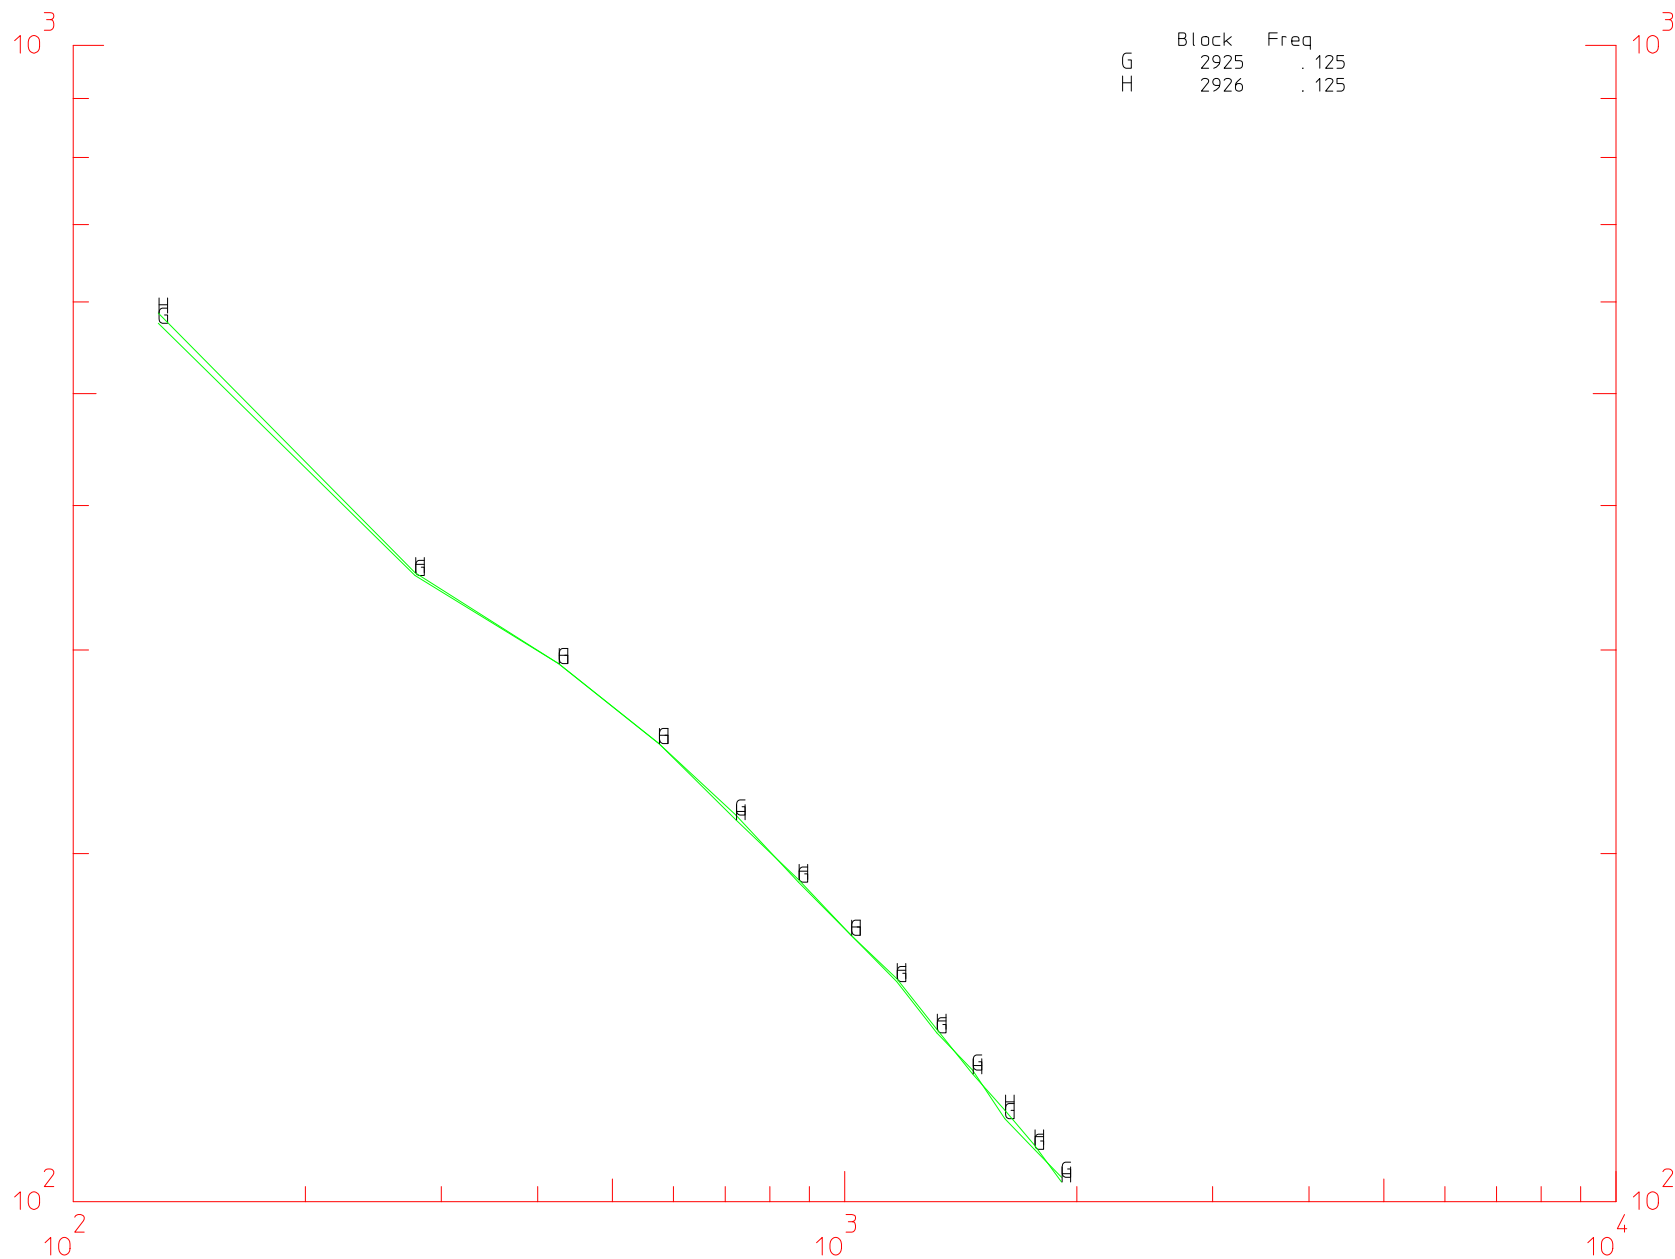

Mable Flats Grid5

Line= 11

TxLen= 7345. Line= 6014. Stn= -1.

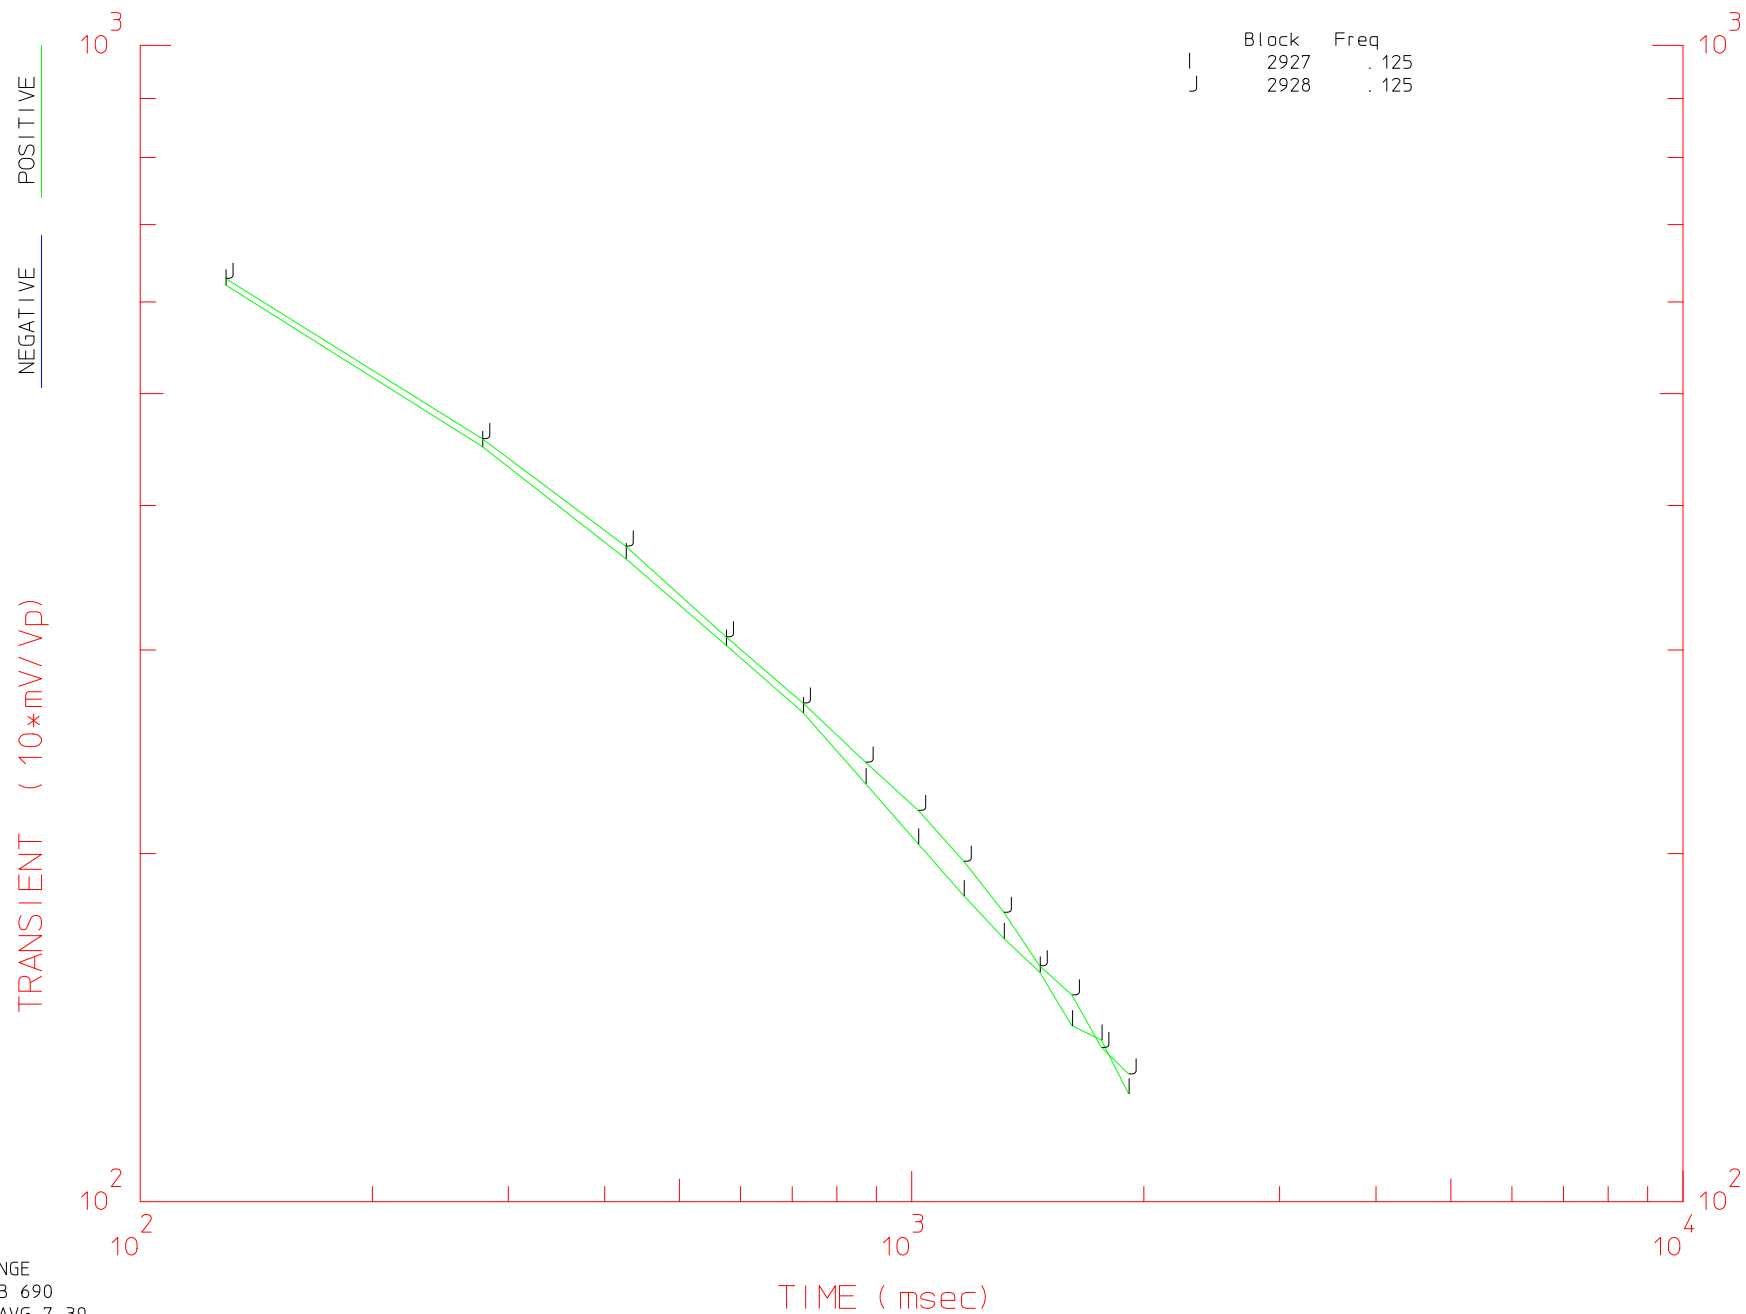

Mable Flats Grid5

Line= 11


TxLen= 7345. Line= 5989. Stn= -2.

	Block	Freq
K	2927	.125
L	2928	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

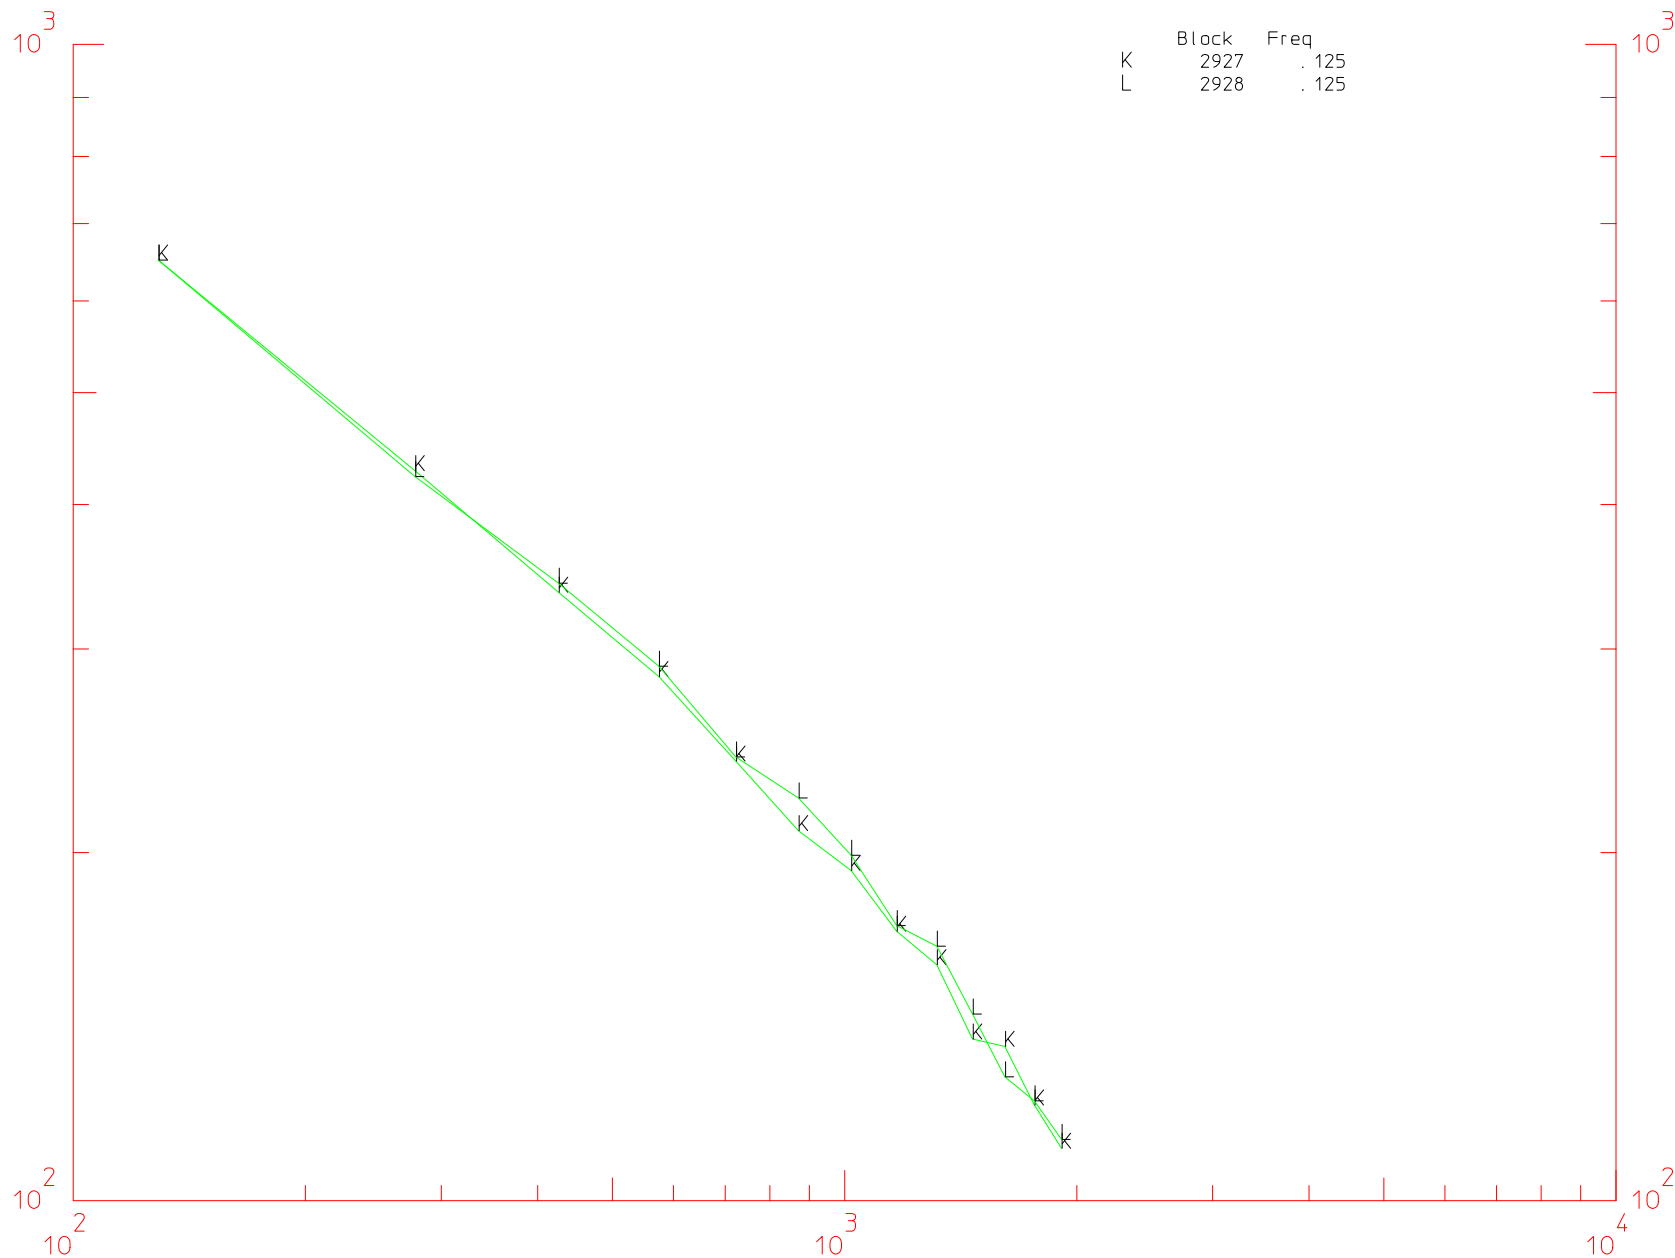


Mable Flats Grid5

Line= 11


TxLen= 7345. Line= 5964. Stn= -3.

	Block	Freq
M	2927	.125
N	2928	.125

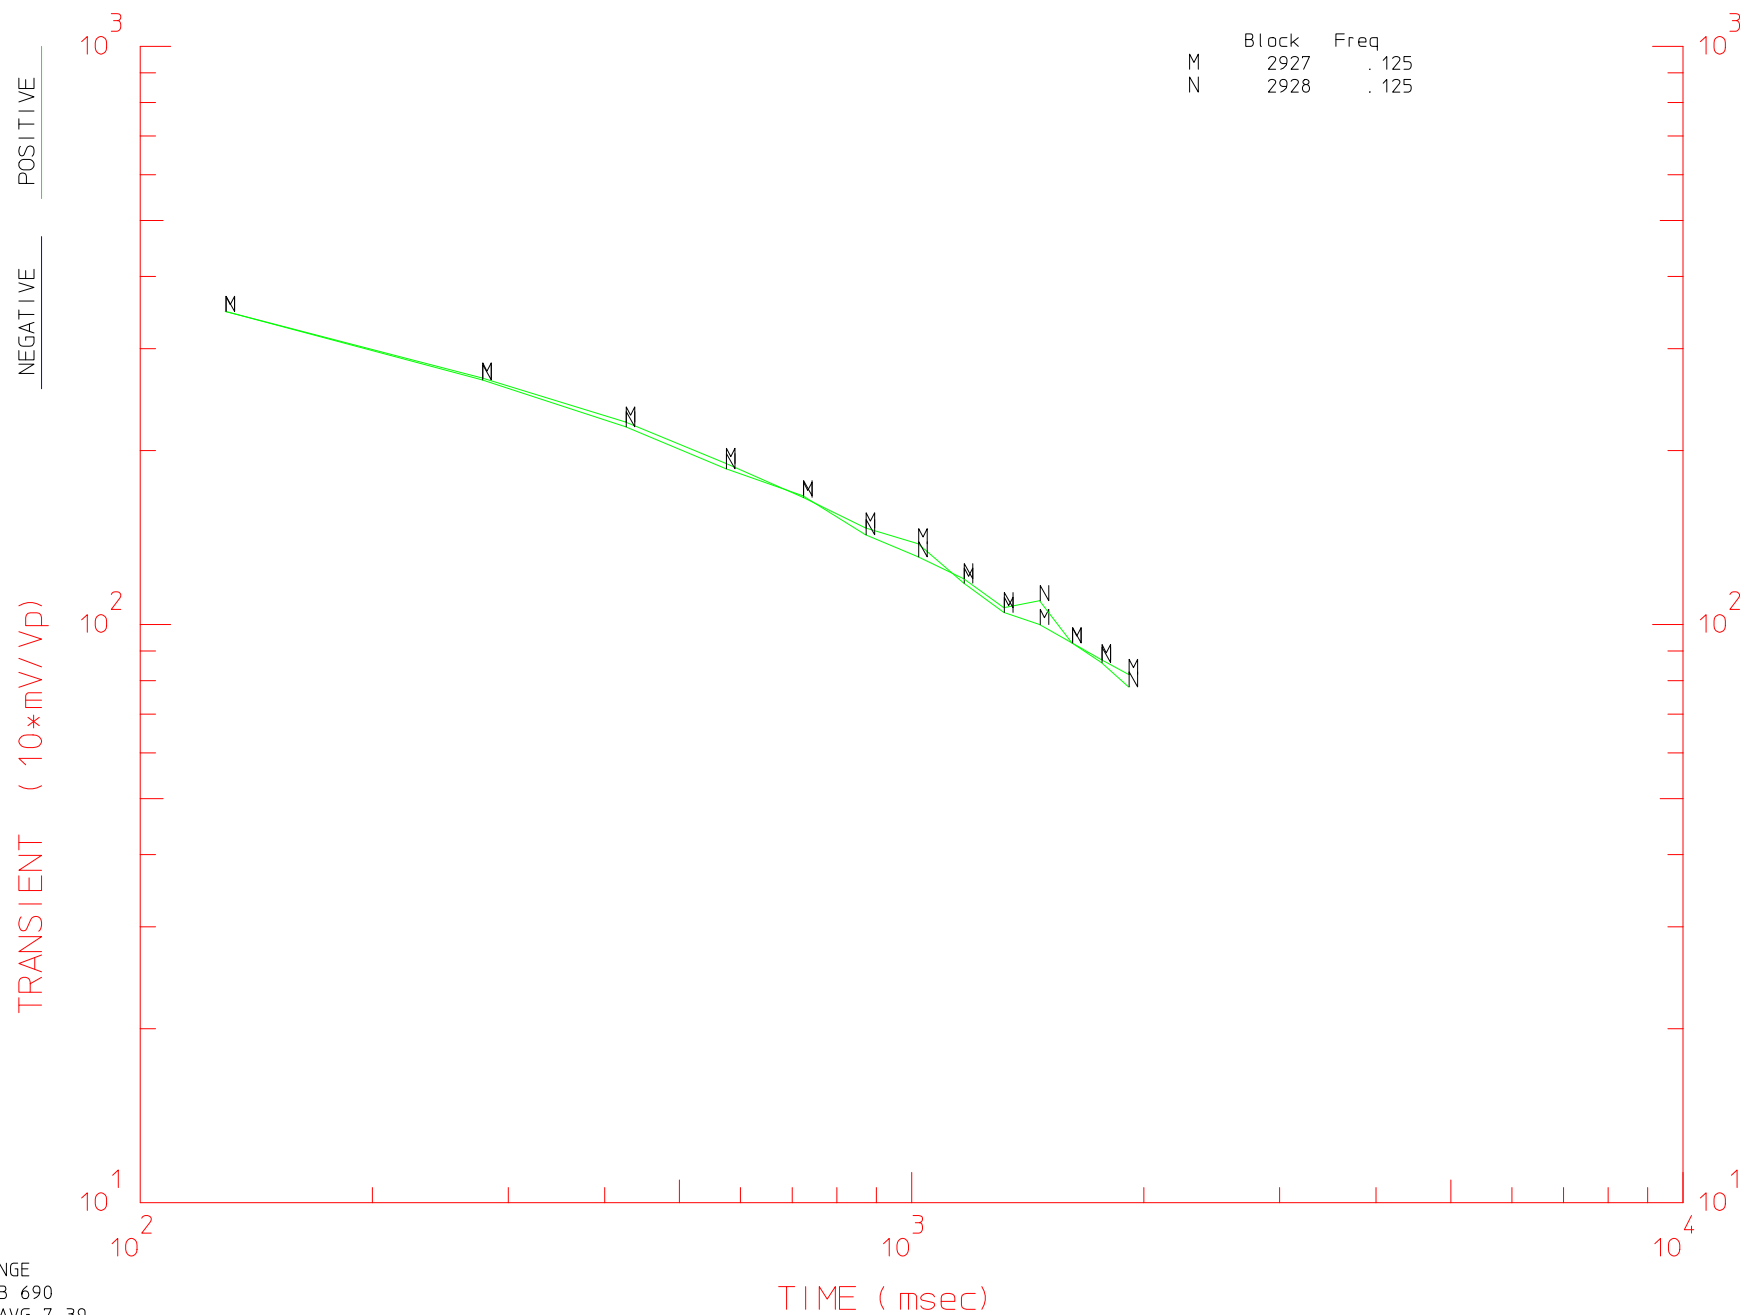

Mable Flats Grid5
Line= 11
TxLen= 7345. Line= 5939. Stn= -4.


	Block	Freq
O	2927	.125
P	2928	.125

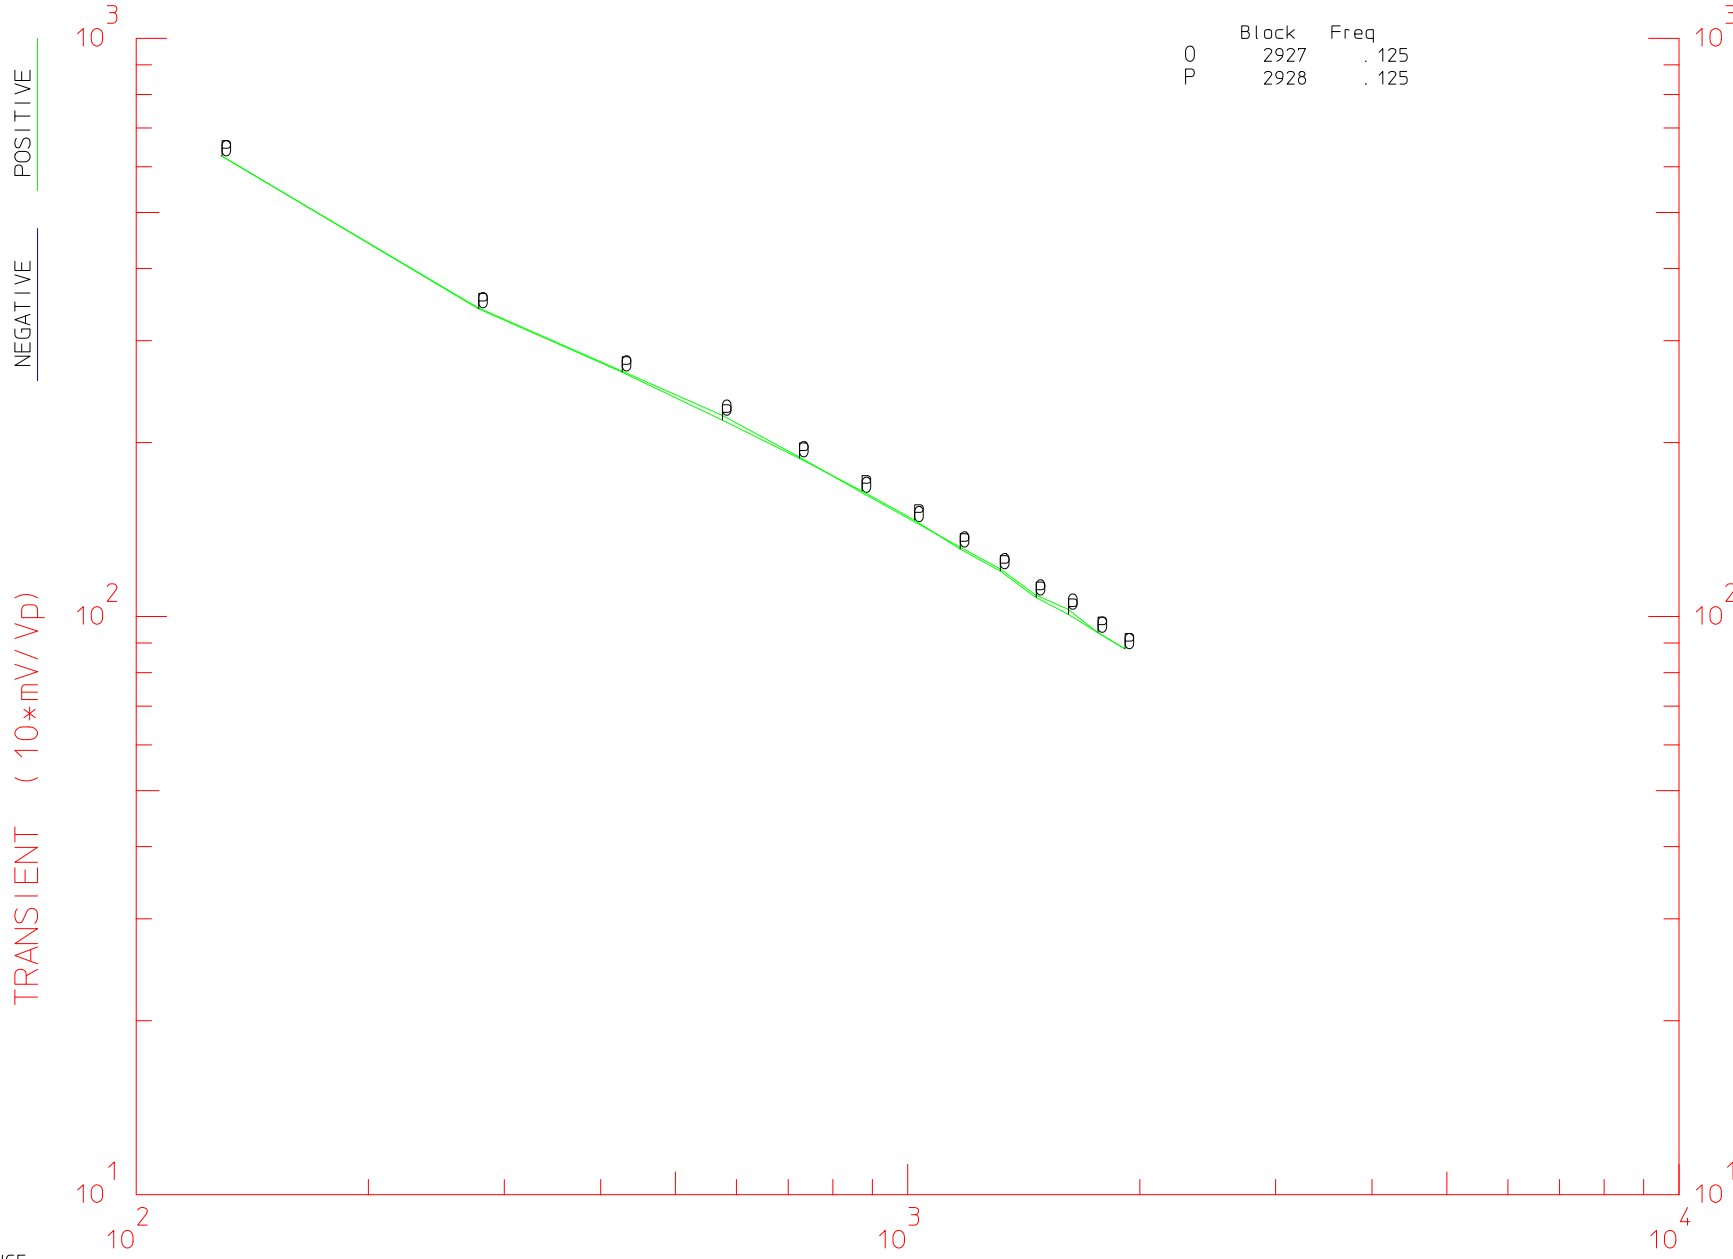

Mable Flats Grid5

Line= 11

TxLen= 7345. Line= 6114. Stn= -1.

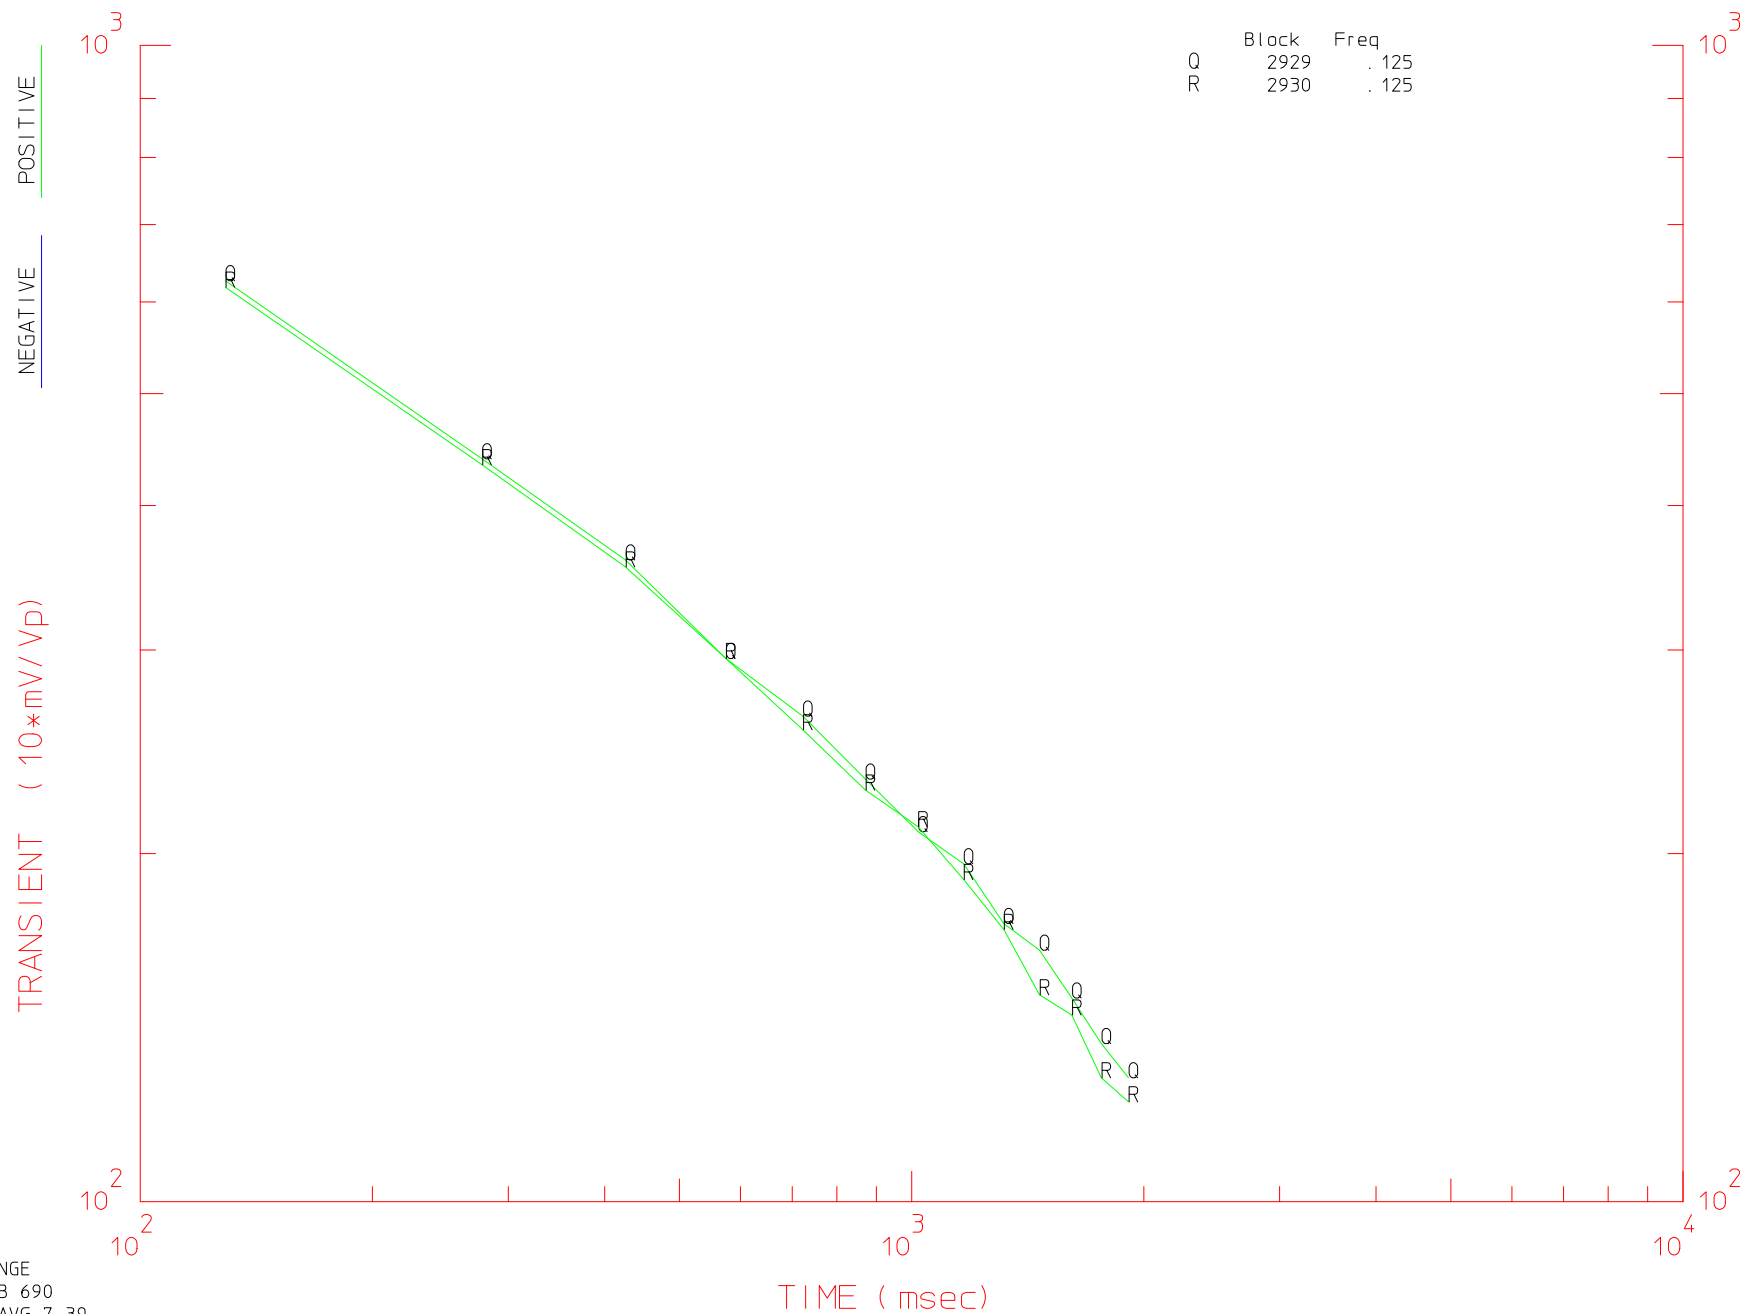

Mable Flats Grid5

Line= 11


TxLen= 7345. Line= 6089. Stn= -2.

	Block	Freq
S	2929	. 125
T	2930	. 125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

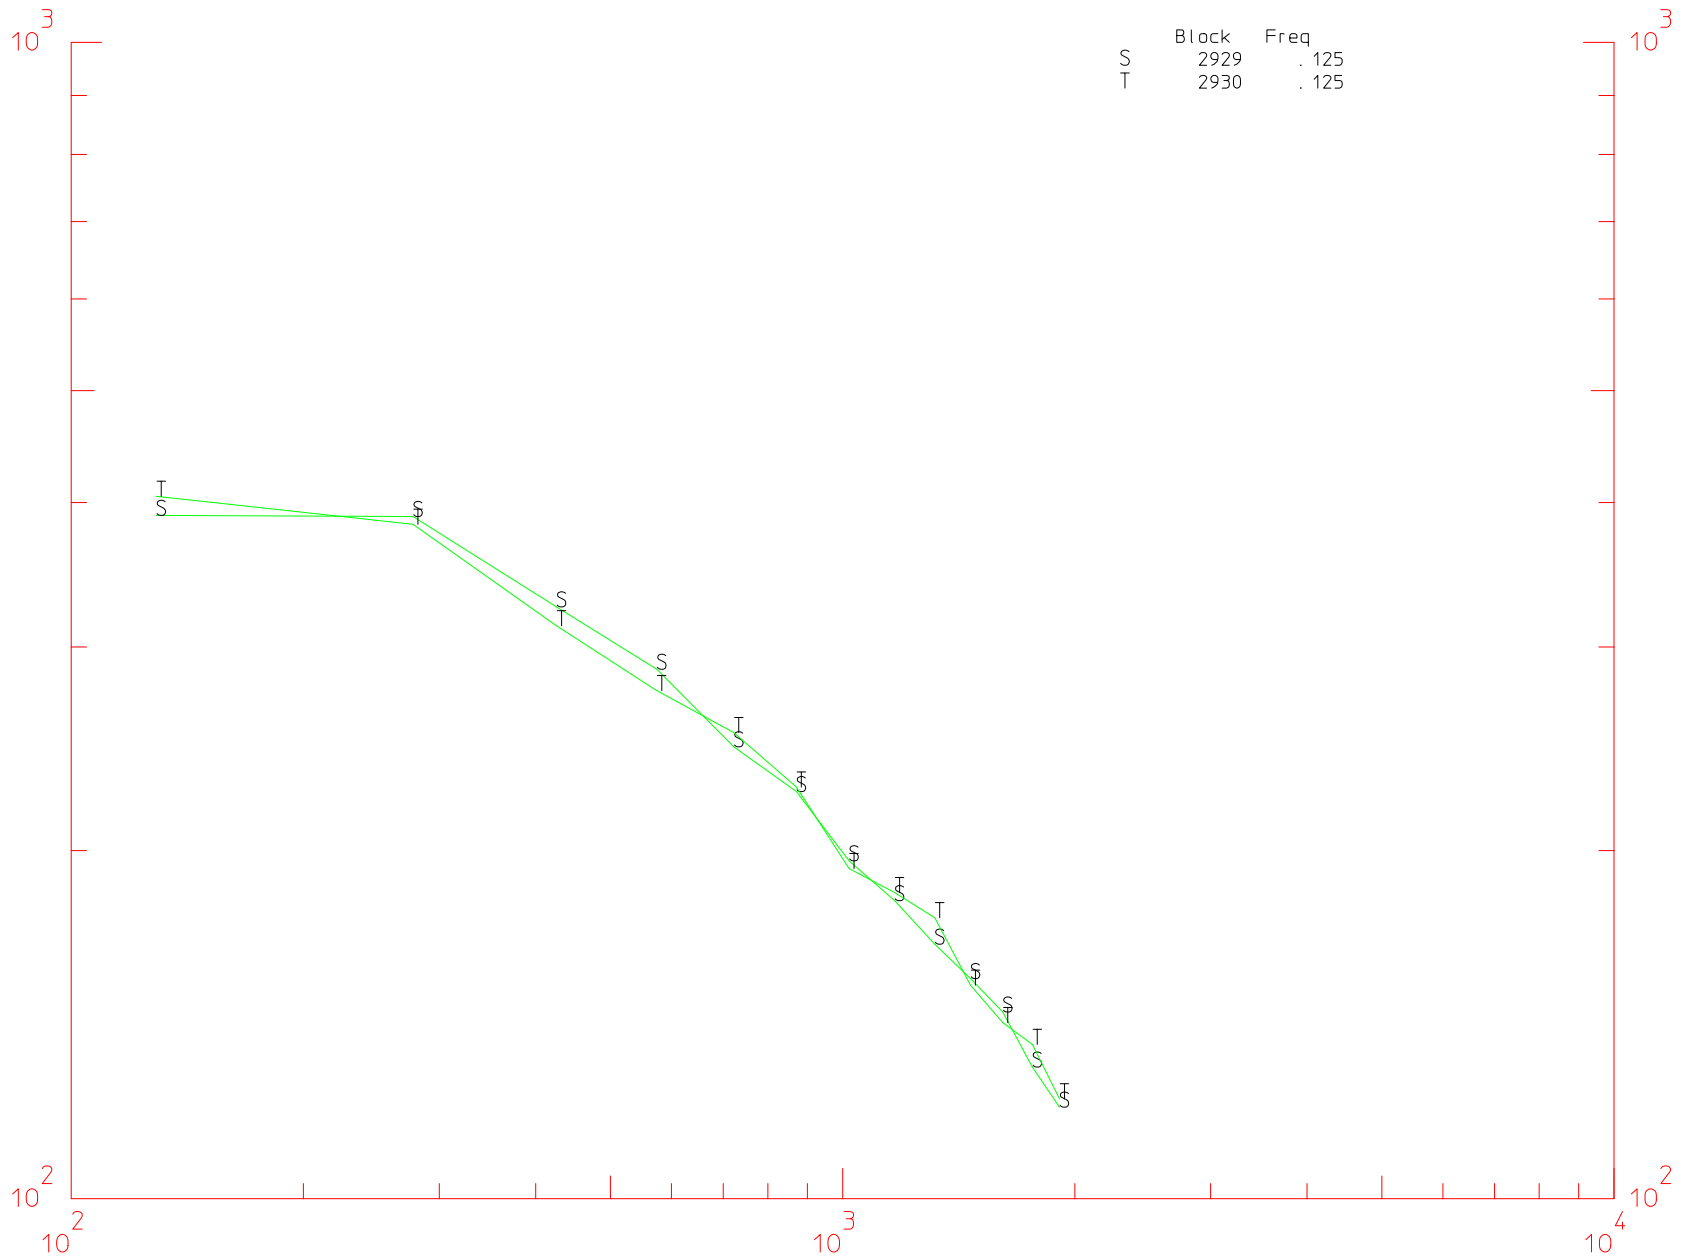


Mable Flats Grid5


Line= 11

TxLen= 7345. Line= 6064. Stn= -3.

	Block	Freq
U	2929	.125
V	2930	.125

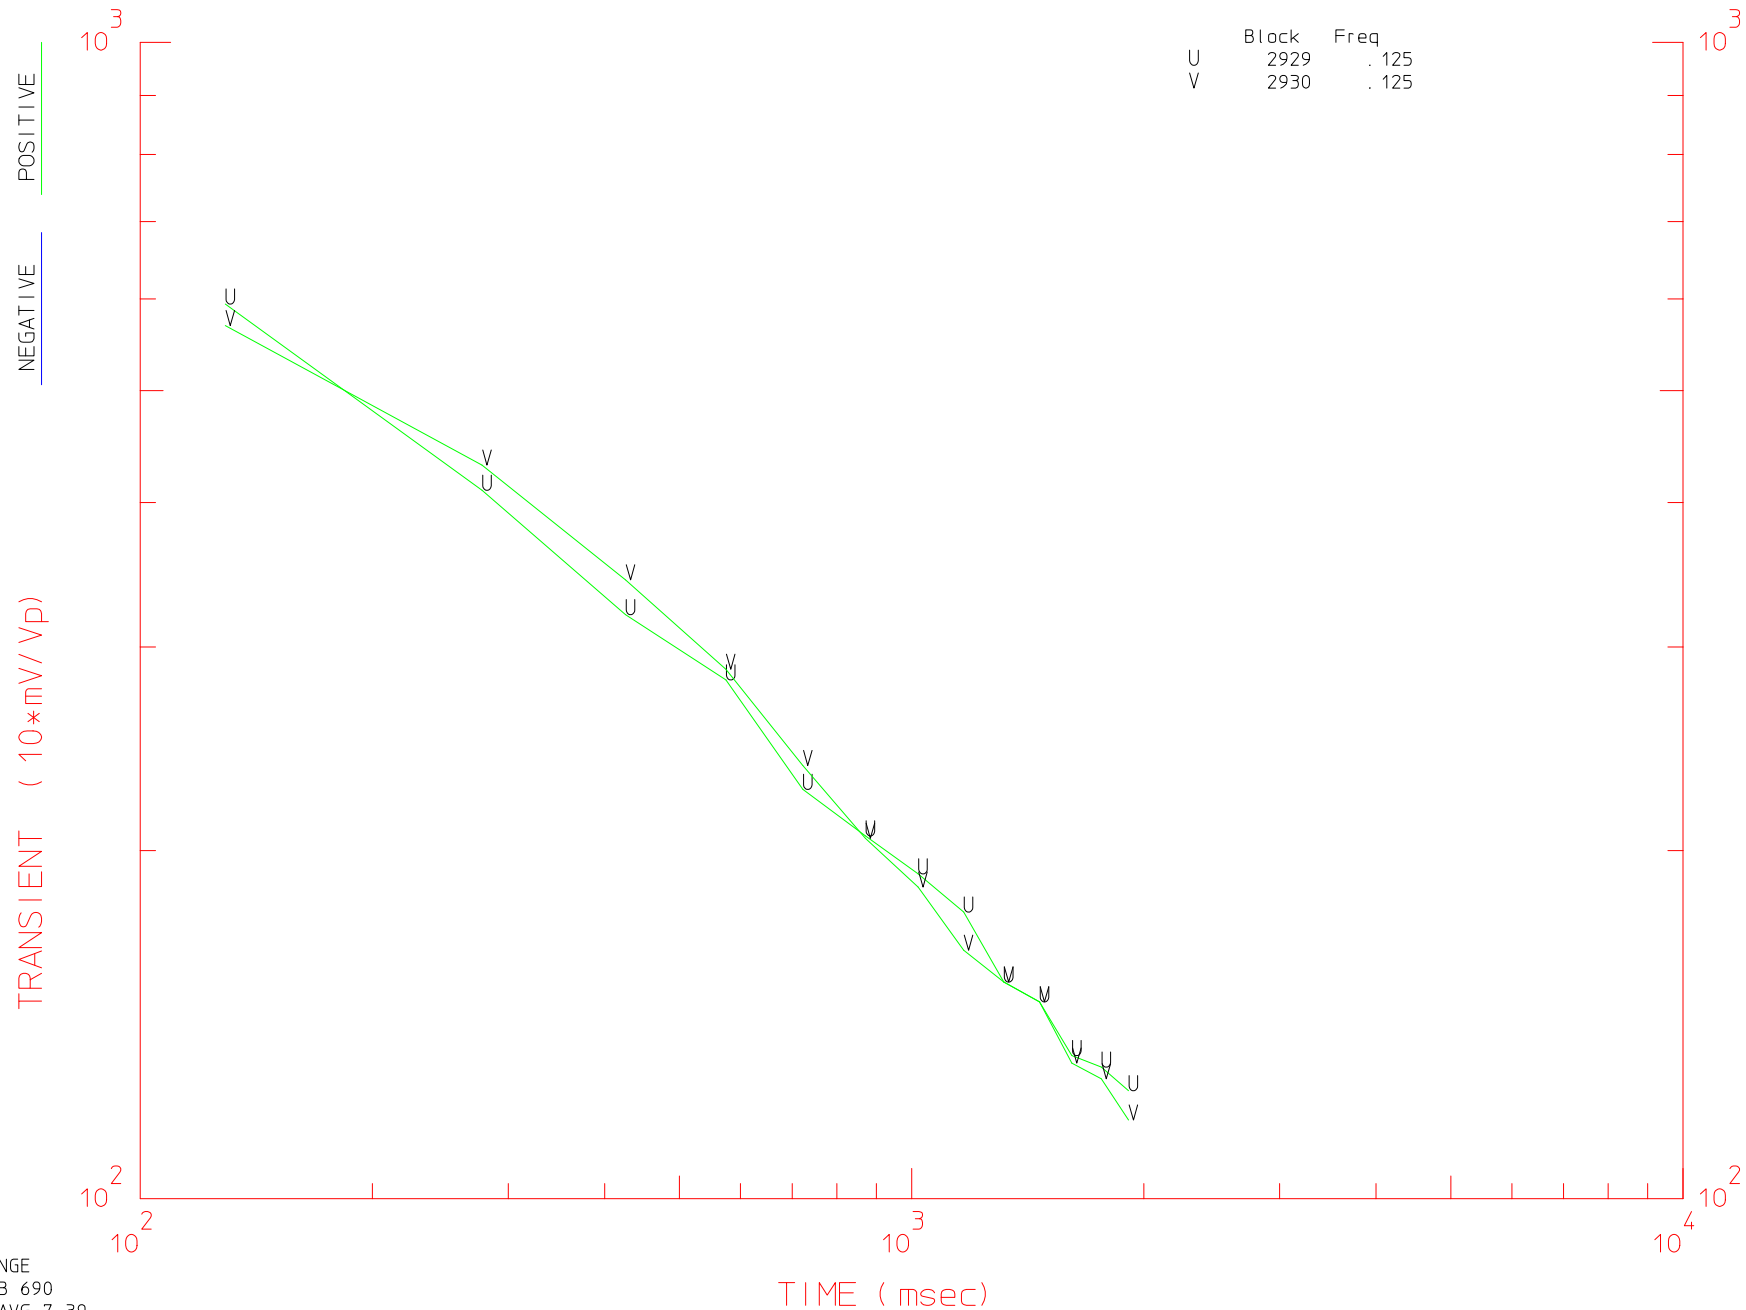

TxLen= 7345. Line= 6039. Stn= -4.



Mable Flats Grid5

Line= 11


TxLen= 7345. Line= 6214. Stn= -1.

	Block	Freq
Y	2931	.125
Z	2932	.125

POSITIVE


NEGATIVE

TRANSIENT (10*mV/Vp)

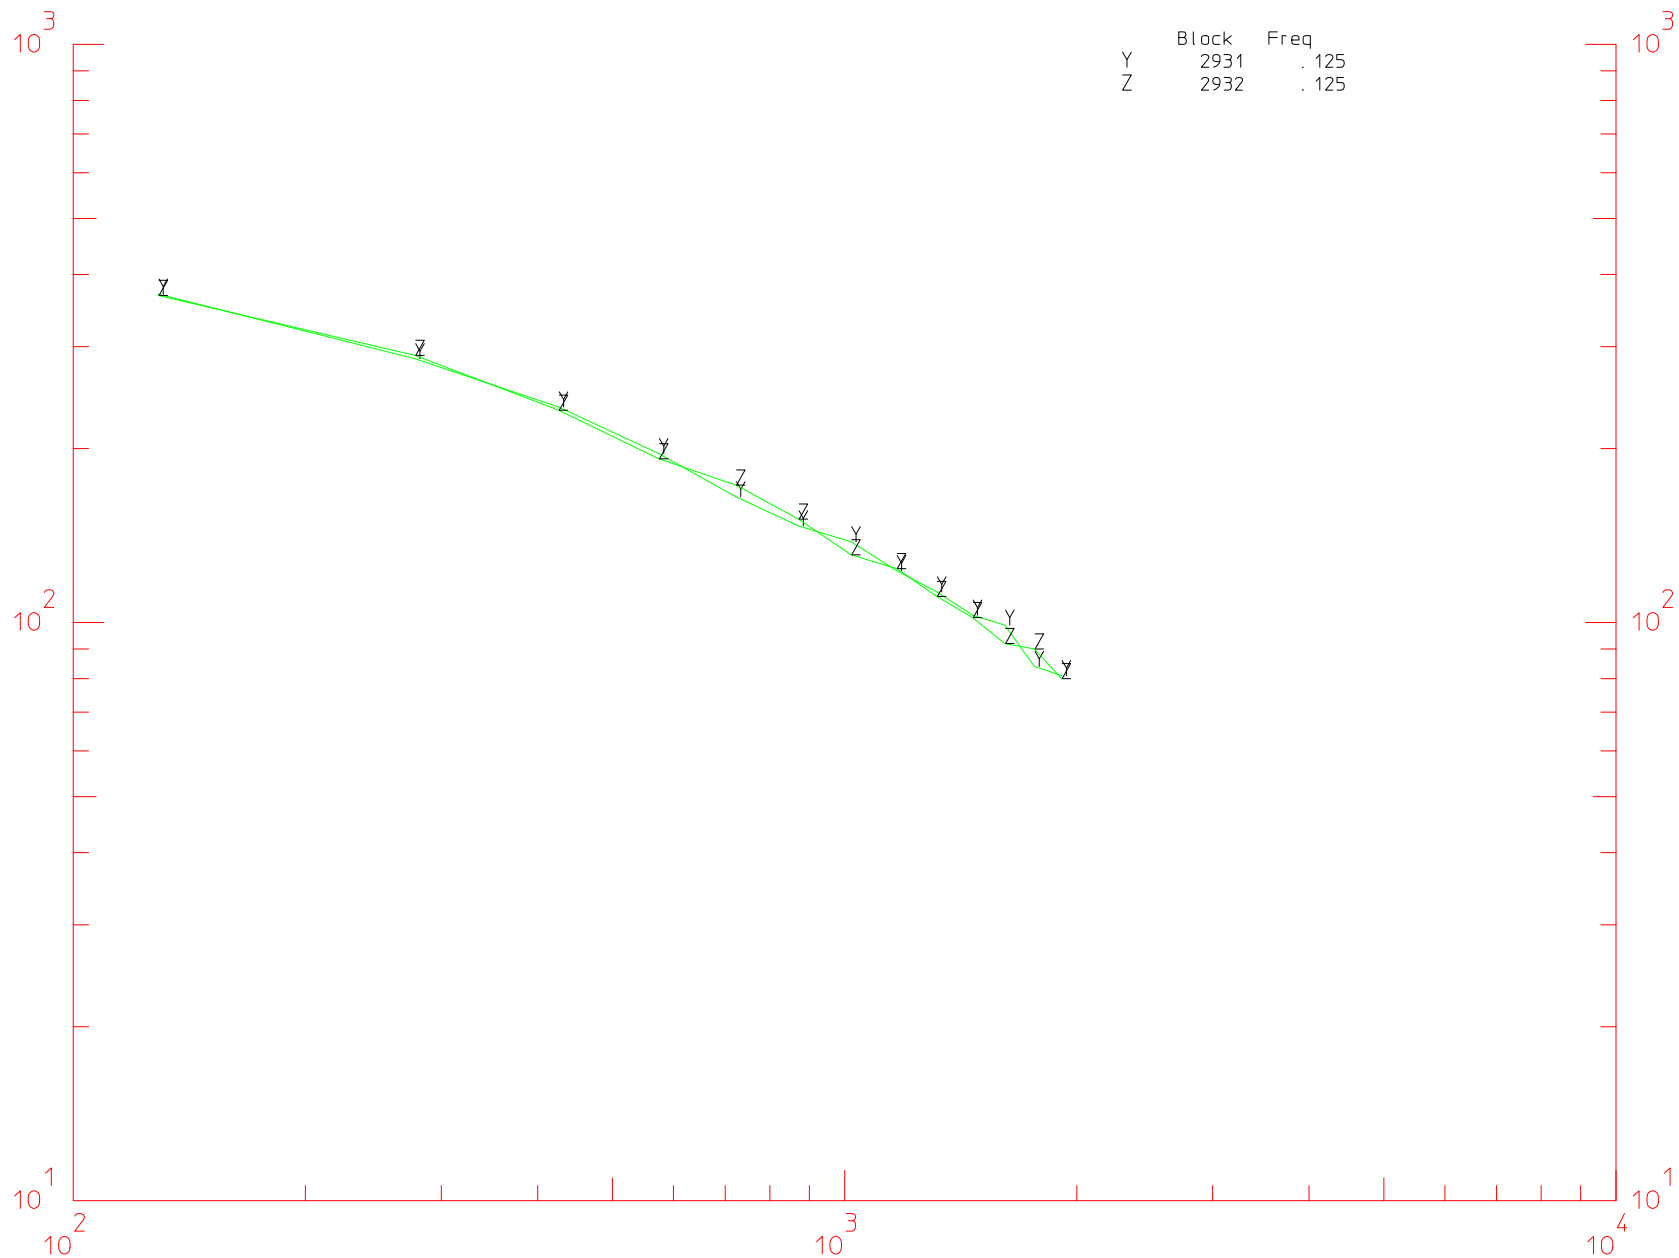

TxLen= 7345. Line= 6189. Stn= -2.

	Stock	Freq
A	2931	.125
B	2932	.125

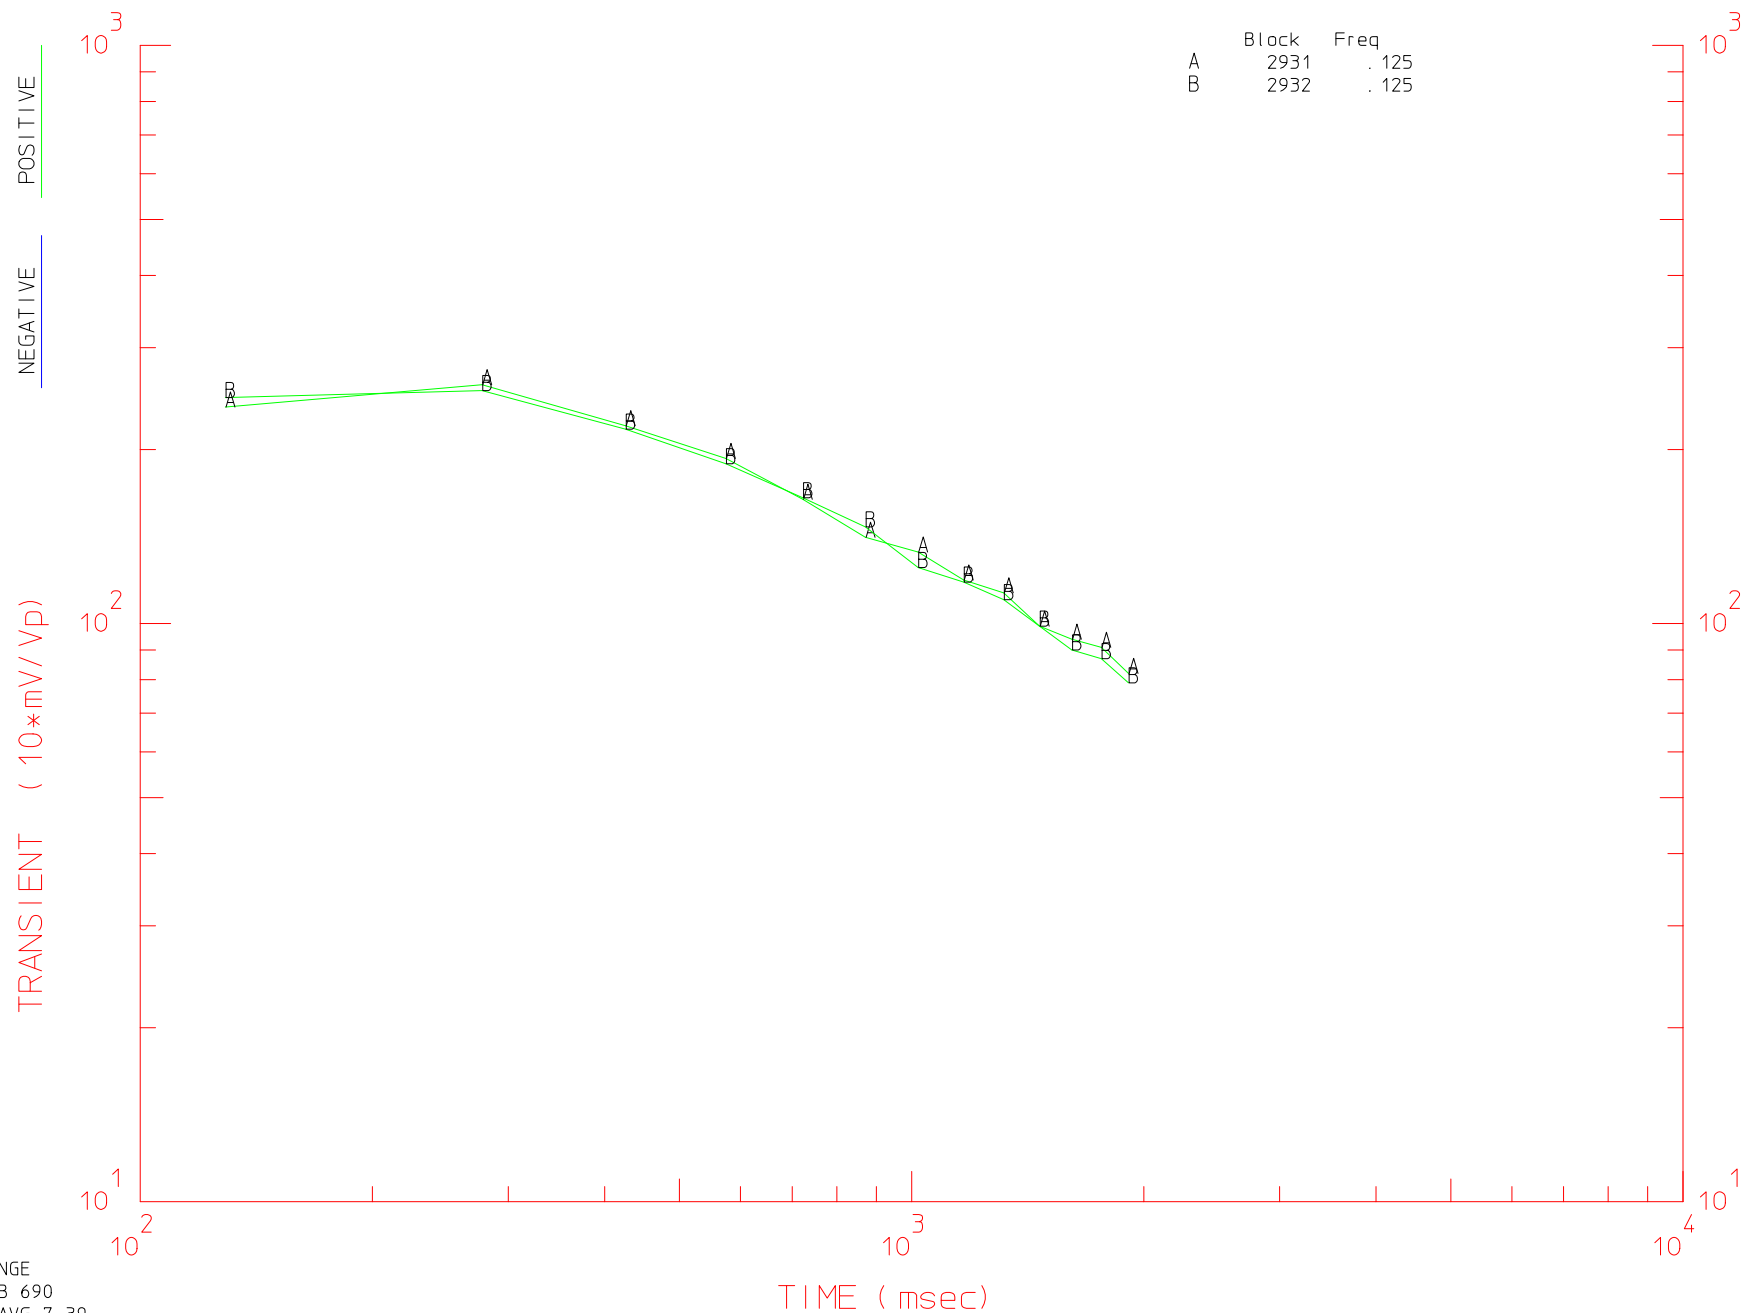


Mable Flats Grid5

Line= 11

TxLen= 7345. Line= 6164. Stn= -3.

	Block	Freq
C	2931	.125
D	2932	.125

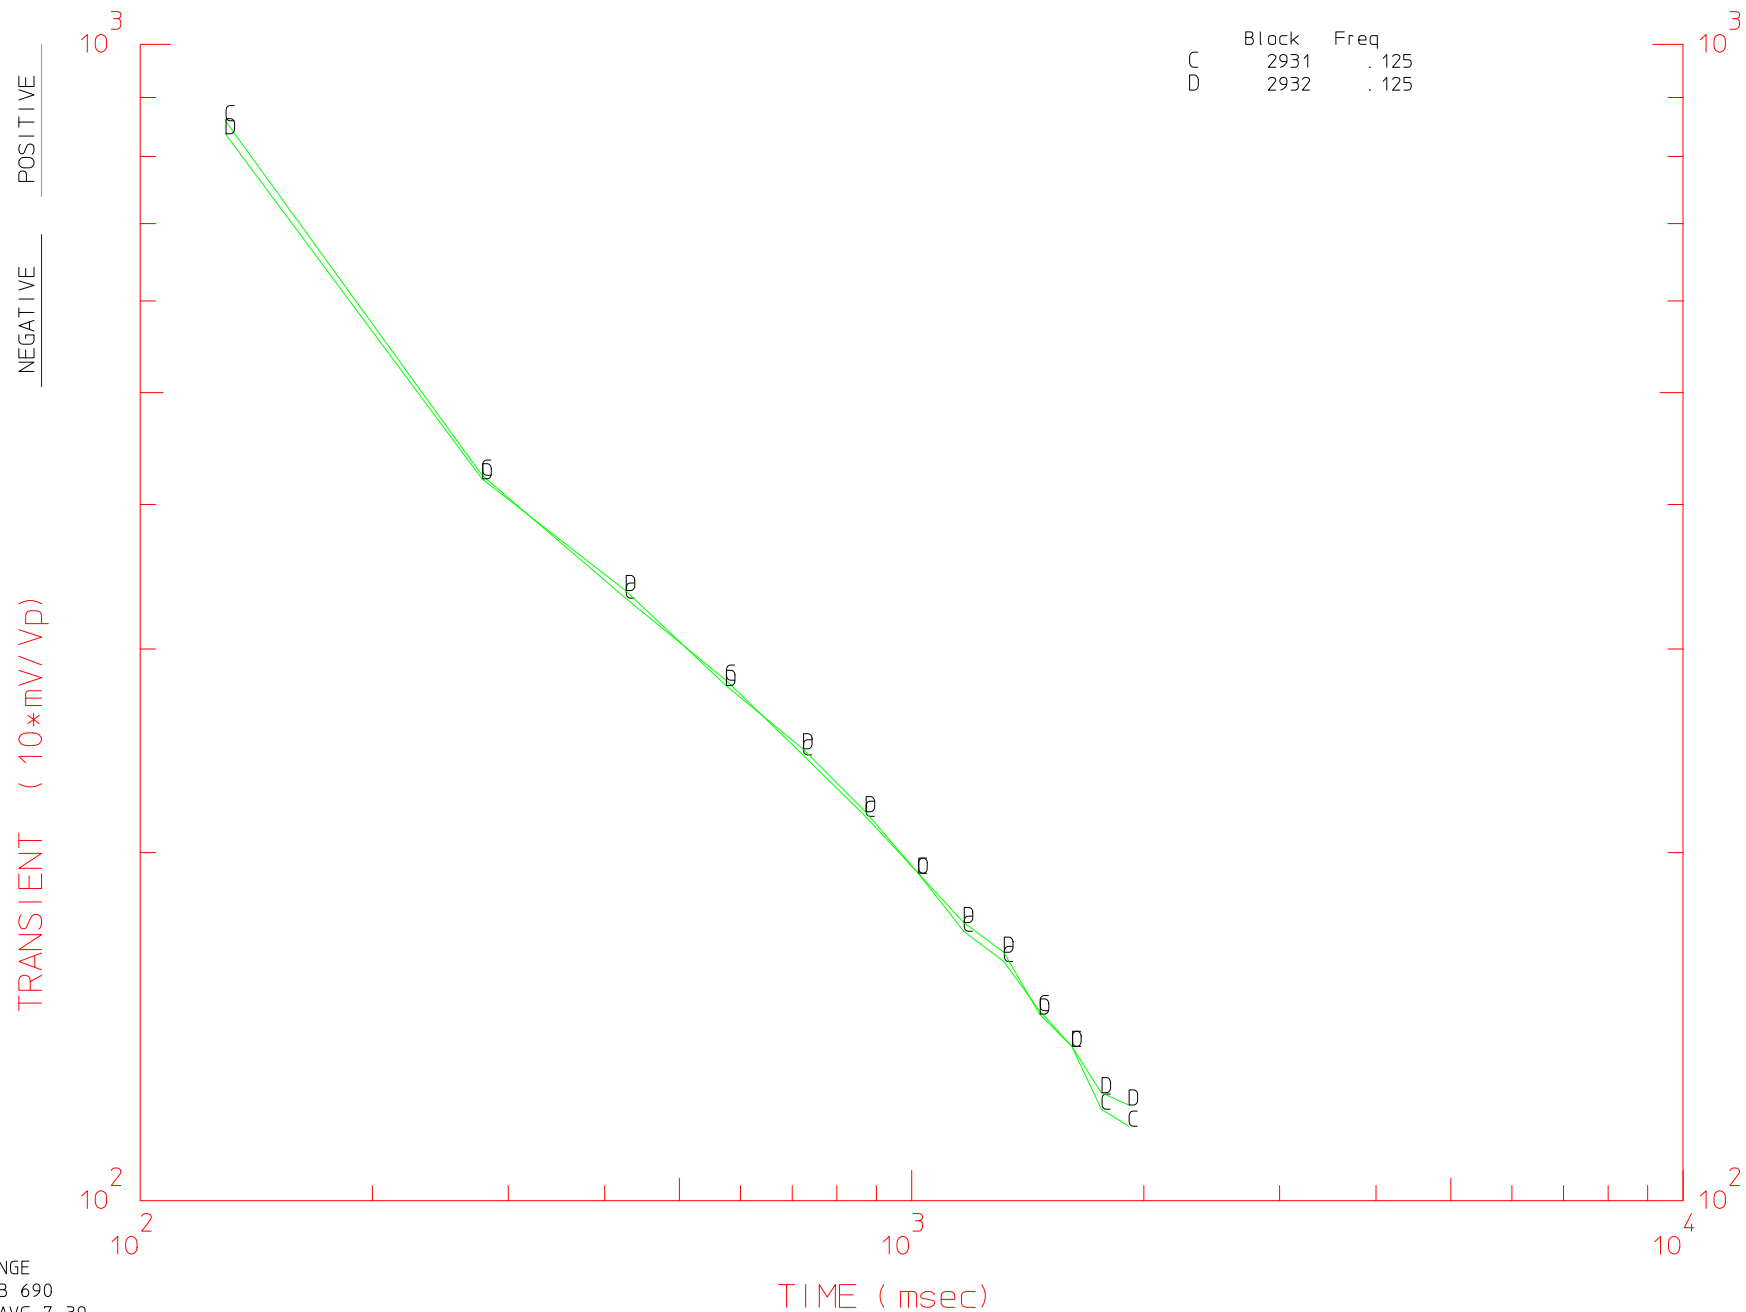

Mable Flats Grid5

Line= 11


TxLen= 7345. Line= 6139. Stn= -4.

	Block	Freq
E	2931	.125
F	2932	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

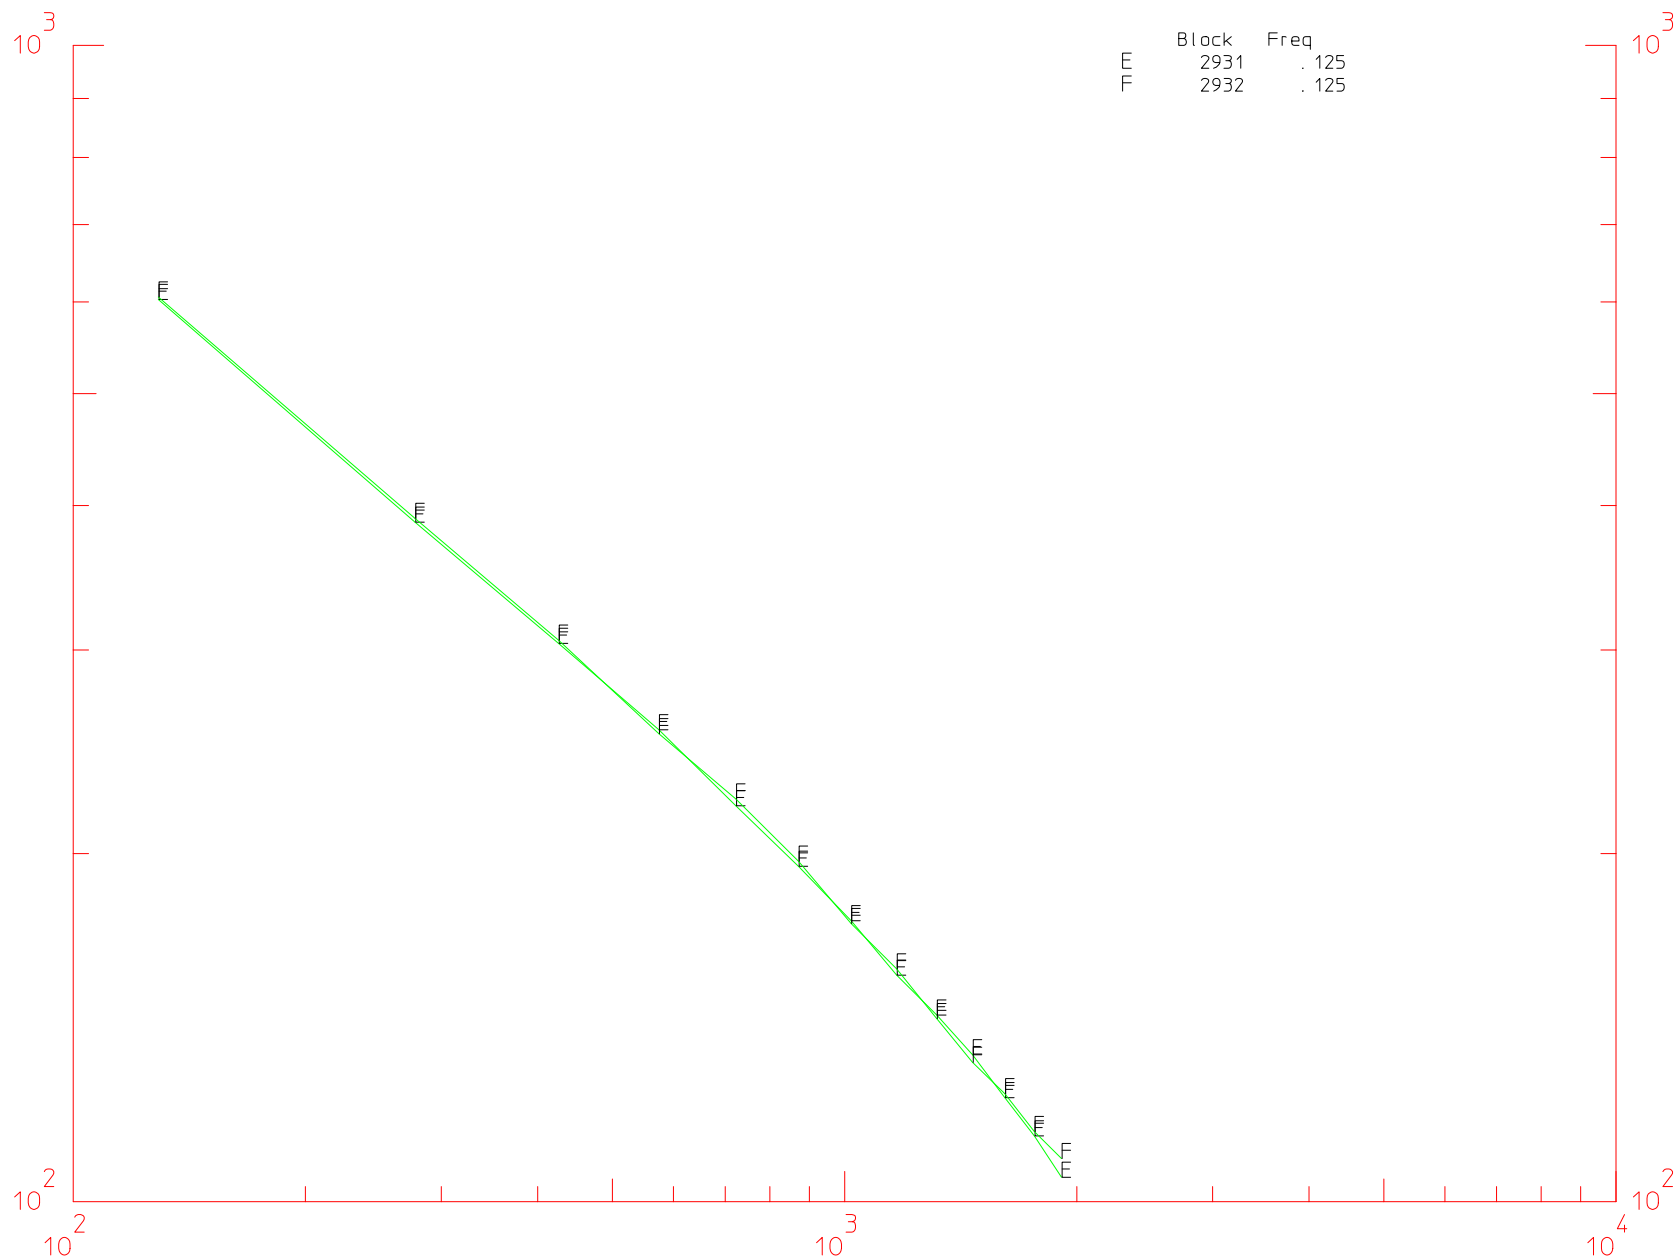


Mable Flats Grid5

Line= 11

TxLen= 7345. Line= 6339. Stn= 1.

	Block	Freq
G	2935	.125
H	2936	.125

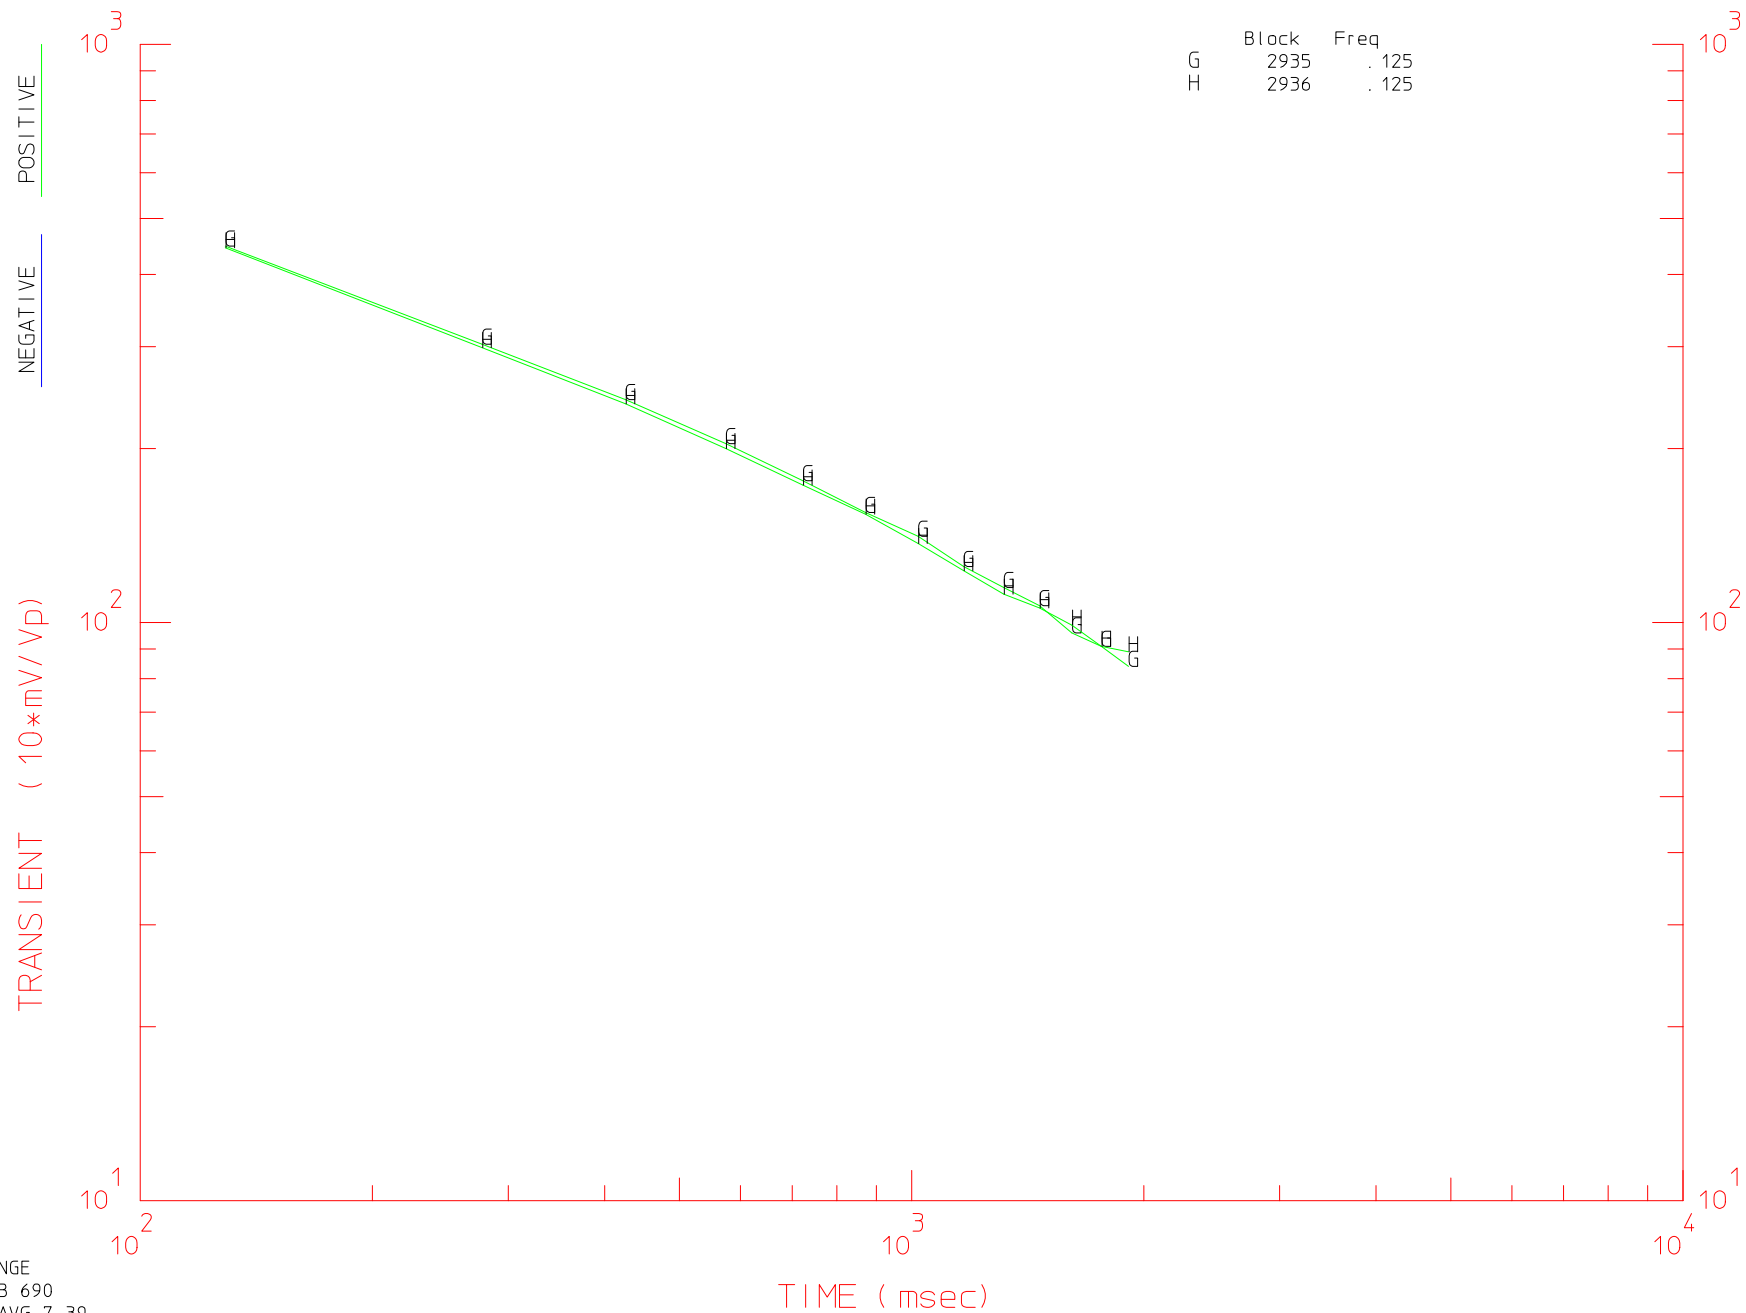

Mable Flats Grid5

Line= 11


TxLen= 7345. Line= 6364. Stn= 2.

	Block	Freq
I	2935	.125
J	2936	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

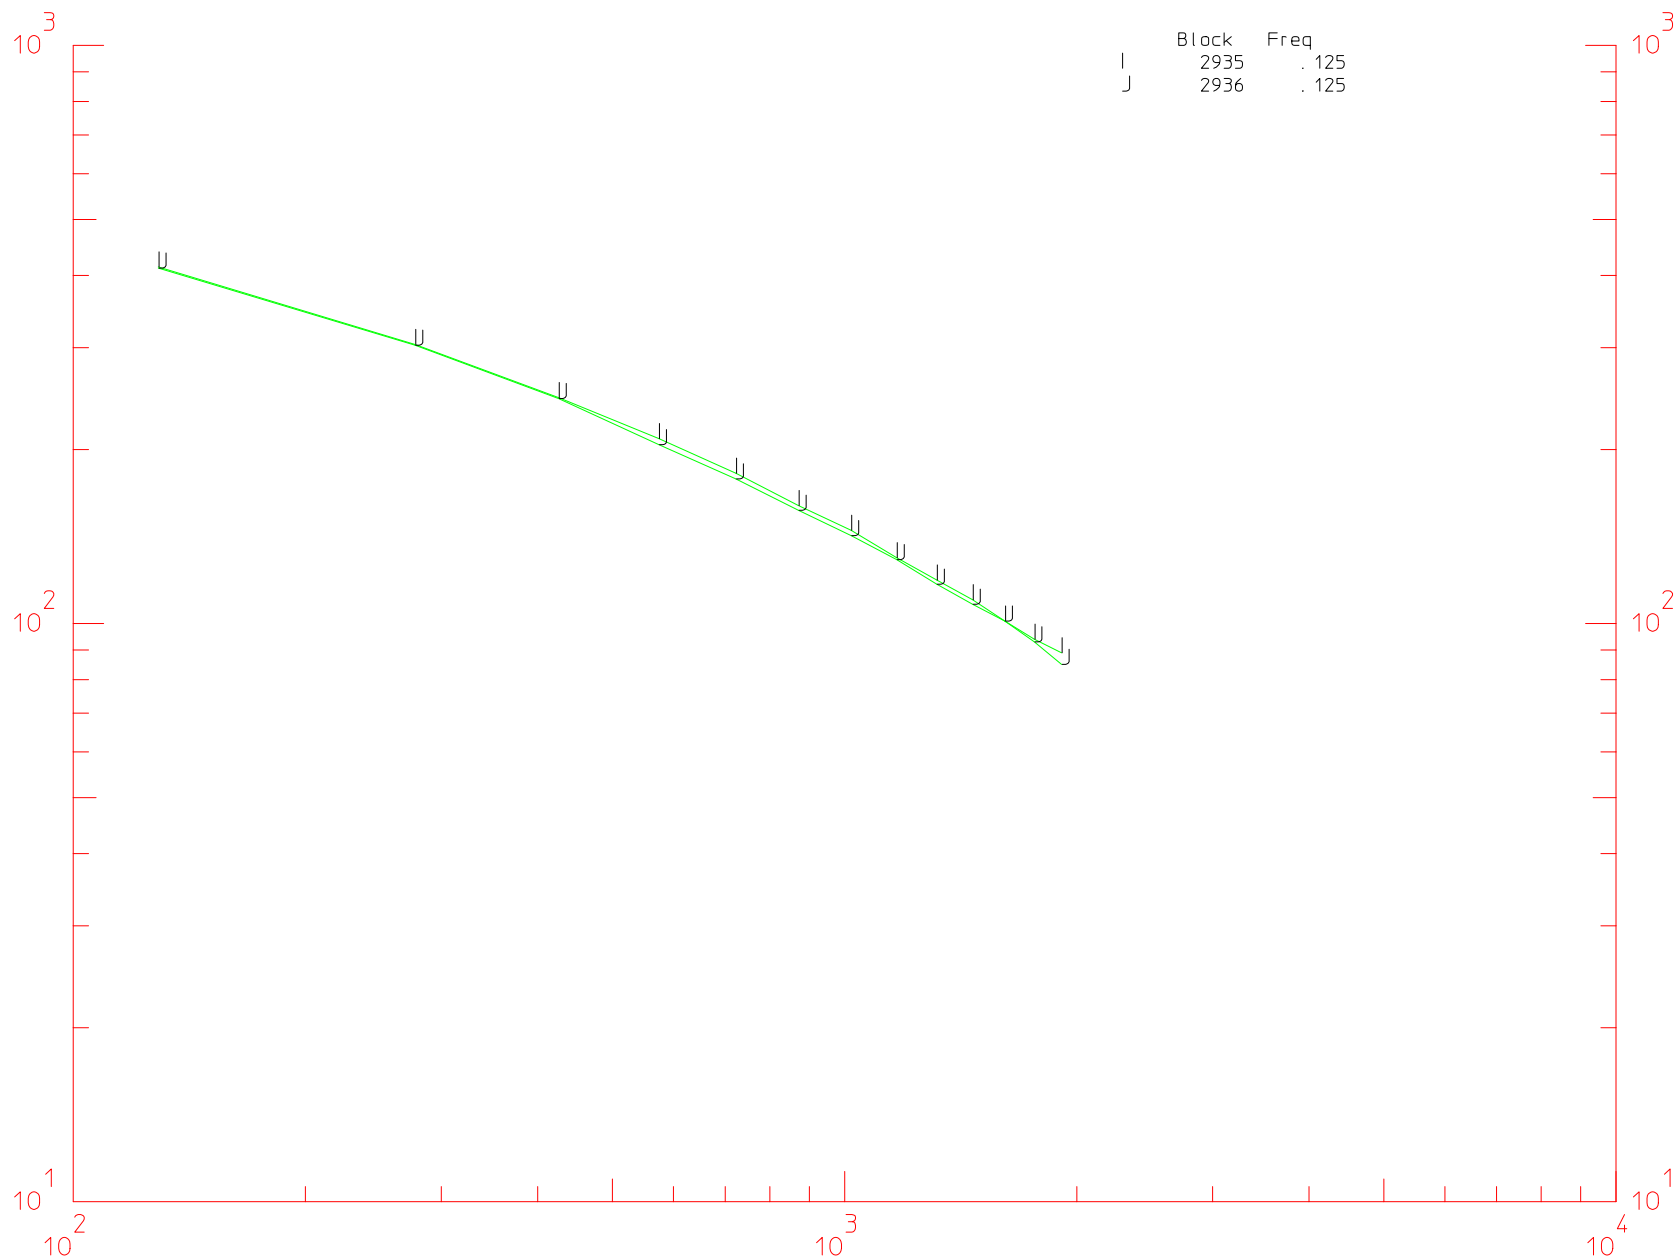

Mable Flats Grid5


Line= 11

TxLen= 7345. Line= 6389. Stn= 3.

	Block	Freq
K	2935	.125
L	2936	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

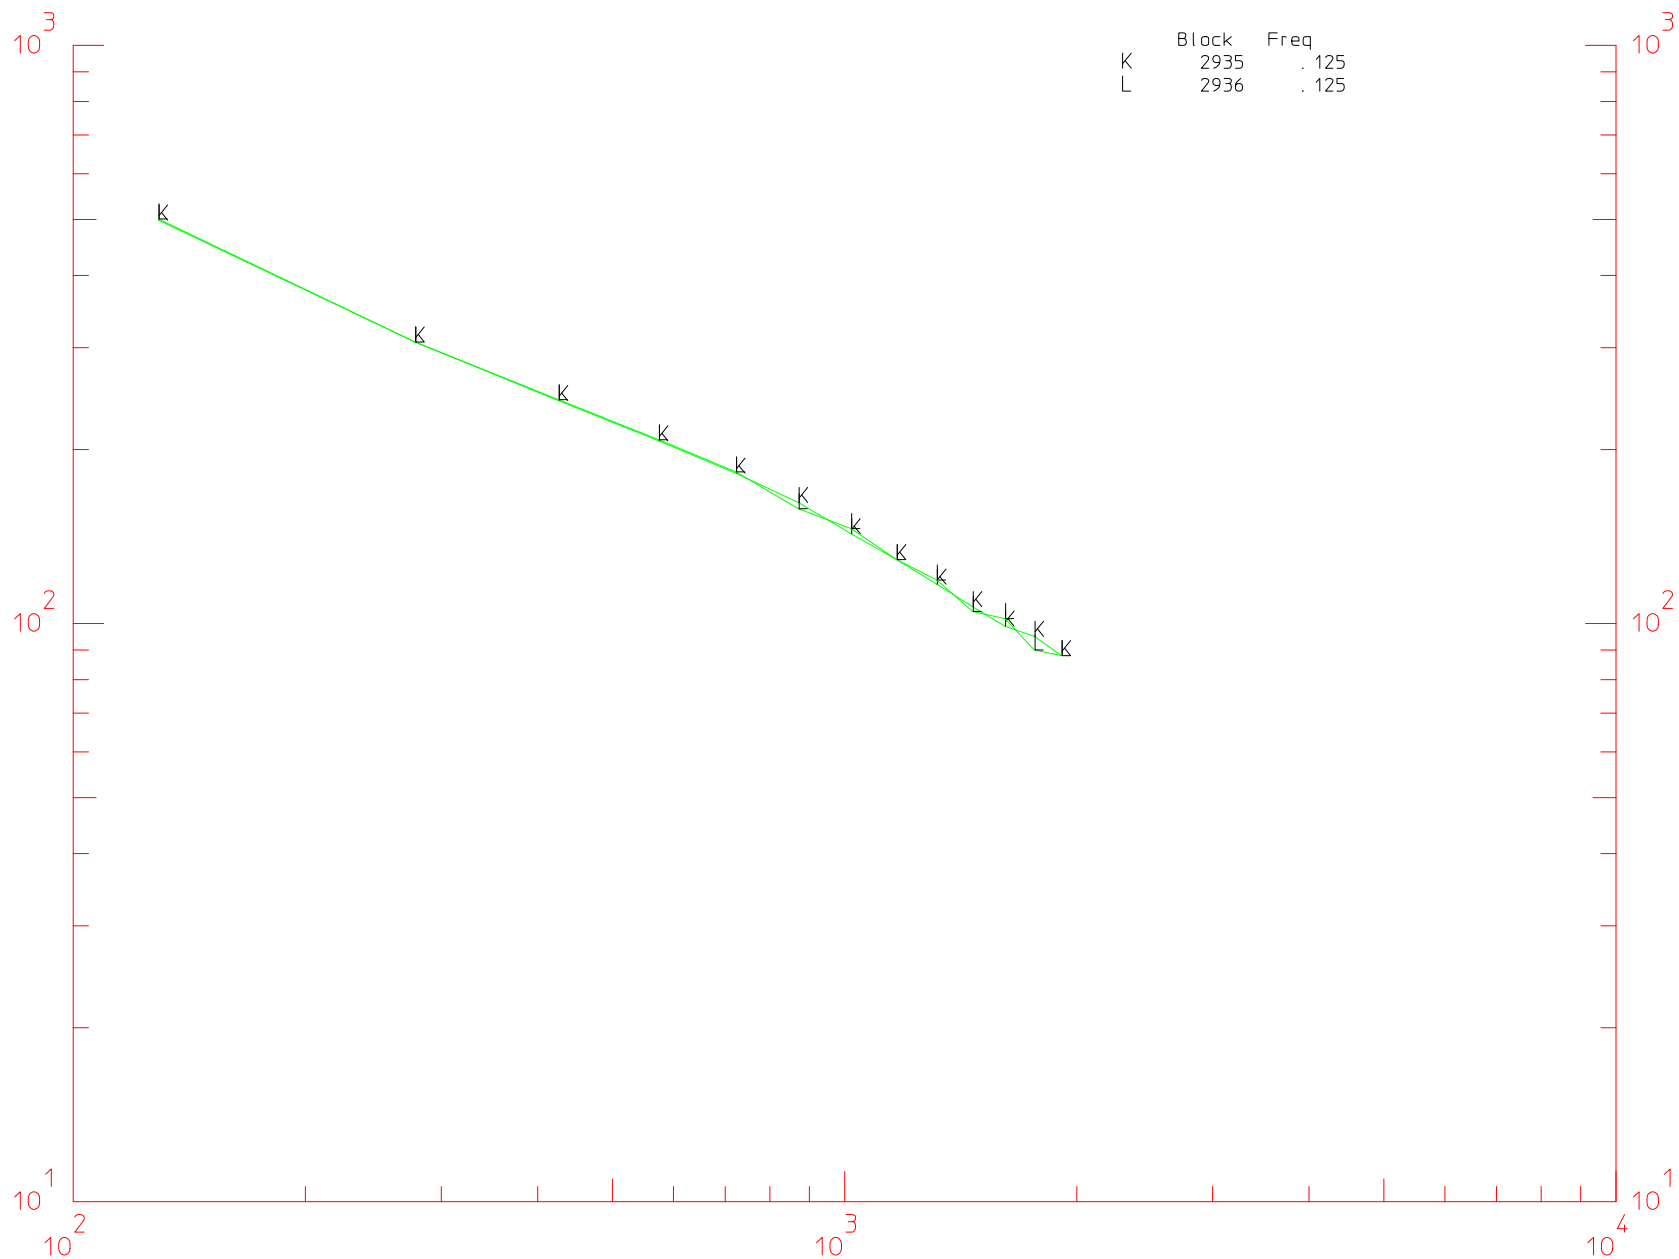

Mable Flats Grid5

Line= 11


TxLen= 7345. Line= 6414. Stn= 4.

	Block	Freq
M	2935	.125
N	2936	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

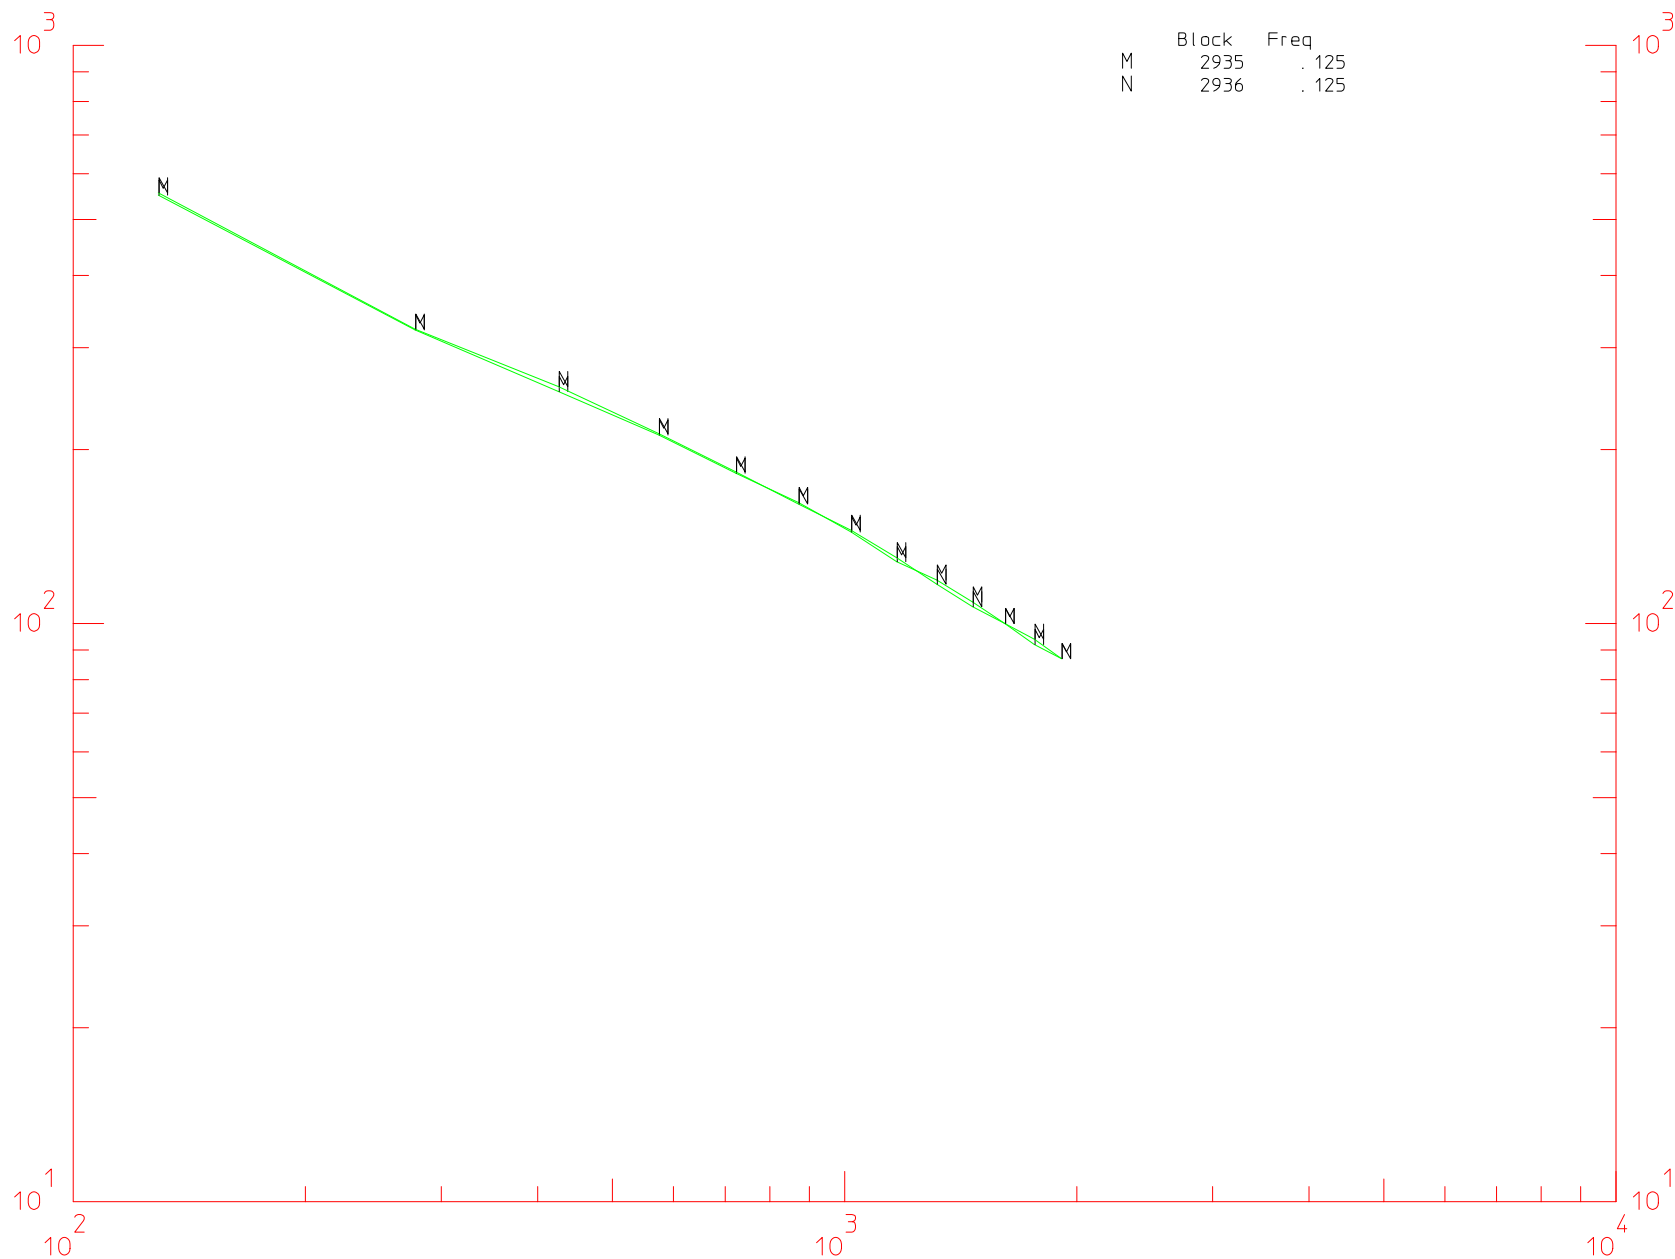


Mable Flats Grid5

Line= 11

TxLen= 7345. Line= 6314. Stn= -1.

	Block	Freq
O	2933	.125
P	2934	.125

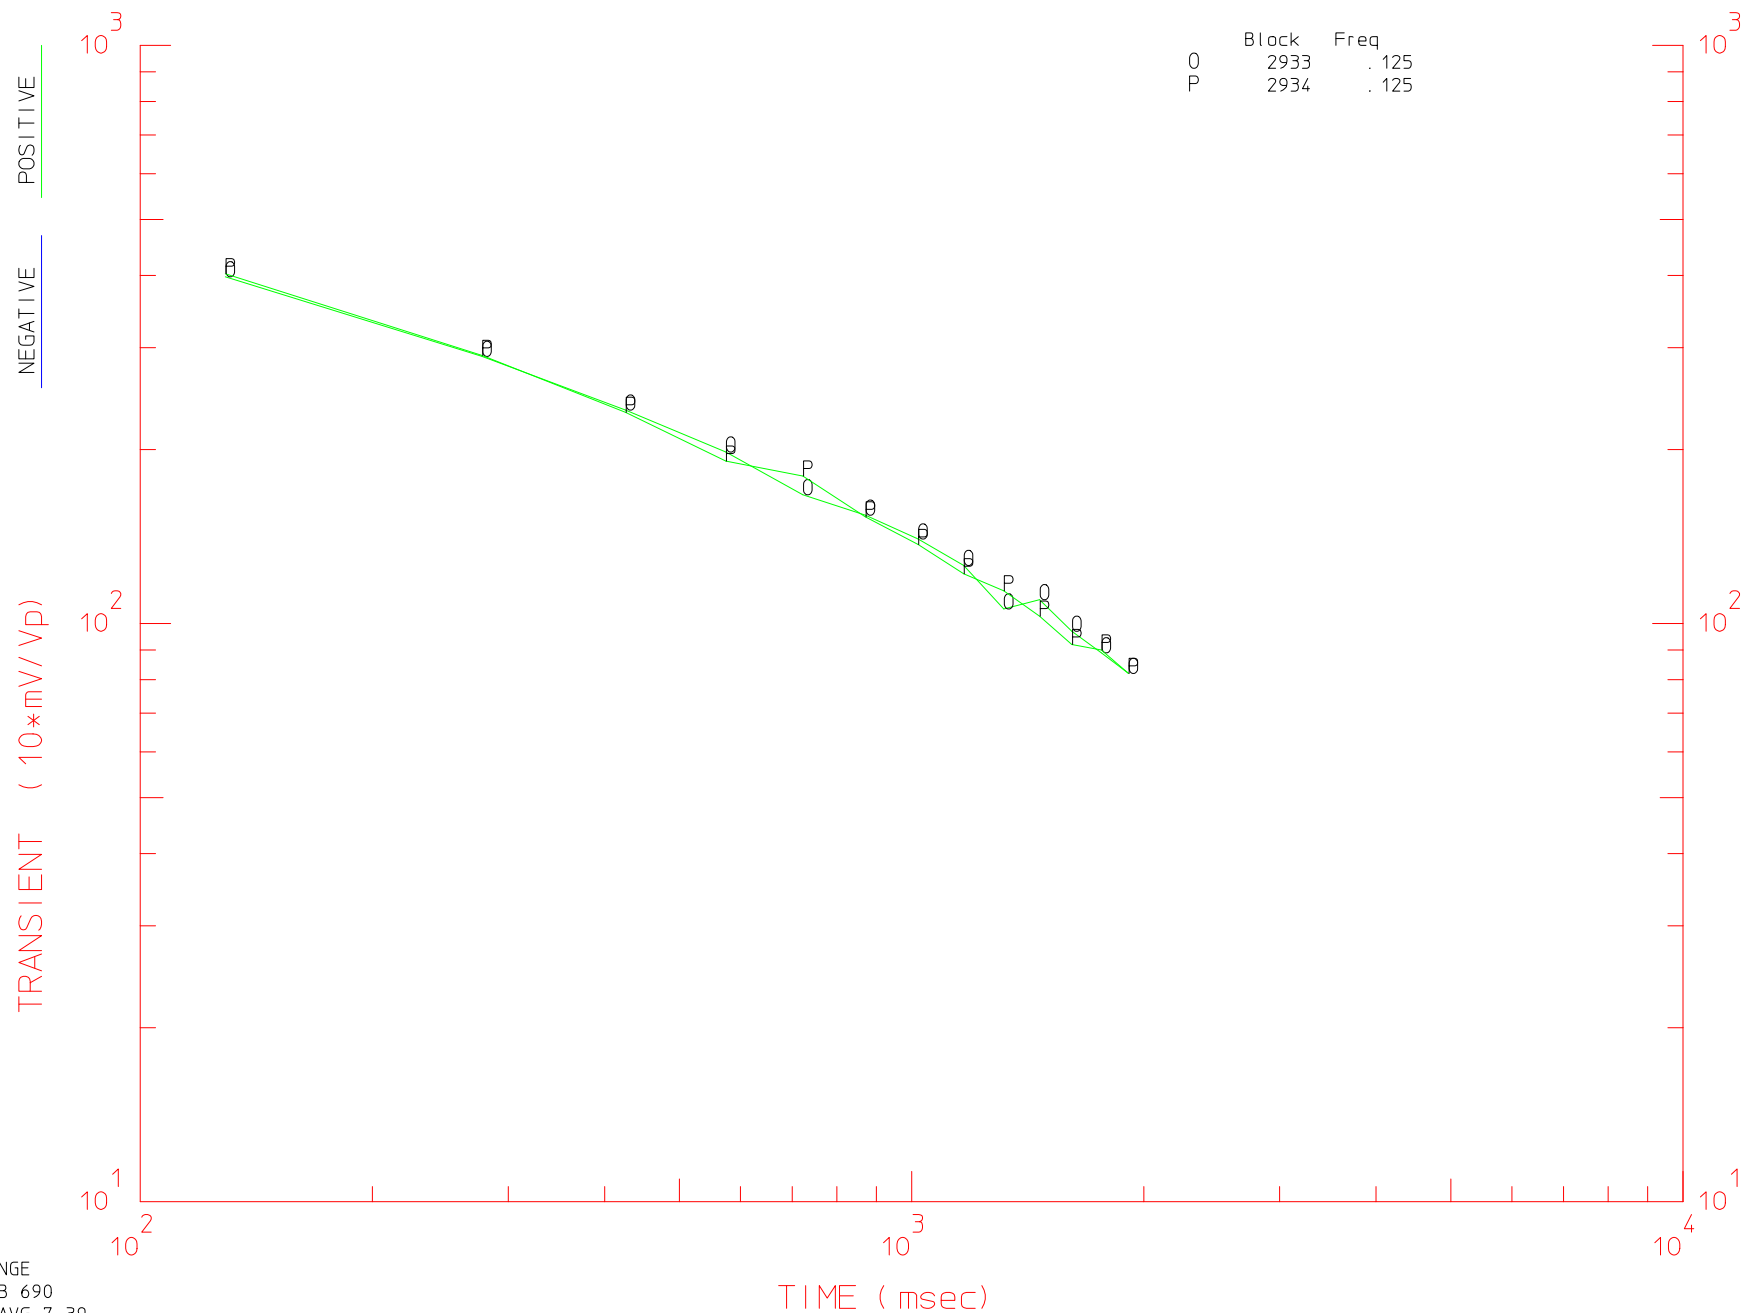


Mable Flats Grid5

Line= 11

TxLen= 7345. Line= 6289. Stn= -2.

	Block	Freq
Q	2933	.125
R	2934	.125

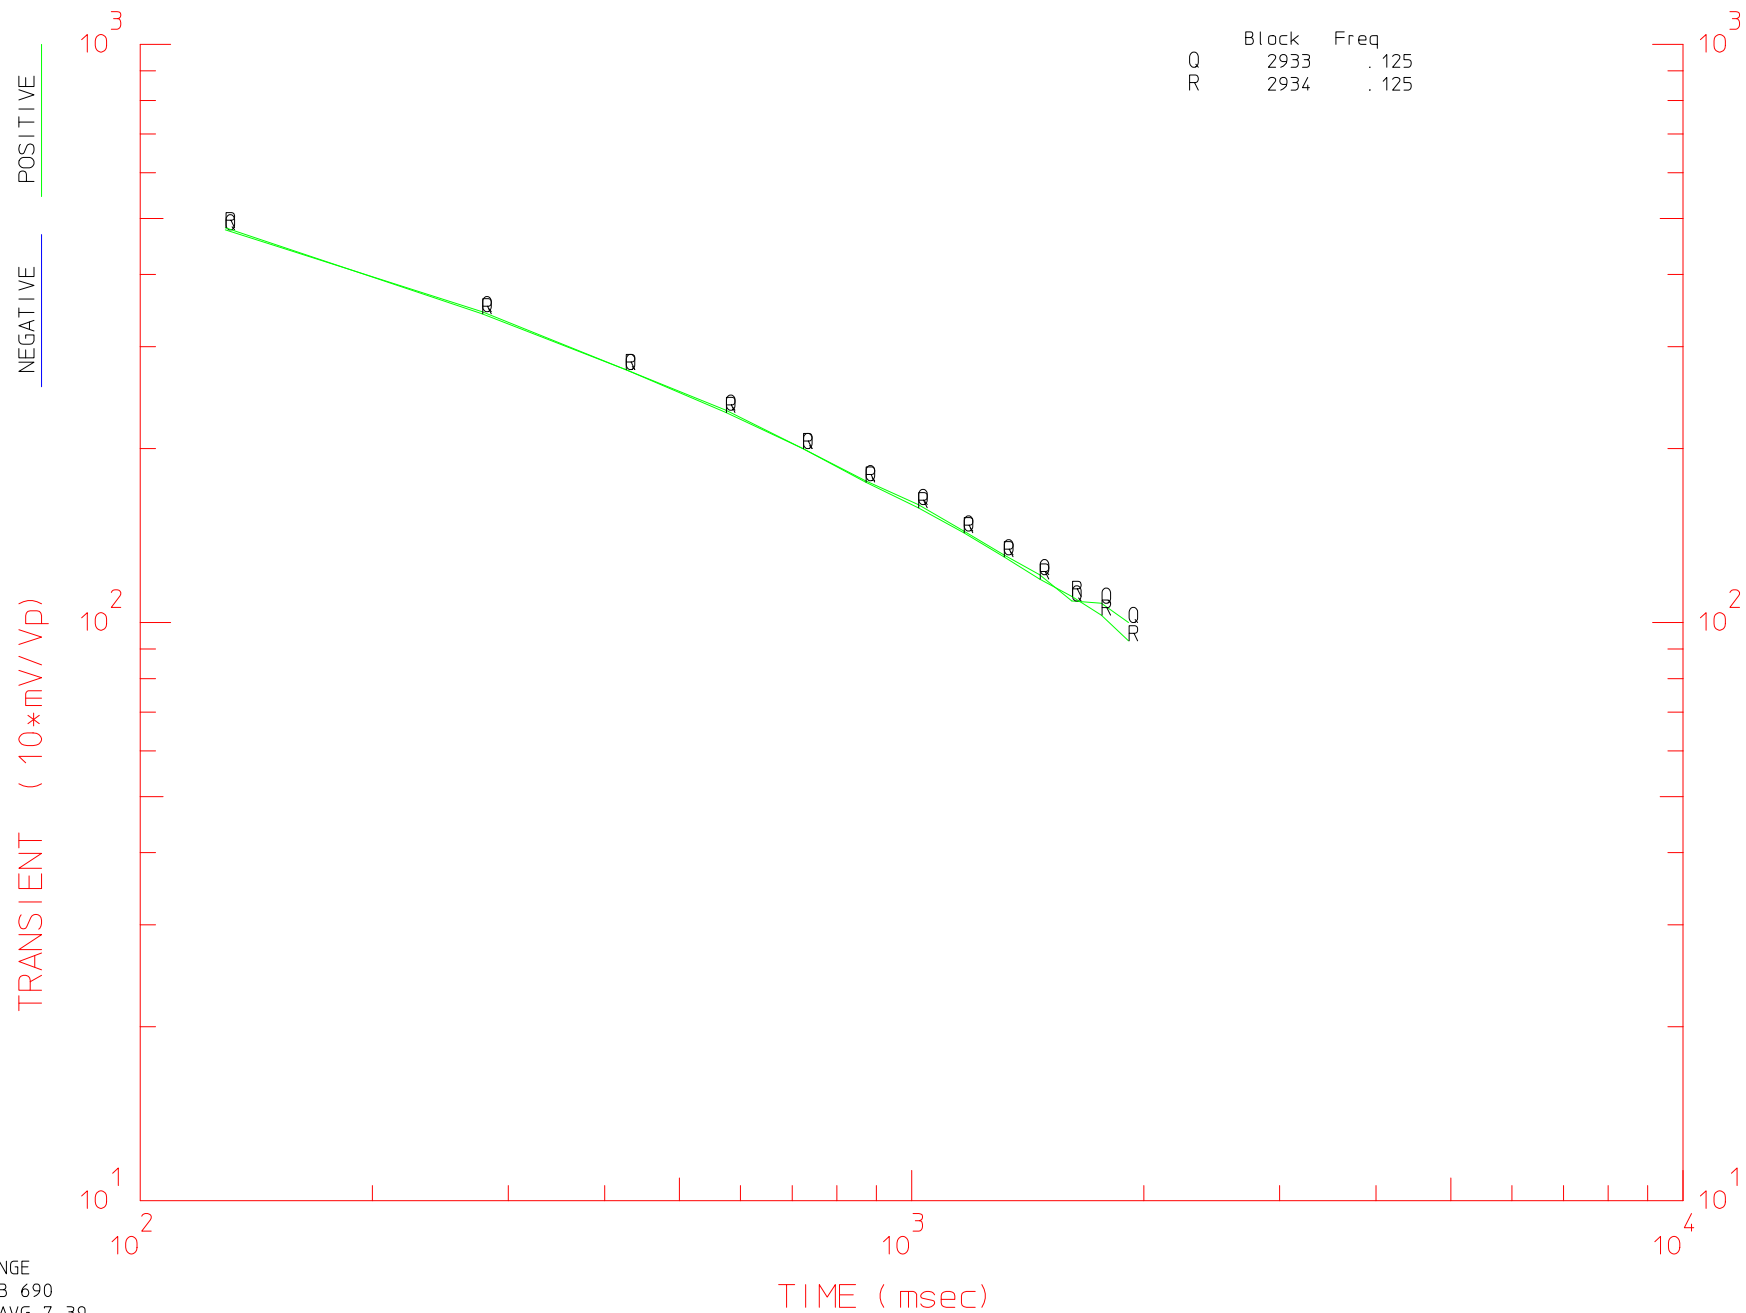

Mable Flats Grid5

Line= 11


TxLen= 7345. Line= 6264. Stn= -3.

	Block	Freq
S	2933	.125
T	2934	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

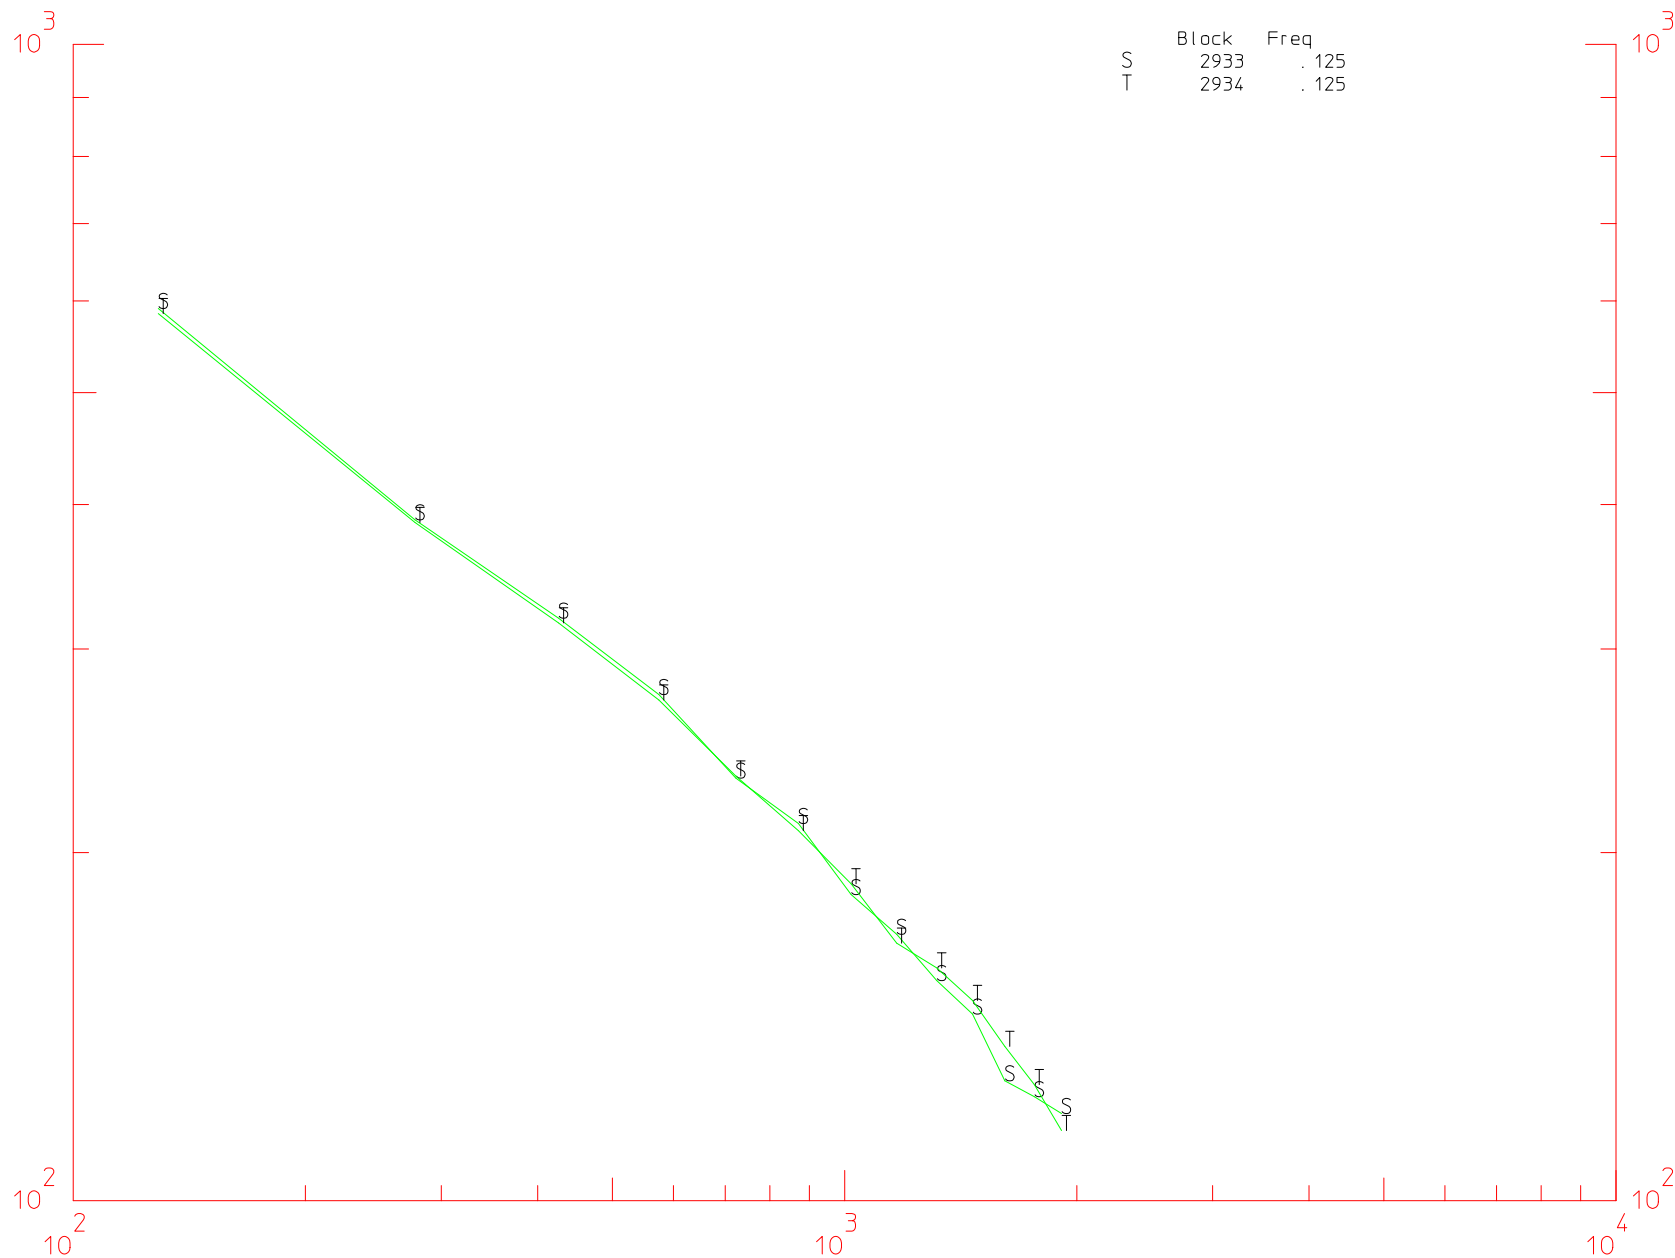

Mable Flats Grid5

Line= 11

TxLen= 7345. Line= 6239. Stn= -4.

	Block	Freq
U	2933	.125
V	2934	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

