


Mable Flats Grid5

Line= 13

TxLen= 7442. Line= 5922. Stn= -1.

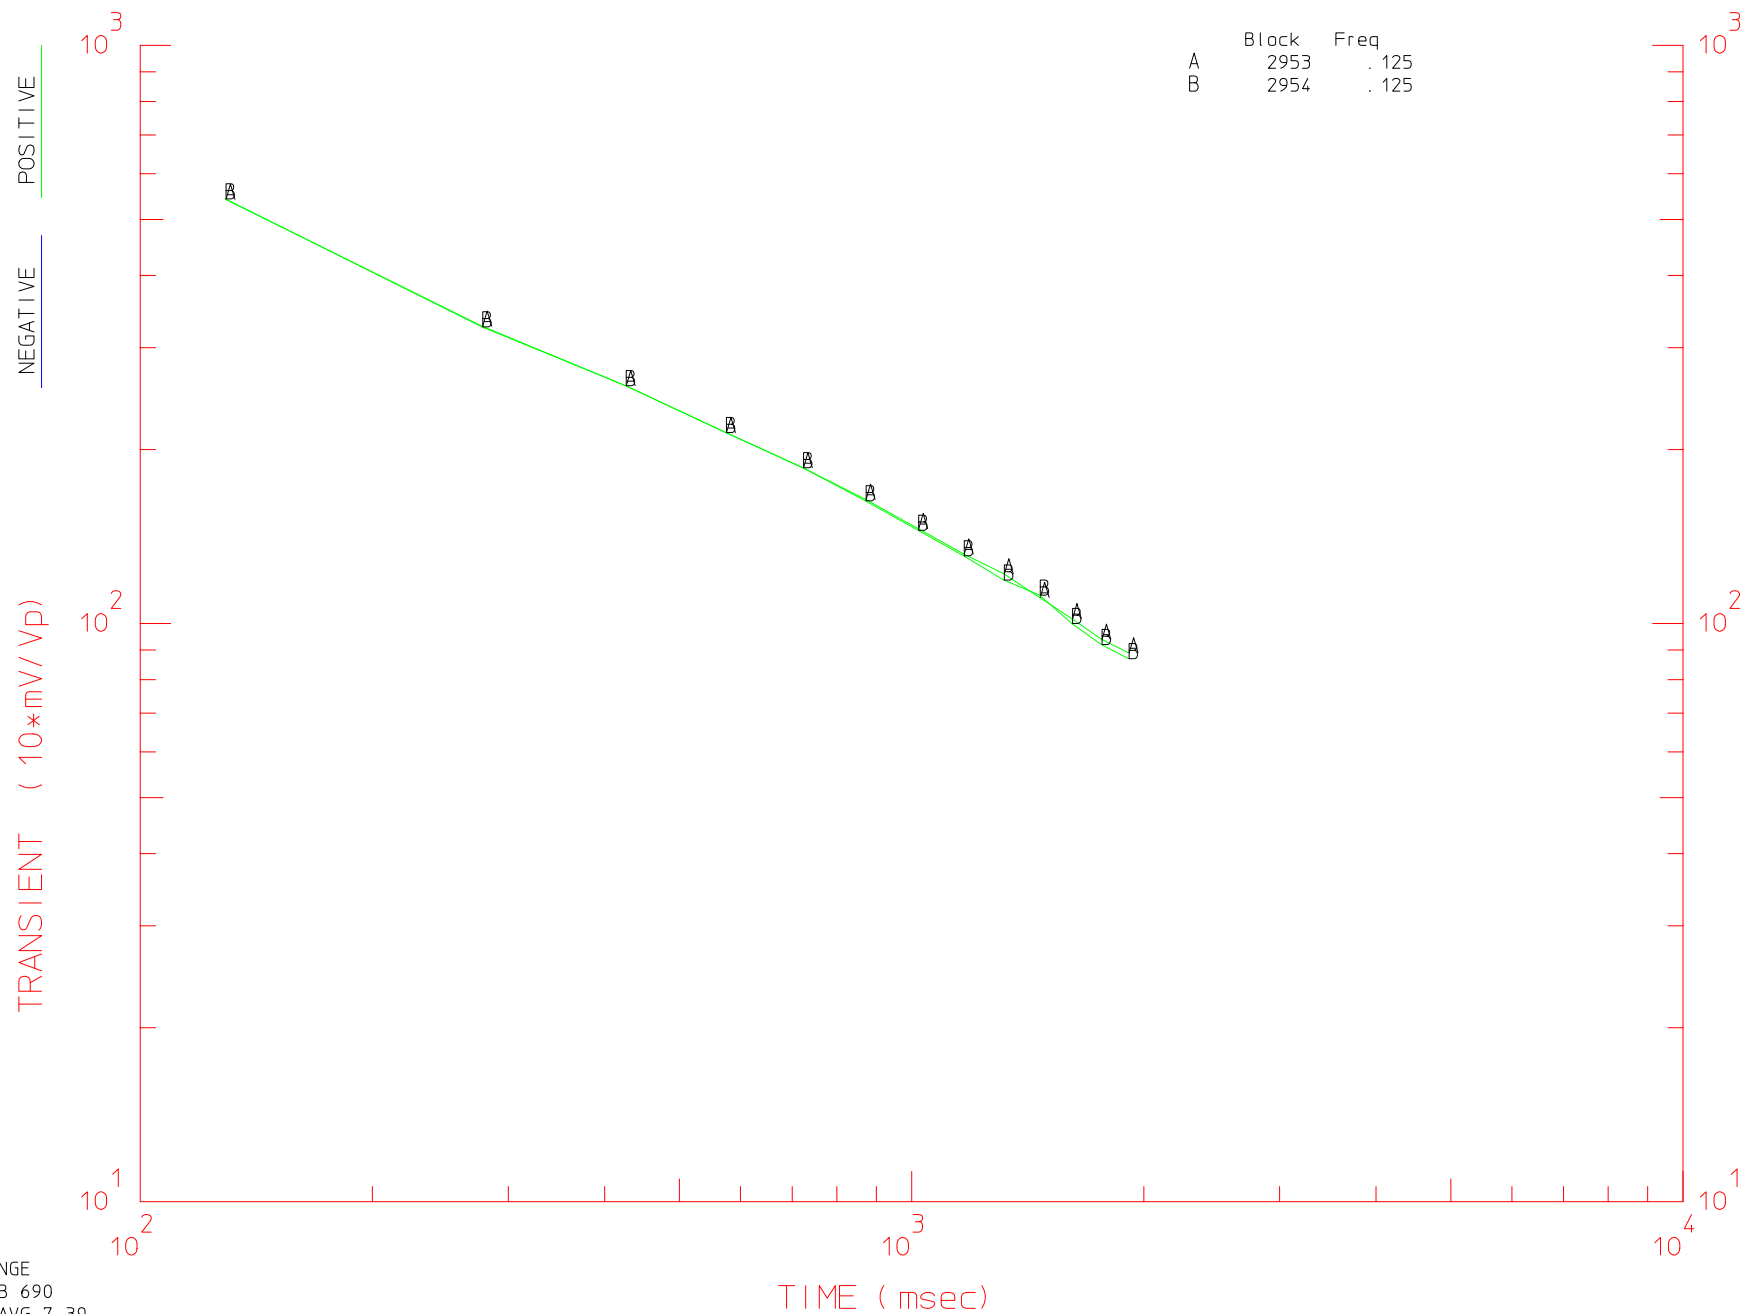

Mable Flats Grid5

Line= 13


TxLen= 7442. Line= 5897. Stn= -2.

	Block	Freq
C	2953	.125
D	2954	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

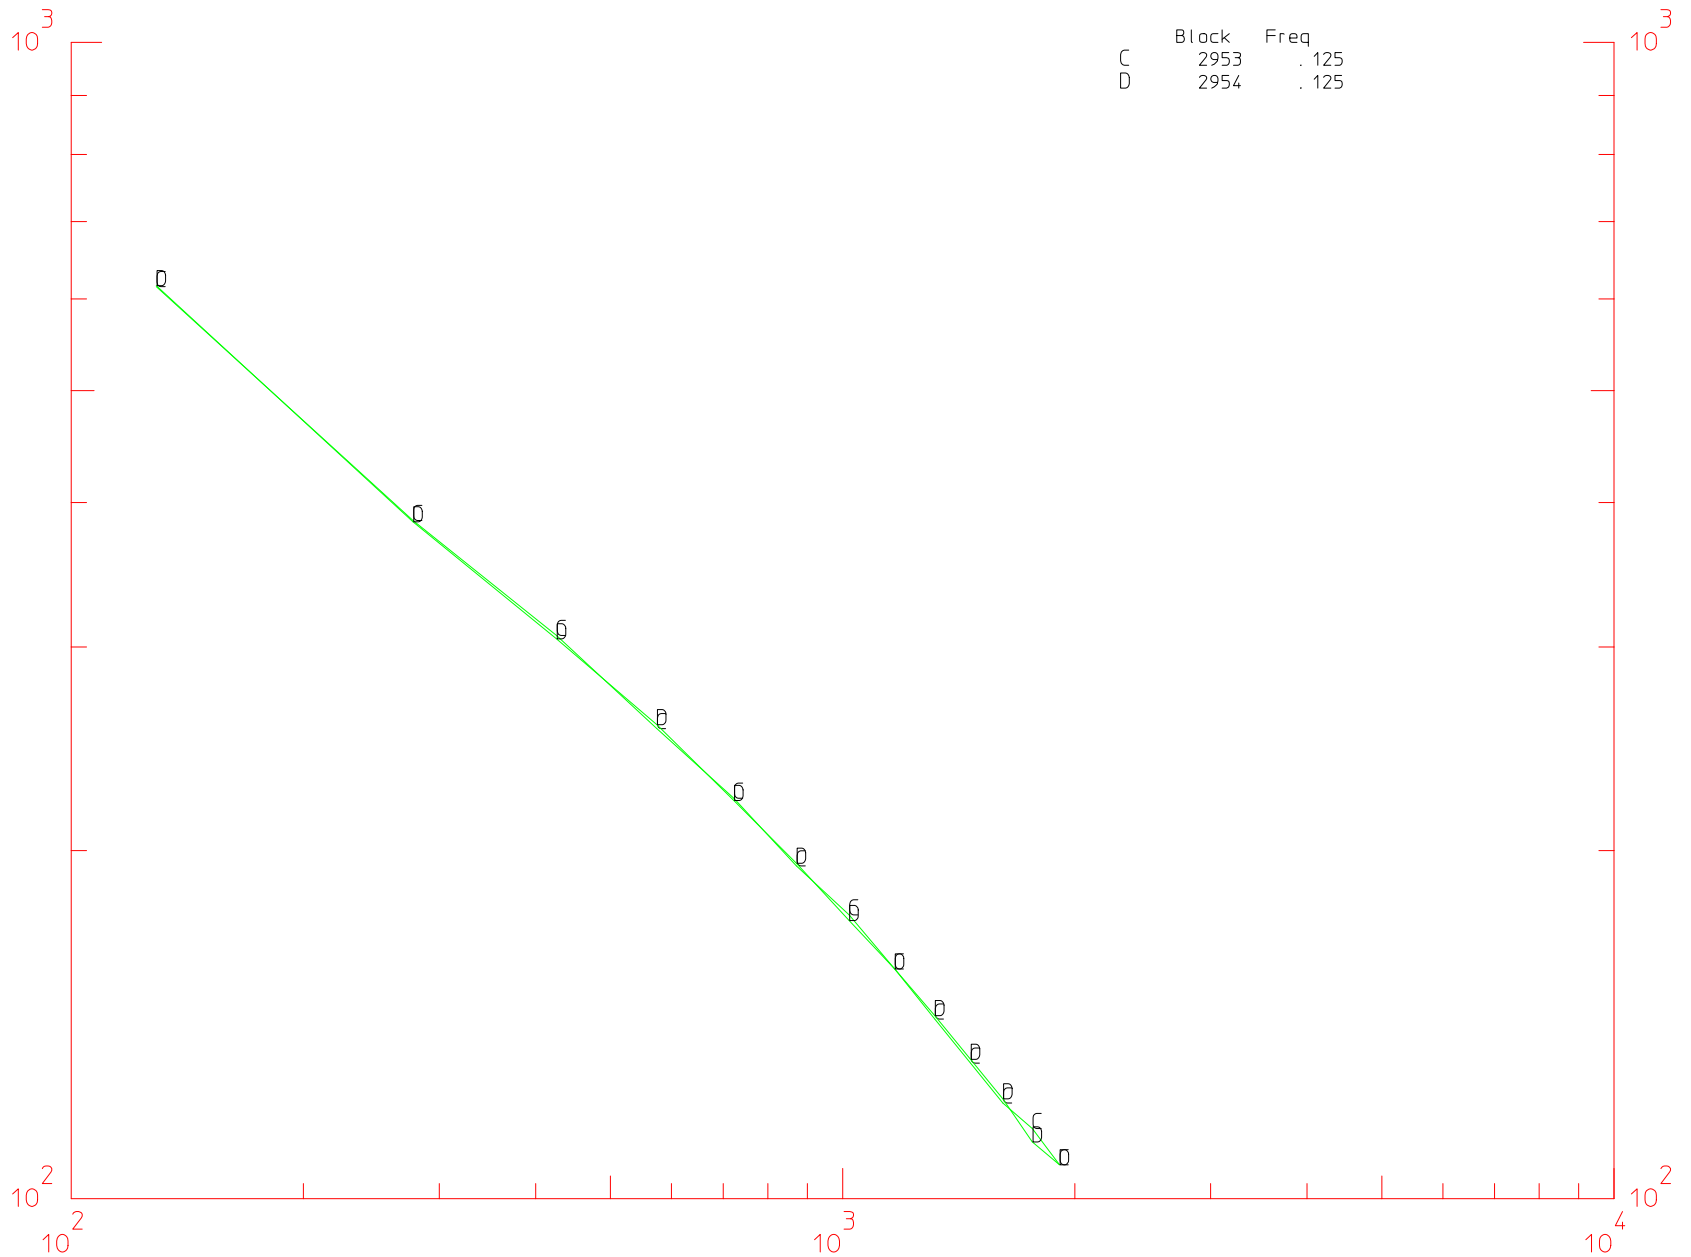

Mable Flats Grid5

Line= 13

TxLen= 7442. Line= 5872. Stn= -3.

	Block	Freq
E	2953	.125
F	2954	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

10³
10²
10¹

TIME (msec)

10³
10⁴


10³
10²
10¹

Mable Flats Grid5

Line= 13

TxLen= 7442. Line= 5847. Stn= -4.

	Block	Freq
G	2953	.125
H	2954	.125

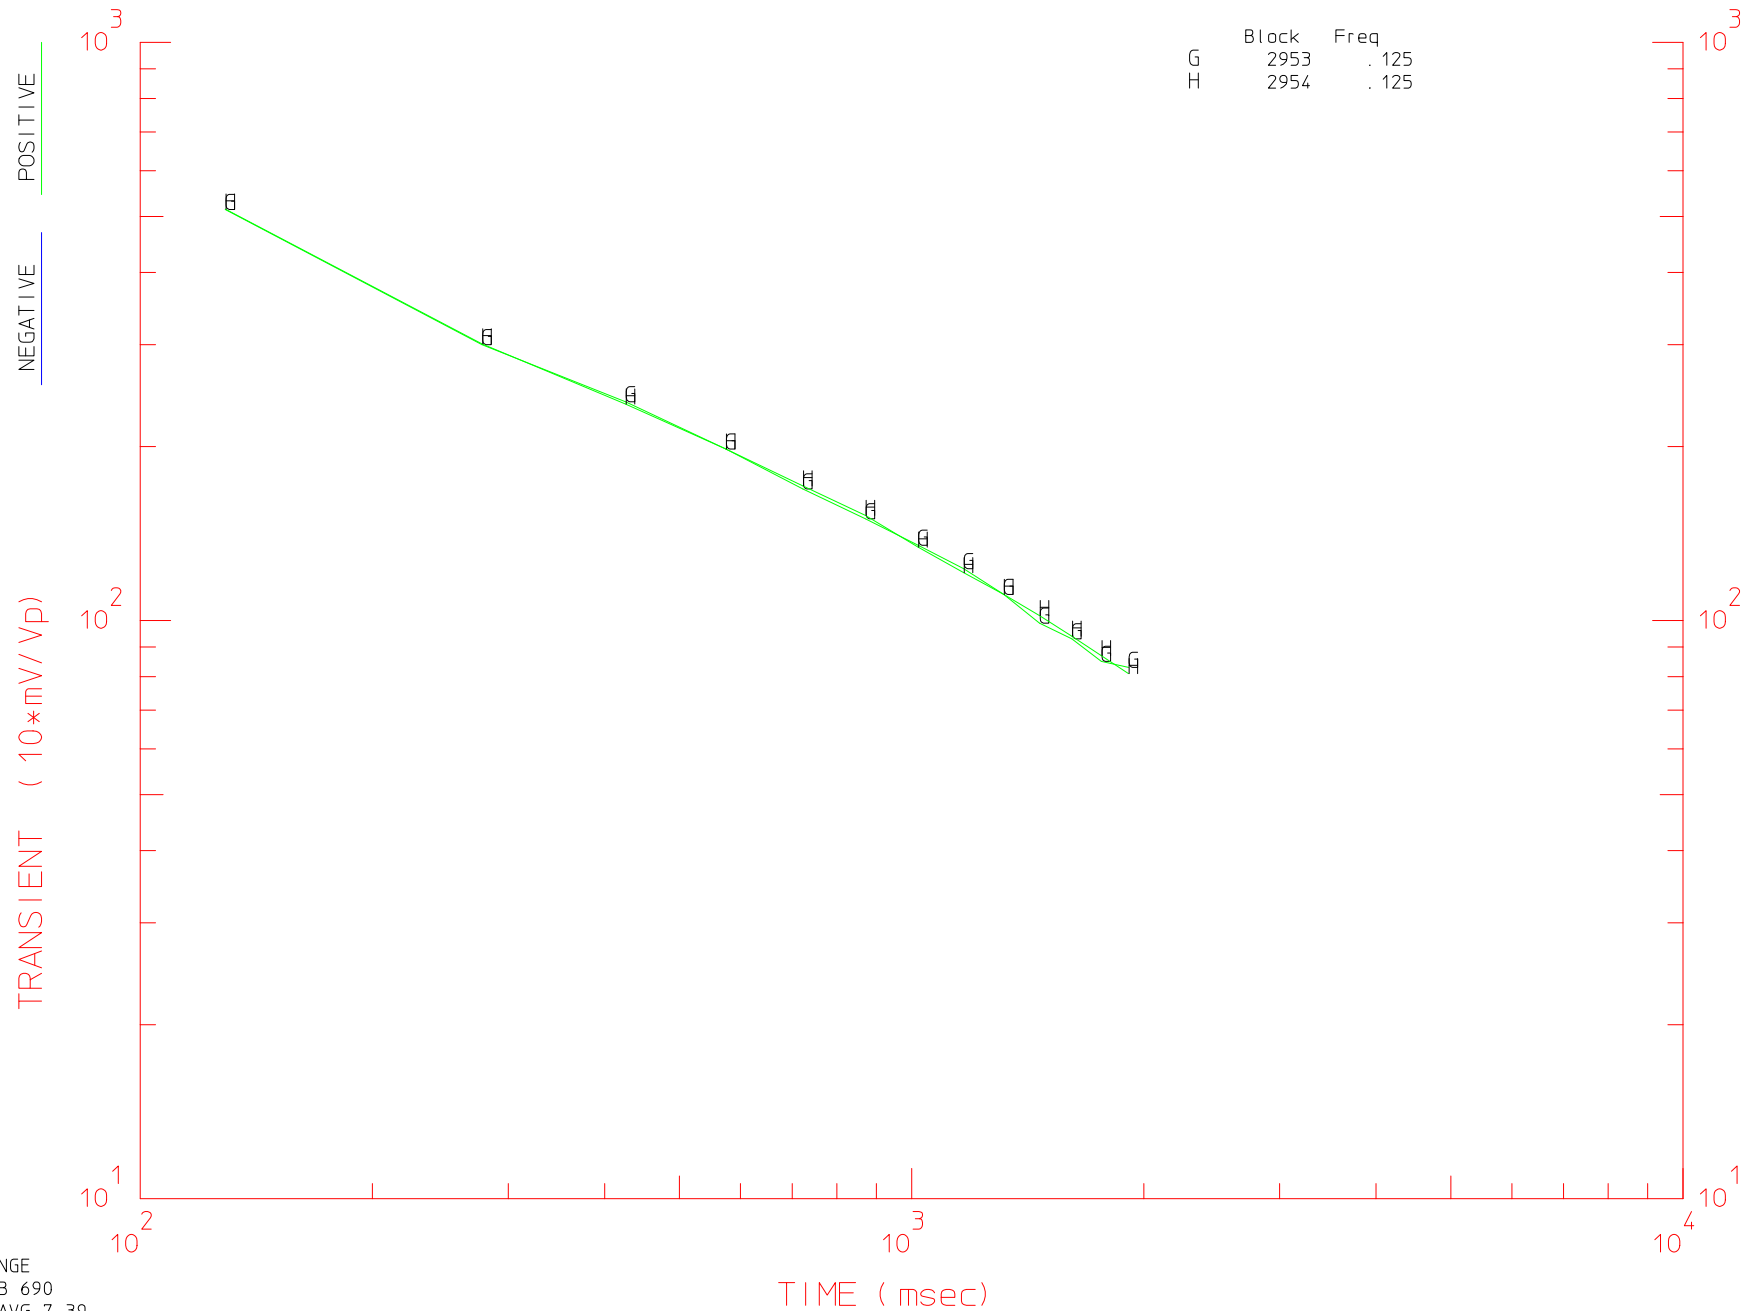

Mable Flats Grid5


Line= 13

TxLen= 7442. Line= 6022. Stn= -1.

	Block	Freq
I	2955	.125
J	2956	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

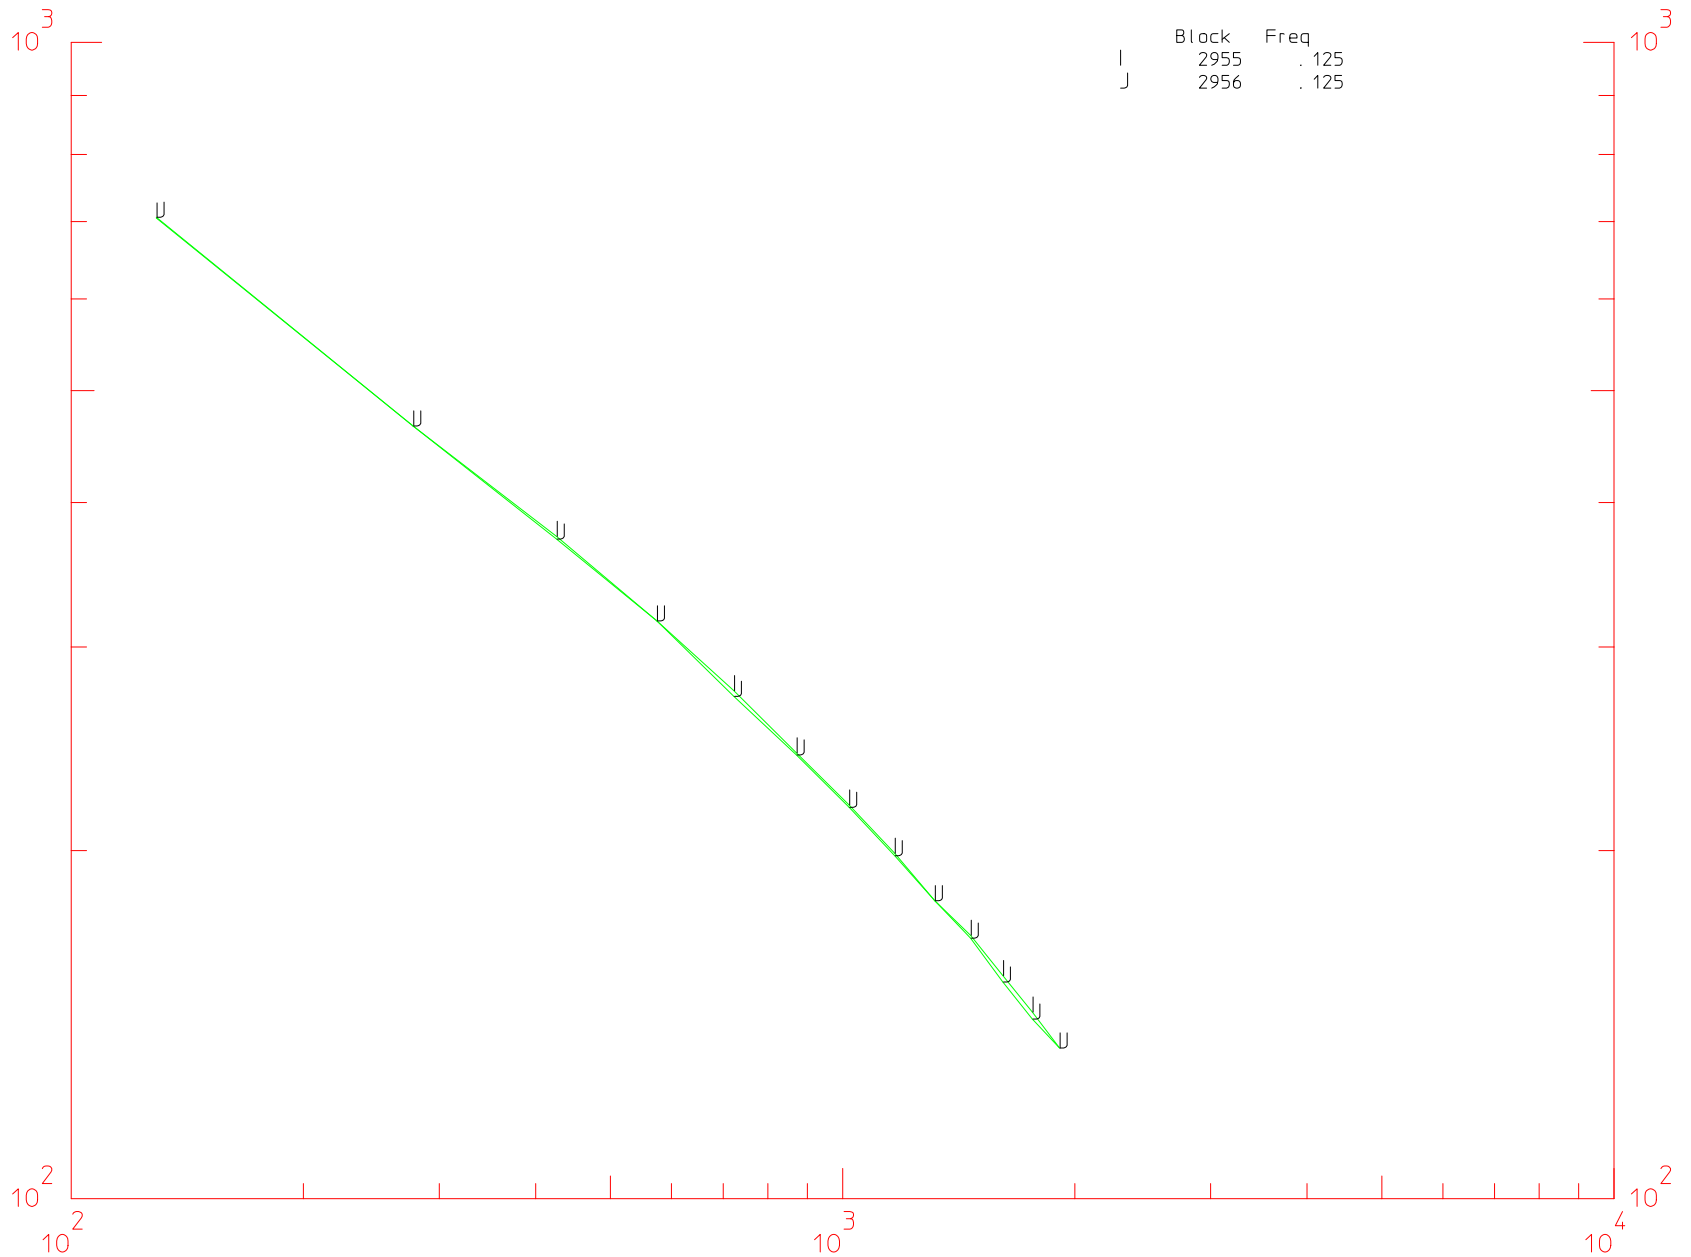


Mable Flats Grid5

Line= 13

TxLen= 7442. Line= 5997. Stn= -2.

	Block	Freq
K	2955	.125
L	2956	.125

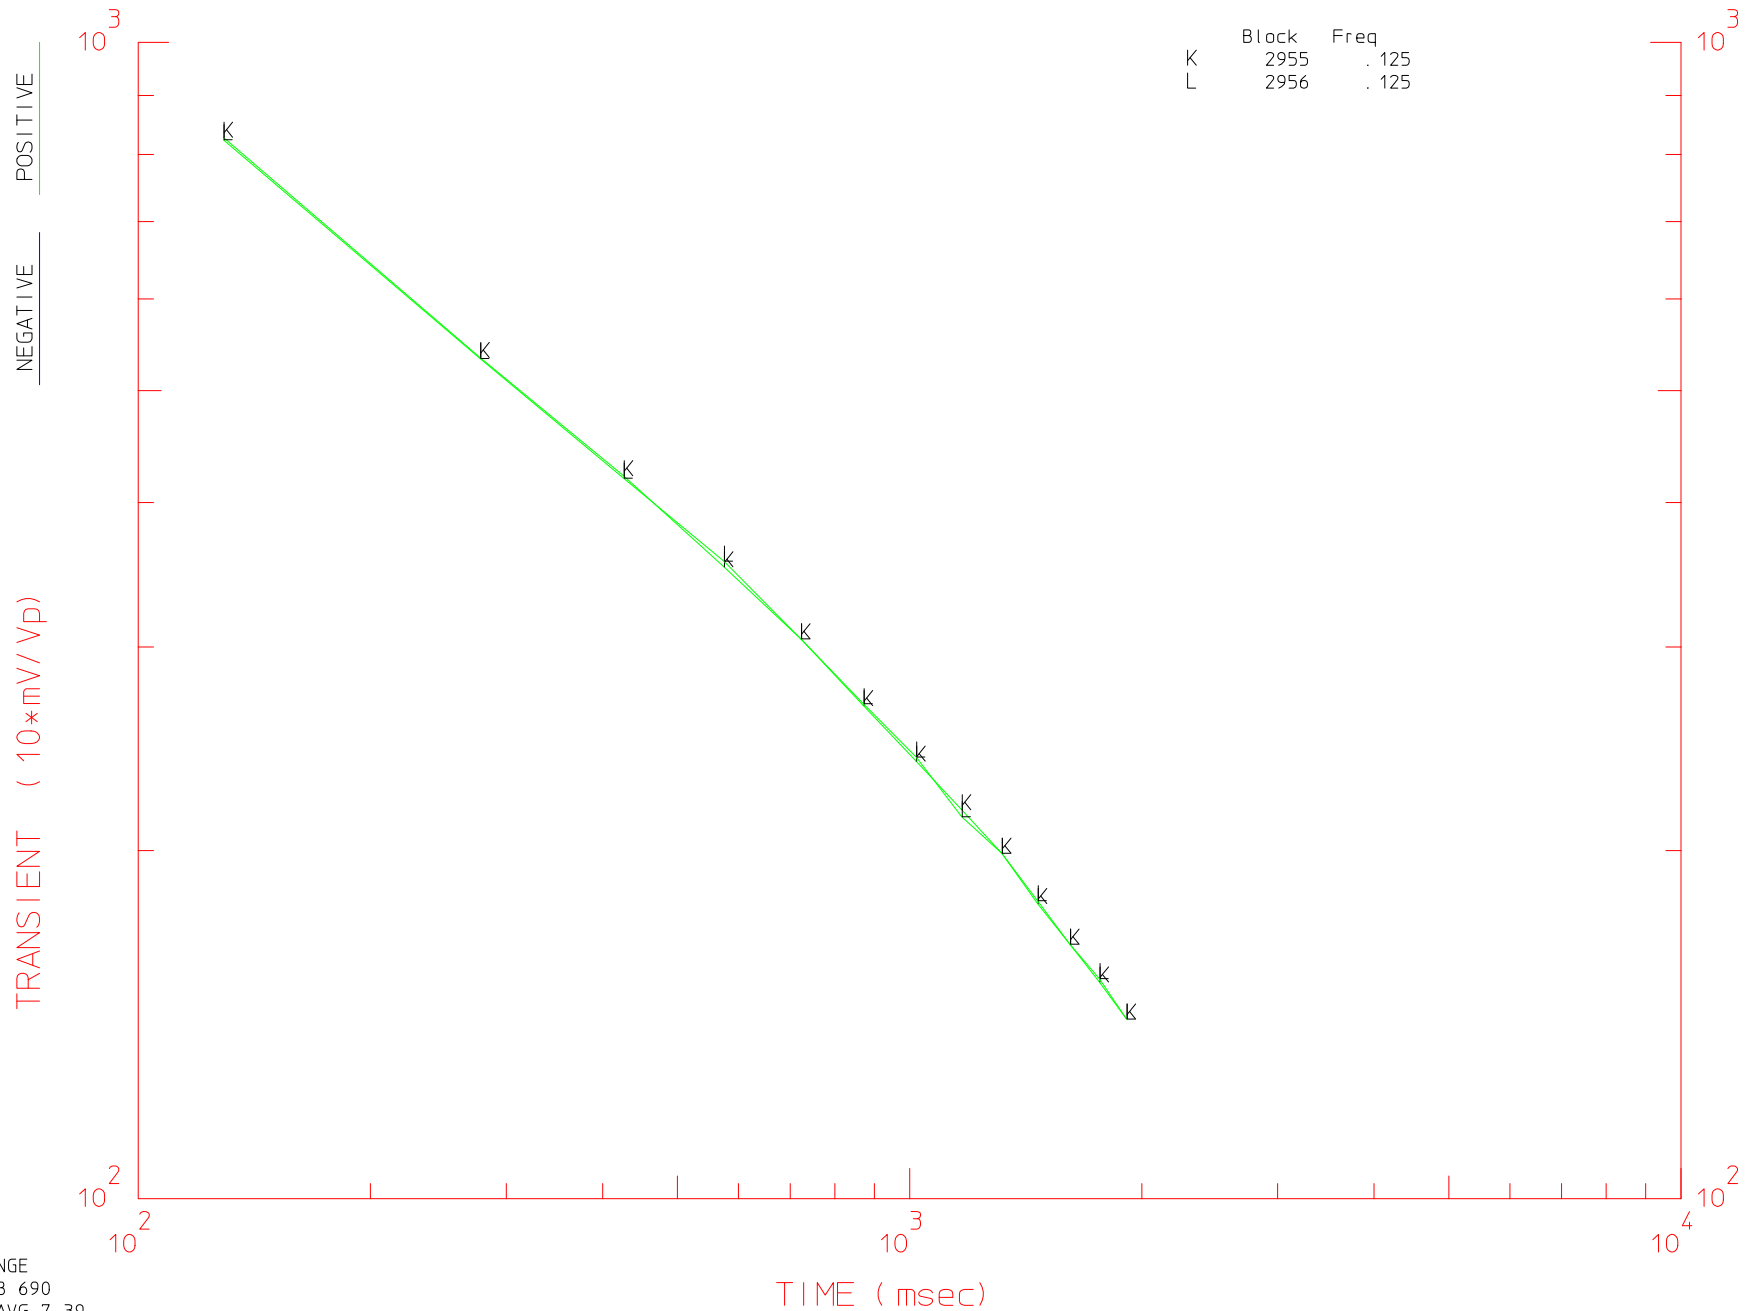

Mable Flats Grid5

Line= 13


TxLen= 7442. Line= 5972. Stn= -3.

	Block	Freq
M	2955	.125
N	2956	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

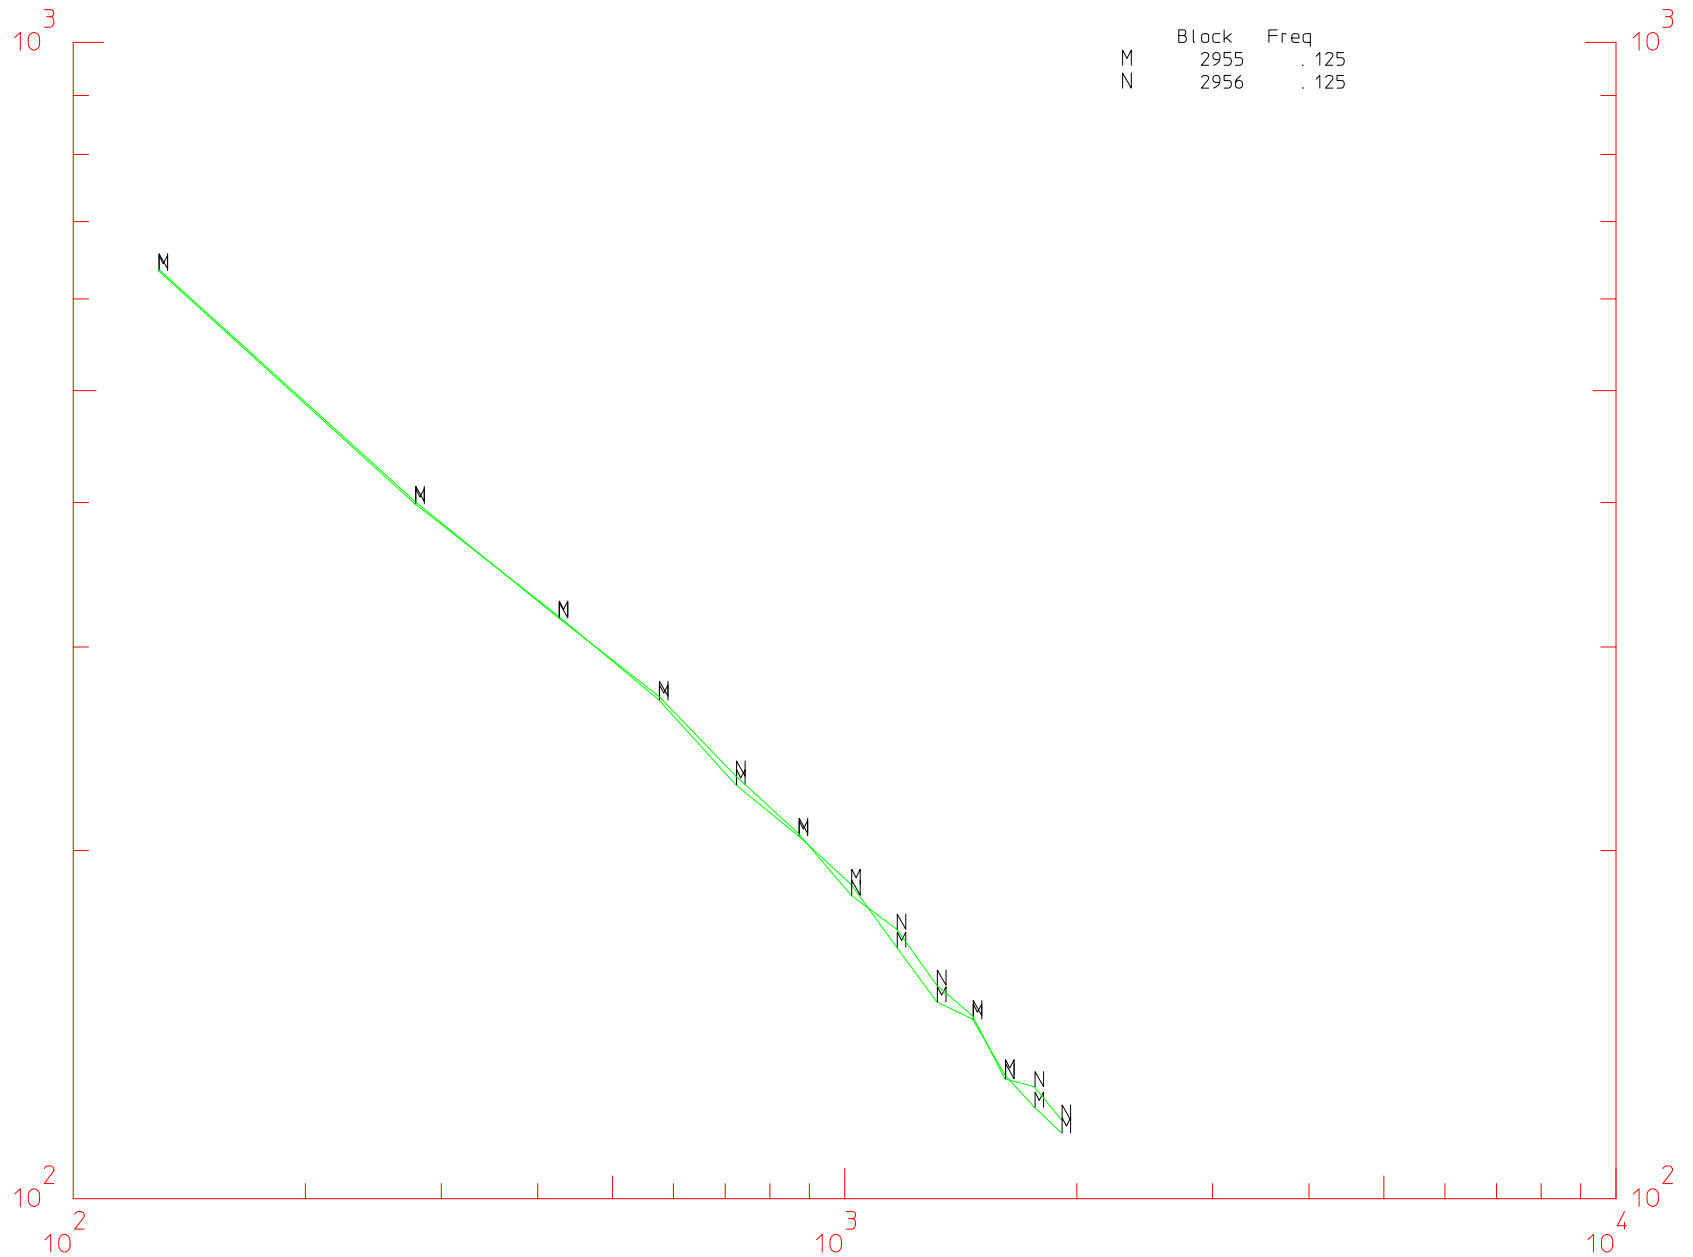


Mable Flats Grid5

Line= 13

TxLen= 7442. Line= 5947. Stn= -4.

	Block	Freq
0	2955	.125
P	2956	.125

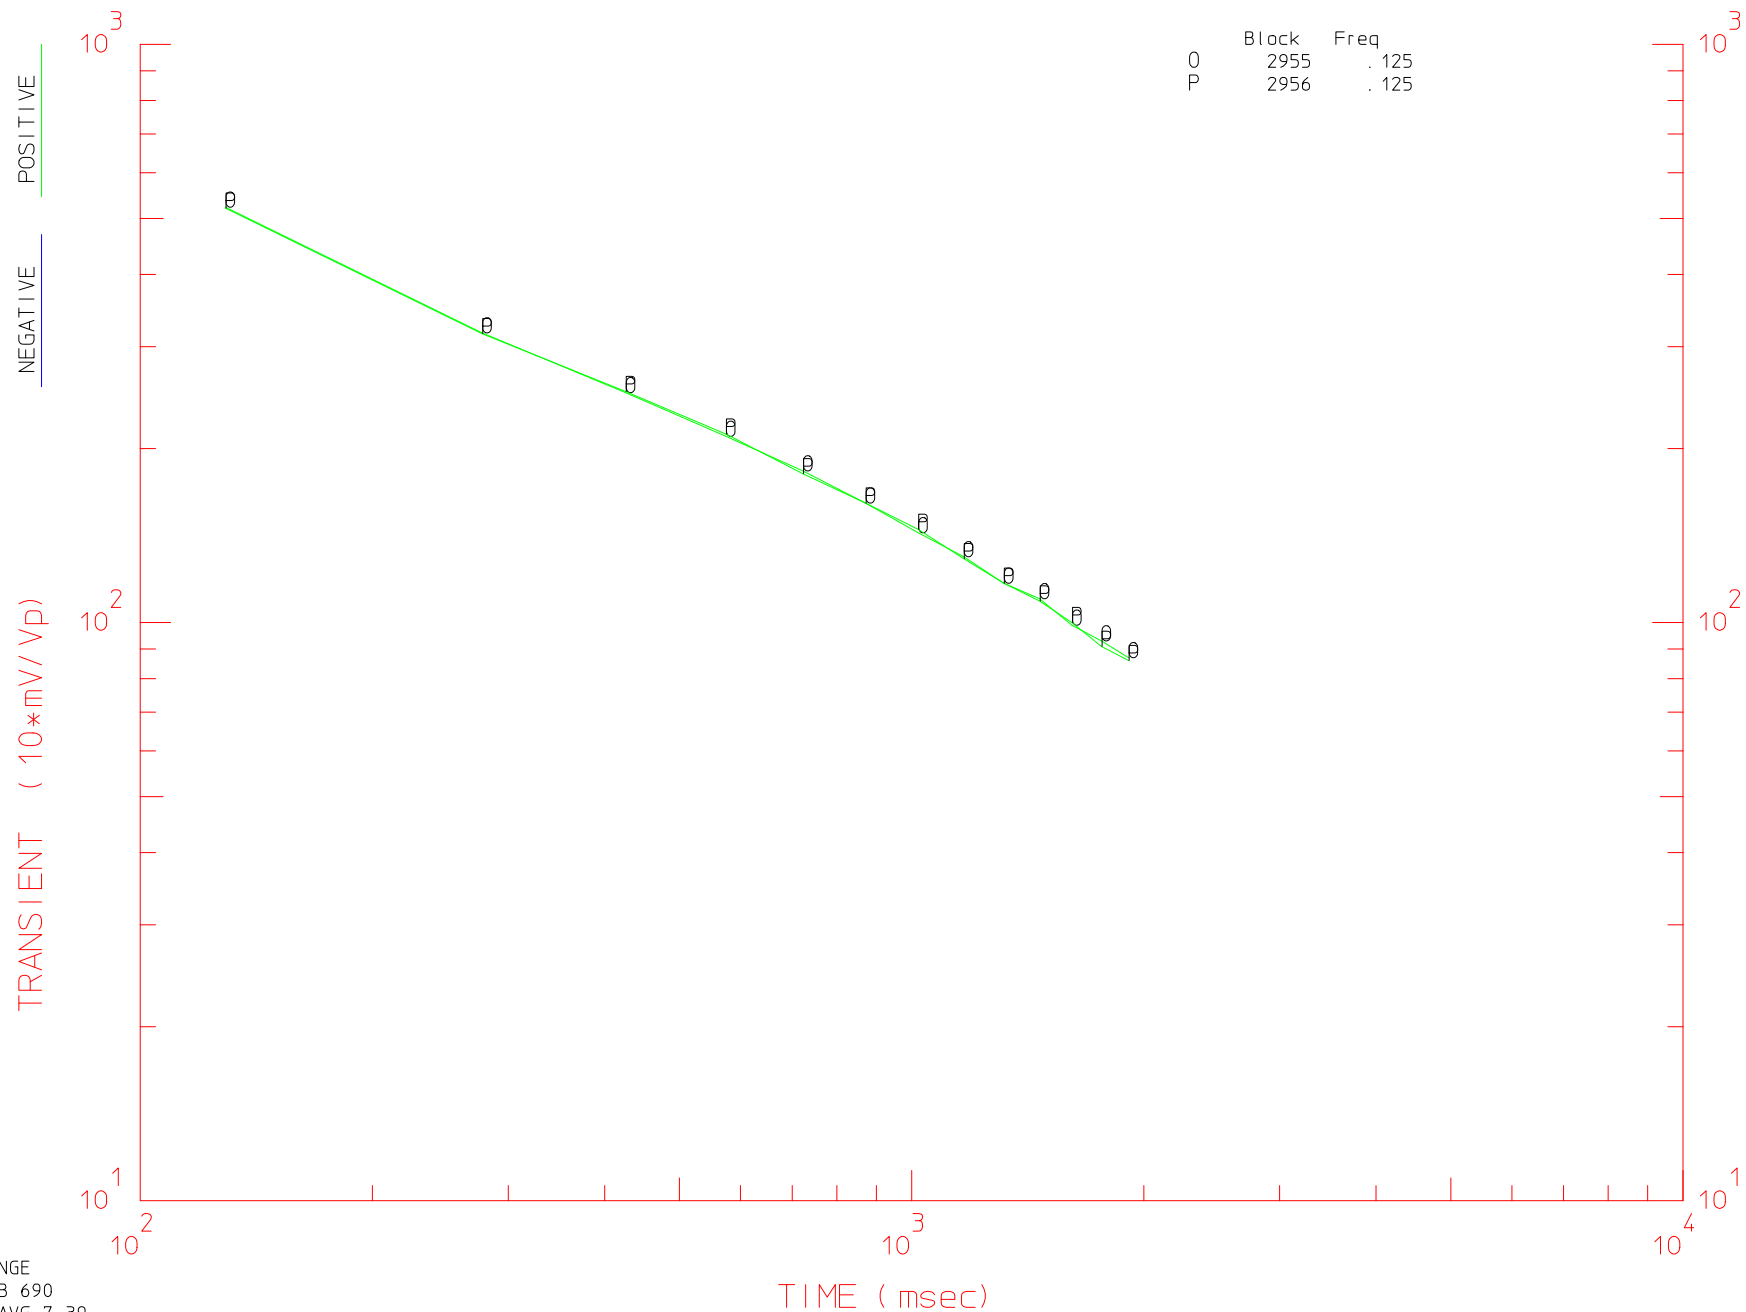


Mable Flats Grid5

Line= 13

TxLen= 7442. Line= 6122. Stn= -1.

	Block	Freq
Q	2957	.125
R	2958	.125

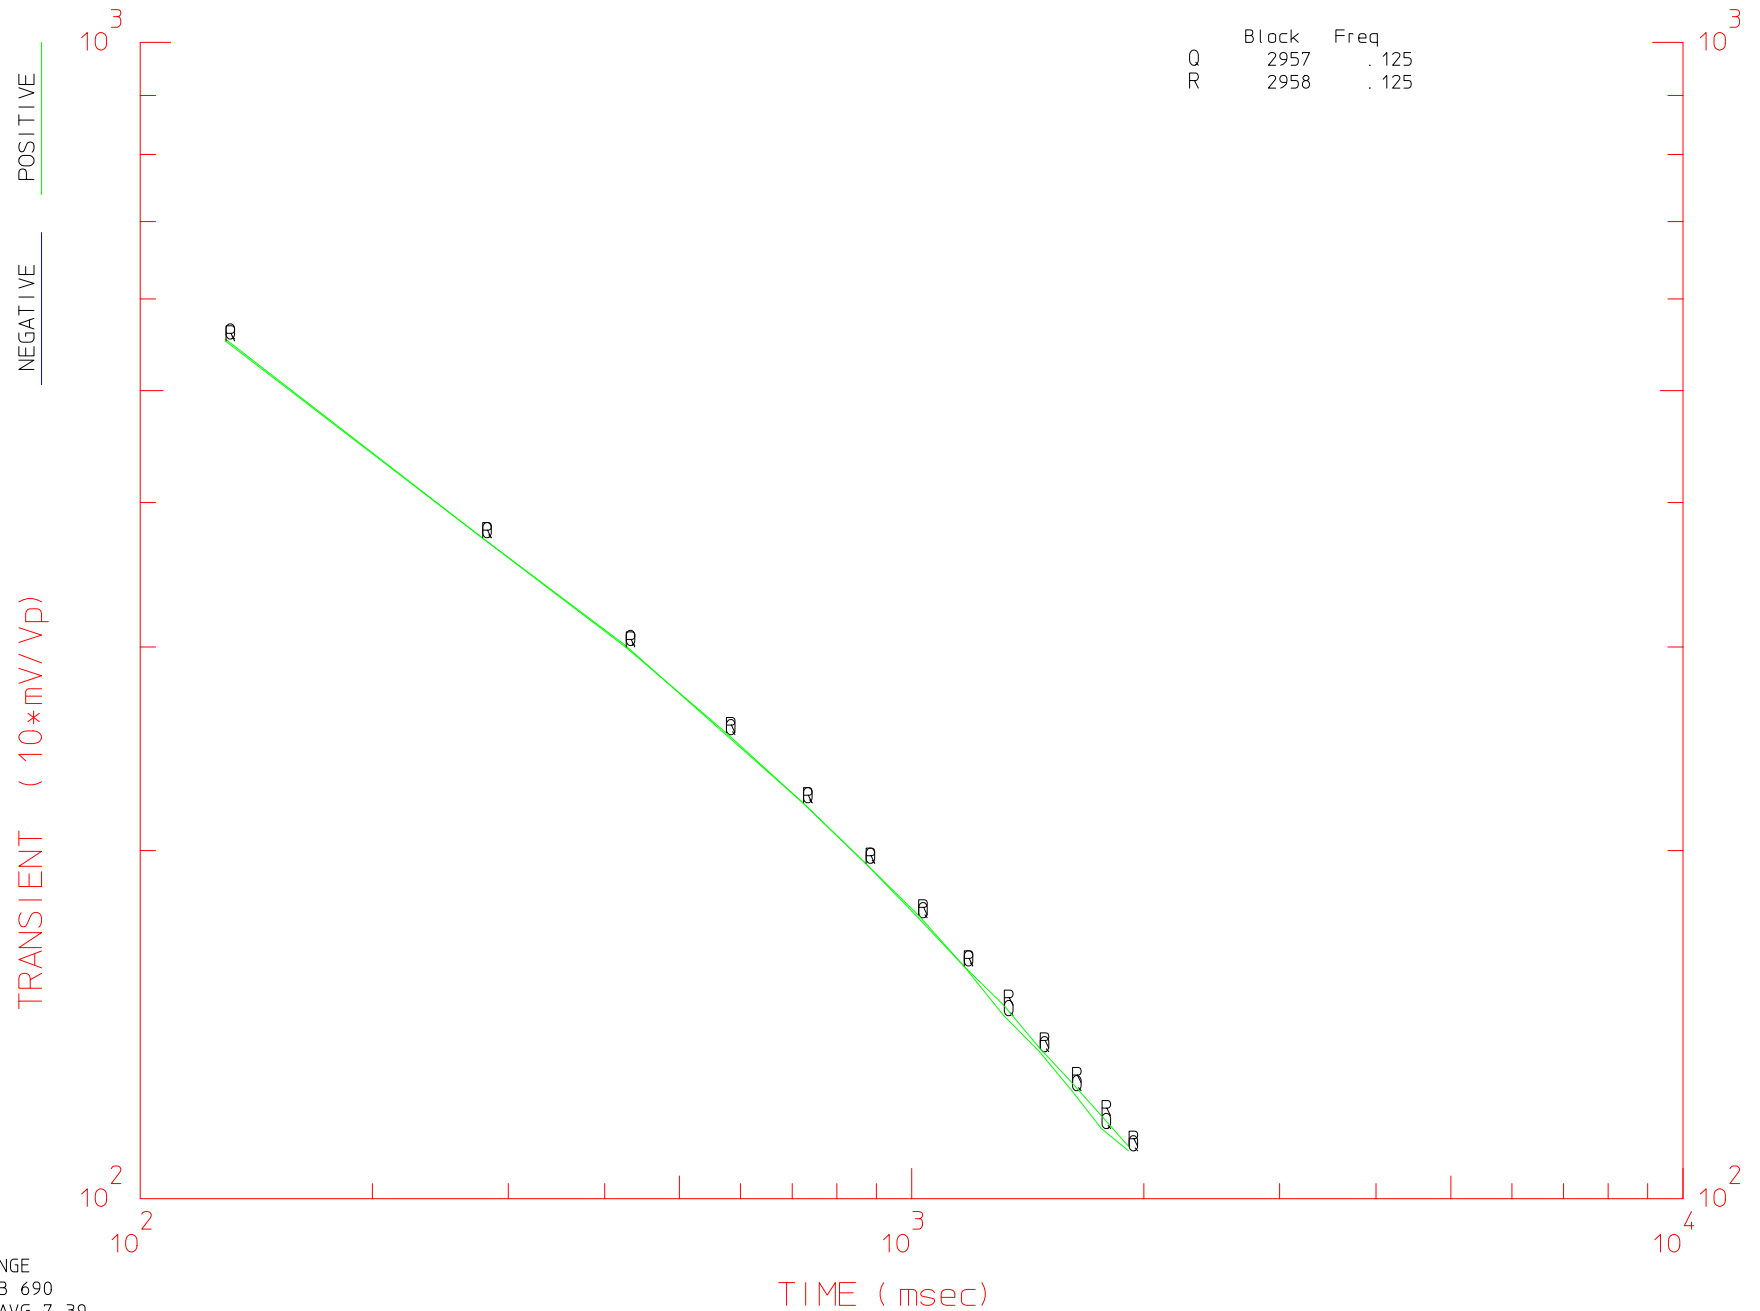

Mable Flats Grid5

Line= 13


TxLen= 7442. Line= 6097. Stn= -2.

	Block	Freq
S	2957	.125
T	2958	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

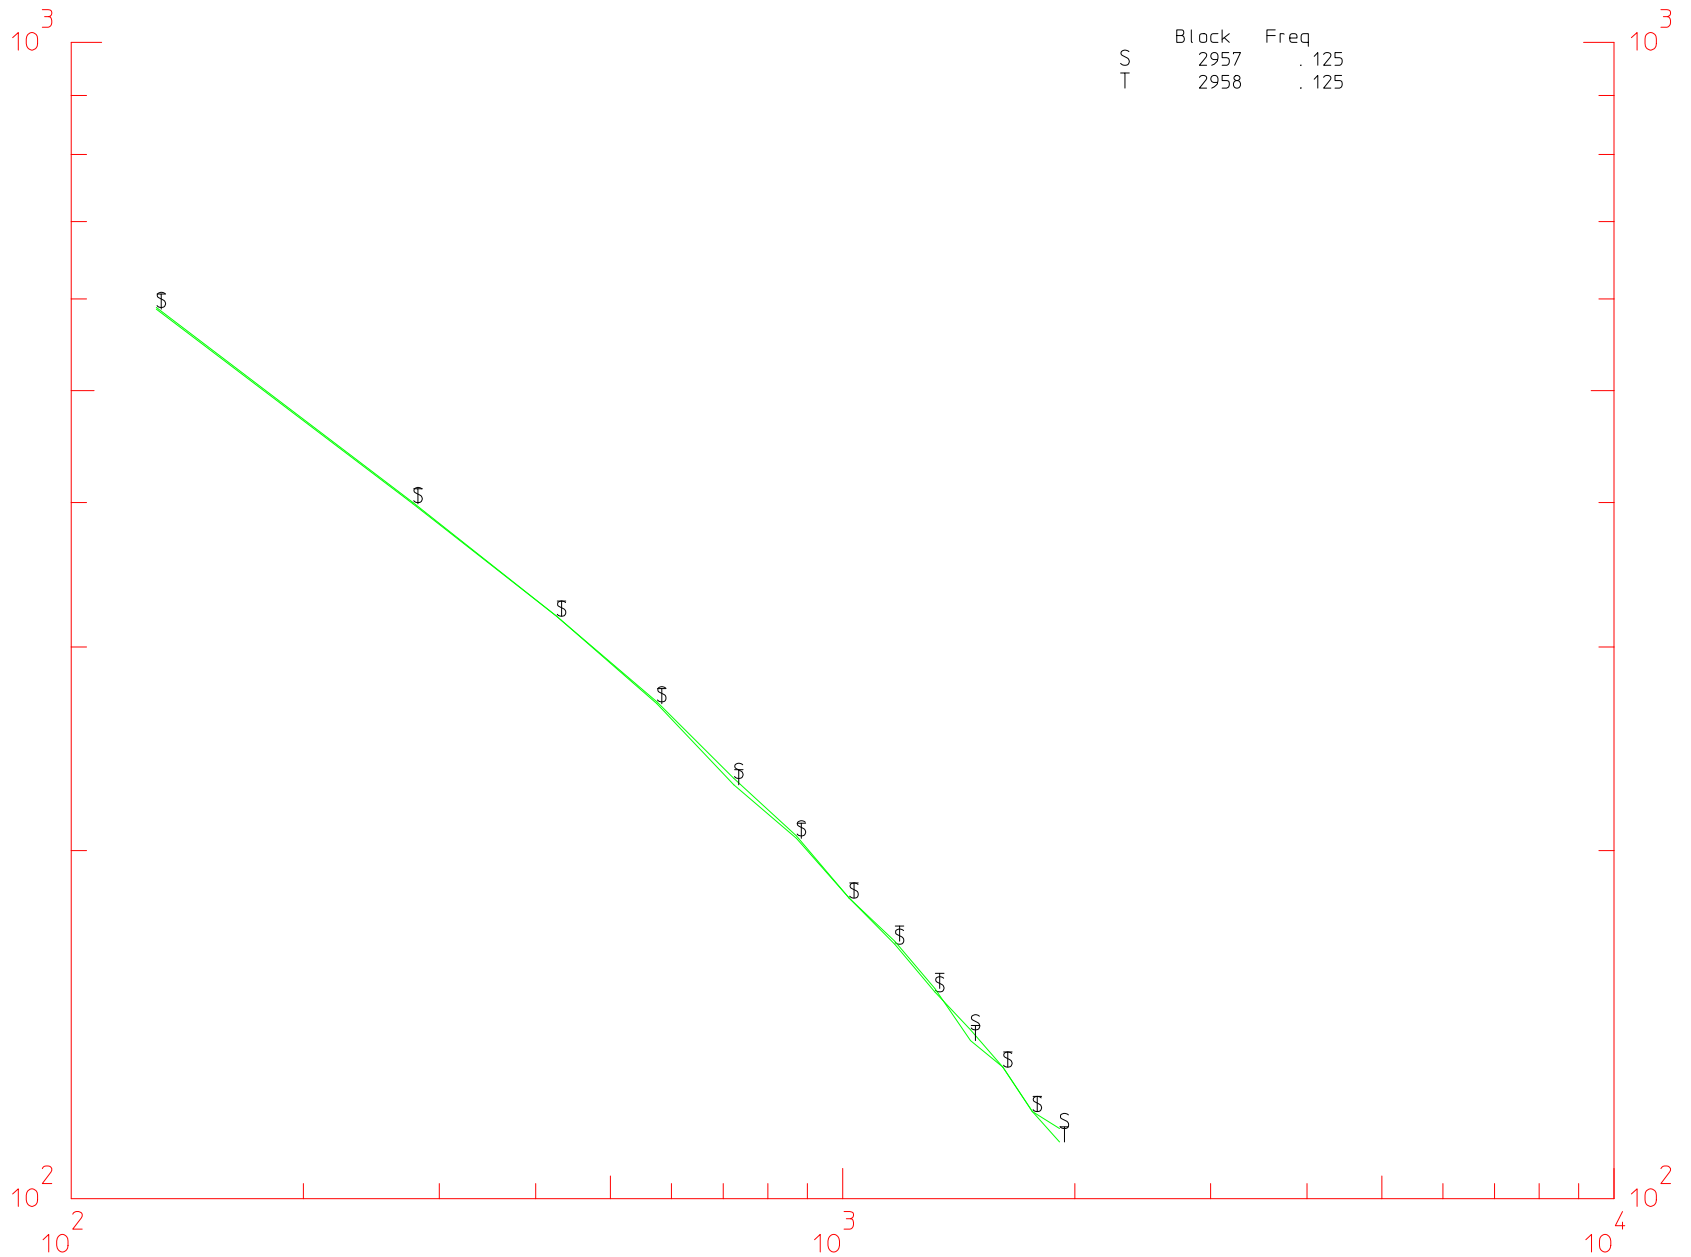

Mable Flats Grid5

Line= 13

TxLen= 7442.

Line= 6072.

Stn= -3.

	Block	Freq
U	2957	.125
V	2958	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

10²

10³

TIME (msec)

10²

10³

10⁴

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

10²

10³

10⁴

Mable Flats Grid5

Line= 13


TxLen= 7442. Line= 6047. Stn= -4.

	Block	Freq
W	2957	.125
X	2958	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

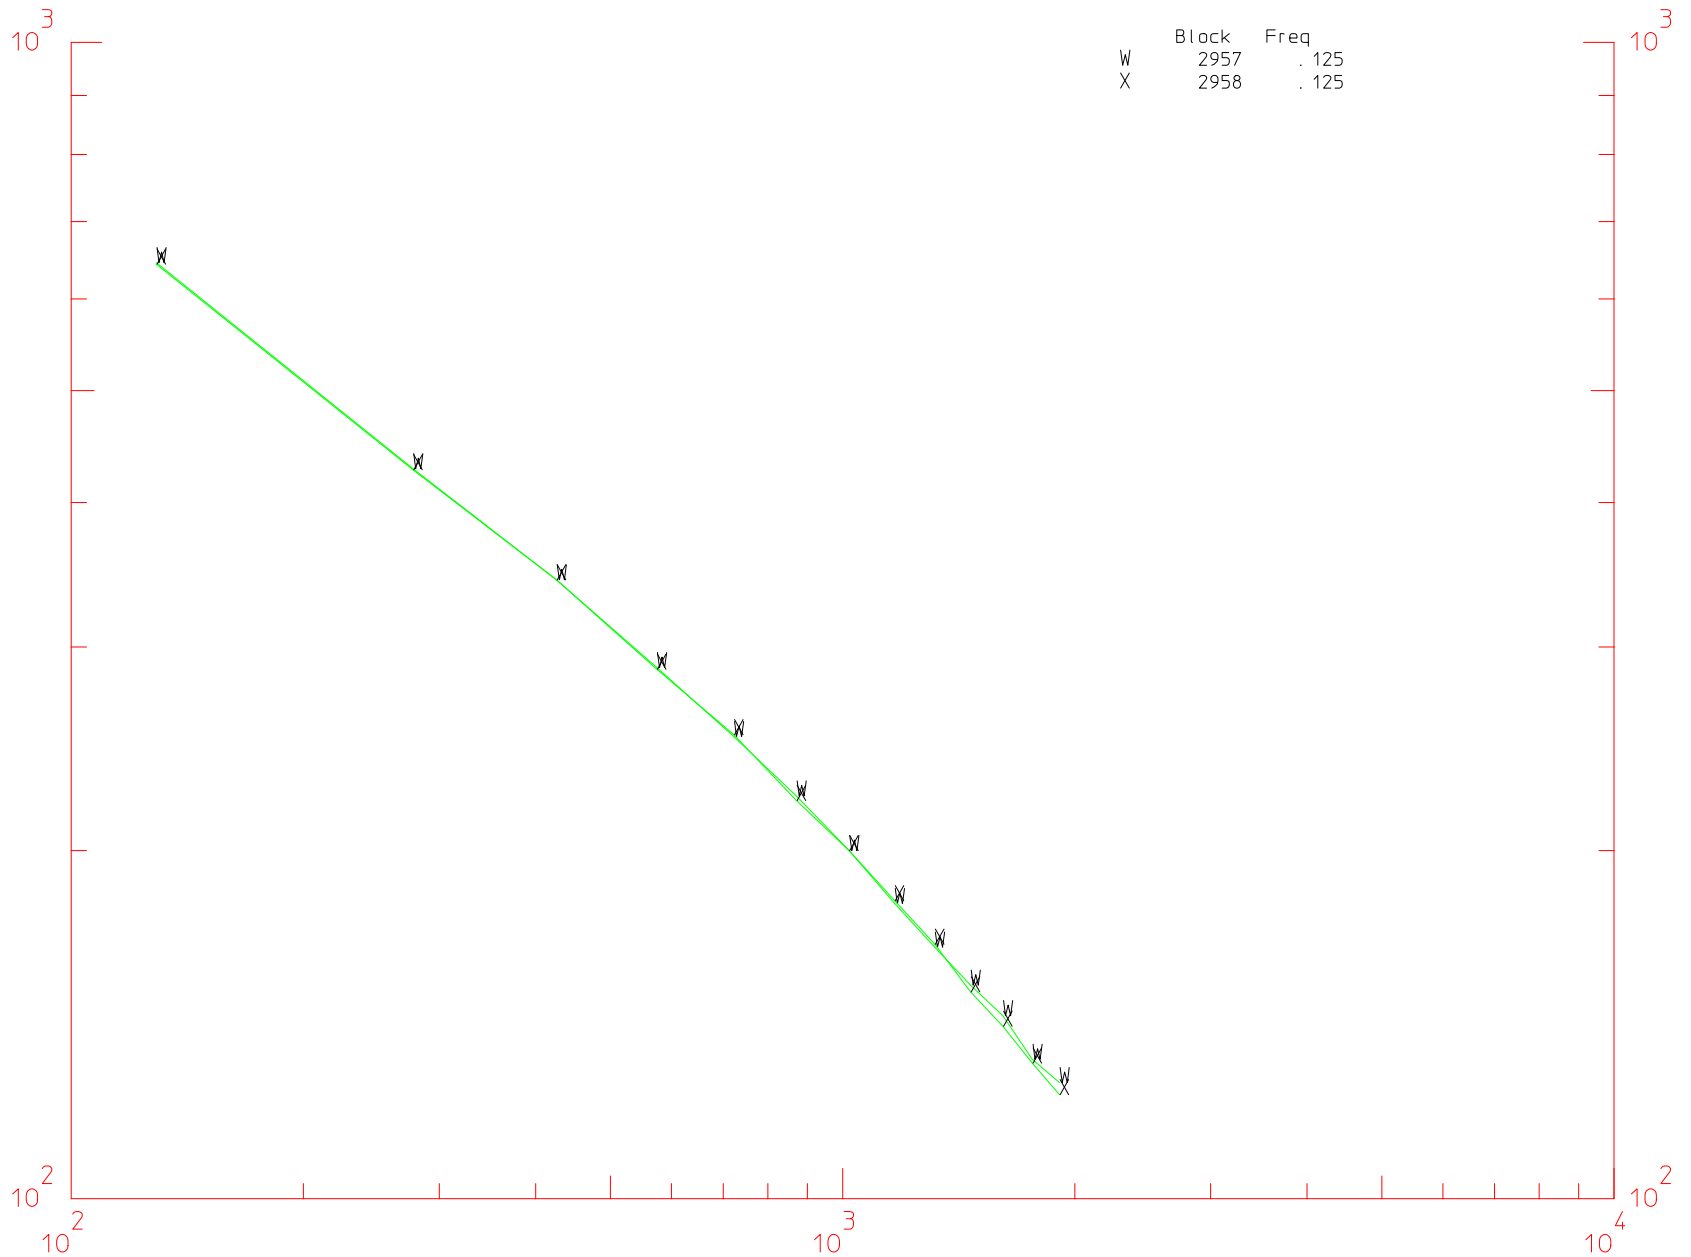

Mable Flats Grid5


Line= 13

TxLen= 7442. Line= 6222. Stn= -1.

	Block	Freq
Y	2959	.125
Z	2960	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

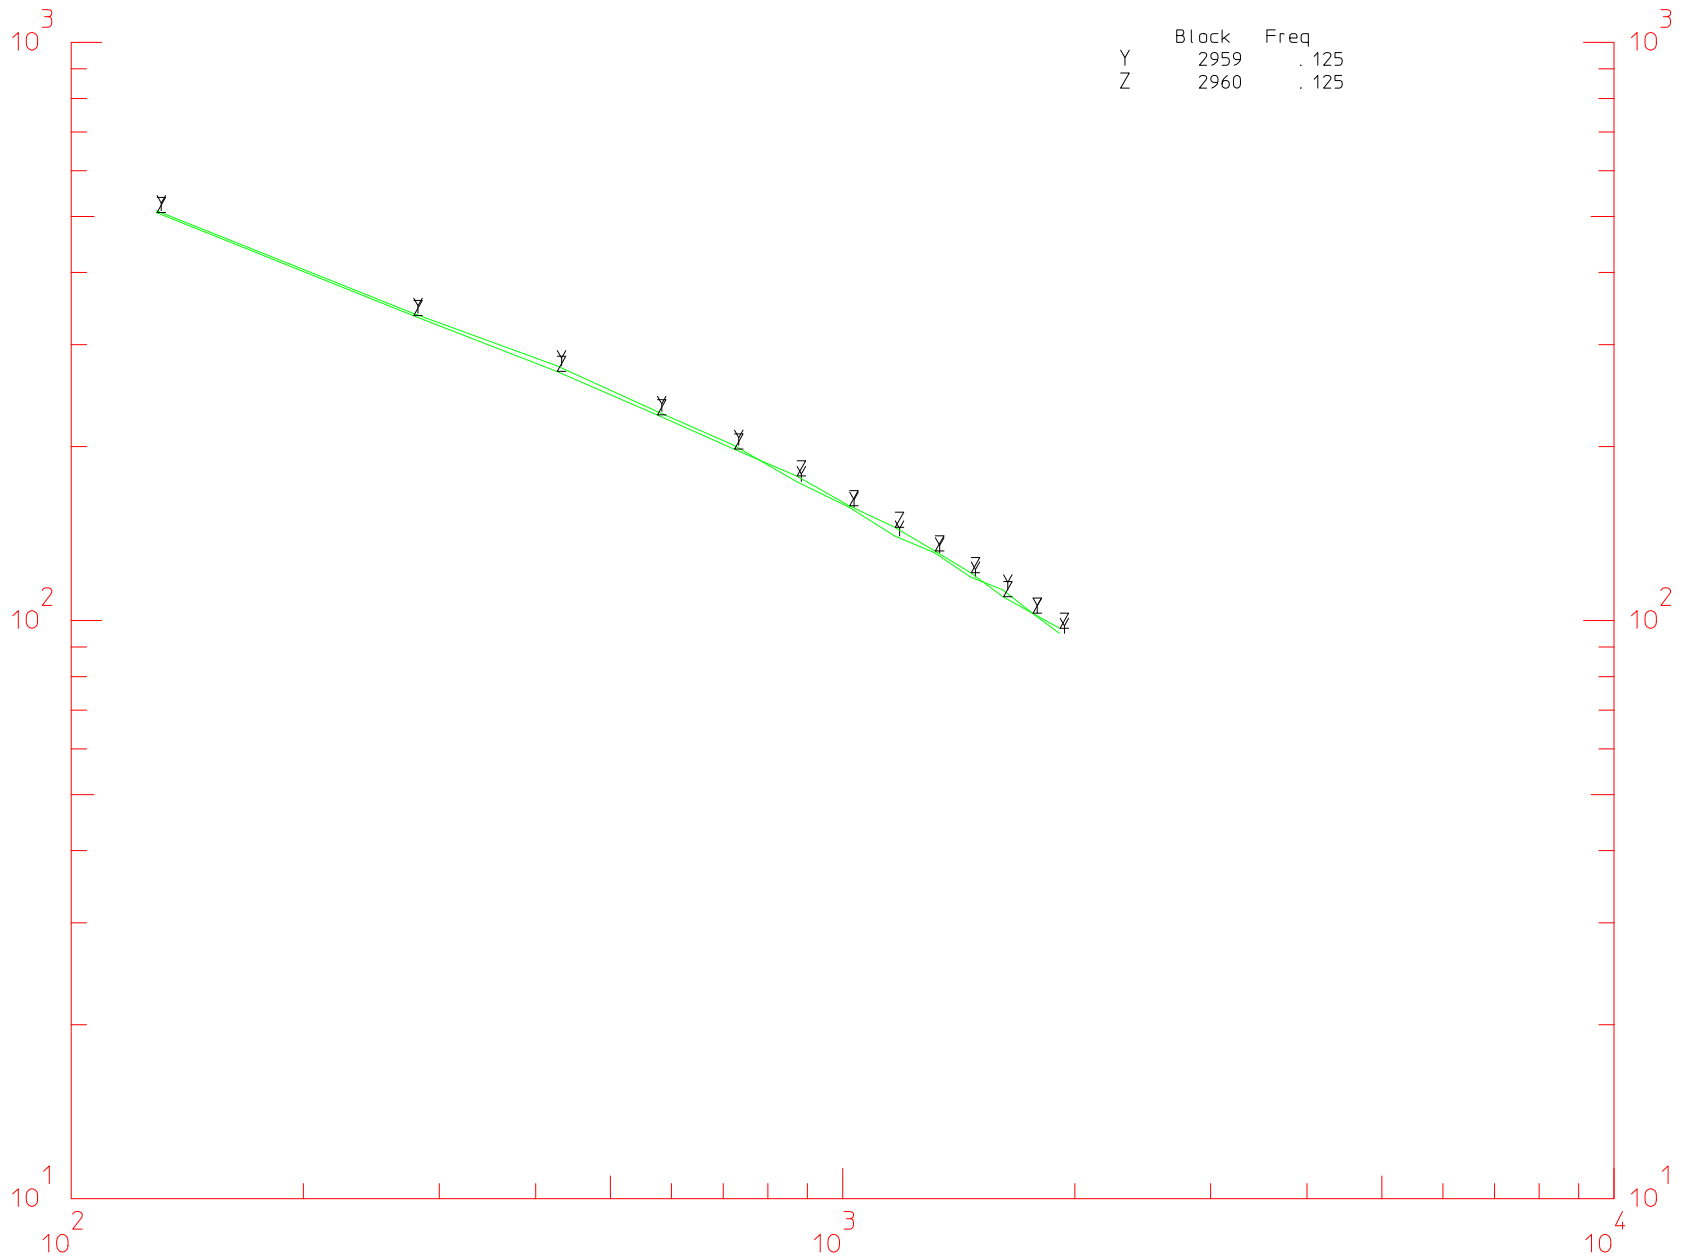

Mable Flats Grid5

Line= 13

TxLen= 7442. Line= 6197. Stn= -2.

	Block	Freq
A	2959	.125
B	2960	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

10³
10²
10¹

TIME (msec)

10³
10⁴

10³
10²
10¹

Mable Flats Grid5

Line= 13

TxLen= 7442. Line= 6172. Stn= -3.

	Block	Freq
C	2959	.125
D	2960	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

10¹

10²

10³

TIME (msec)

10³

10¹

10²

10³

Mable Flats Grid5

Line= 13

TxLen= 7442. Line= 6147. Stn= -4.

	Block	Freq
E	2959	.125
F	2960	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

10³

10²

TIME (msec)

10³

10⁴

10¹

10²


10³

Mable Flats Grid5

Line= 13

TxLen= 7442. Line= 6347. Stn= 1.

	Block	Freq
G	2963	.125
H	2964	.125

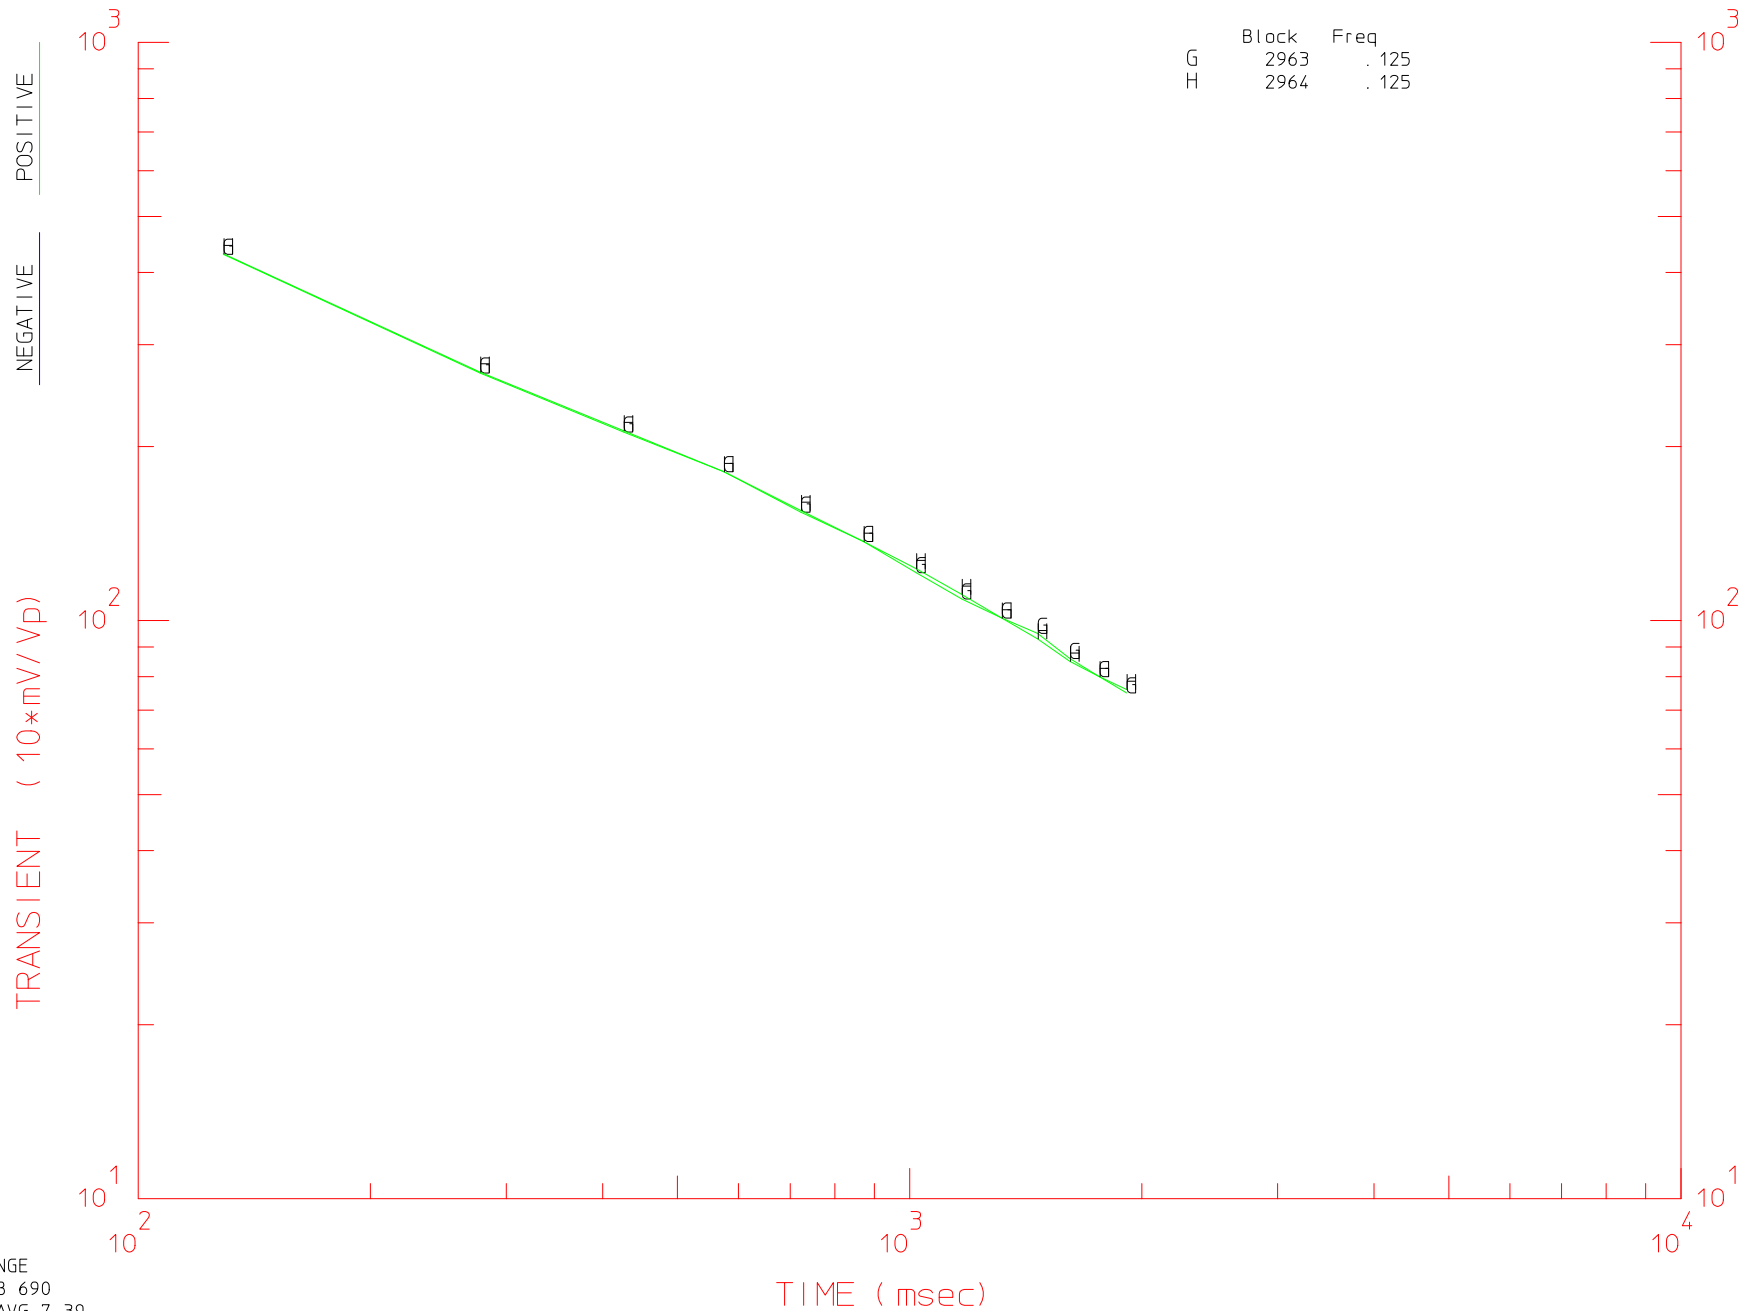

Mable Flats Grid5



Line= 13

TxLen= 7442. Line= 6372. Stn= 2.


	Block	Freq
I	2963	.125
J	2964	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

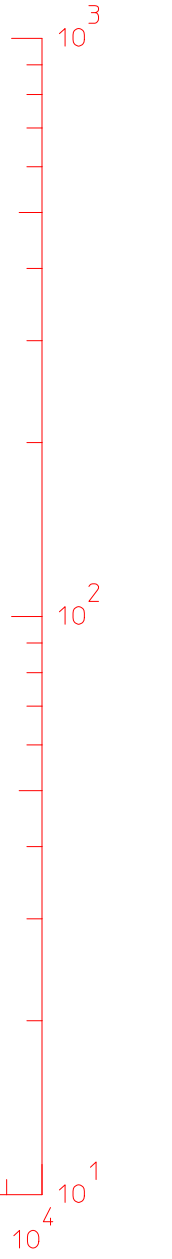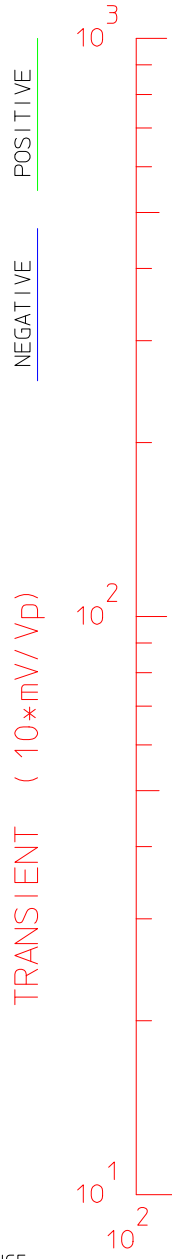

TIME (msec)

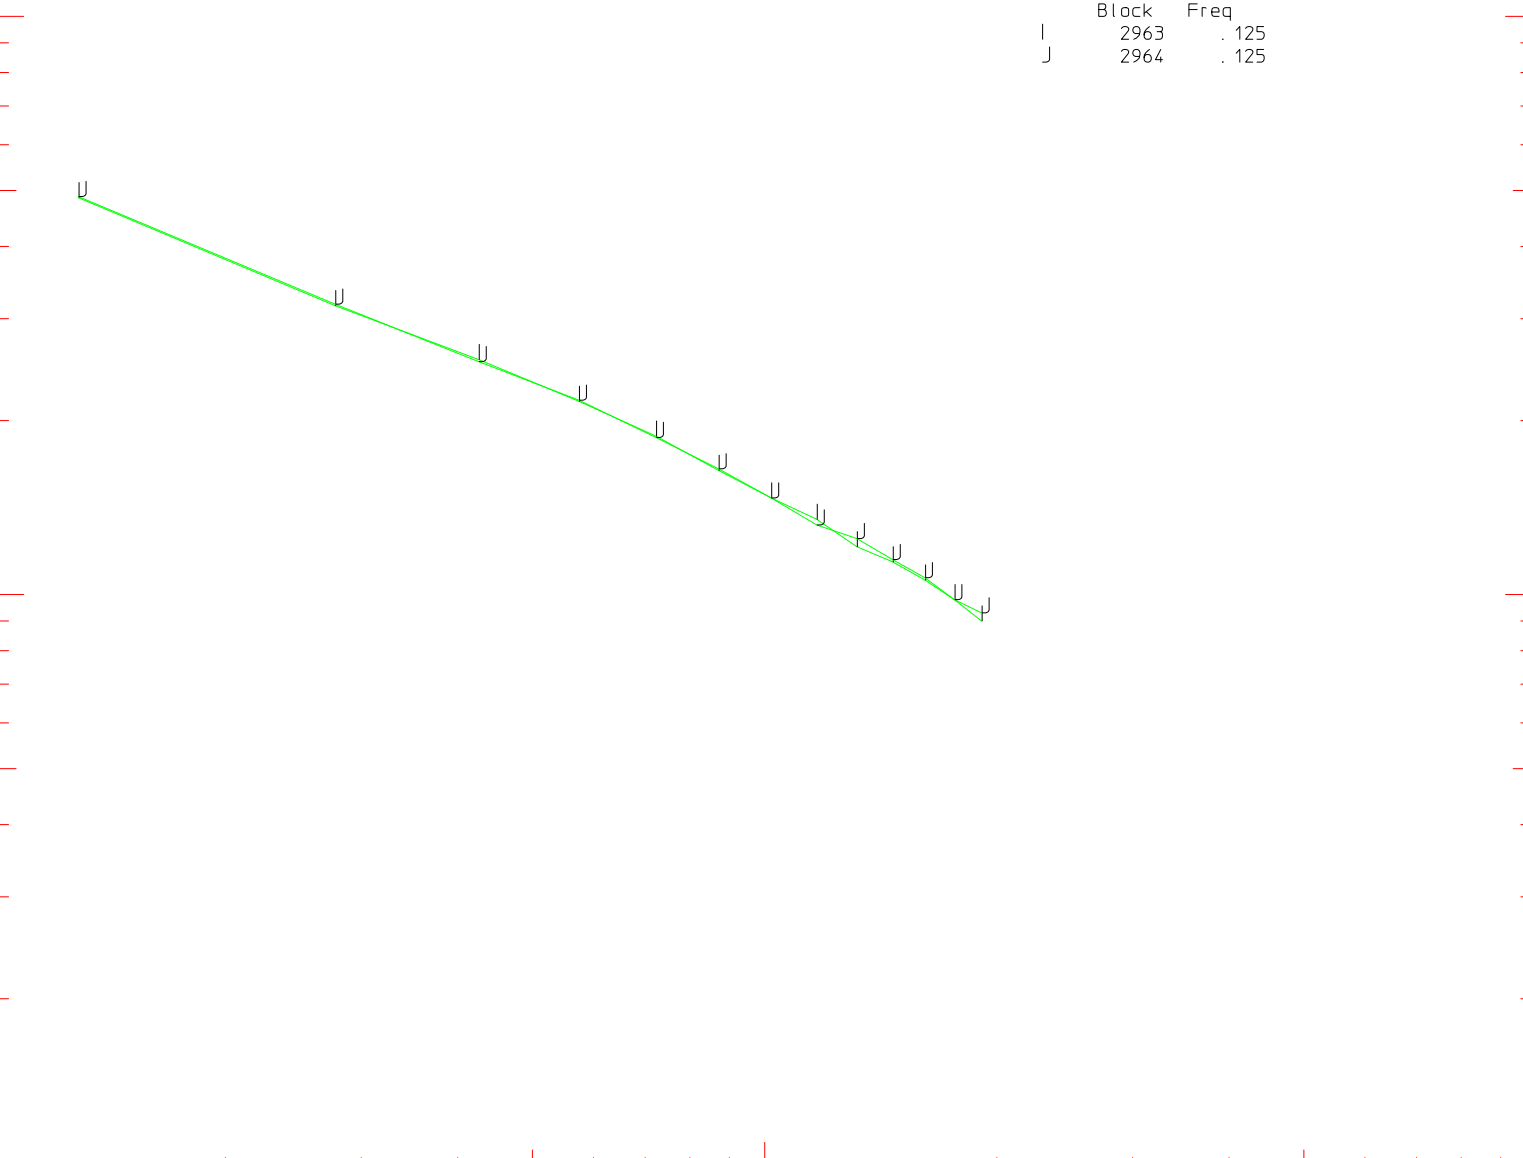

Mable Flats Grid5

Line= 13

TxLen= 7442. Line= 6397. Stn= 3.

	Block	Freq
K	2963	.125
L	2964	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

10¹

10²

10³

TIME (msec)

10³

10¹

10²

10³

Mable Flats Grid5


Line= 13

TxLen= 7442.

Line= 6422.

Stn= 4.

	Block	Freq
M	2963	.125
N	2964	.125

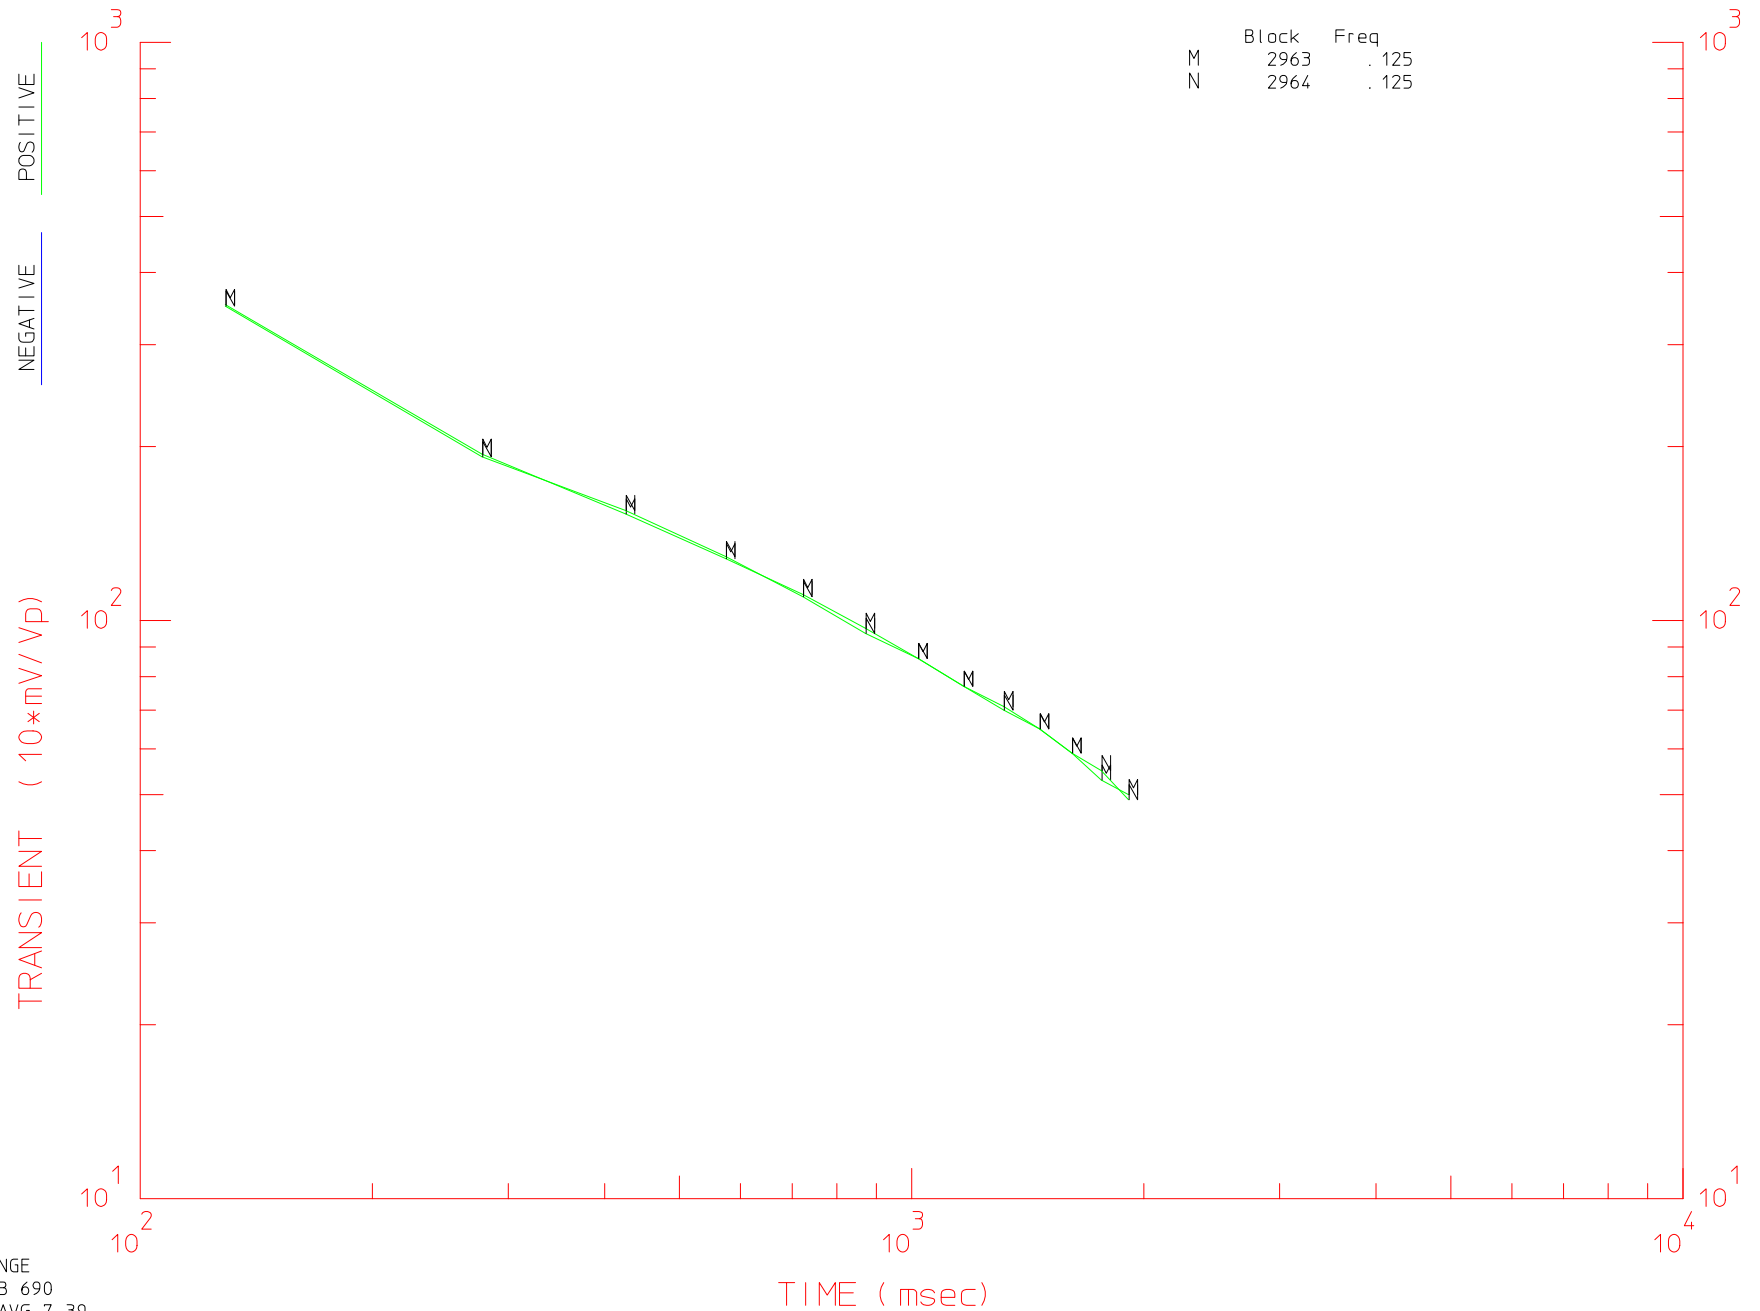


Mable Flats Grid5

Line= 13

TxLen= 7442. Line= 6322. Stn= -1.

	Block	Freq
O	2961	.125
P	2962	.125

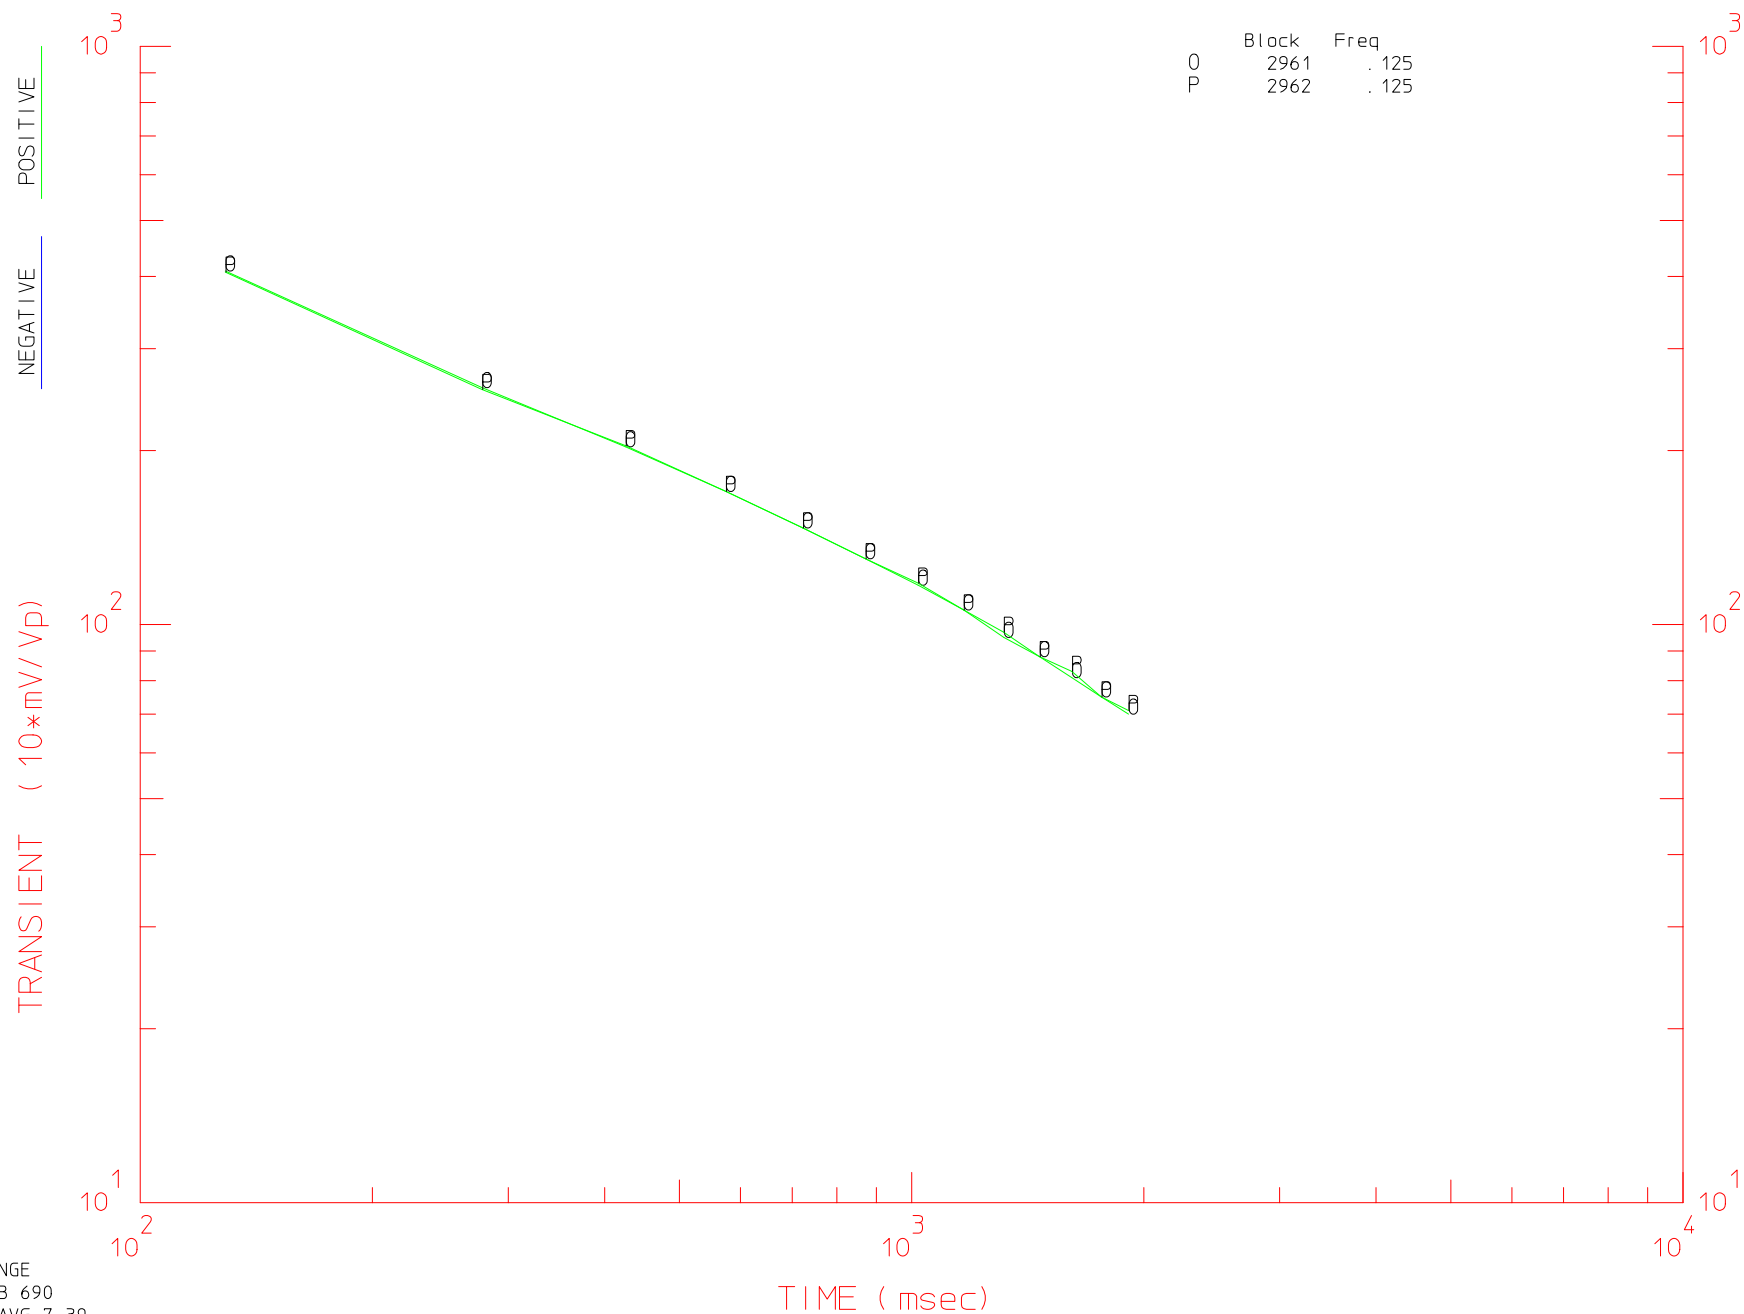

Mable Flats Grid5

Line= 13


TxLen= 7442. Line= 6297. Stn= -2.

	Block	Freq
Q	2961	.125
R	2962	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

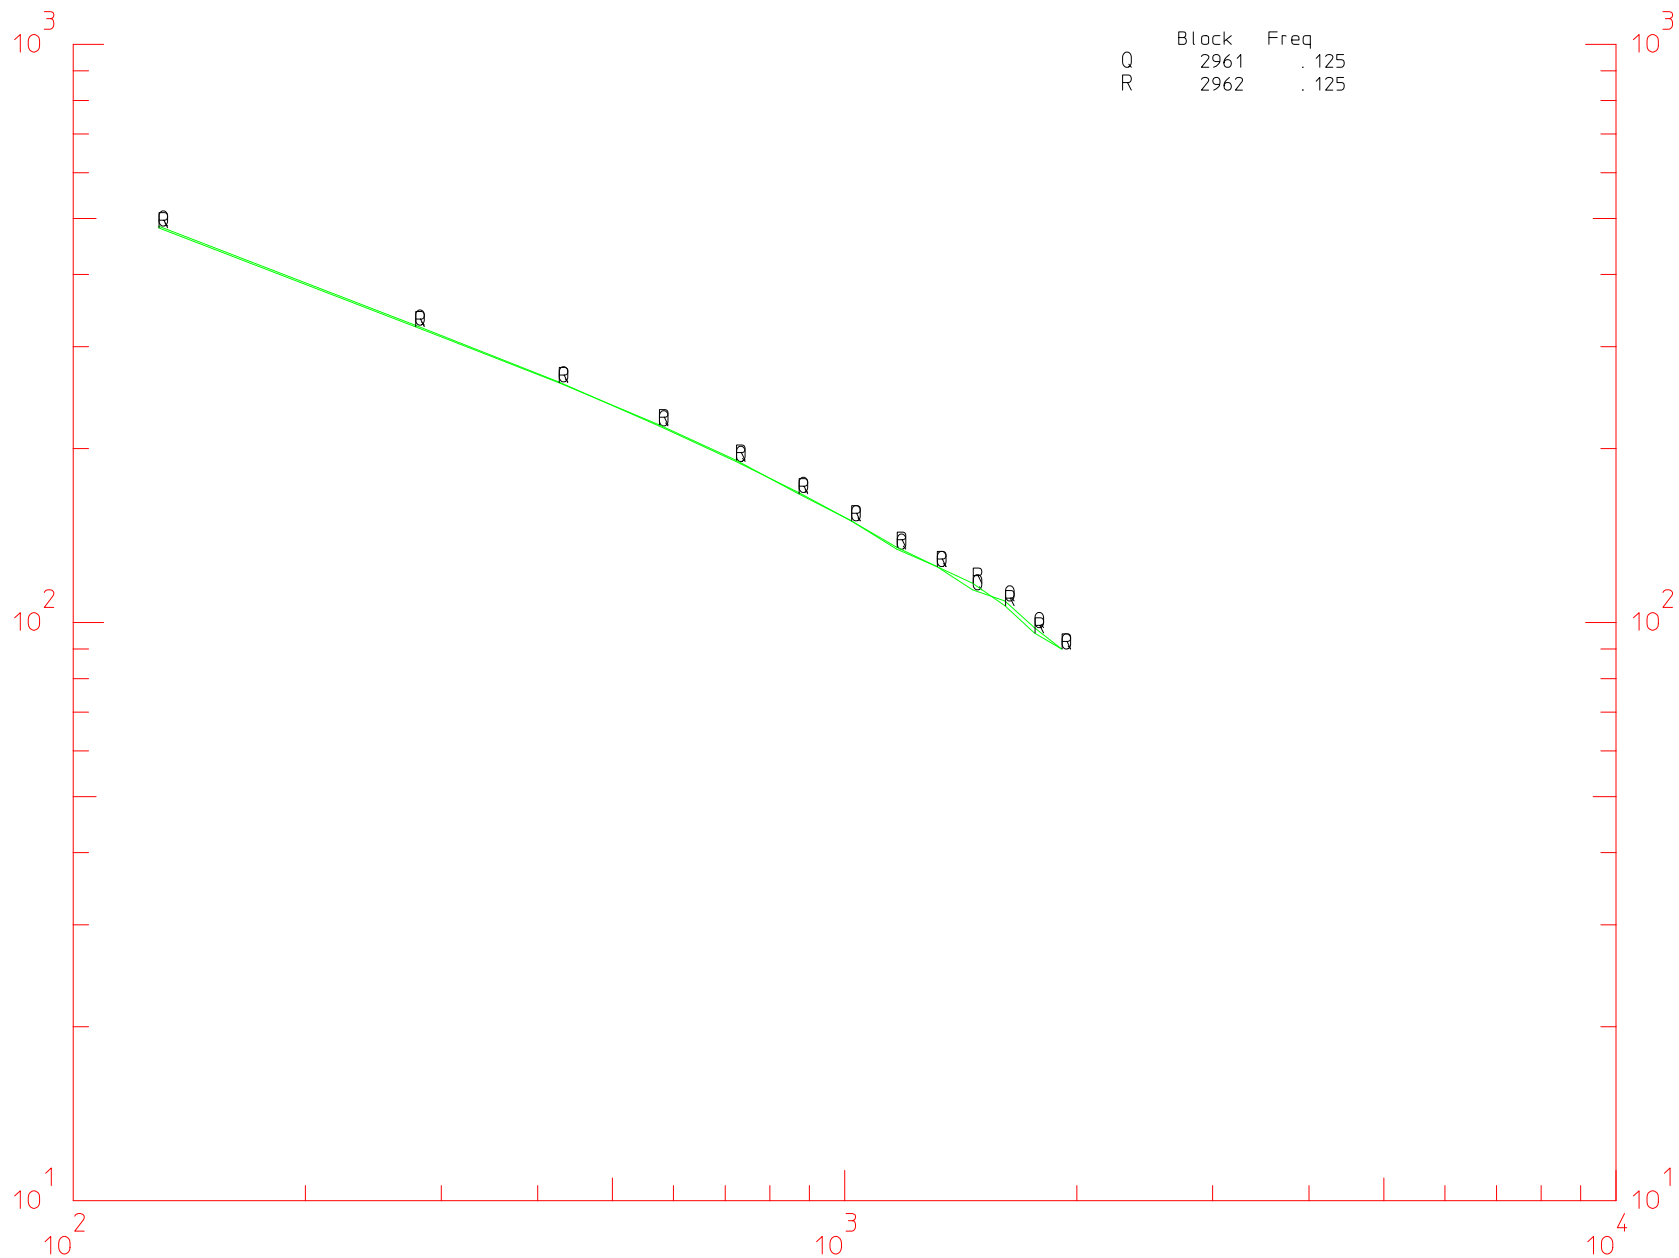

Mable Flats Grid5

Line= 13


TxLen= 7442. Line= 6272. Stn= -3.

	Block	Freq
S	2961	.125
T	2962	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

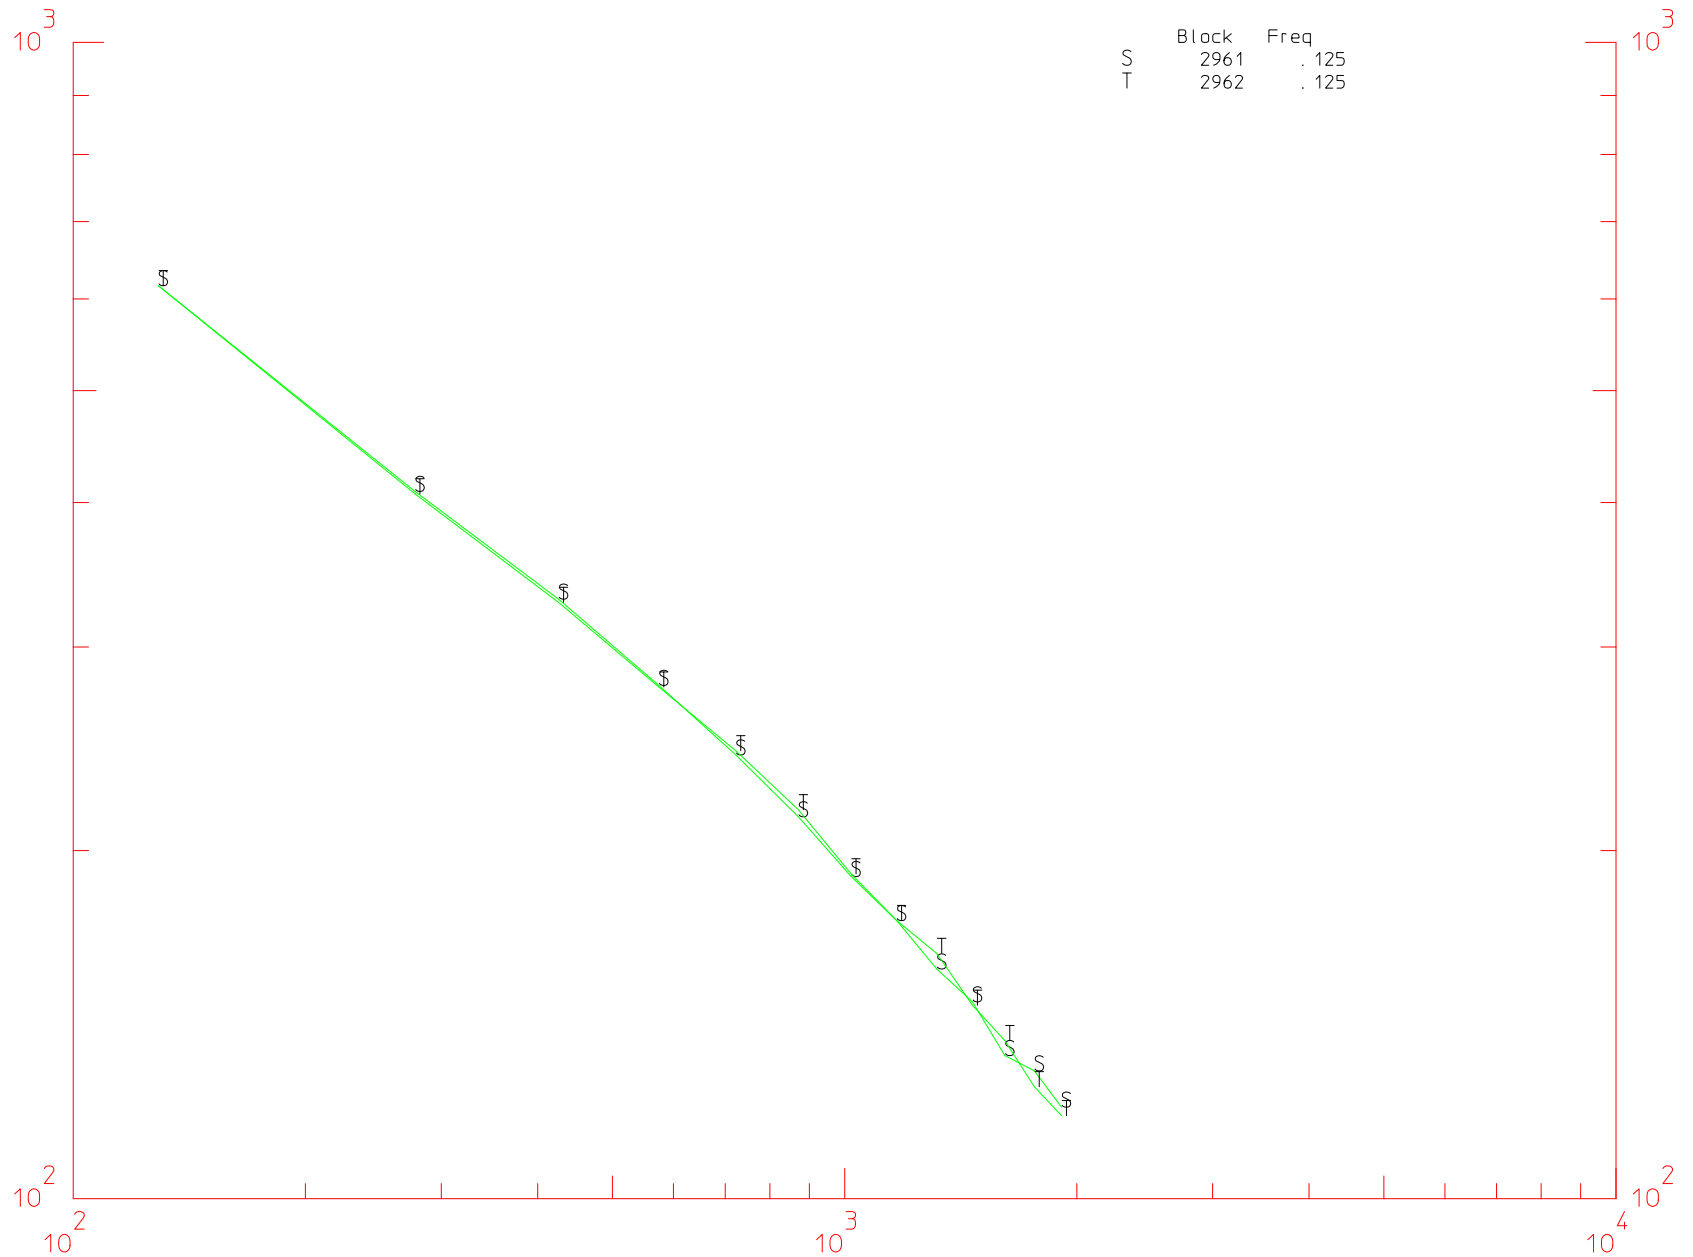

Mable Flats Grid5

Line= 13

TxLen= 7442. Line= 6247. Stn= -4.

	Block	Freq
U	2961	.125
V	2962	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

