

Mable Flats Grid16

Line= 15


TxLen= 7544. Line= 5953. Stn= -1.

	Block	Freq
A	2996	.125
B	2997	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

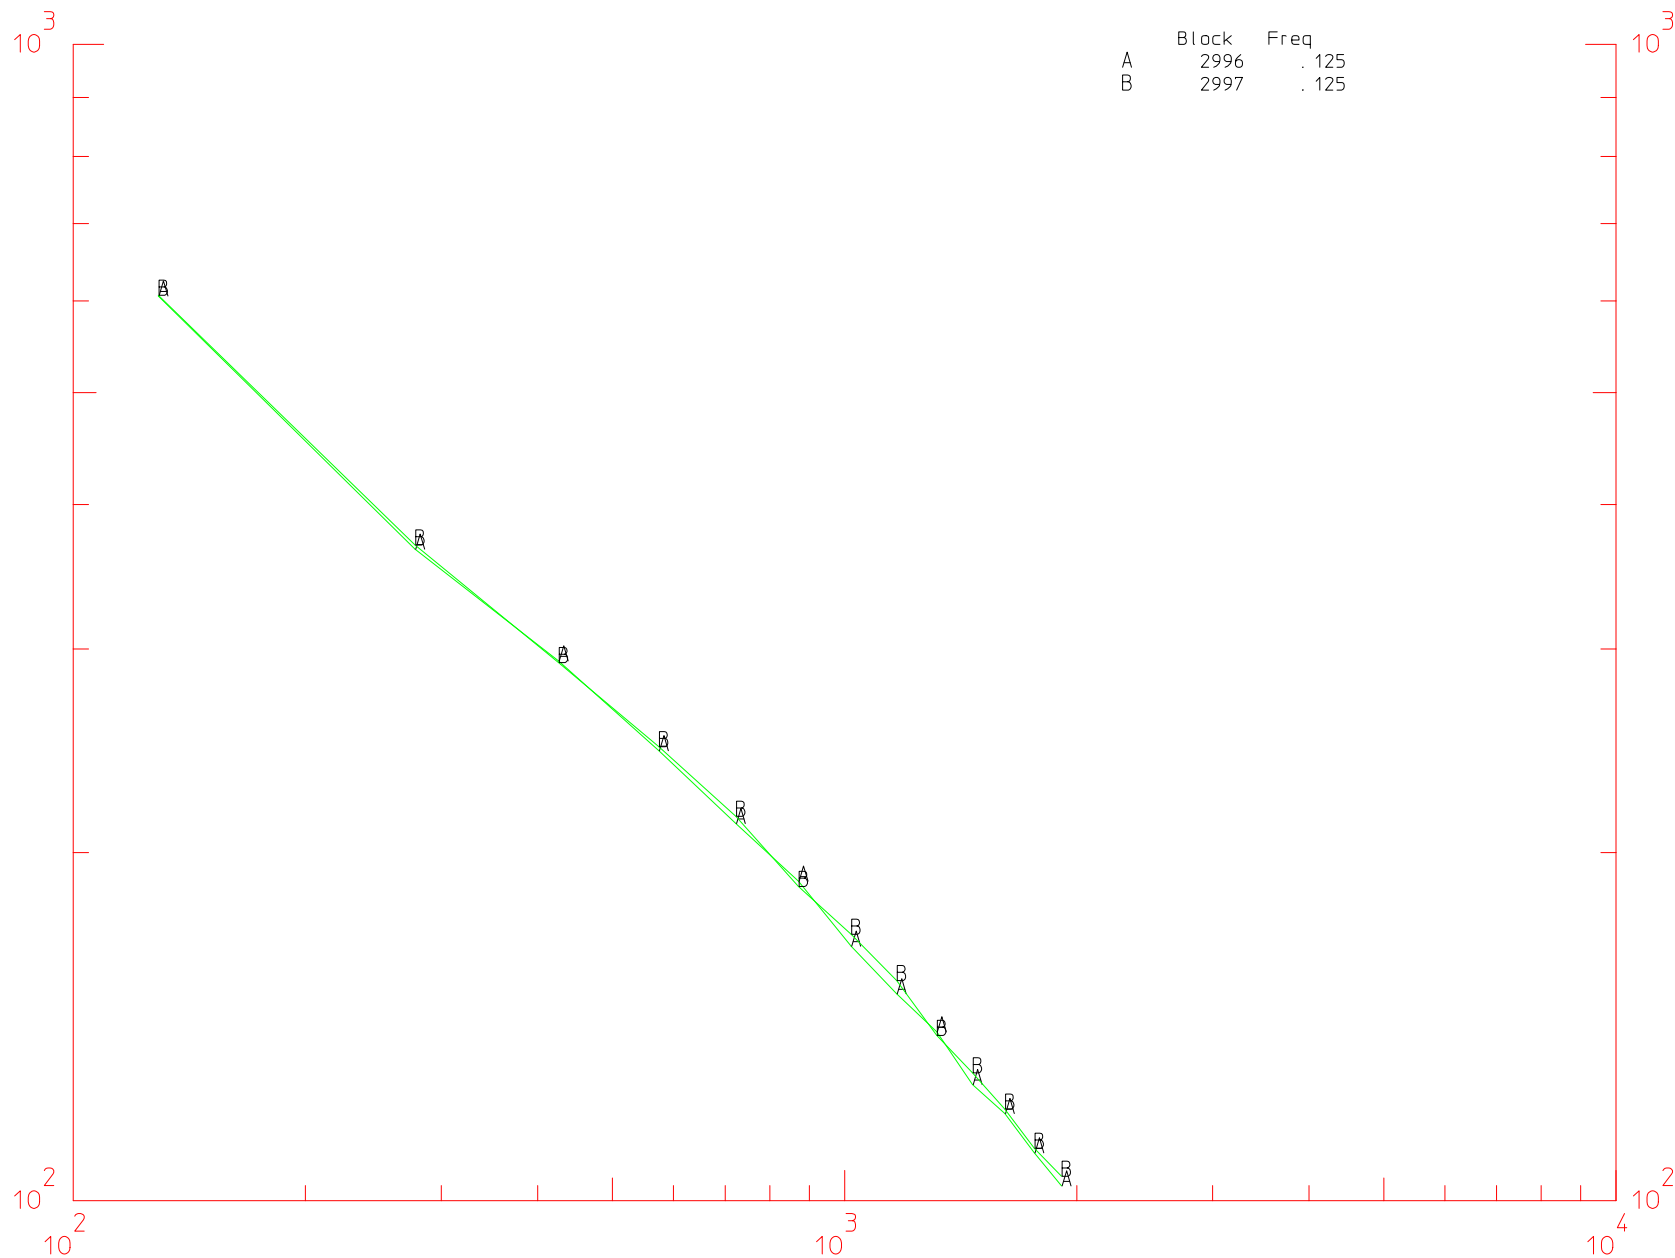

Mable Flats Grid16

Line= 15


TxLen= 7544. Line= 5928. Stn= -2.

	Block	Freq
C	2996	.125
D	2997	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

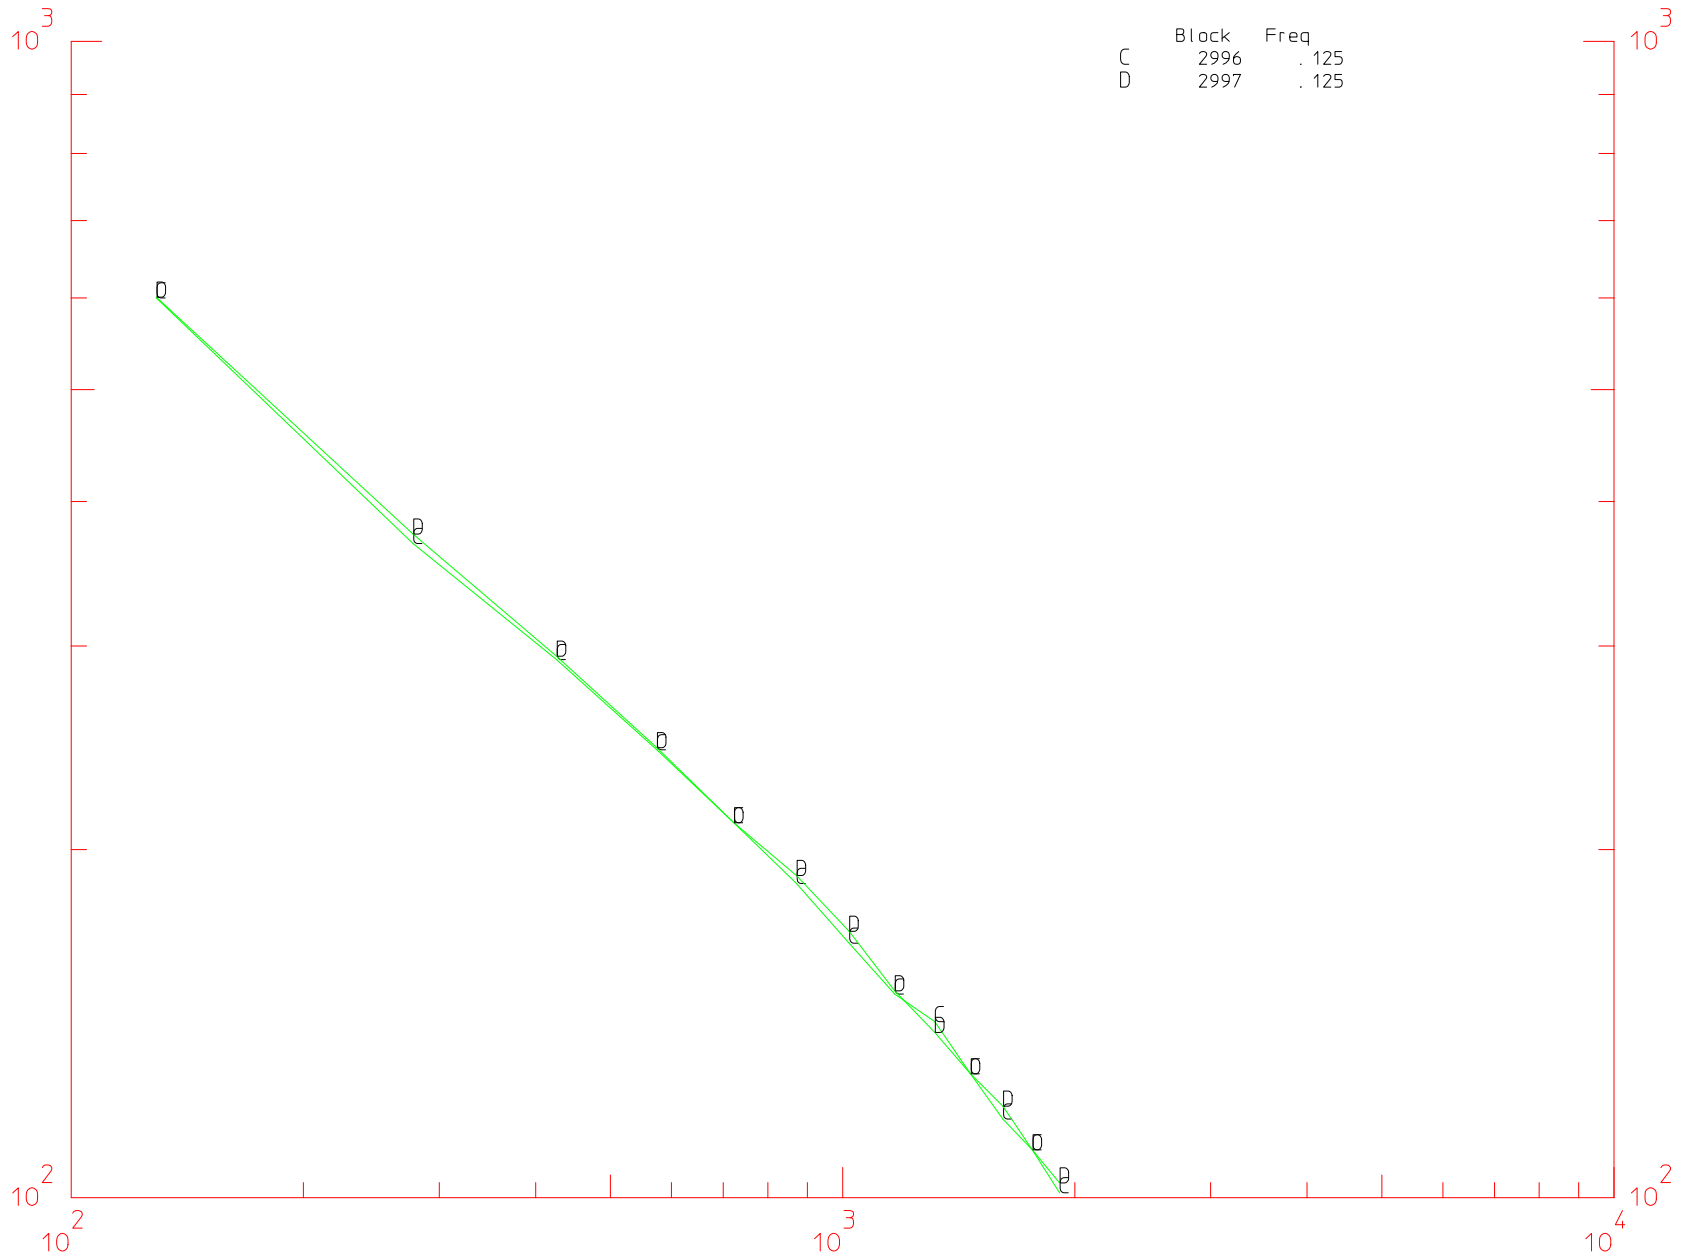

Mable Flats Grid16

Line= 15


TxLen= 7544. Line= 5903. Stn= -3.

	Block	Freq
E	2996	.125
F	2997	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

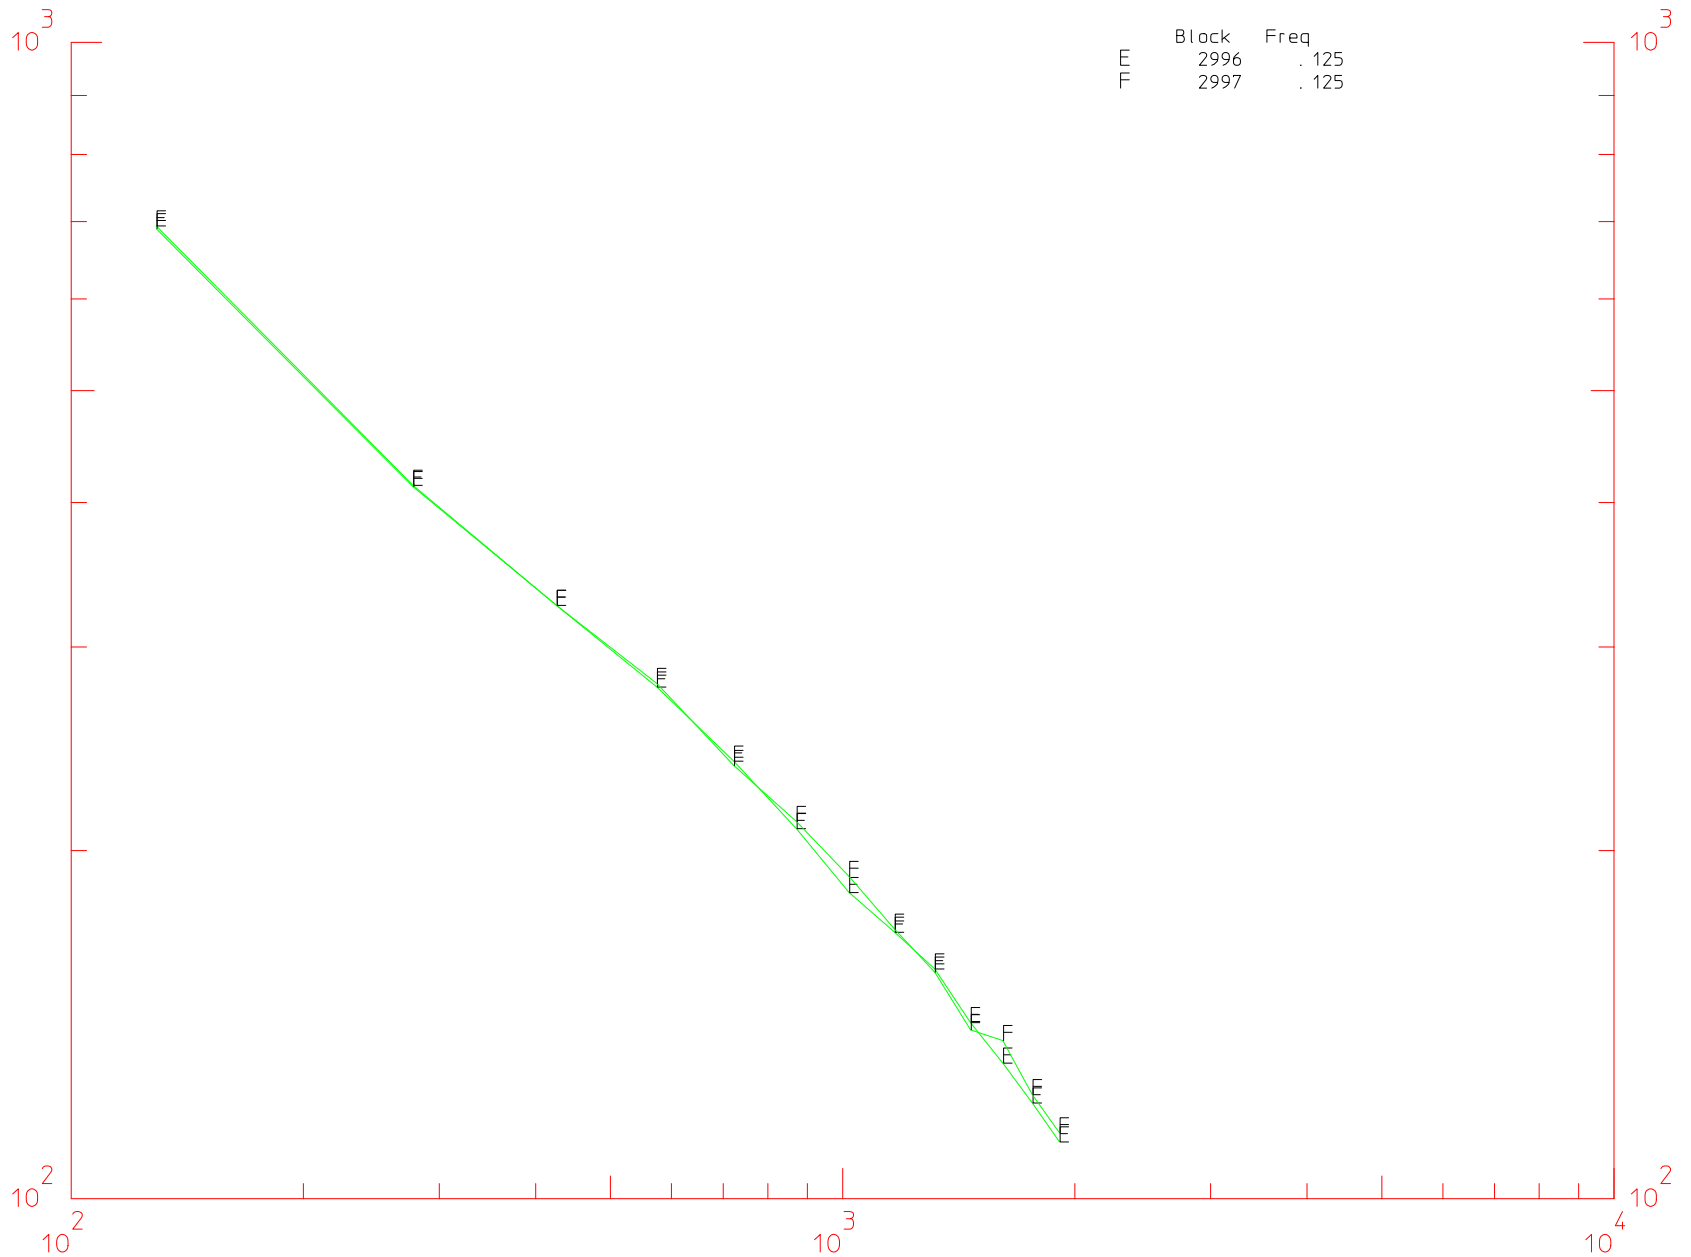


Mable Flats Grid16

Line= 15

TxLen= 7544. Line= 5878. Stn= -4.


	Block	Freq
G	2996	.125
H	2997	.125

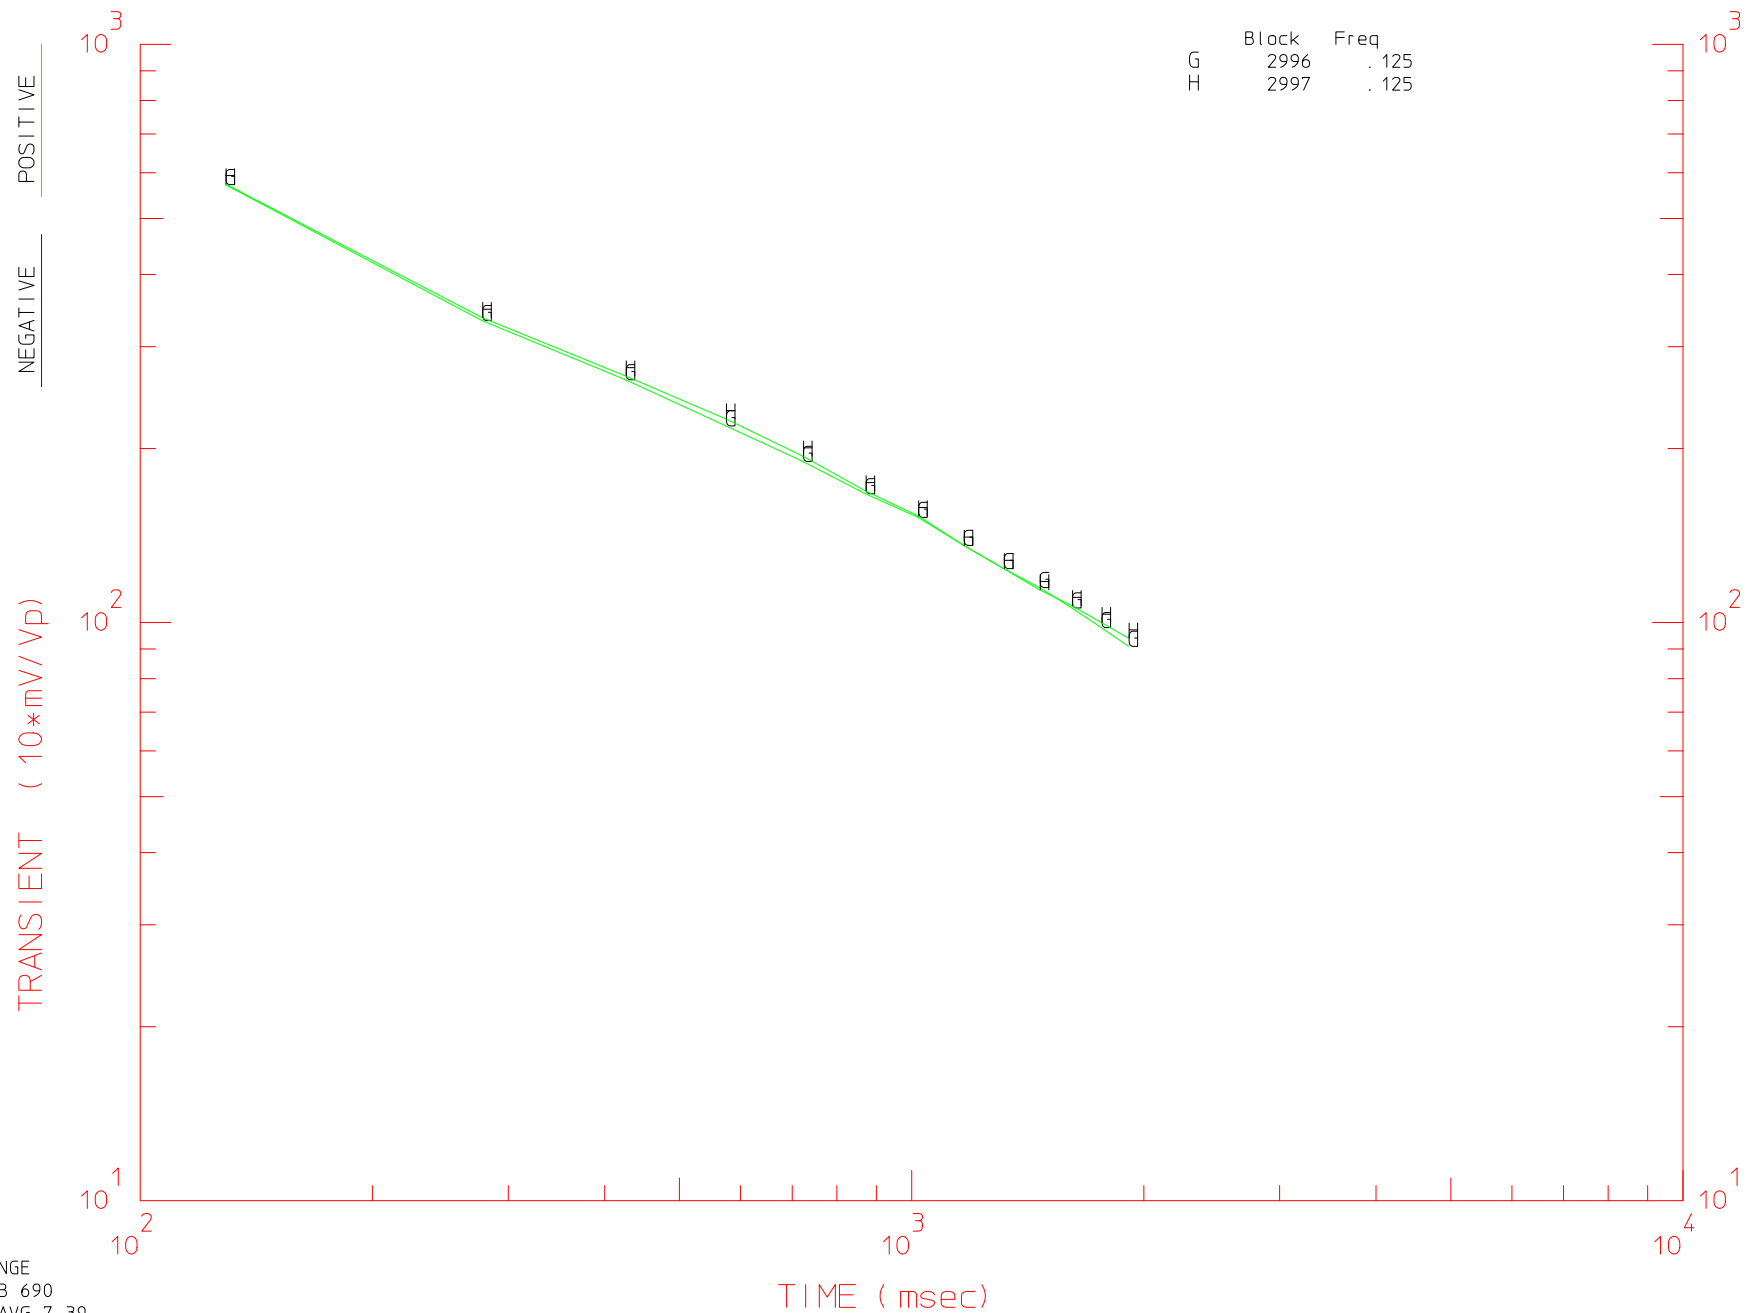

Mable Flats Grid16

Line= 15

TxLen= 7544. Line= 6053. Stn= -1.

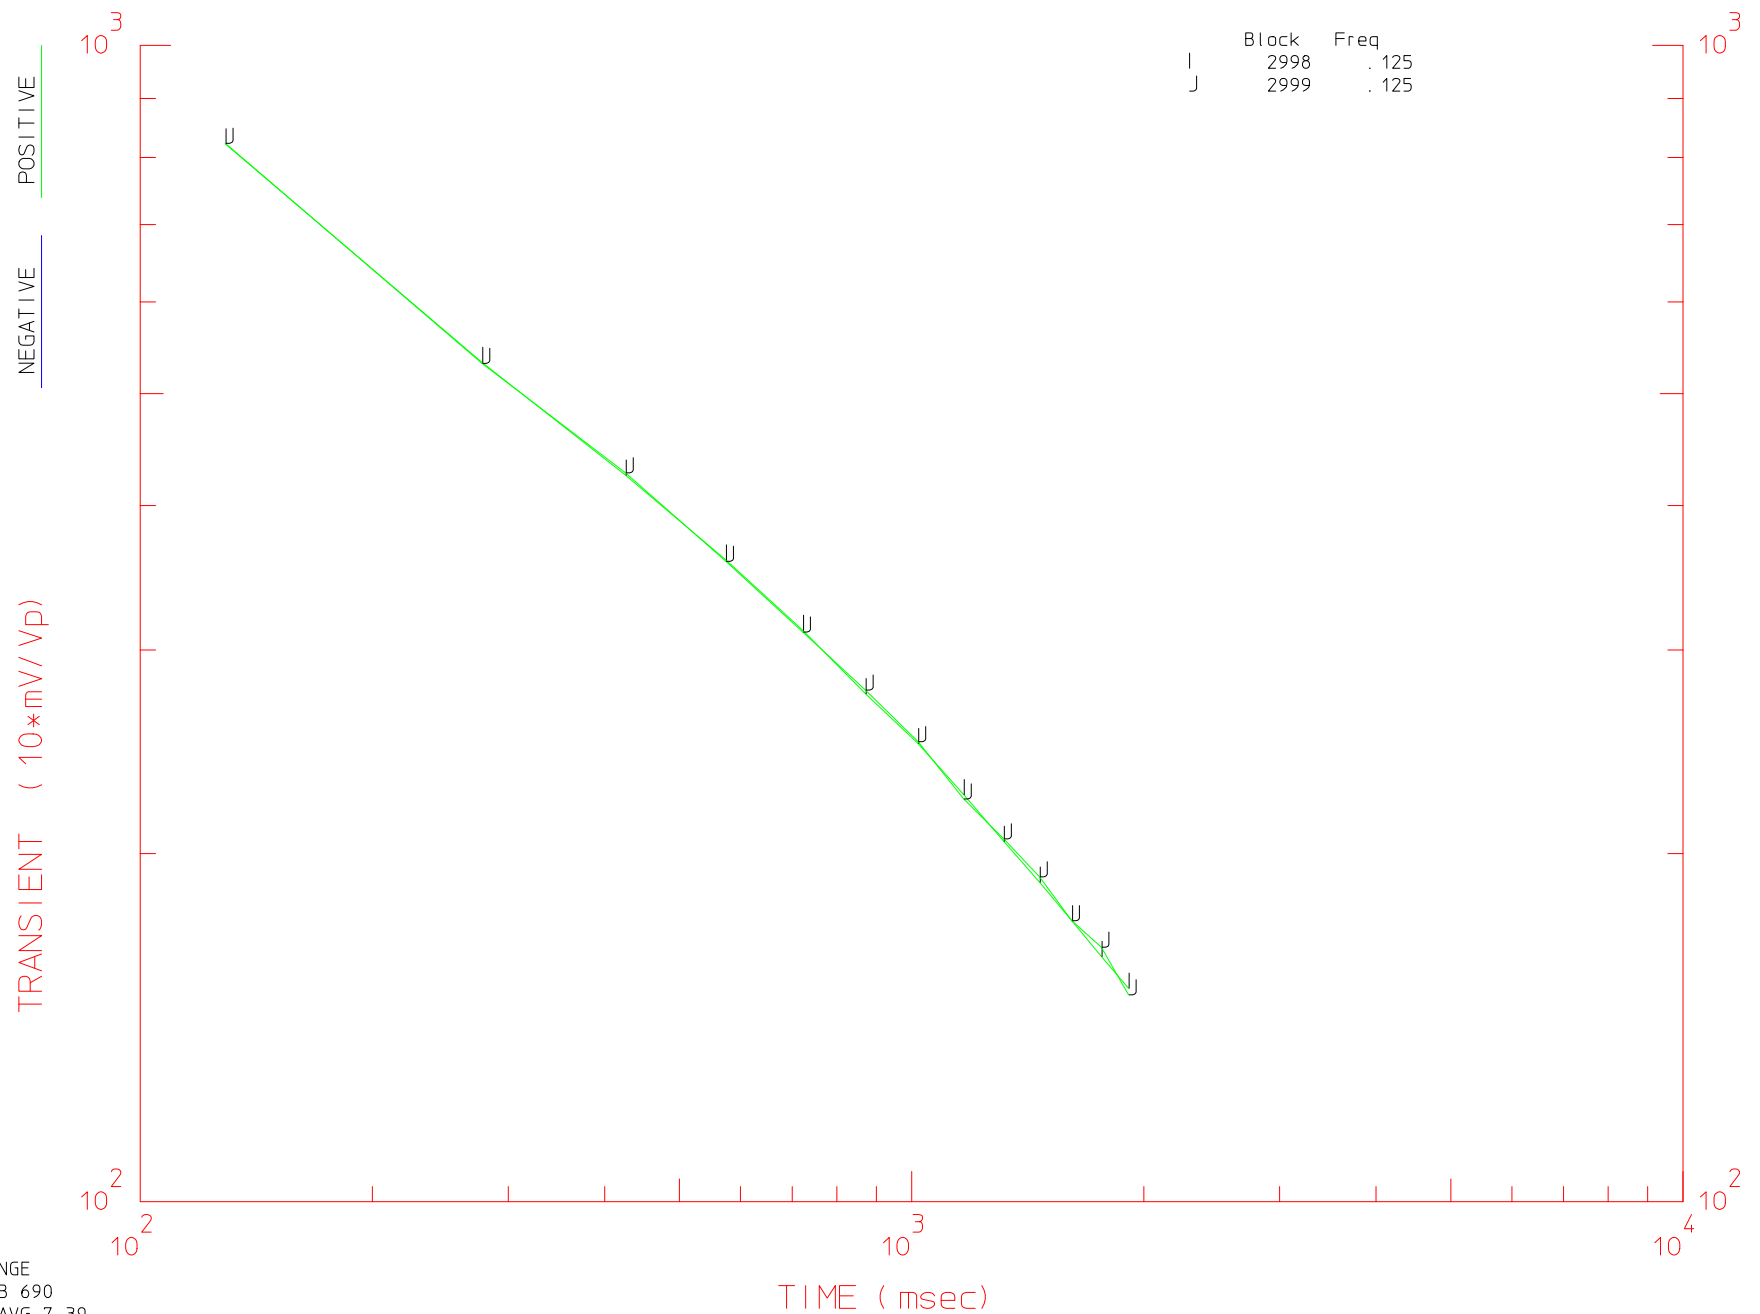

Mable Flats Grid16


Line= 15

TxLen= 7544. Line= 6028. Stn= -2.

	Block	Freq
K	2998	.125
L	2999	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

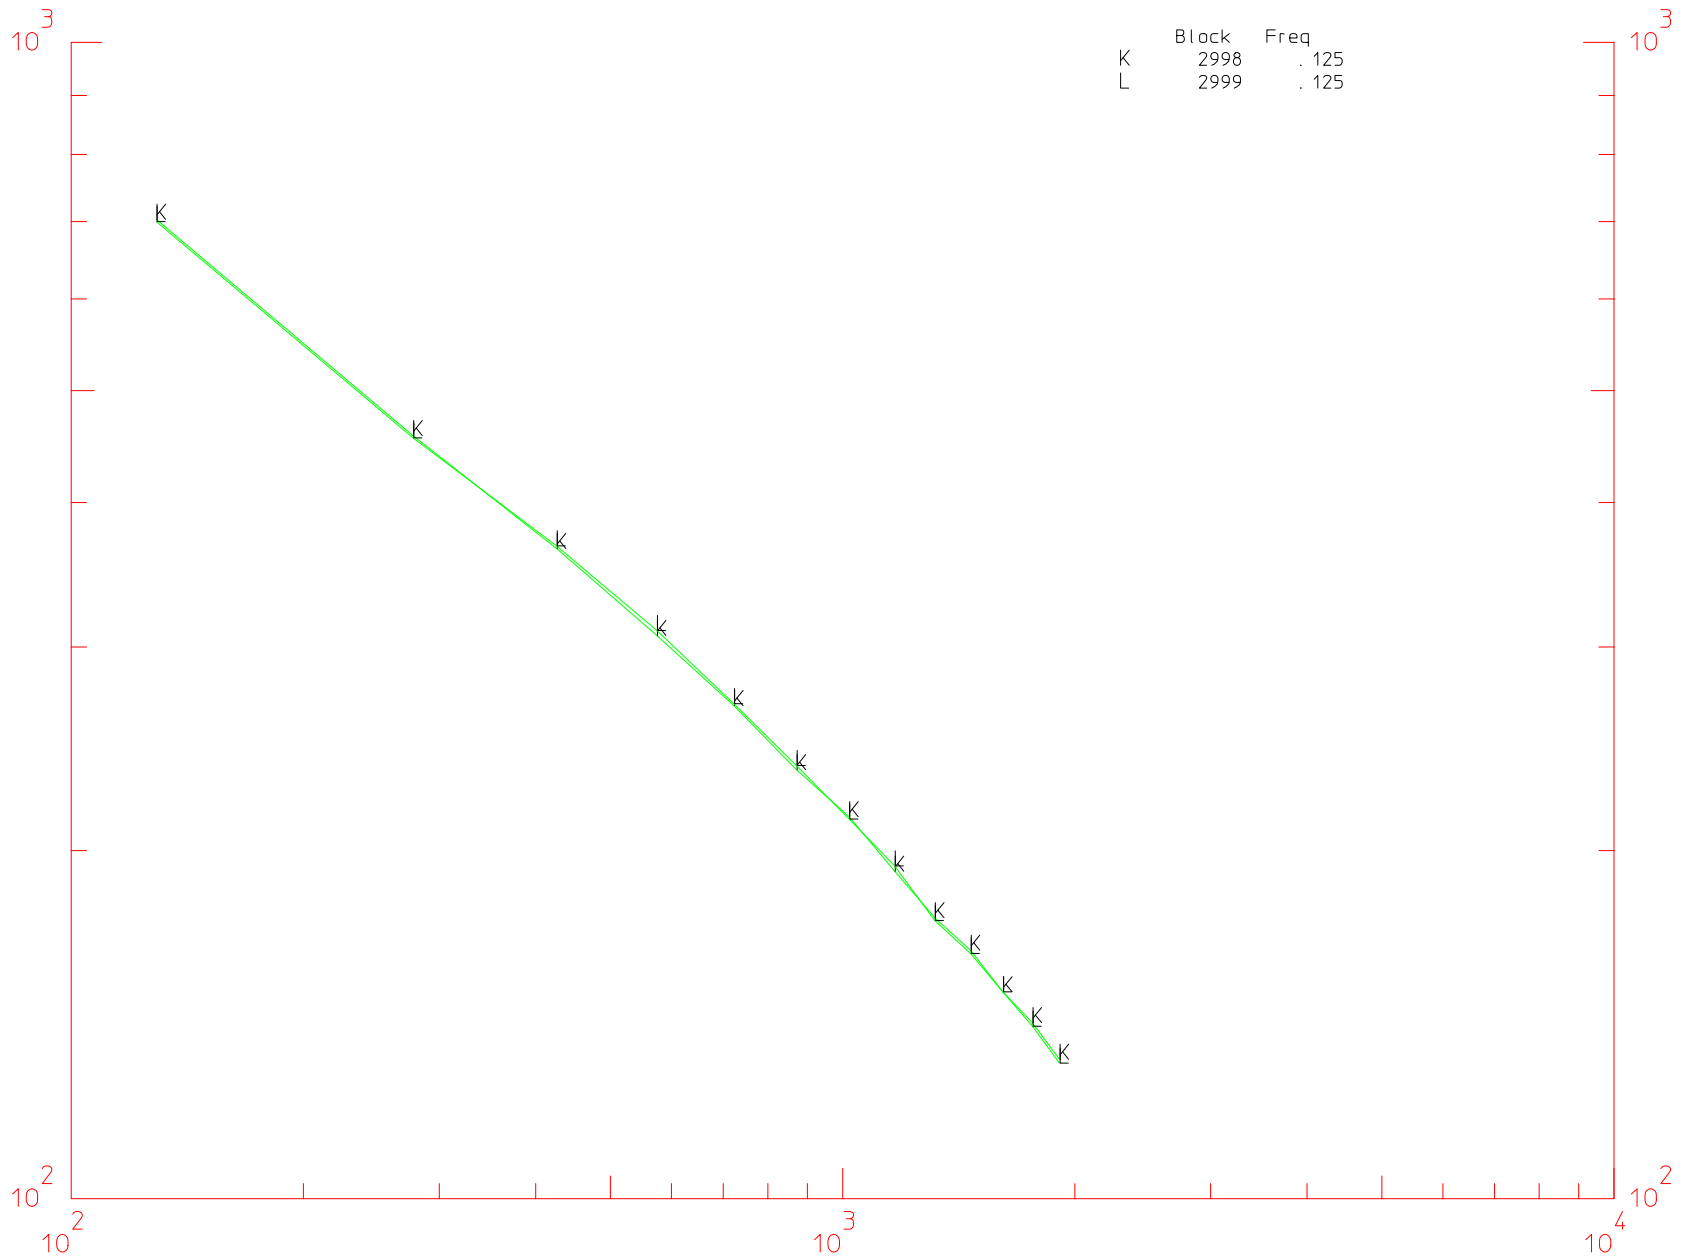

Mable Flats Grid16

Line= 15


TxLen= 7544. Line= 6003. Stn= -3.

	Block	Freq
M	2998	.125
N	2999	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

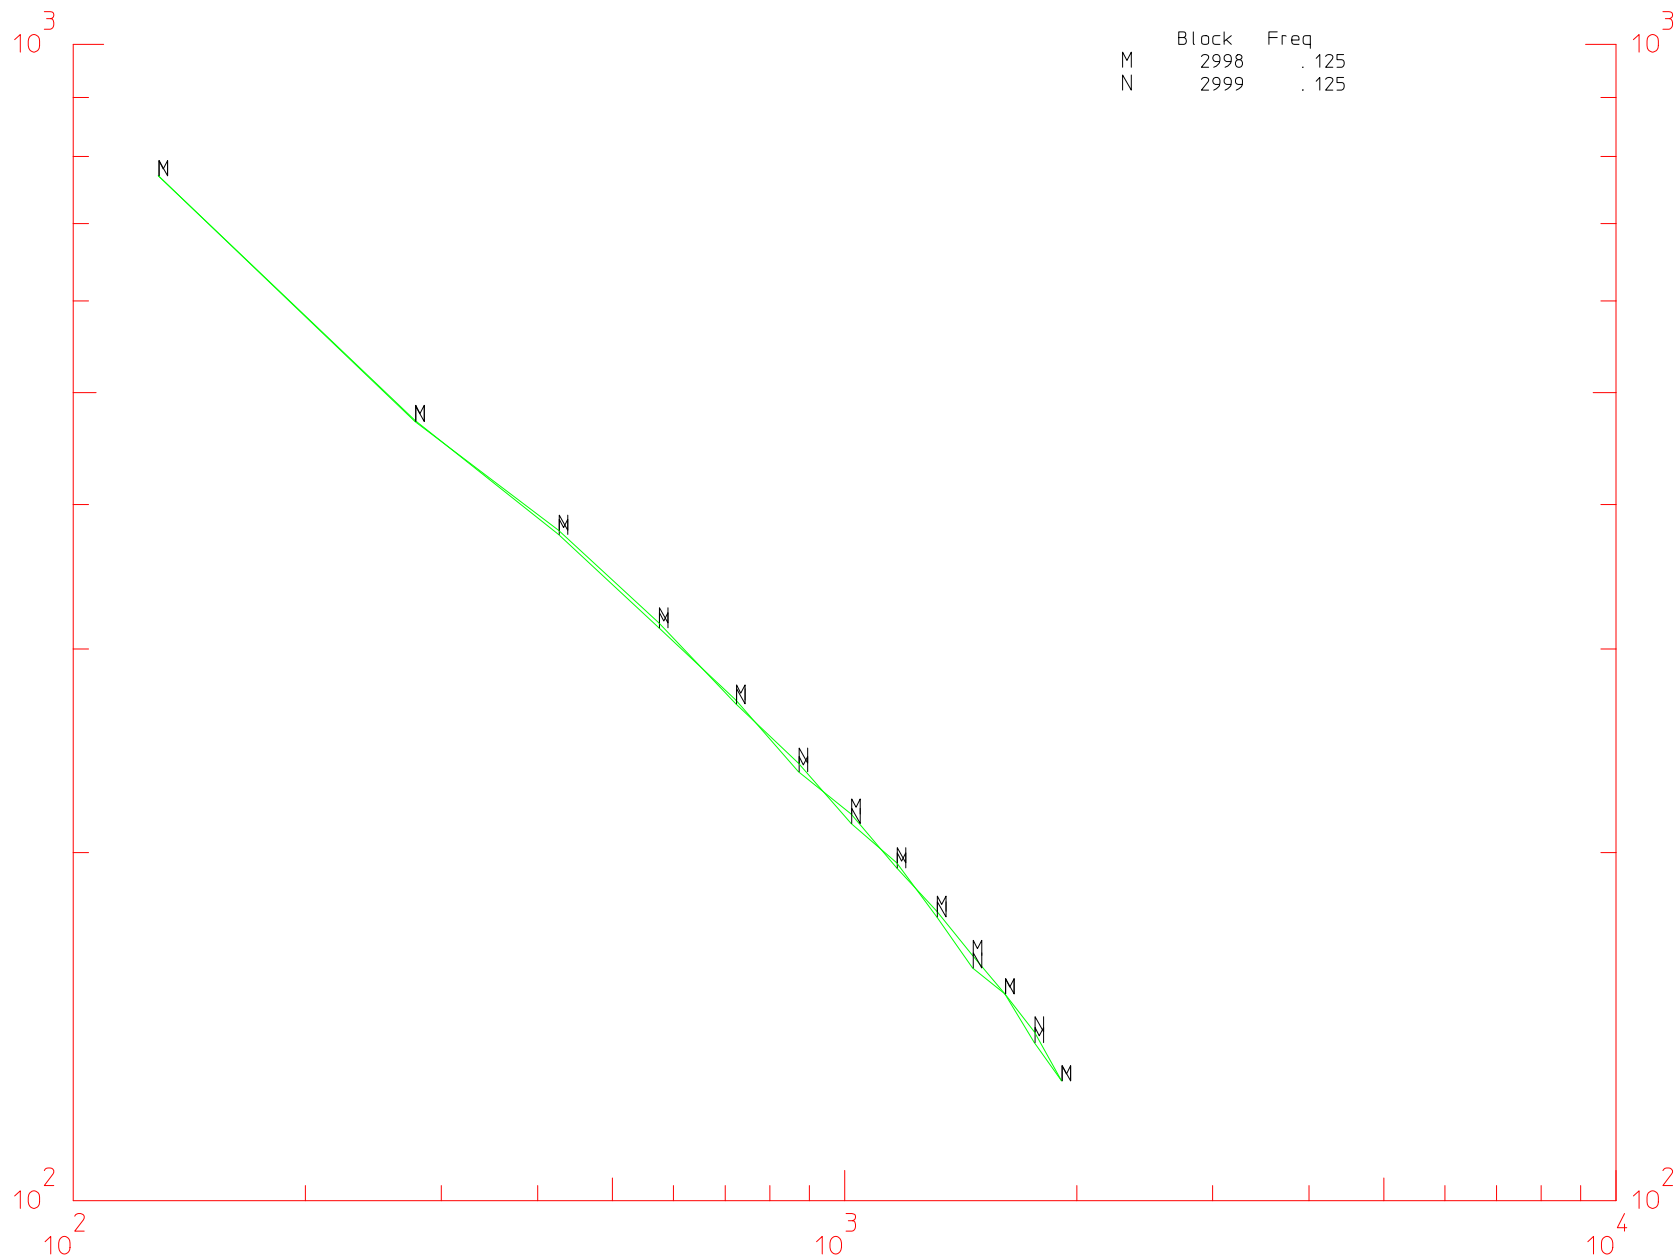


Mable Flats Grid16
Line= 15
TxLen= 7544. Line= 5978. Stn= -4.

	Block	Freq
O	2998	.125
P	2999	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

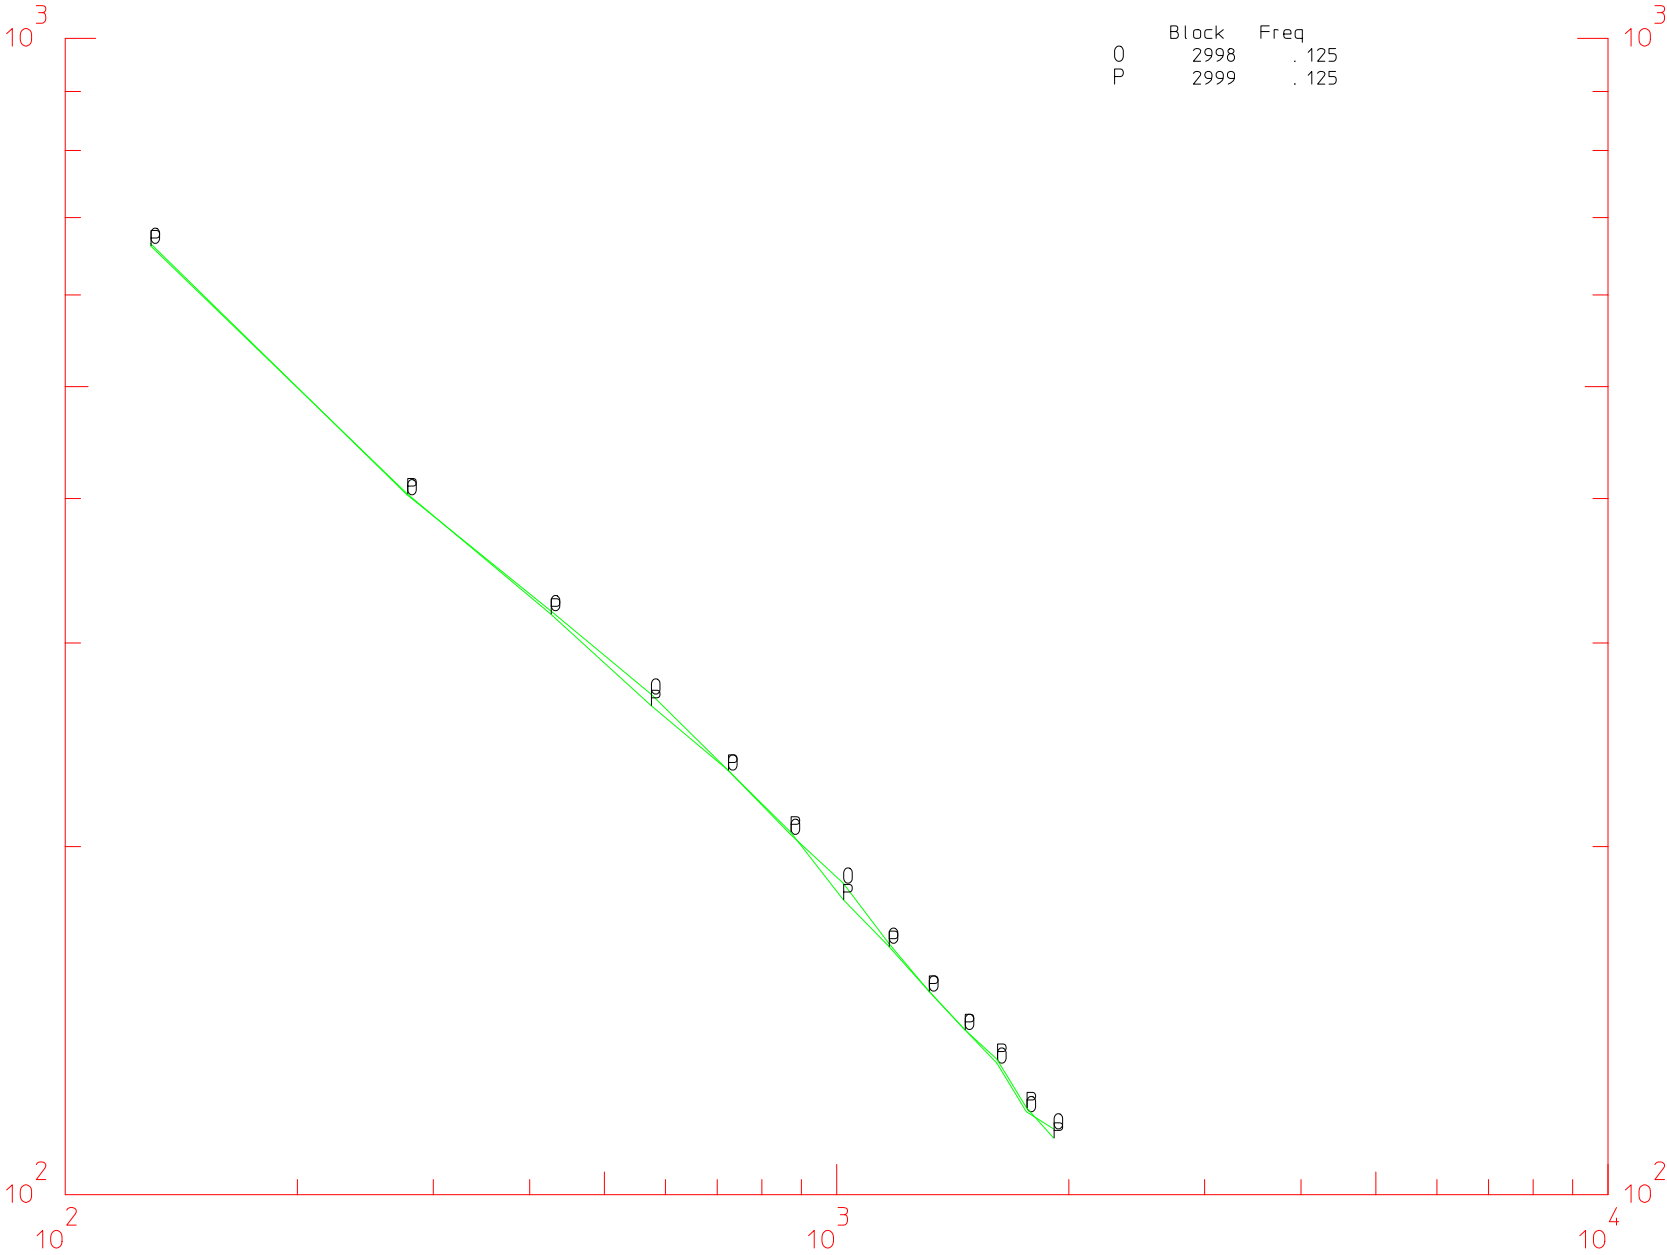


Mable Flats Grid16

Line= 15

TxLen= 7544. Line= 6153. Stn= -1.

	Block	Freq
Q	3000	.125
R	3001	.125

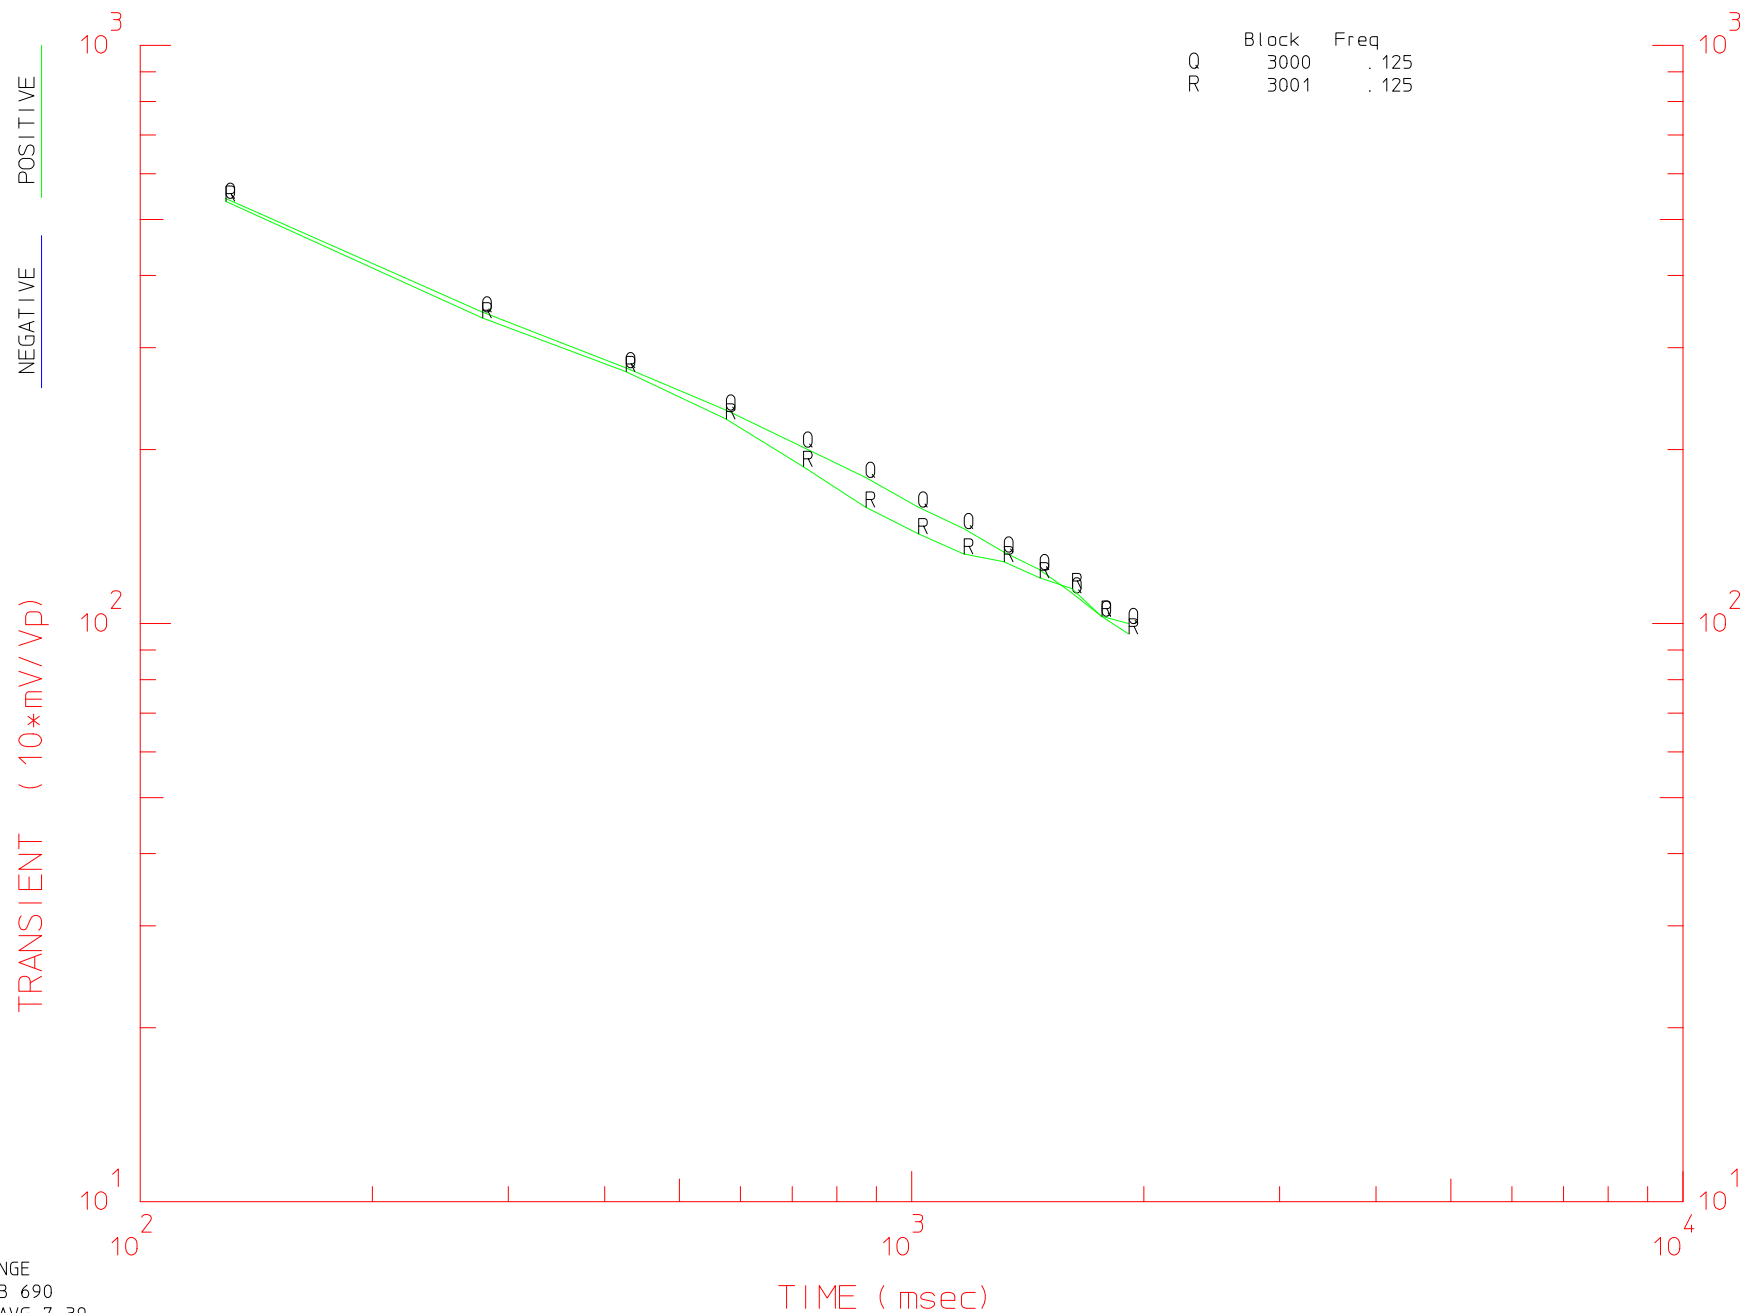


Mable Flats Grid16

Line= 15

TxLen= 7544. Line= 6128. Stn= -2.

	Block	Freq
S	3000	.125
T	3001	.125

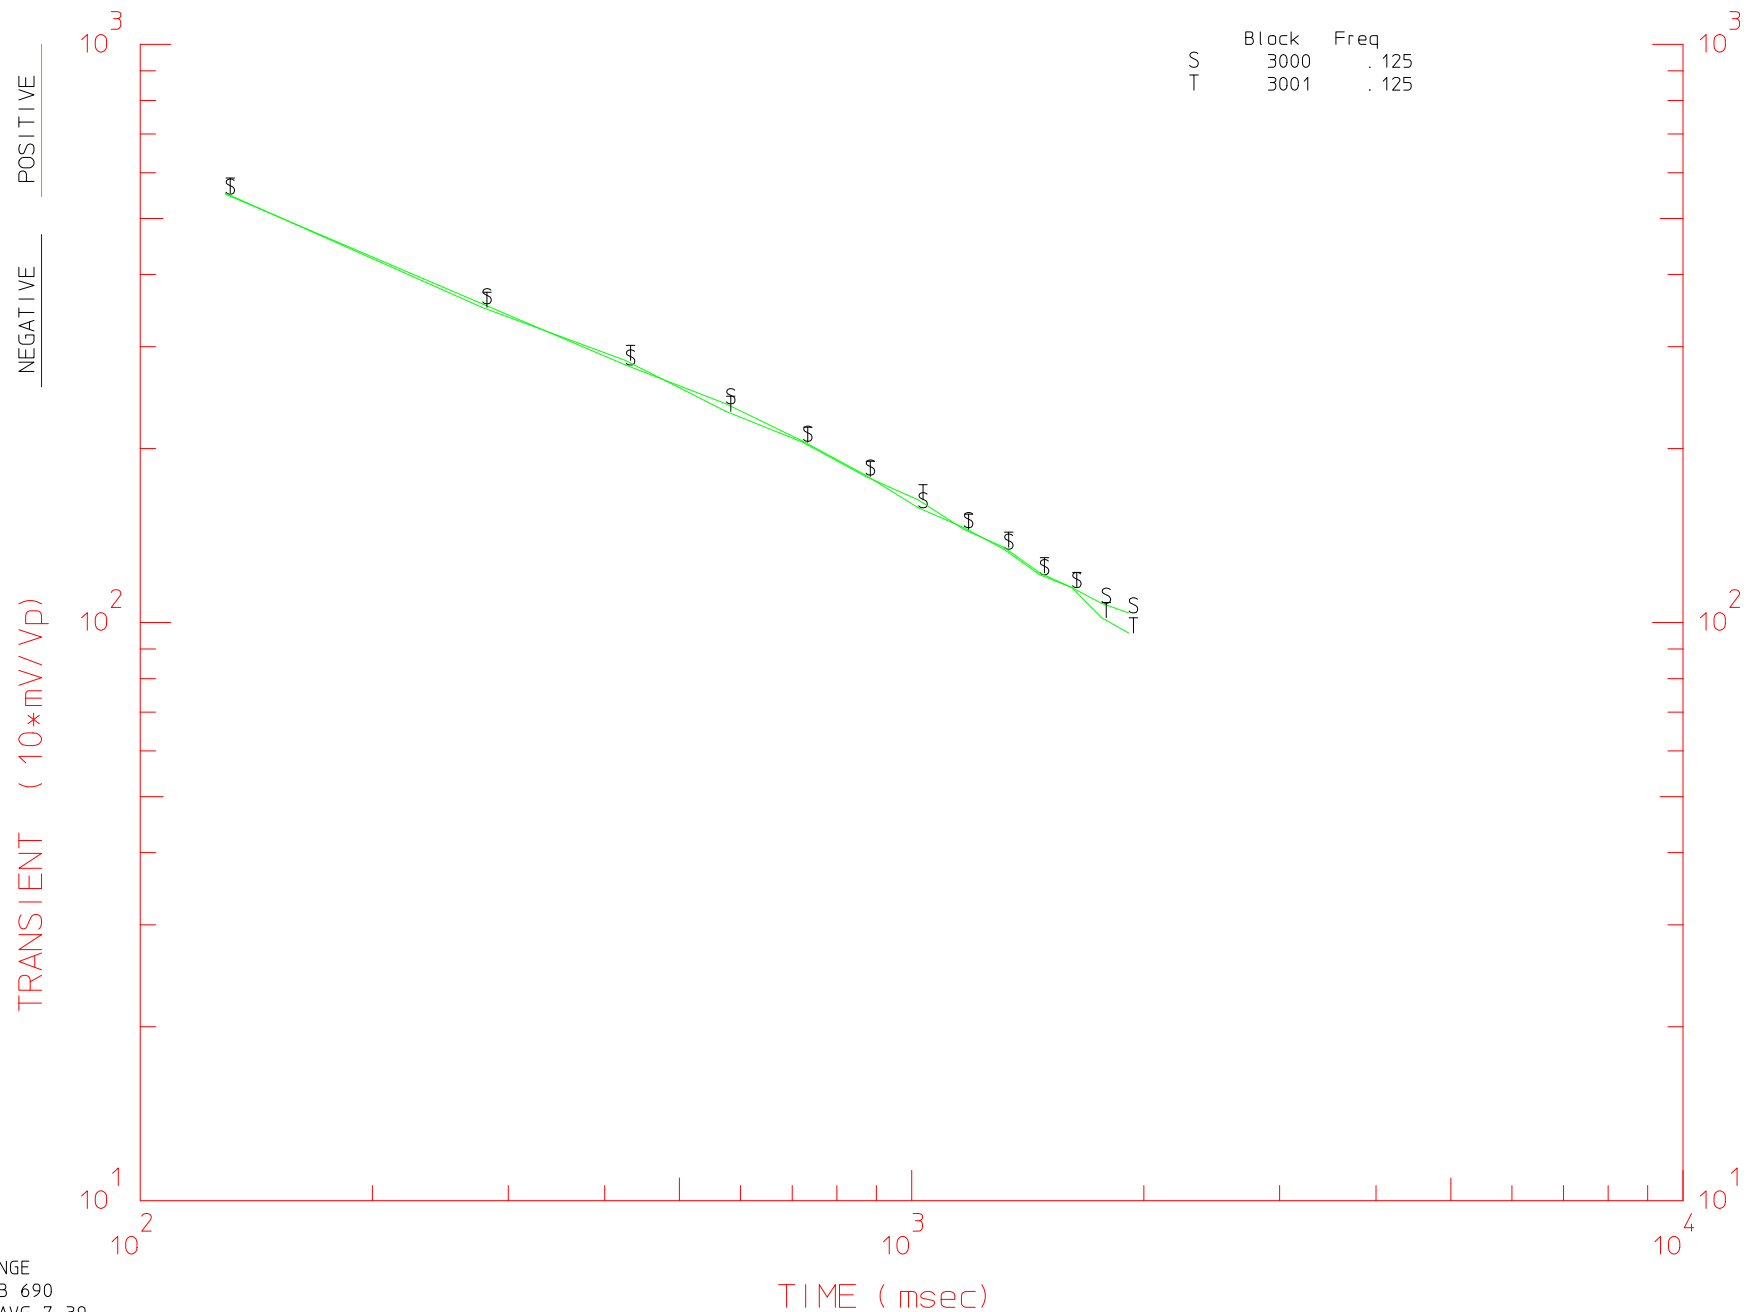

Mable Flats Grid16

Line= 15


TxLen= 7544. Line= 6103. Stn= -3.

	Block	Freq
U	3000	.125
V	3001	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

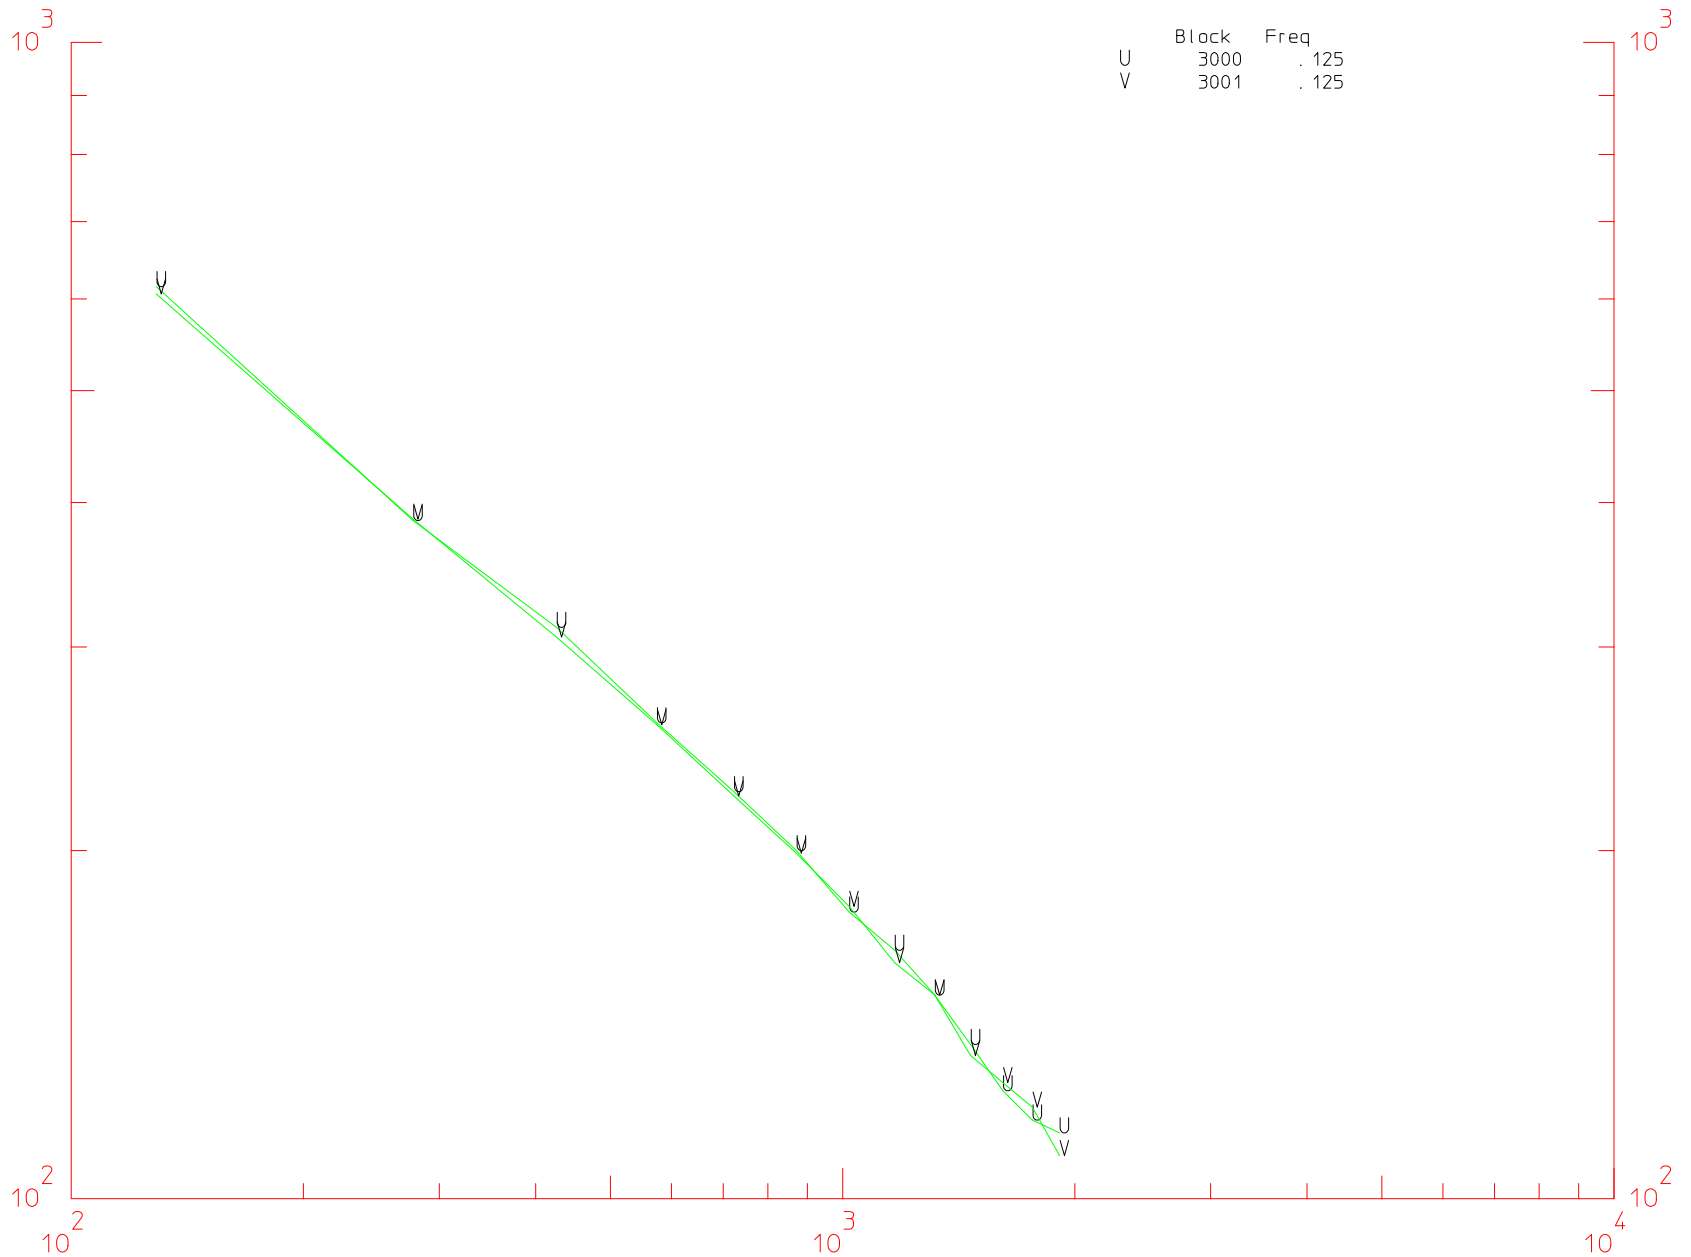

Mable Flats Grid16

Line= 15


TxLen= 7544. Line= 6078. Stn= -4.

	Block	Freq
W	3000	.125
X	3001	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

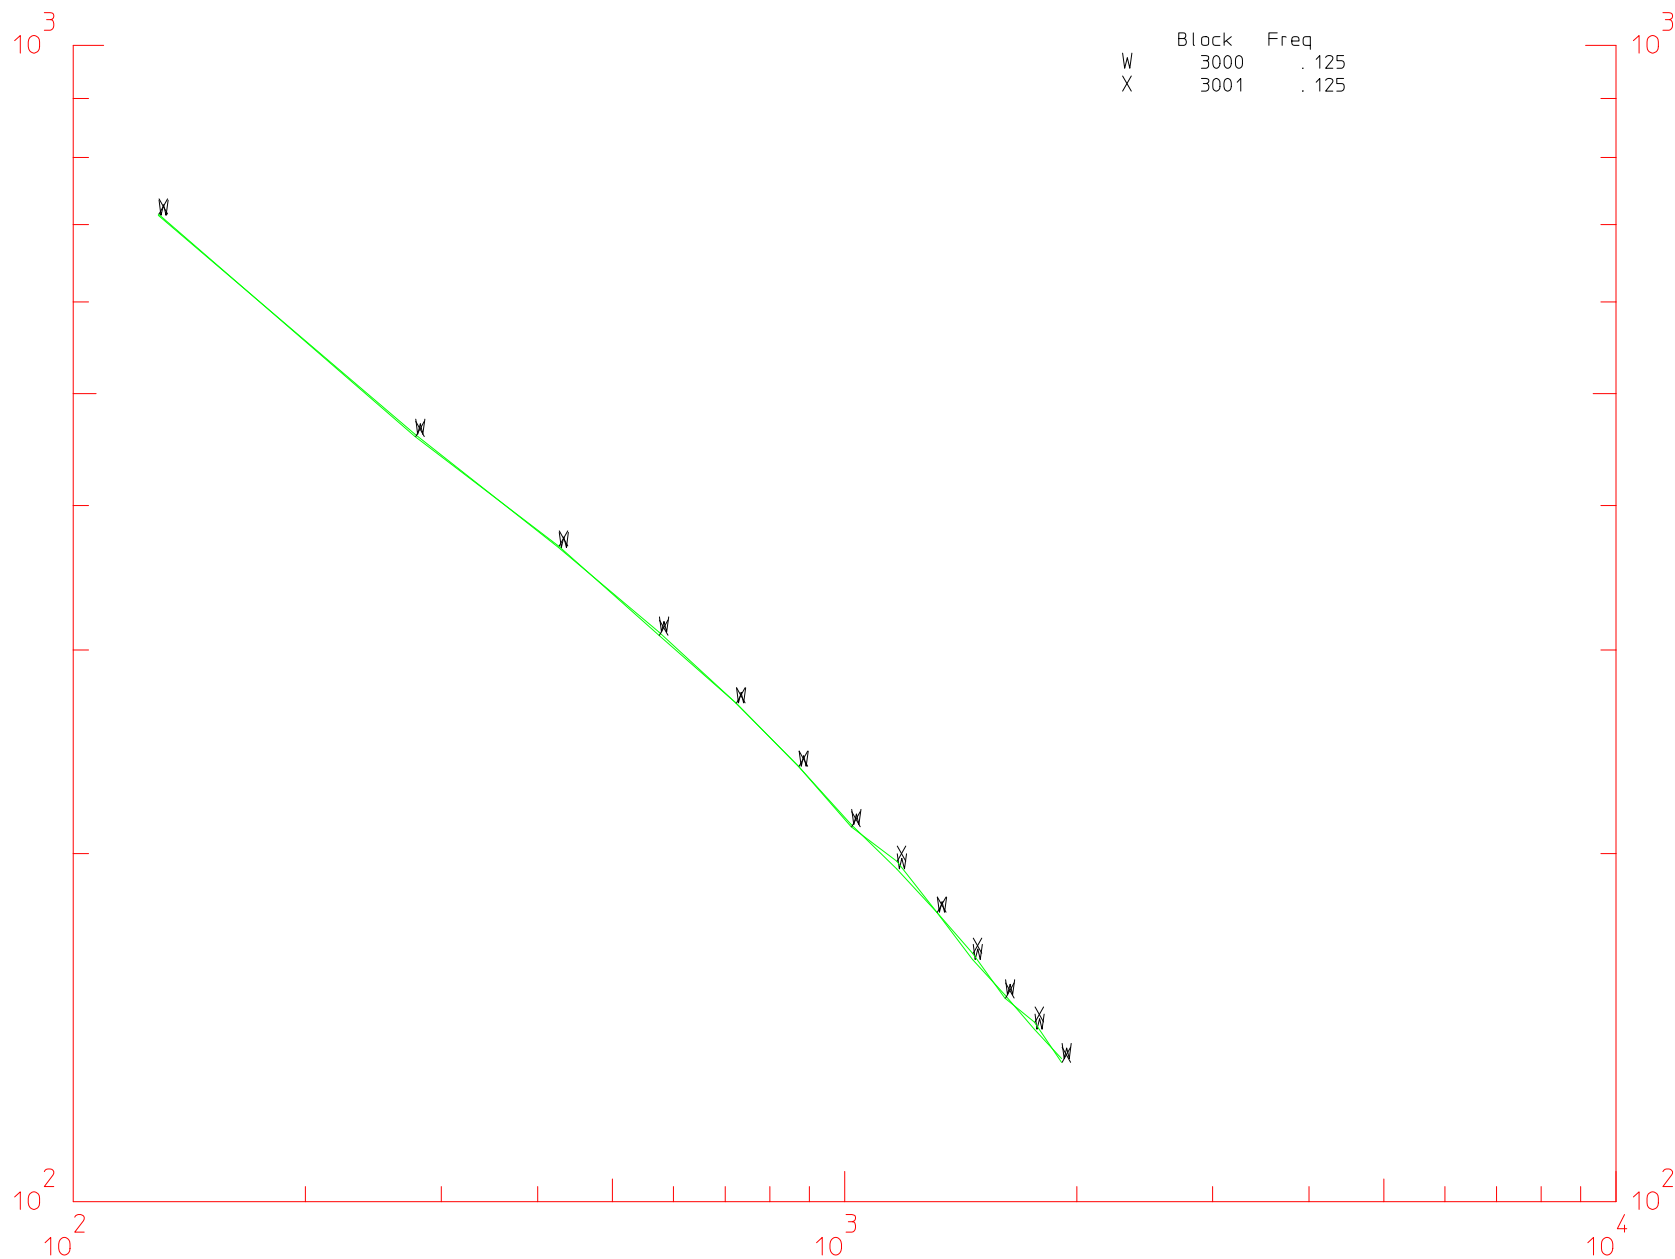

Mable Flats Grid16


Line= 15

TxLen= 7544. Line= 6253. Stn= -1.

	Block	Freq
Y	3002	.125
Z	3003	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

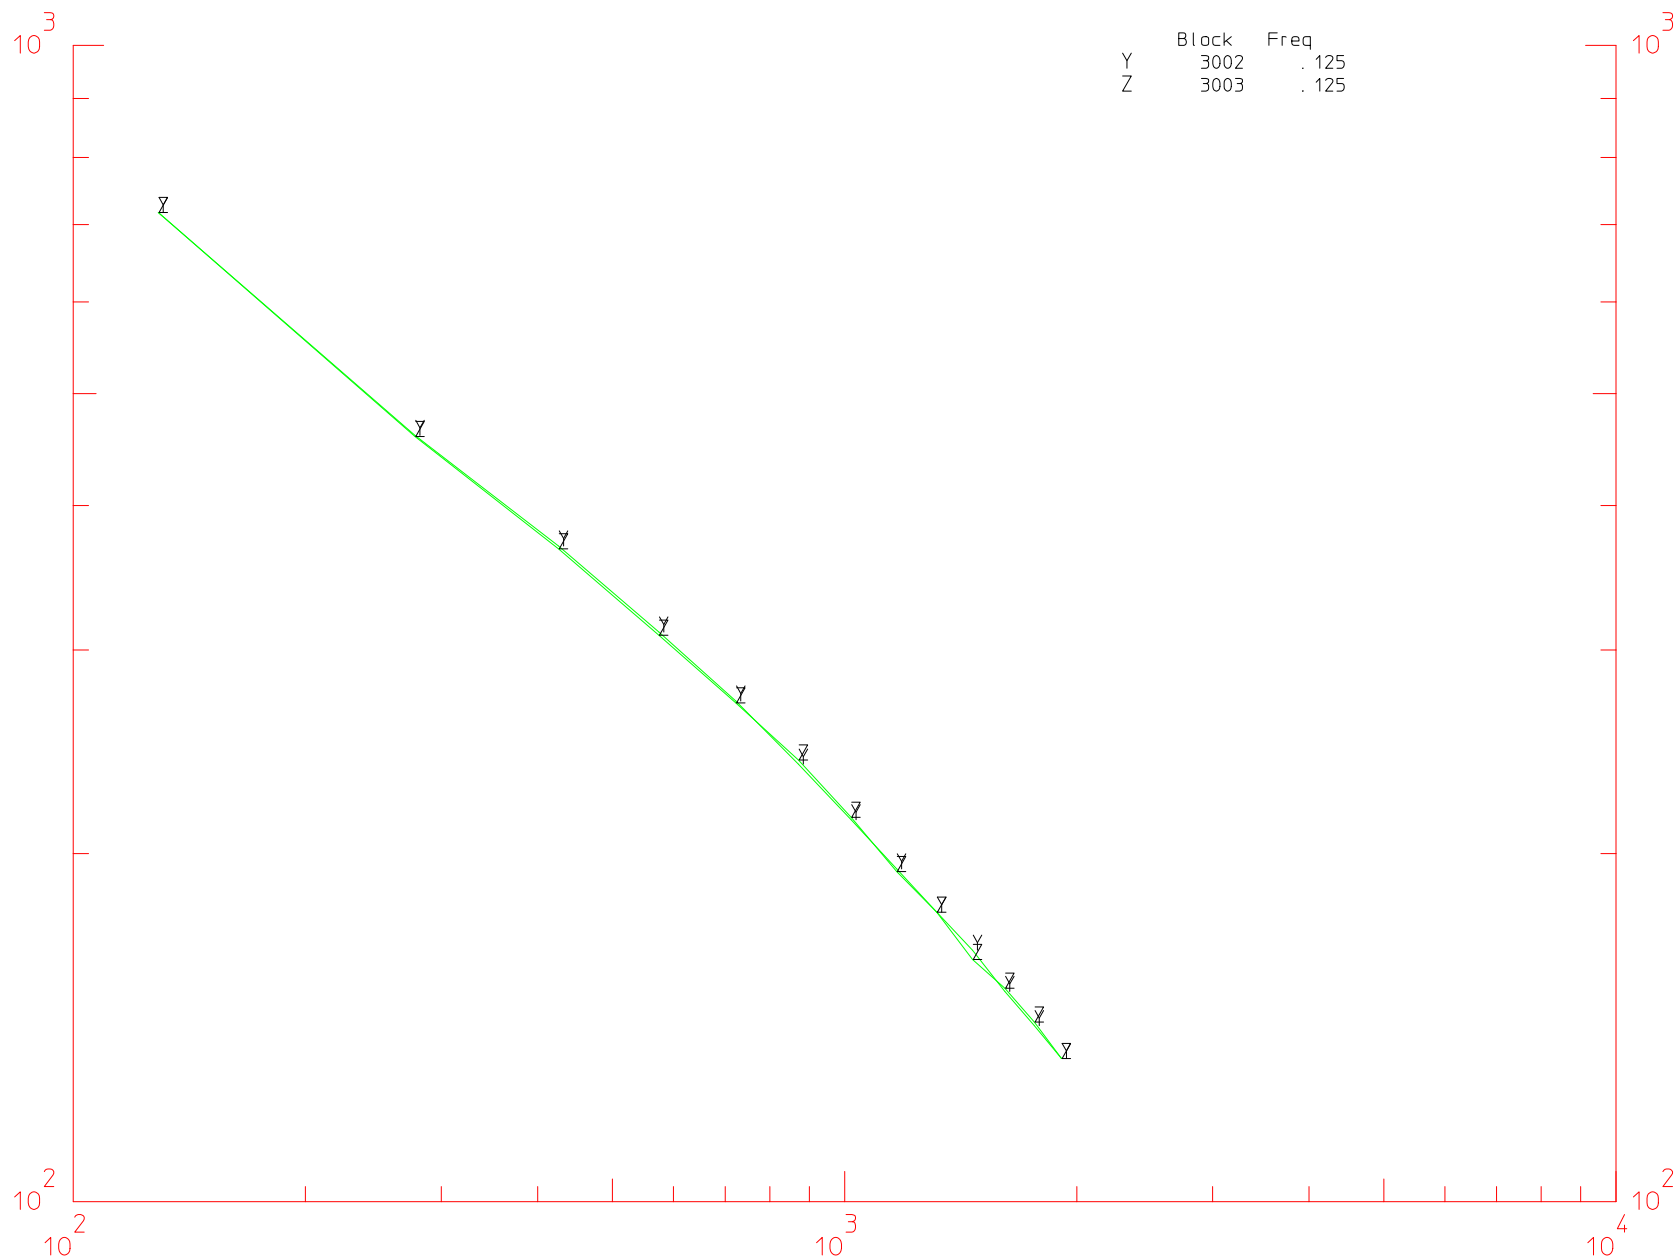

Mable Flats Grid16

Line= 15


TxLen= 7544. Line= 6228. Stn= -2.

	Block	Freq
A	3002	.125
B	3003	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

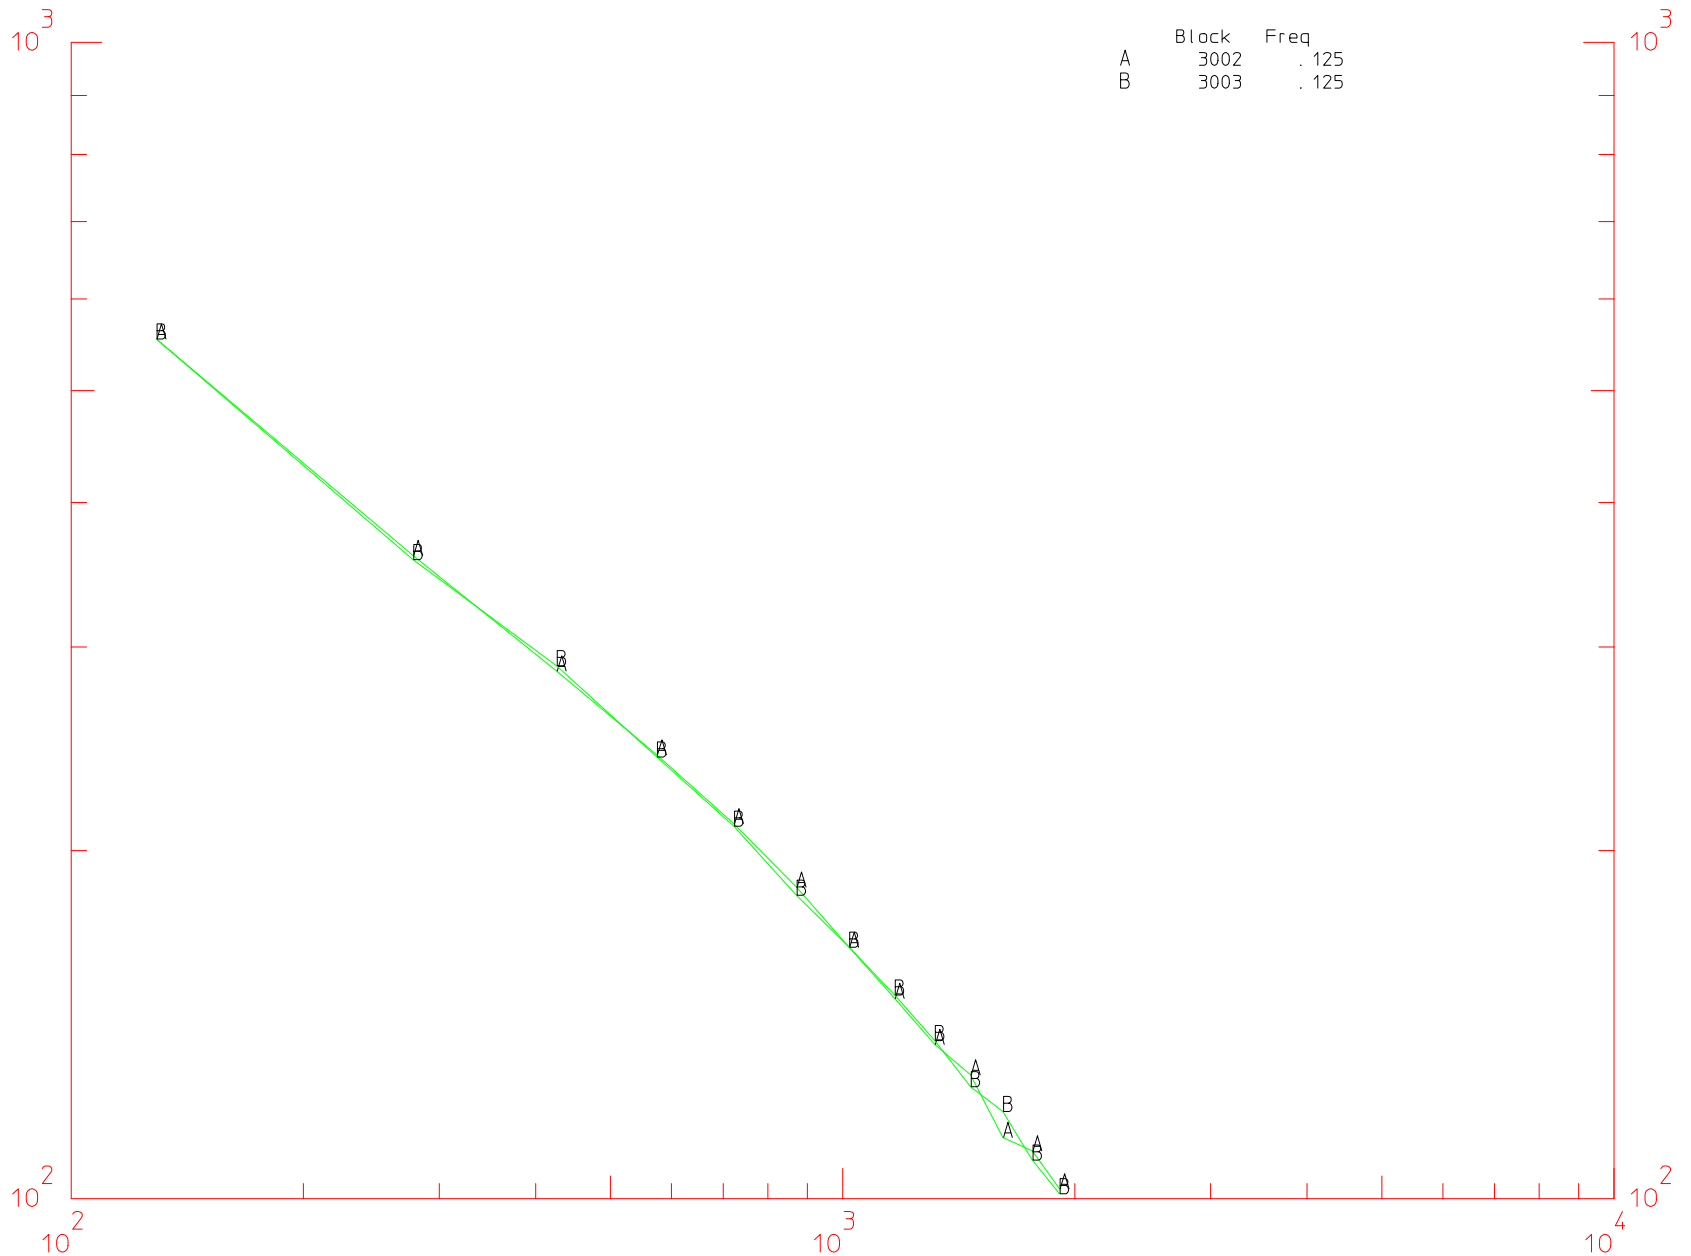


Mable Flats Grid16

Line= 15

TxLen= 7544. Line= 6203. Stn= -3.

	Block	Freq
C	3002	.125
D	3003	.125

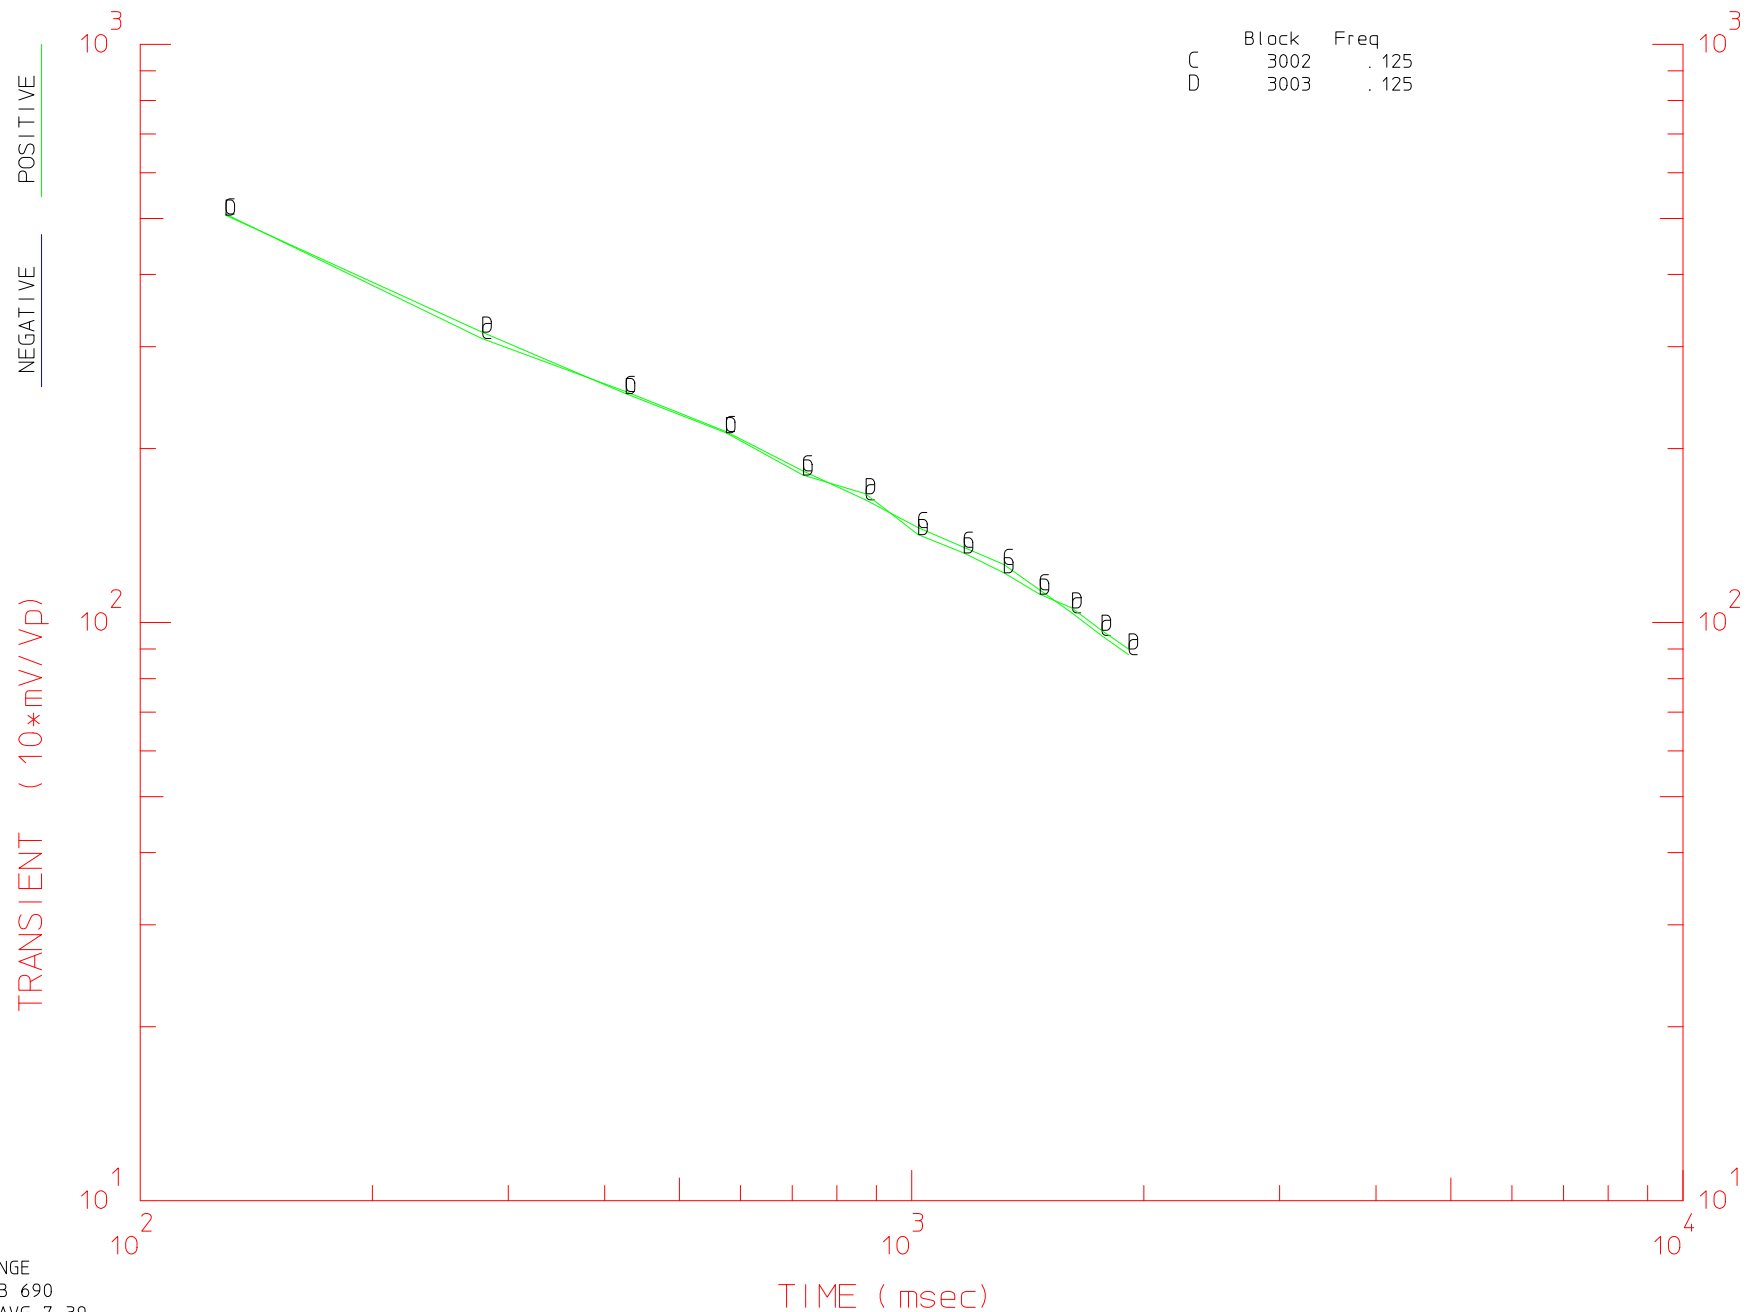


Mable Flats Grid16

Line= 15

TxLen= 7544. Line= 6178. Stn= -4.

	Block	Freq
E	3002	.125
F	3003	.125

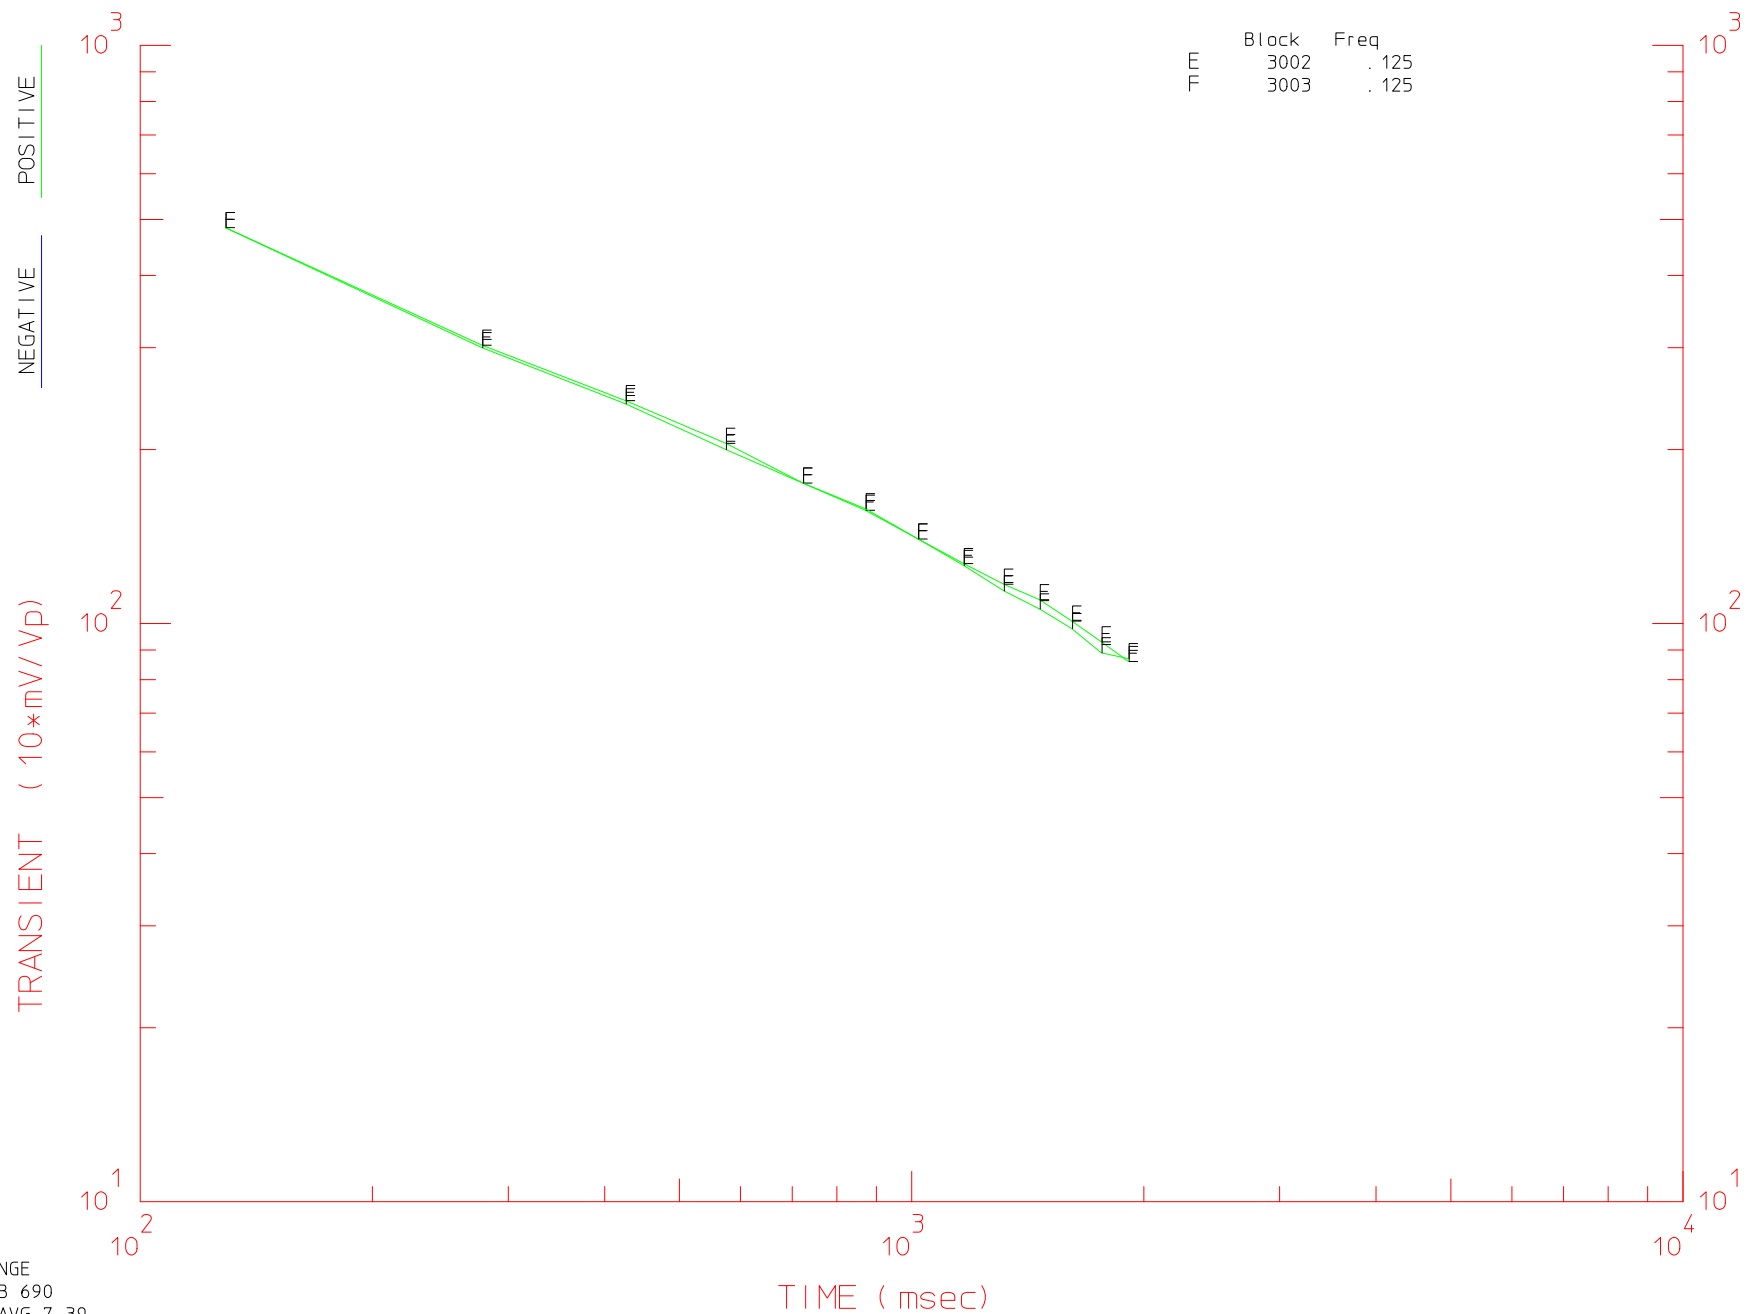


Mable Flats Grid16

Line= 15

TxLen= 7544. Line= 6353. Stn= -1.

	Block	Freq
G	3004	.125
H	3005	.125

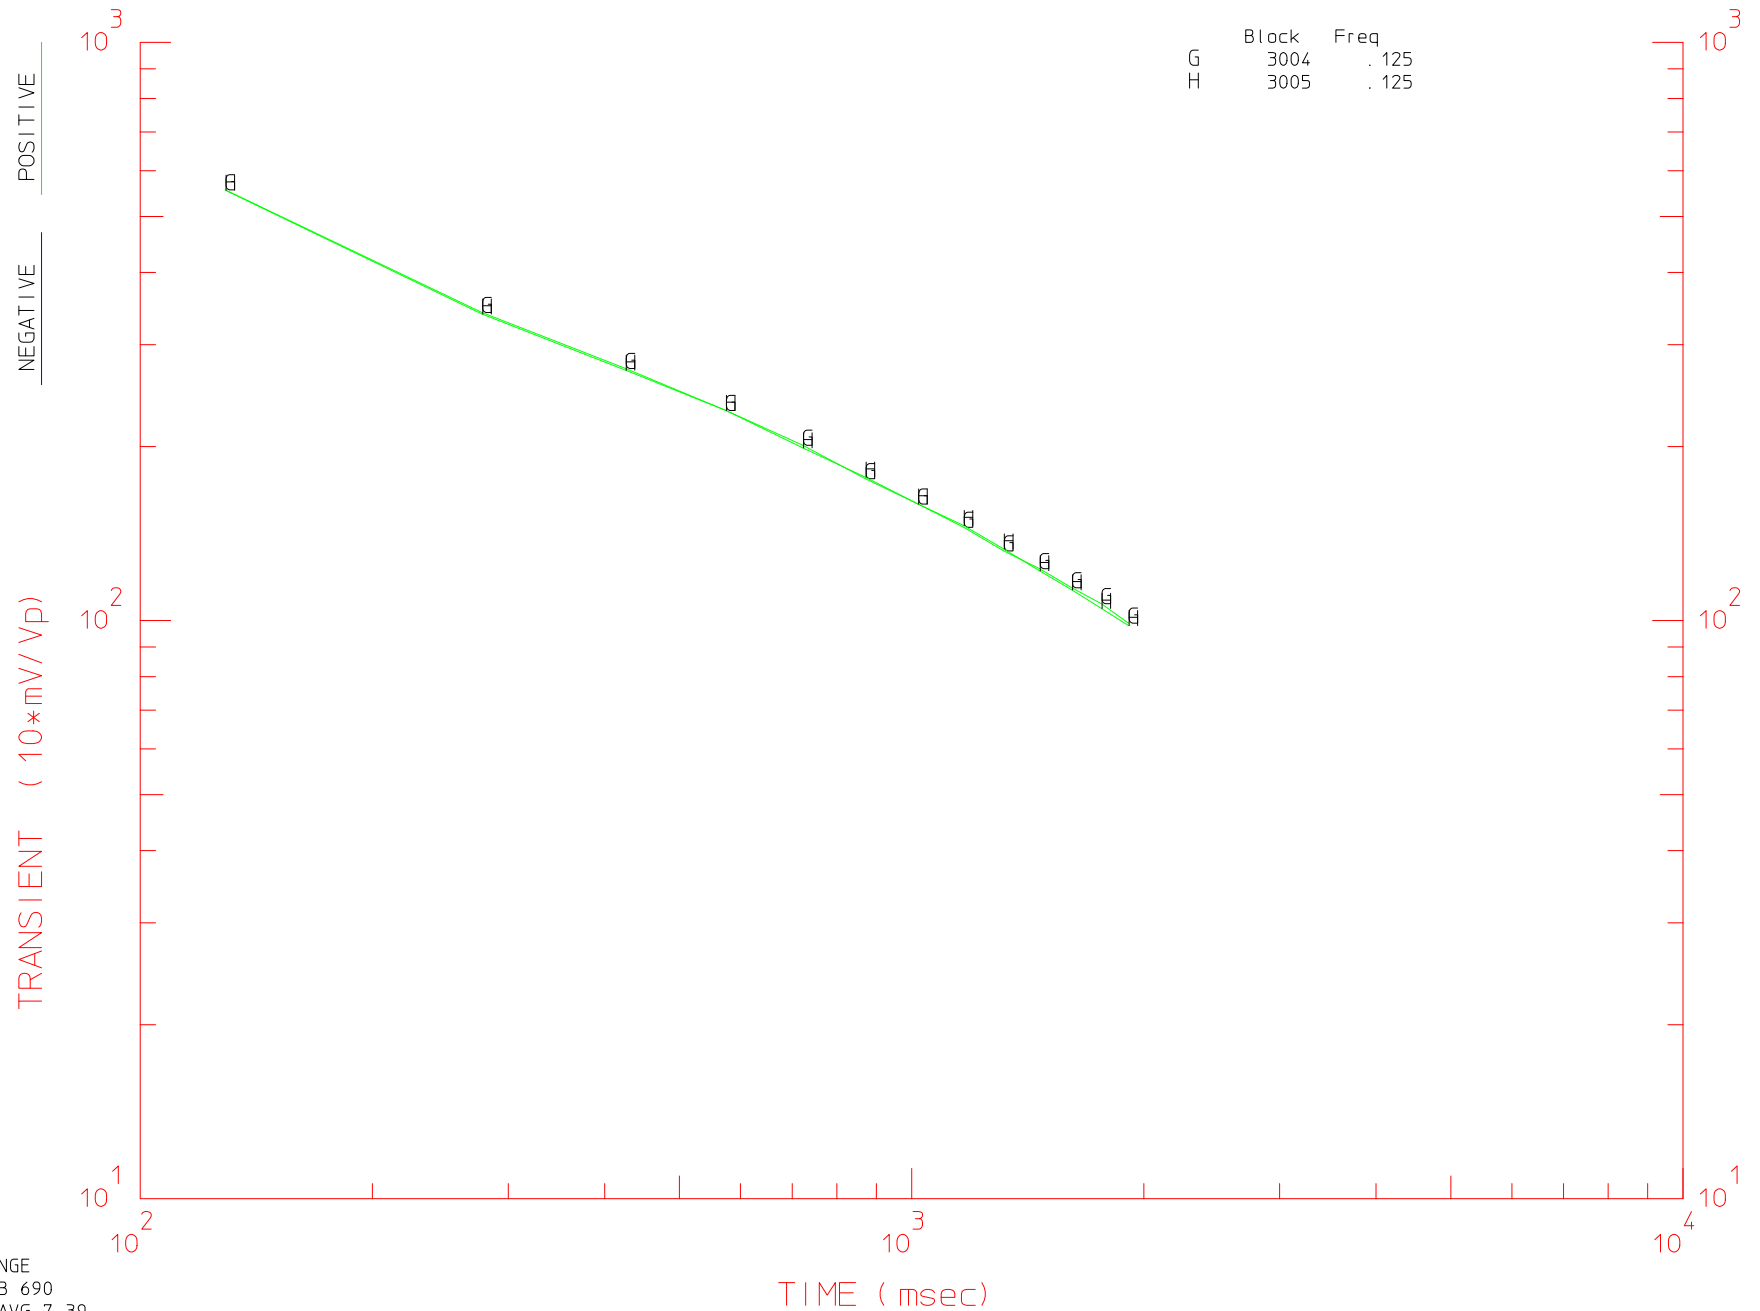

Mable Flats Grid16


Line= 15

TxLen= 7544. Line= 6328. Stn= -2.

	Block	Freq
I	3004	.125
J	3005	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

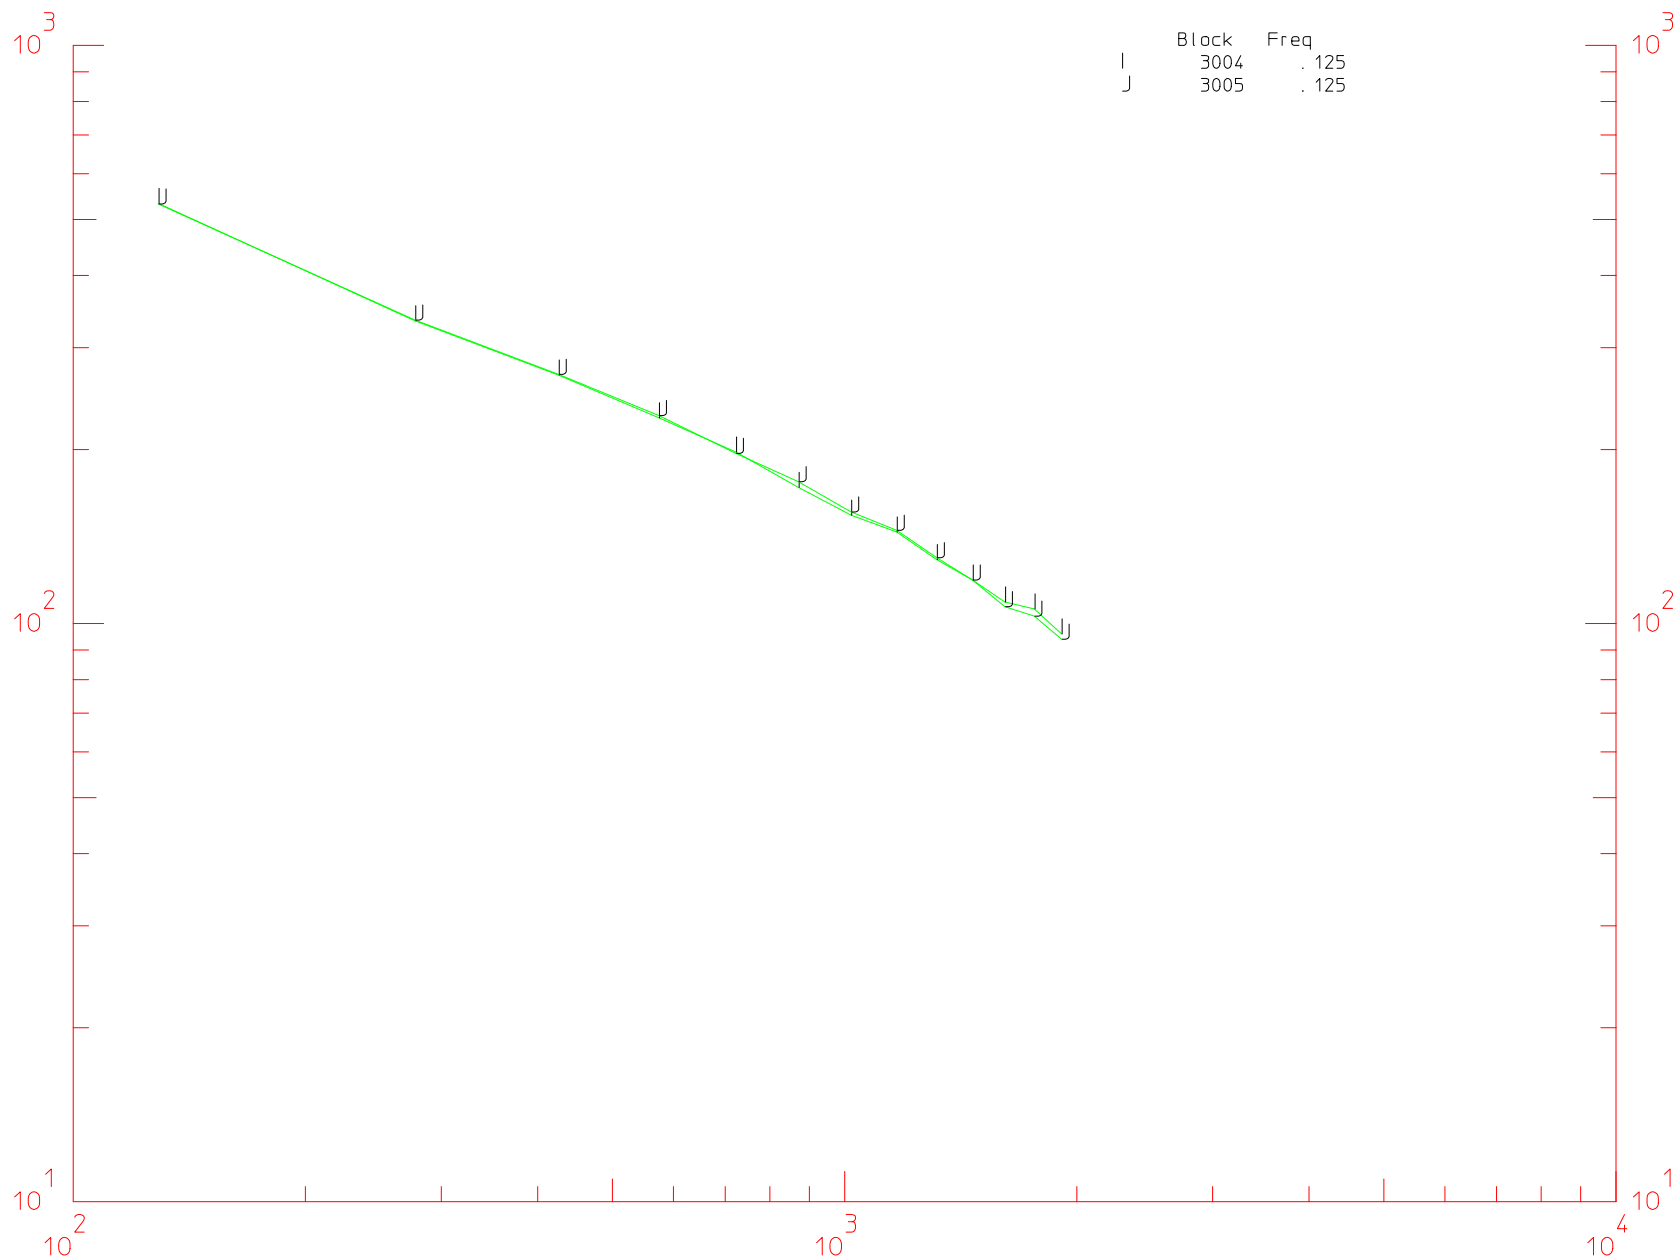


Mable Flats Grid16

Line= 15

TxLen= 7544. Line= 6303. Stn= -3.

	Block	Freq
K	3004	.125
L	3005	.125

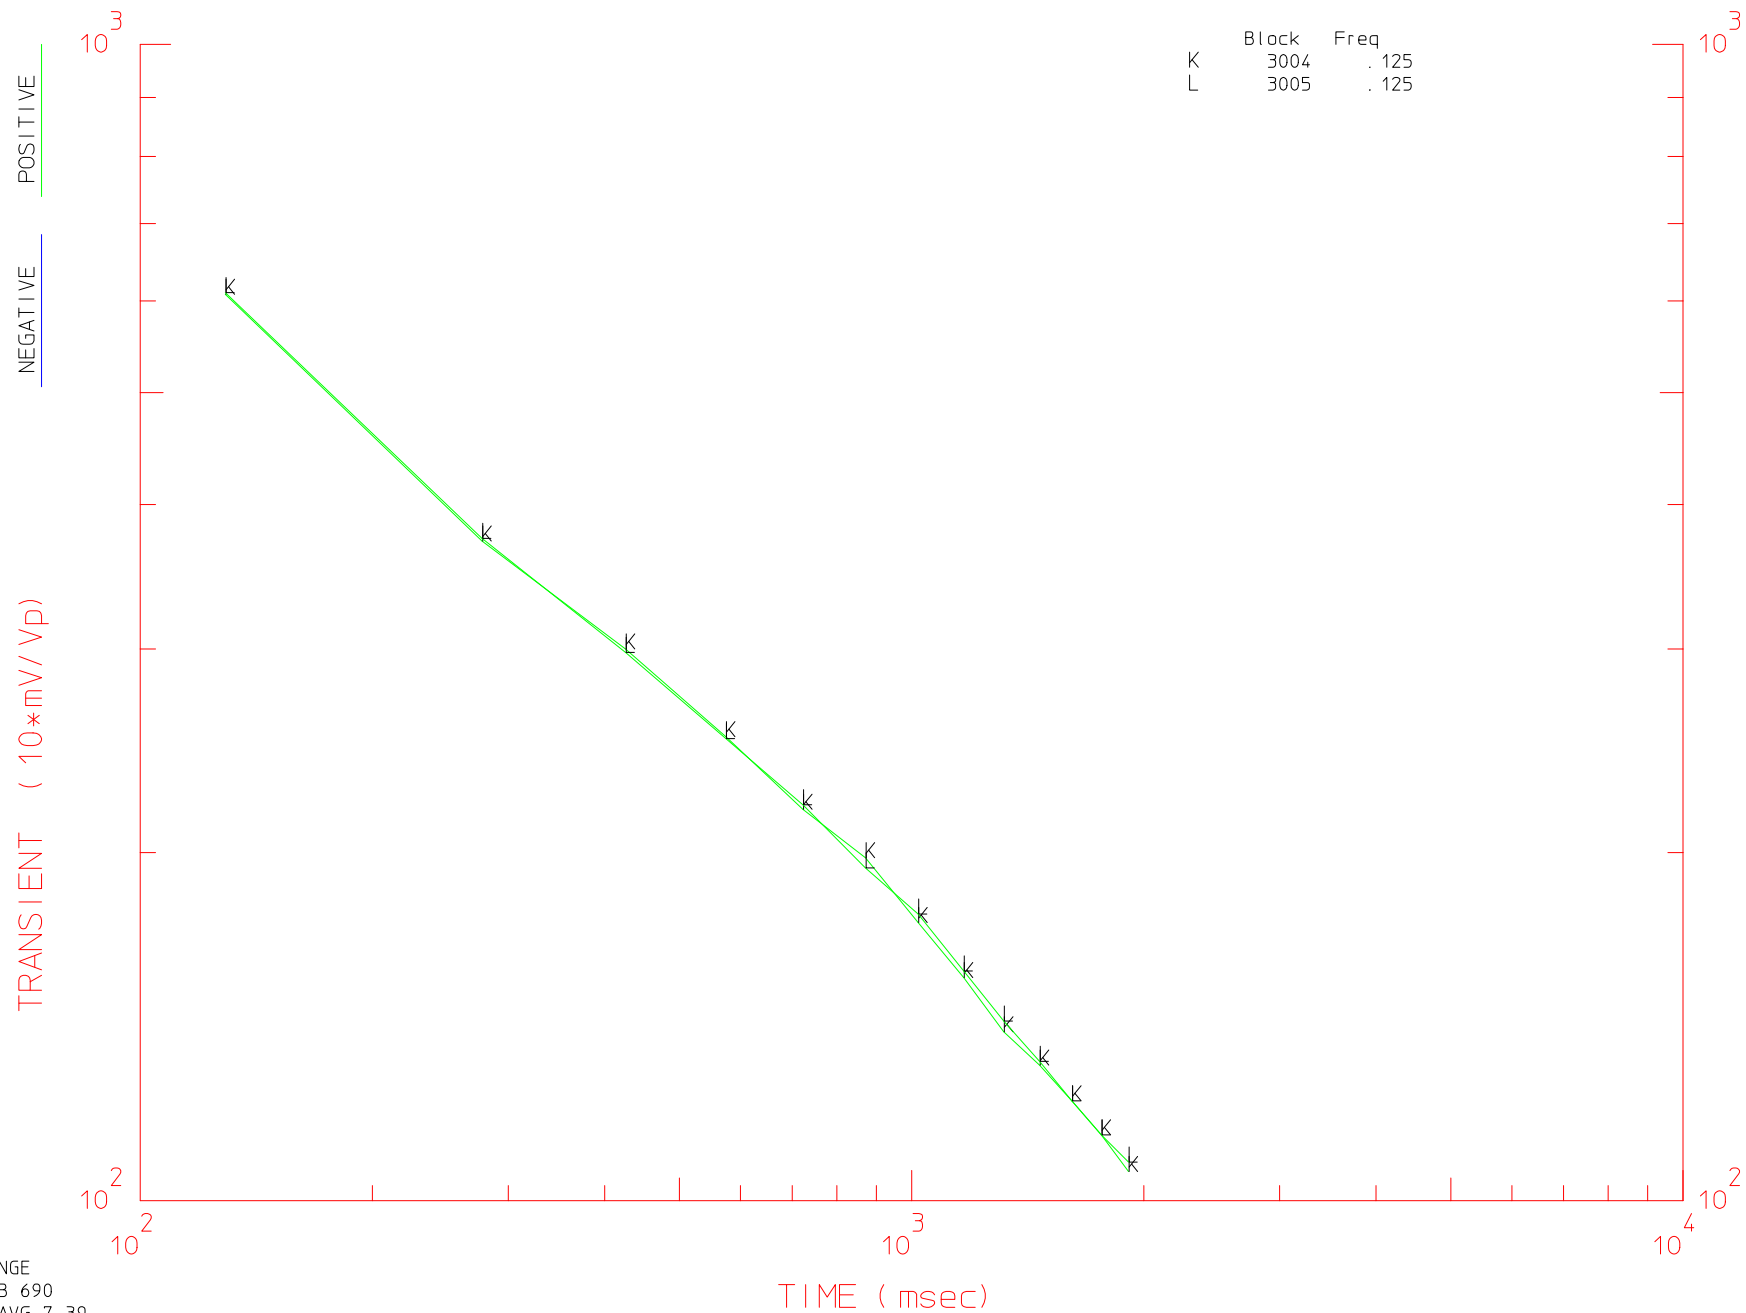

Mable Flats Grid16


Line= 15

TxLen= 7544. Line= 6278. Stn= -4.

	Block	Freq
M	3004	.125
N	3005	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

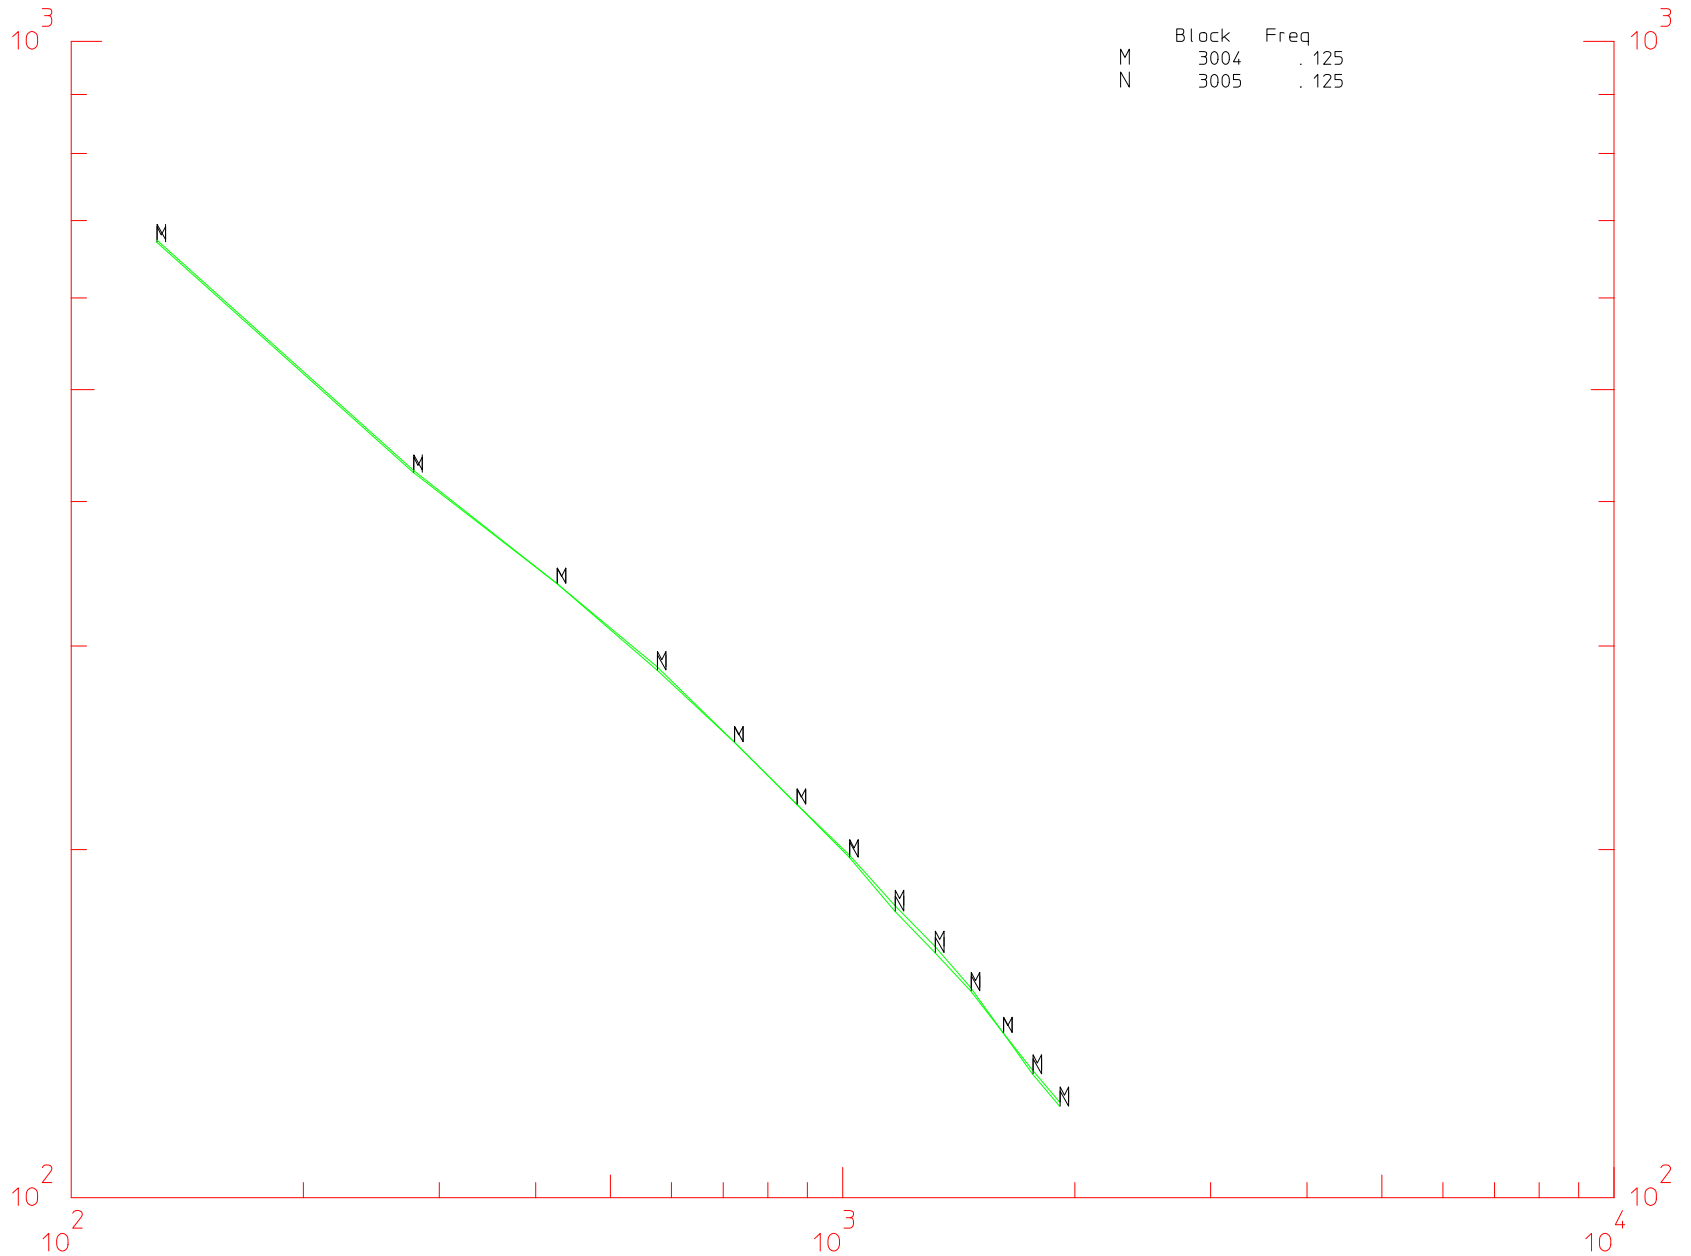

Mable Flats Grid16

Line= 15


TxLen= 7544. Line= 6453. Stn= -1.

	Block	Freq
O	3006	.125
P	3007	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

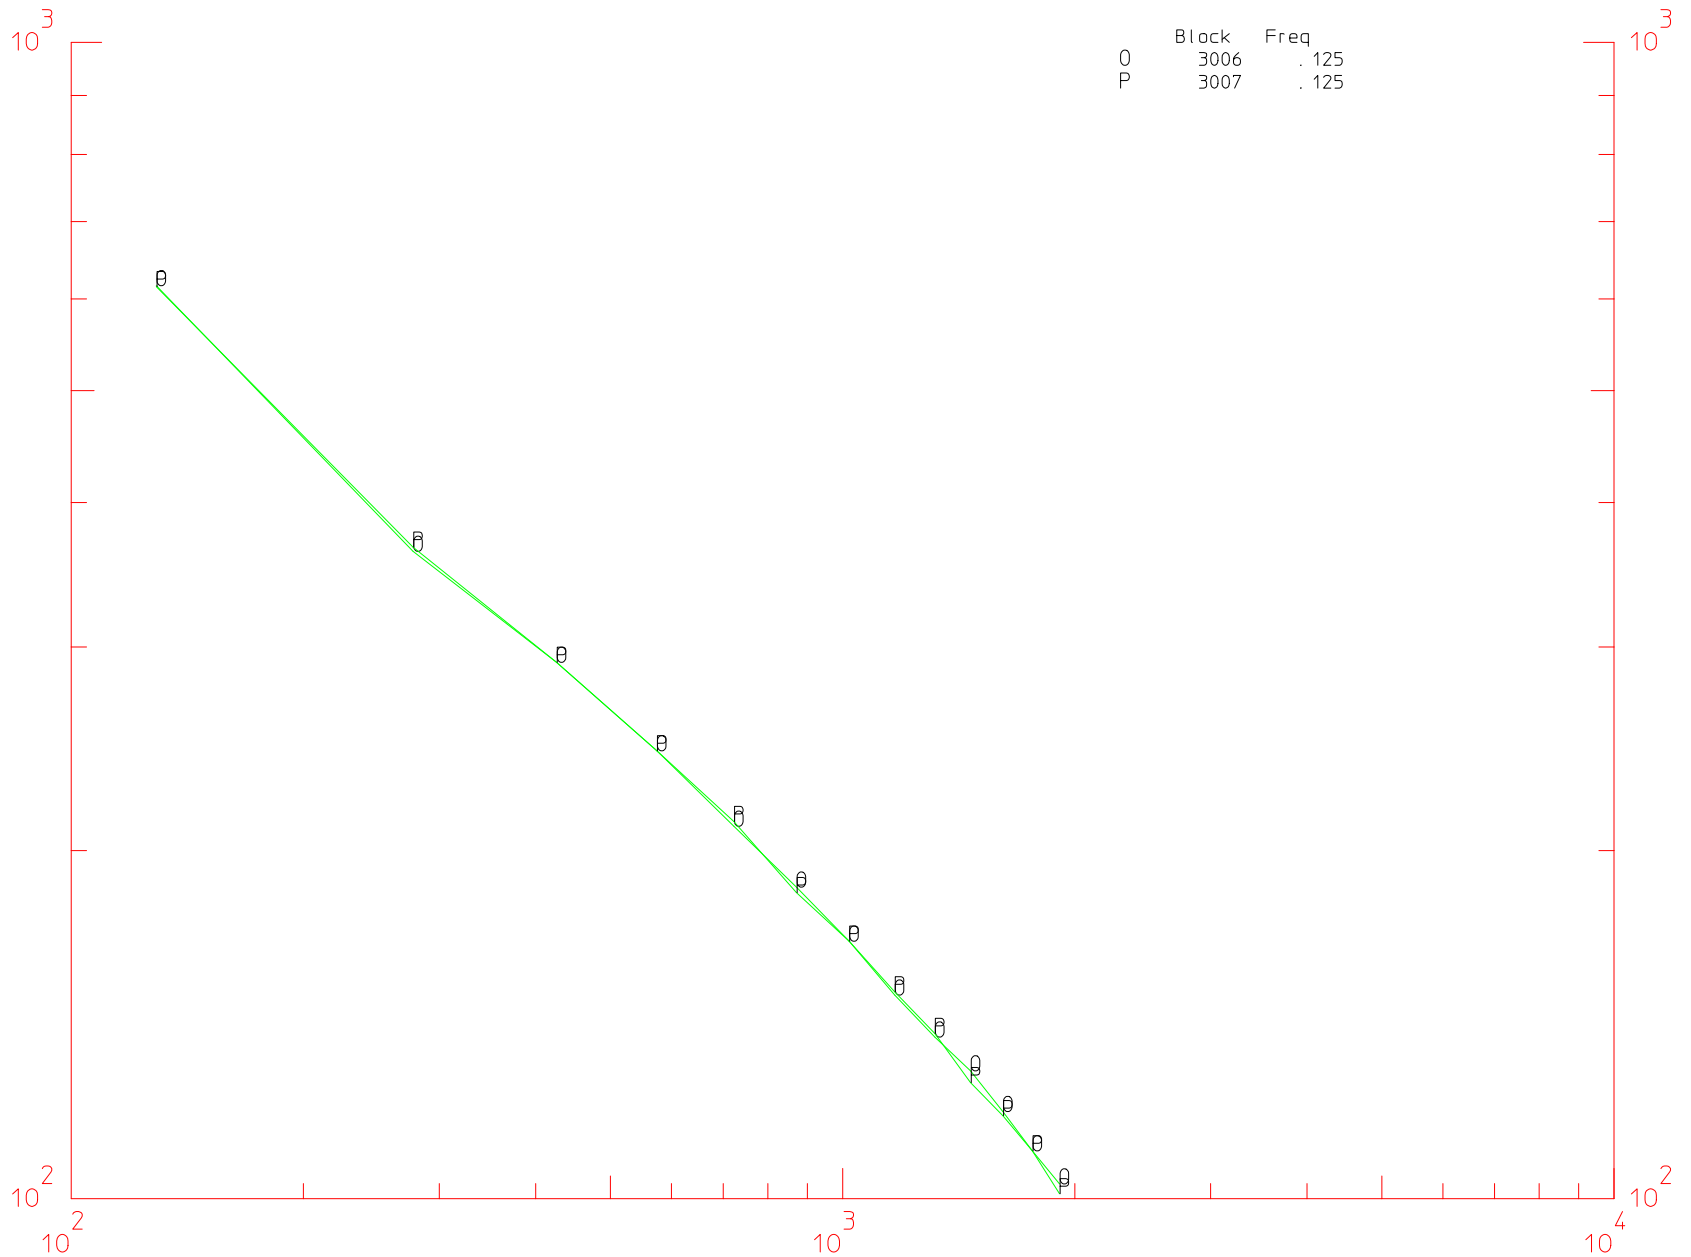

Mable Flats Grid16


Line= 15

TxLen= 7544. Line= 6428. Stn= -2.

	Block	Freq
Q	3006	.125
R	3007	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

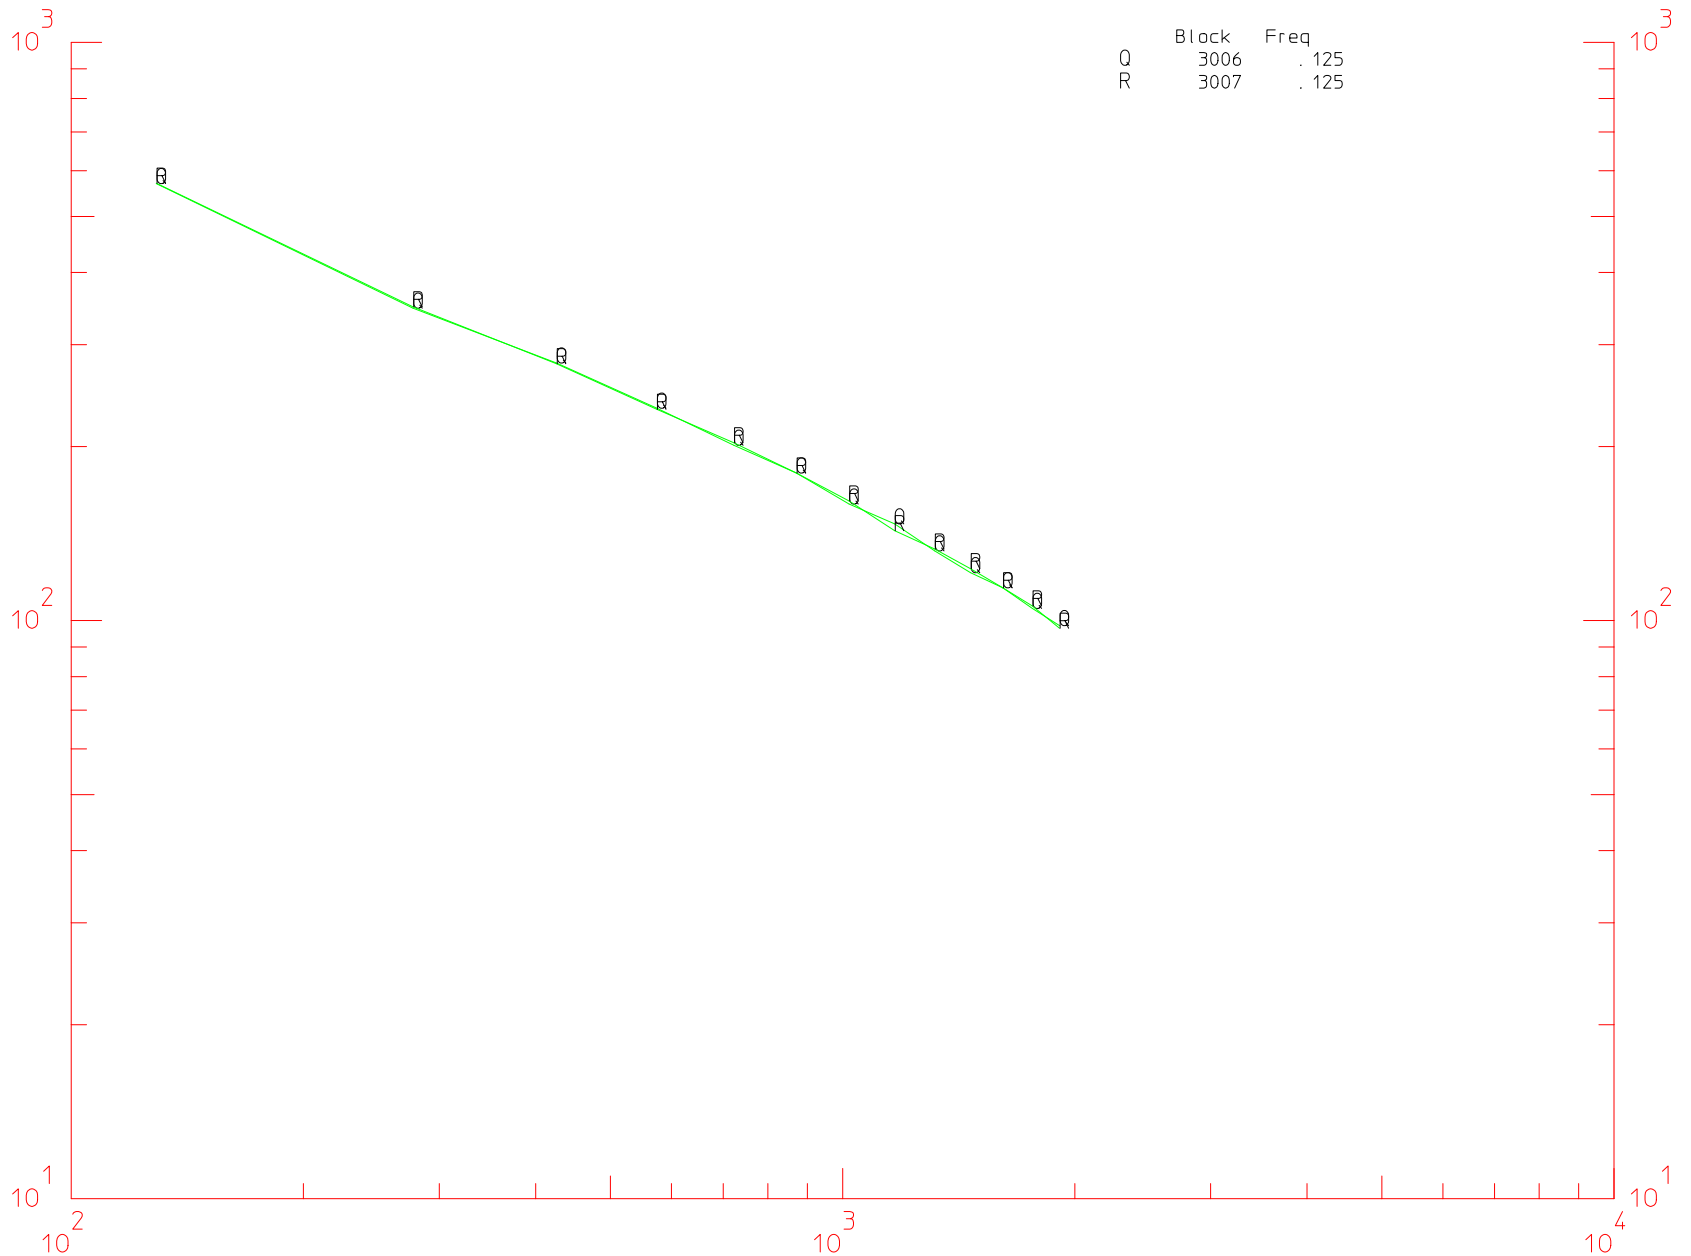

Mable Flats Grid16

Line= 15


TxLen= 7544. Line= 6403. Stn= -3.

	Block	Freq
S	3006	.125
T	3007	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

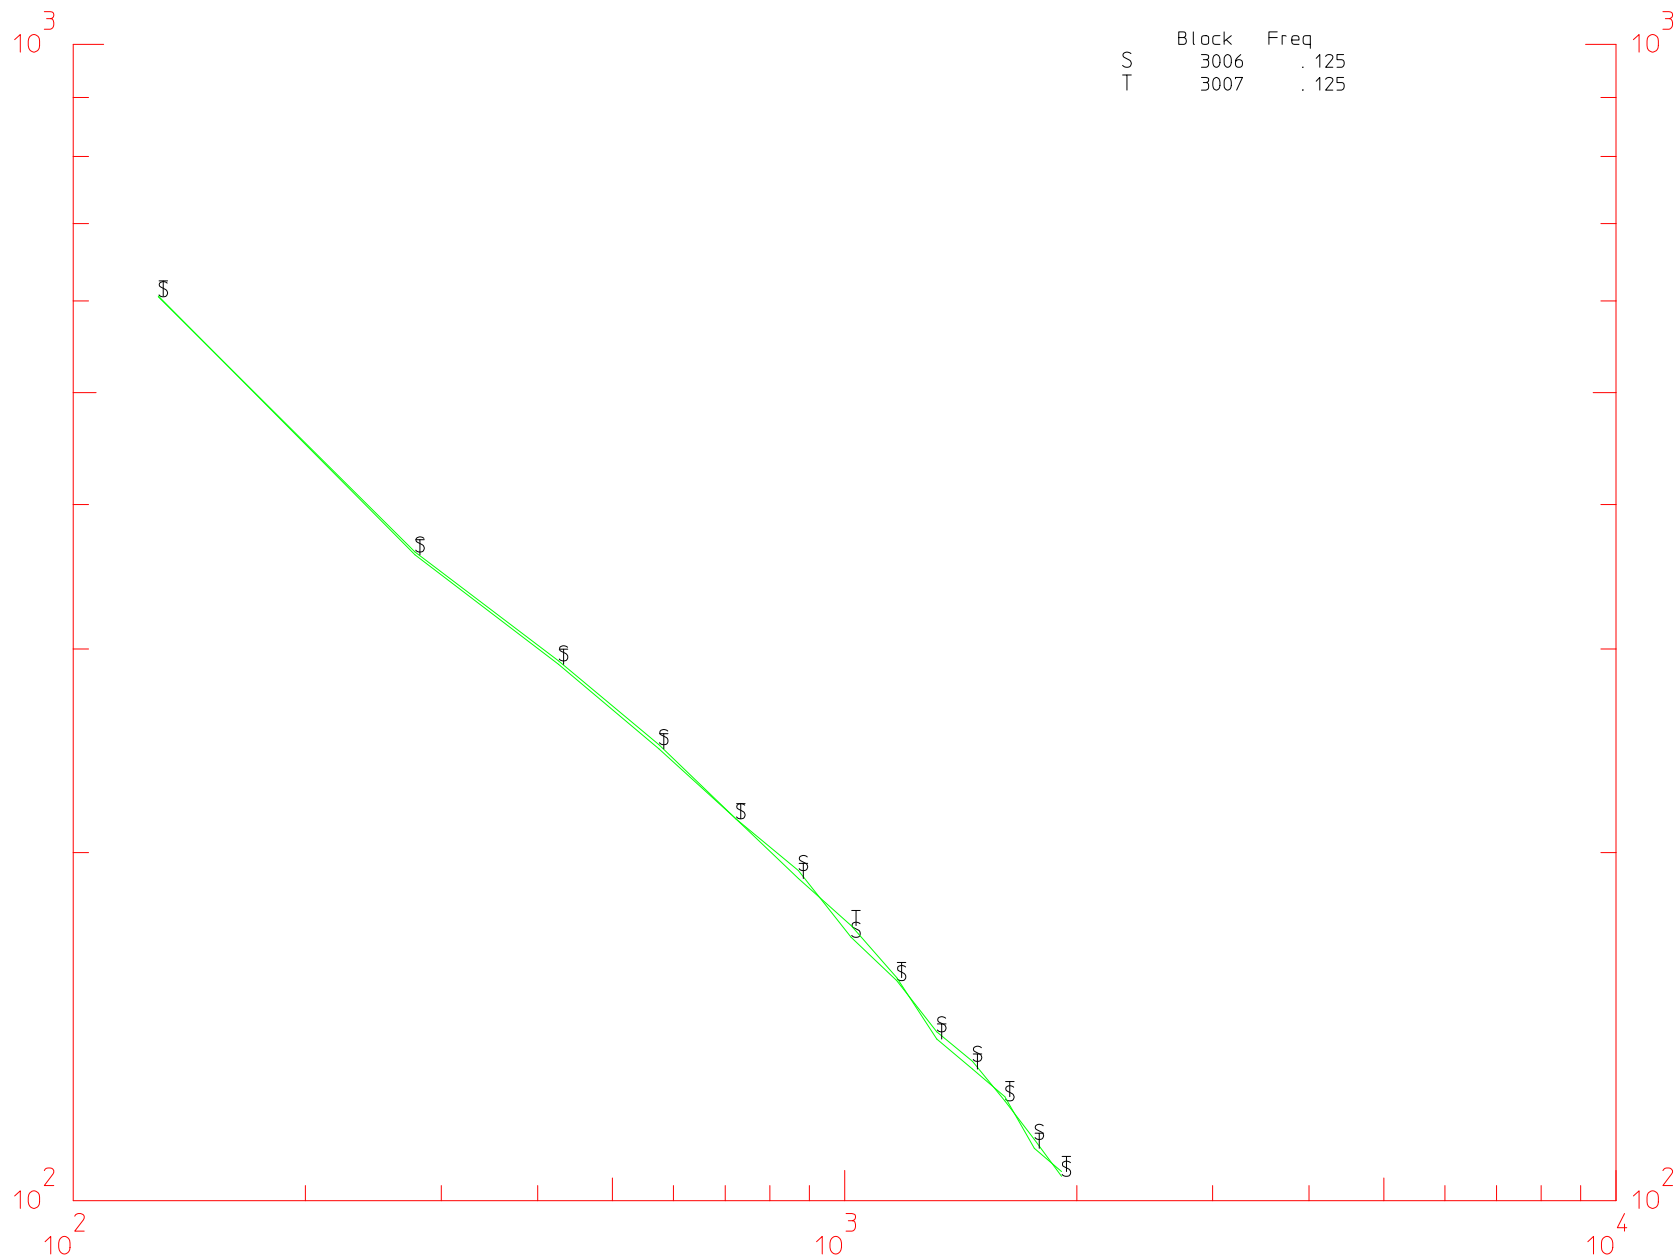

Mable Flats Grid16

Line= 15

TxLen= 7544. Line= 6378. Stn= -4.

	Block	Freq
U	3006	.125
V	3007	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

