


Mable Flats Grid19

Line= 2000N

TxLen= 2000. Line= 5087. Stn= -1.

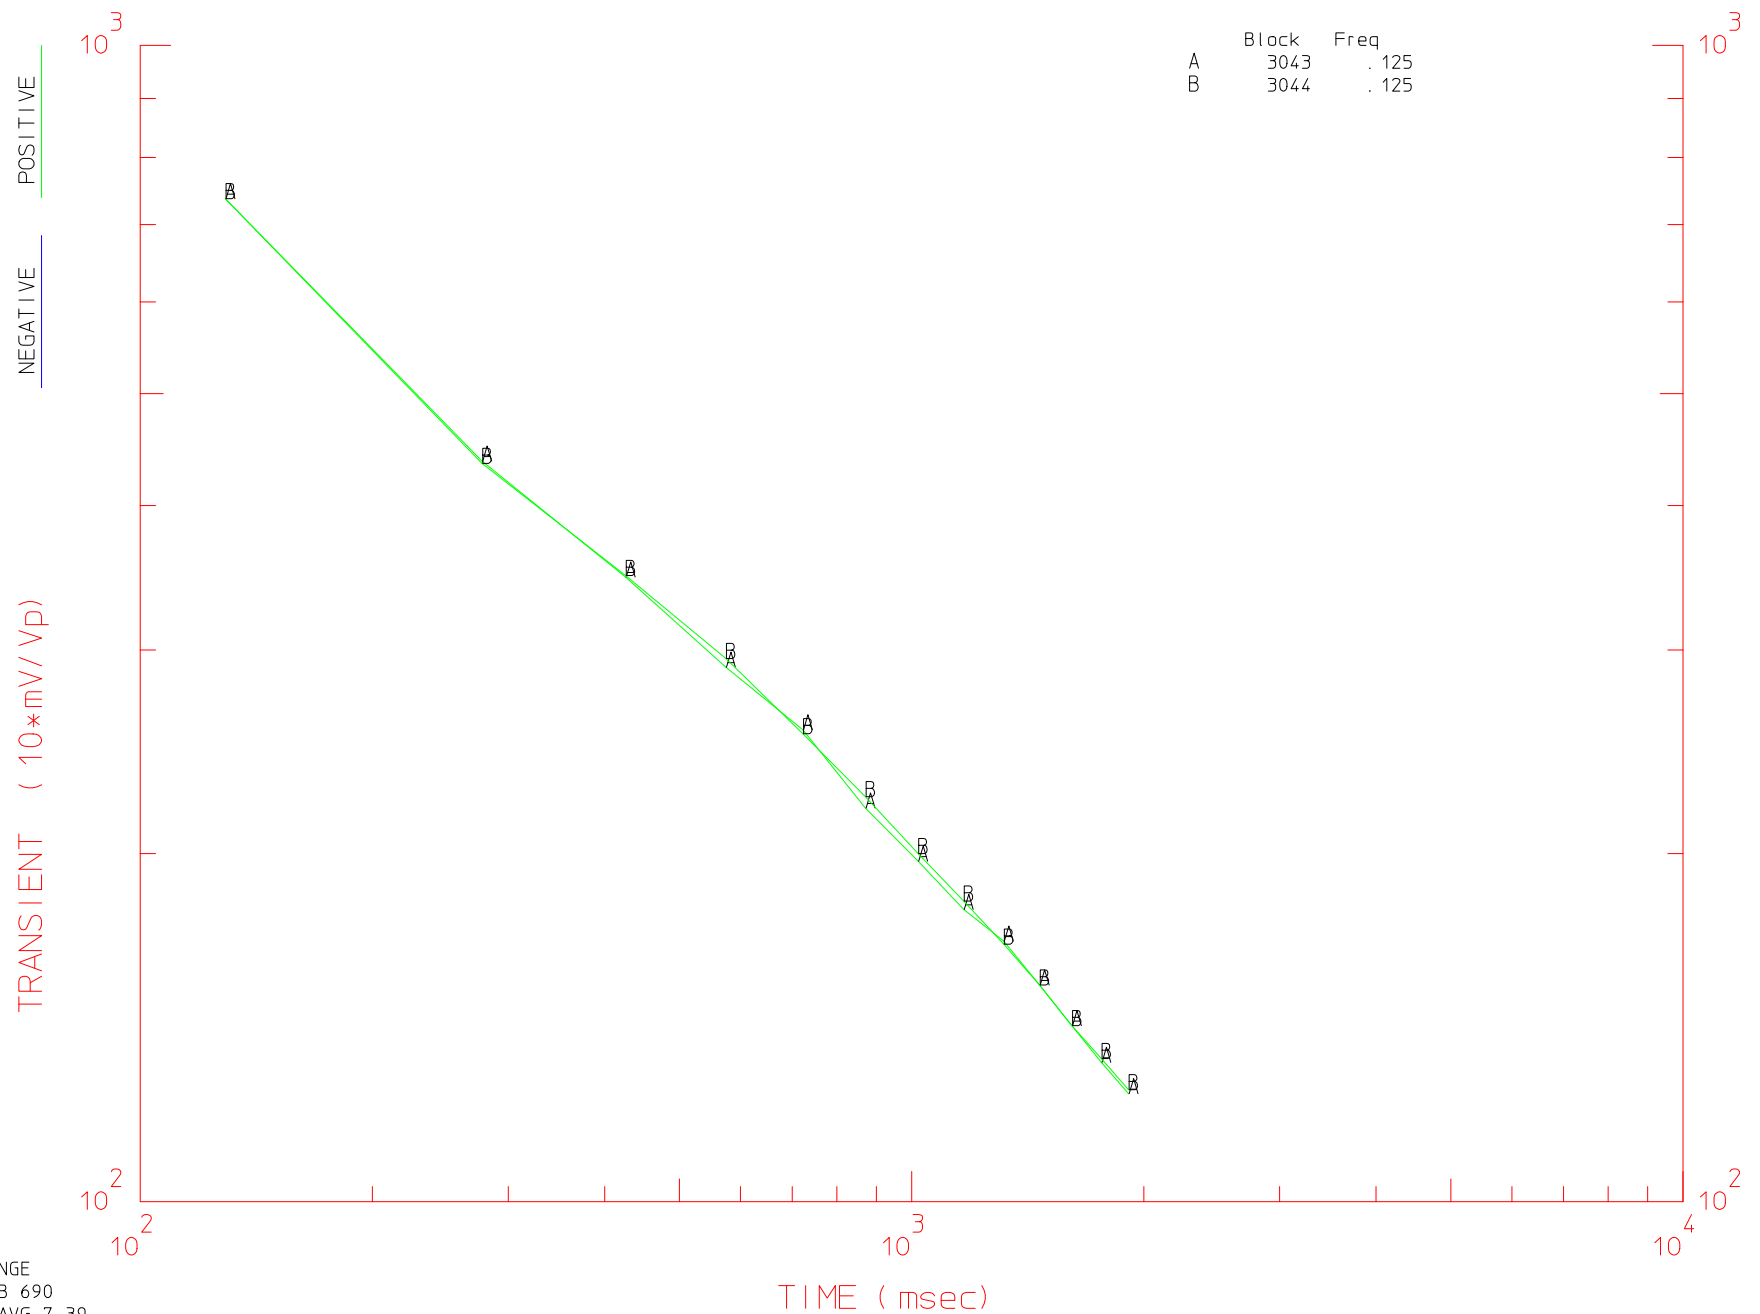

Mable Flats Grid19

Line= 2000N


TxLen= 2000. Line= 5062. Stn= -2.

	Block	Freq
C	3043	.125
D	3044	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

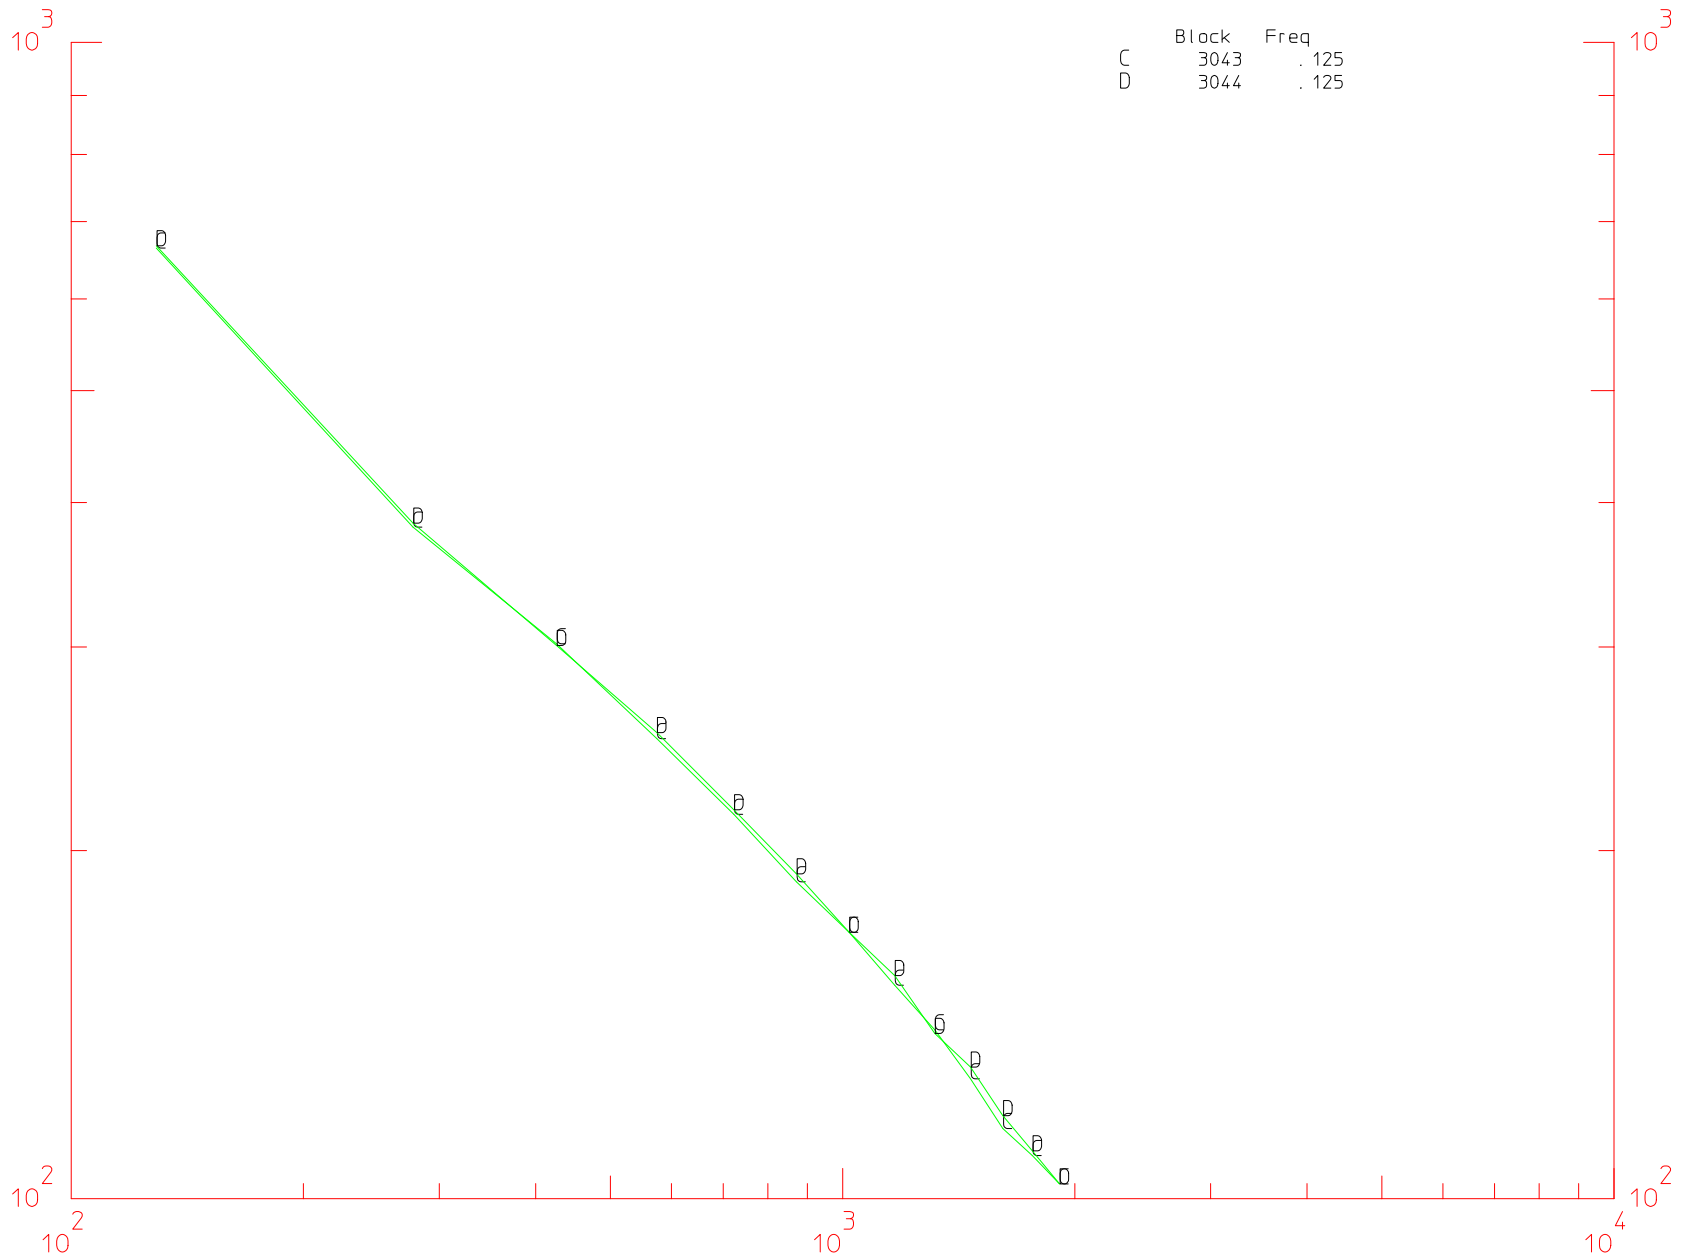

TxLen= 2000. Line= 5037. Stn= -3.

	Block	Freq
E	3043	.125
F	3044	.125

Mable Flats Grid19

Line= 2000N


TxLen= 2000. Line= 5012. Stn= -4.

	Block	Freq
G	3043	.125
H	3044	.125

POSITIVE

NEGATIVE


TRANSIENT (10*mV/Vp)

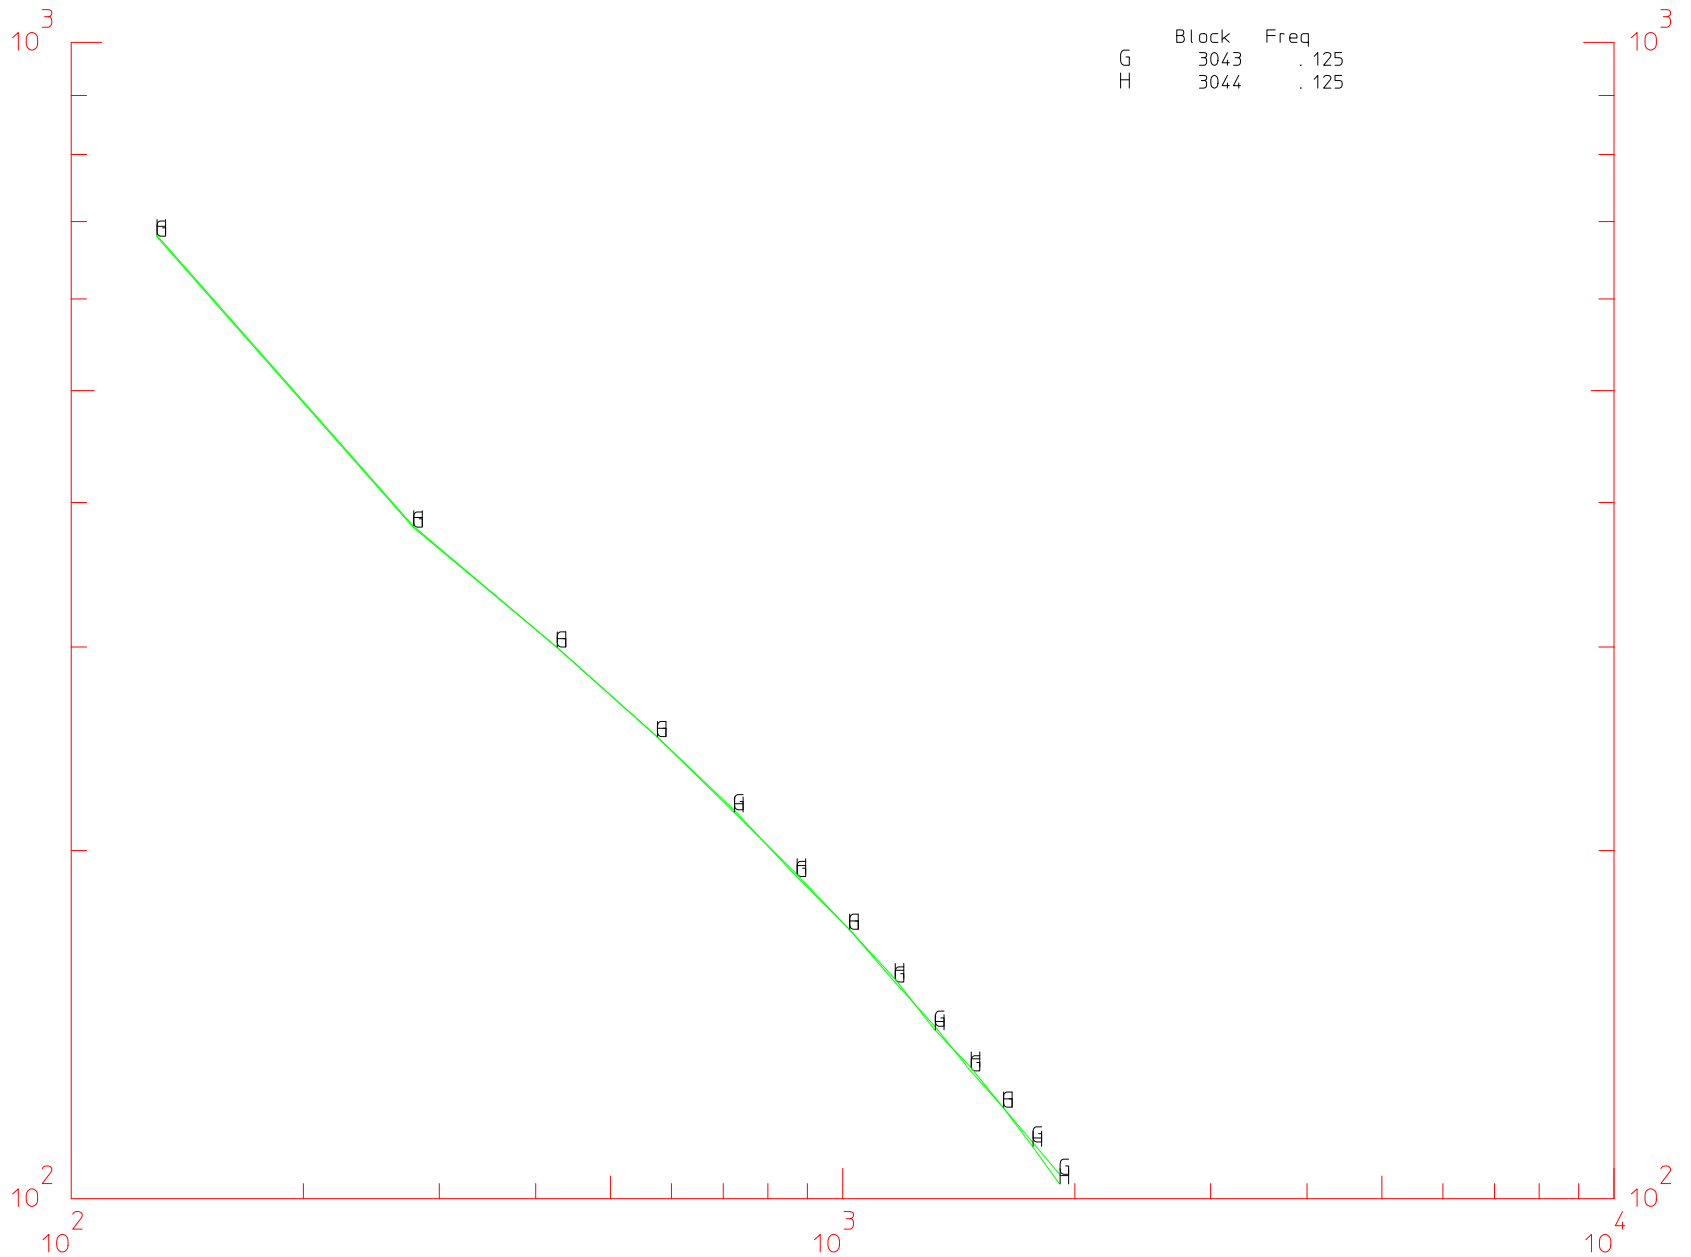

Mable Flats Grid19

Line= 2000N

TxLen= 2000. Line= 5187. Stn= -1.

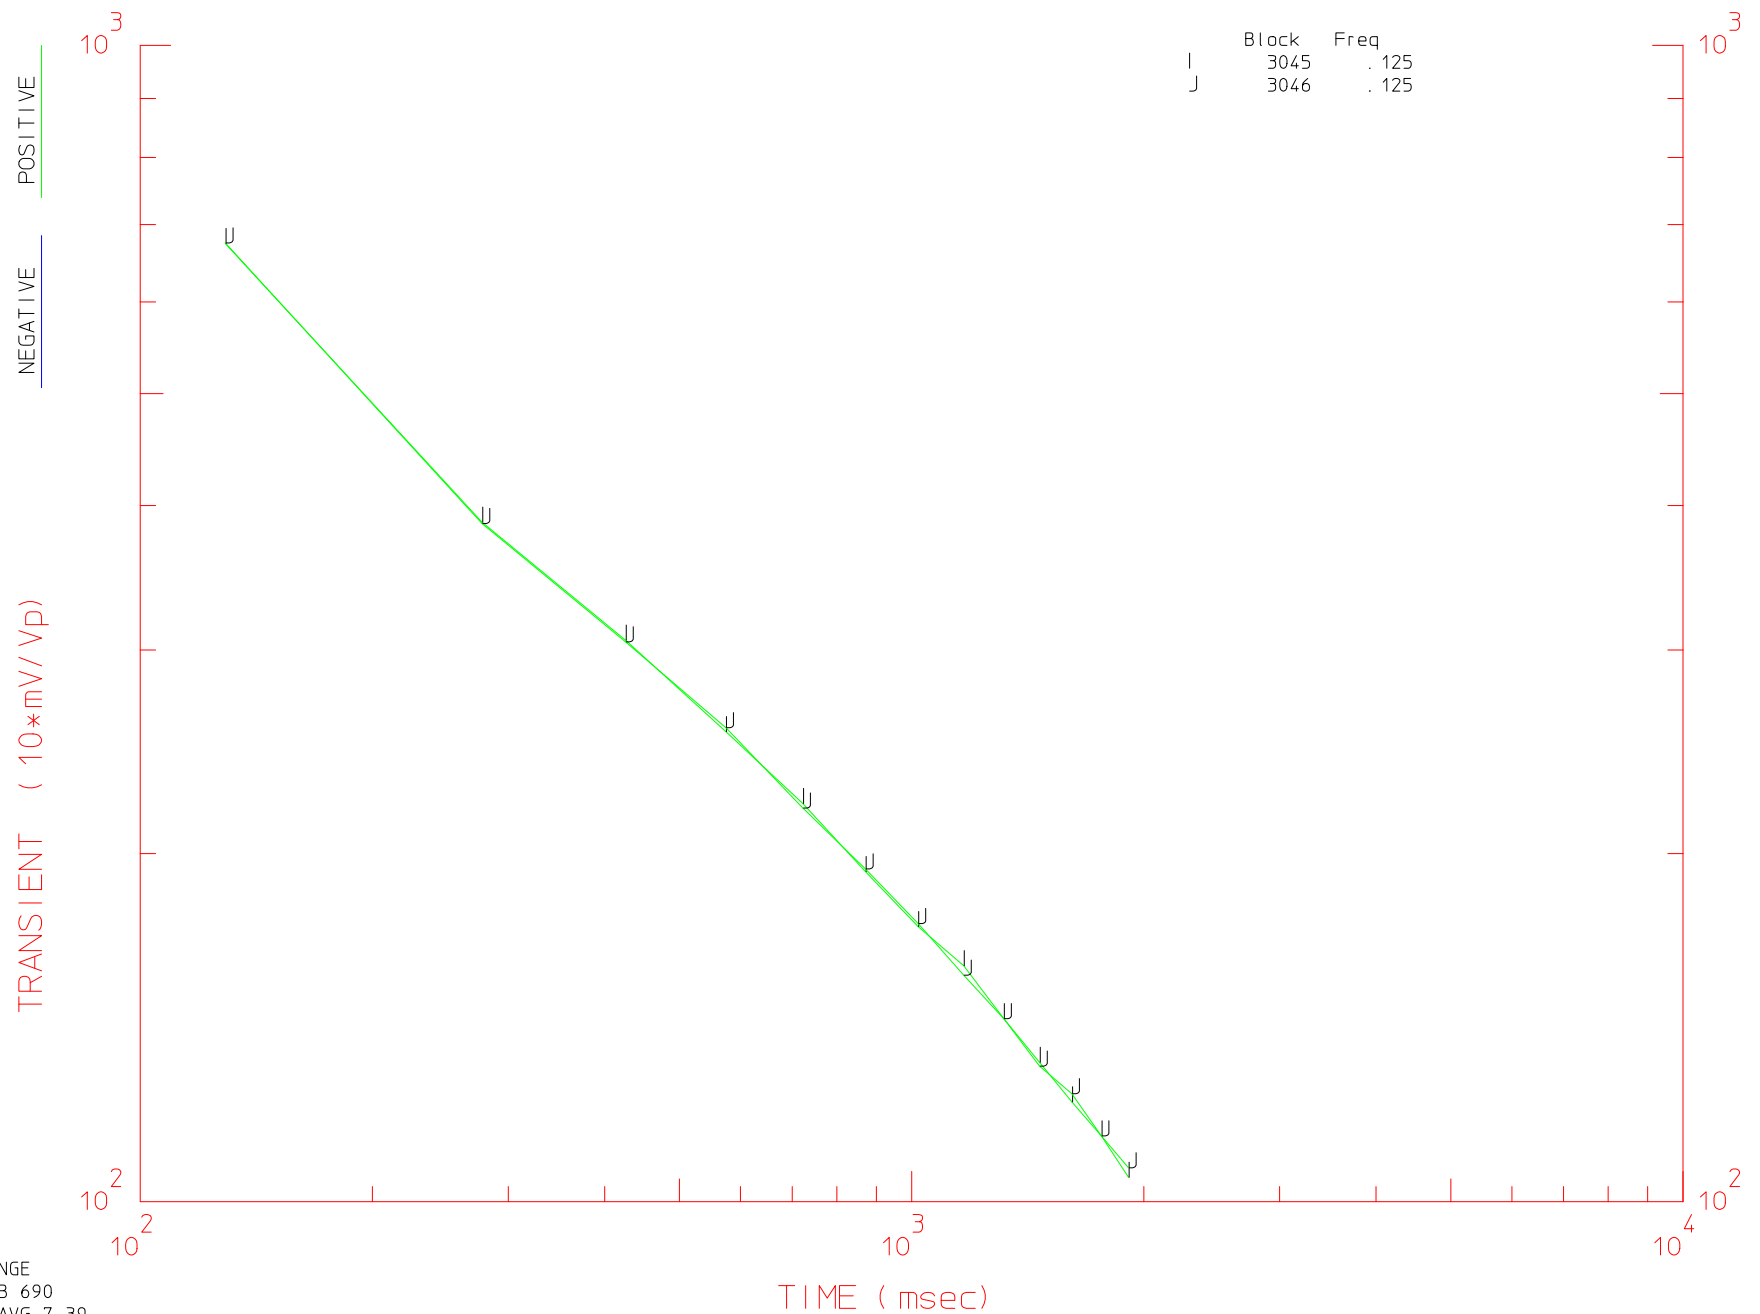

Mable Flats Grid19

Line= 2000N


TxLen= 2000. Line= 5162. Stn= -2.

	Block	Freq
K	3045	.125
L	3046	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

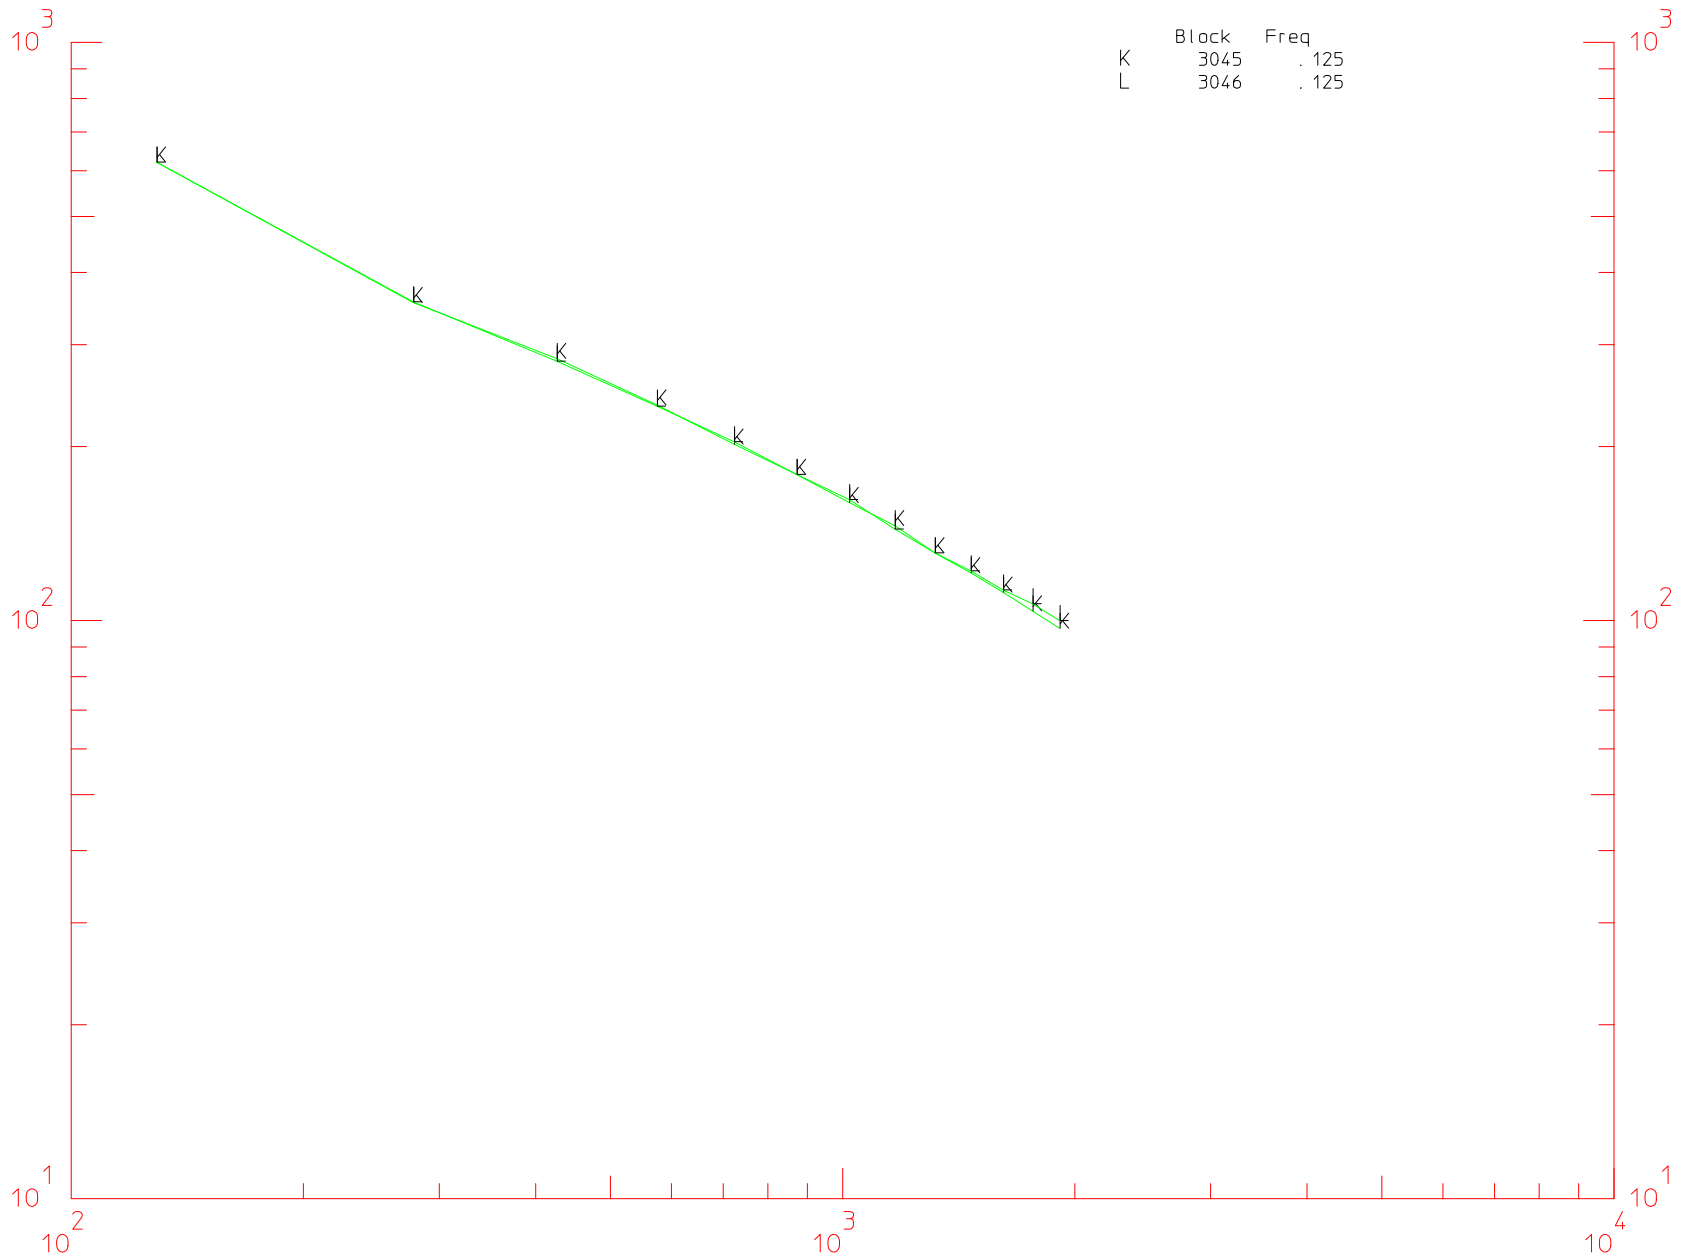

Mable Flats Grid19

Line= 2000N


TxLen= 2000. Line= 5137. Stn= -3.

	Block	Freq
M	3045	.125
N	3046	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

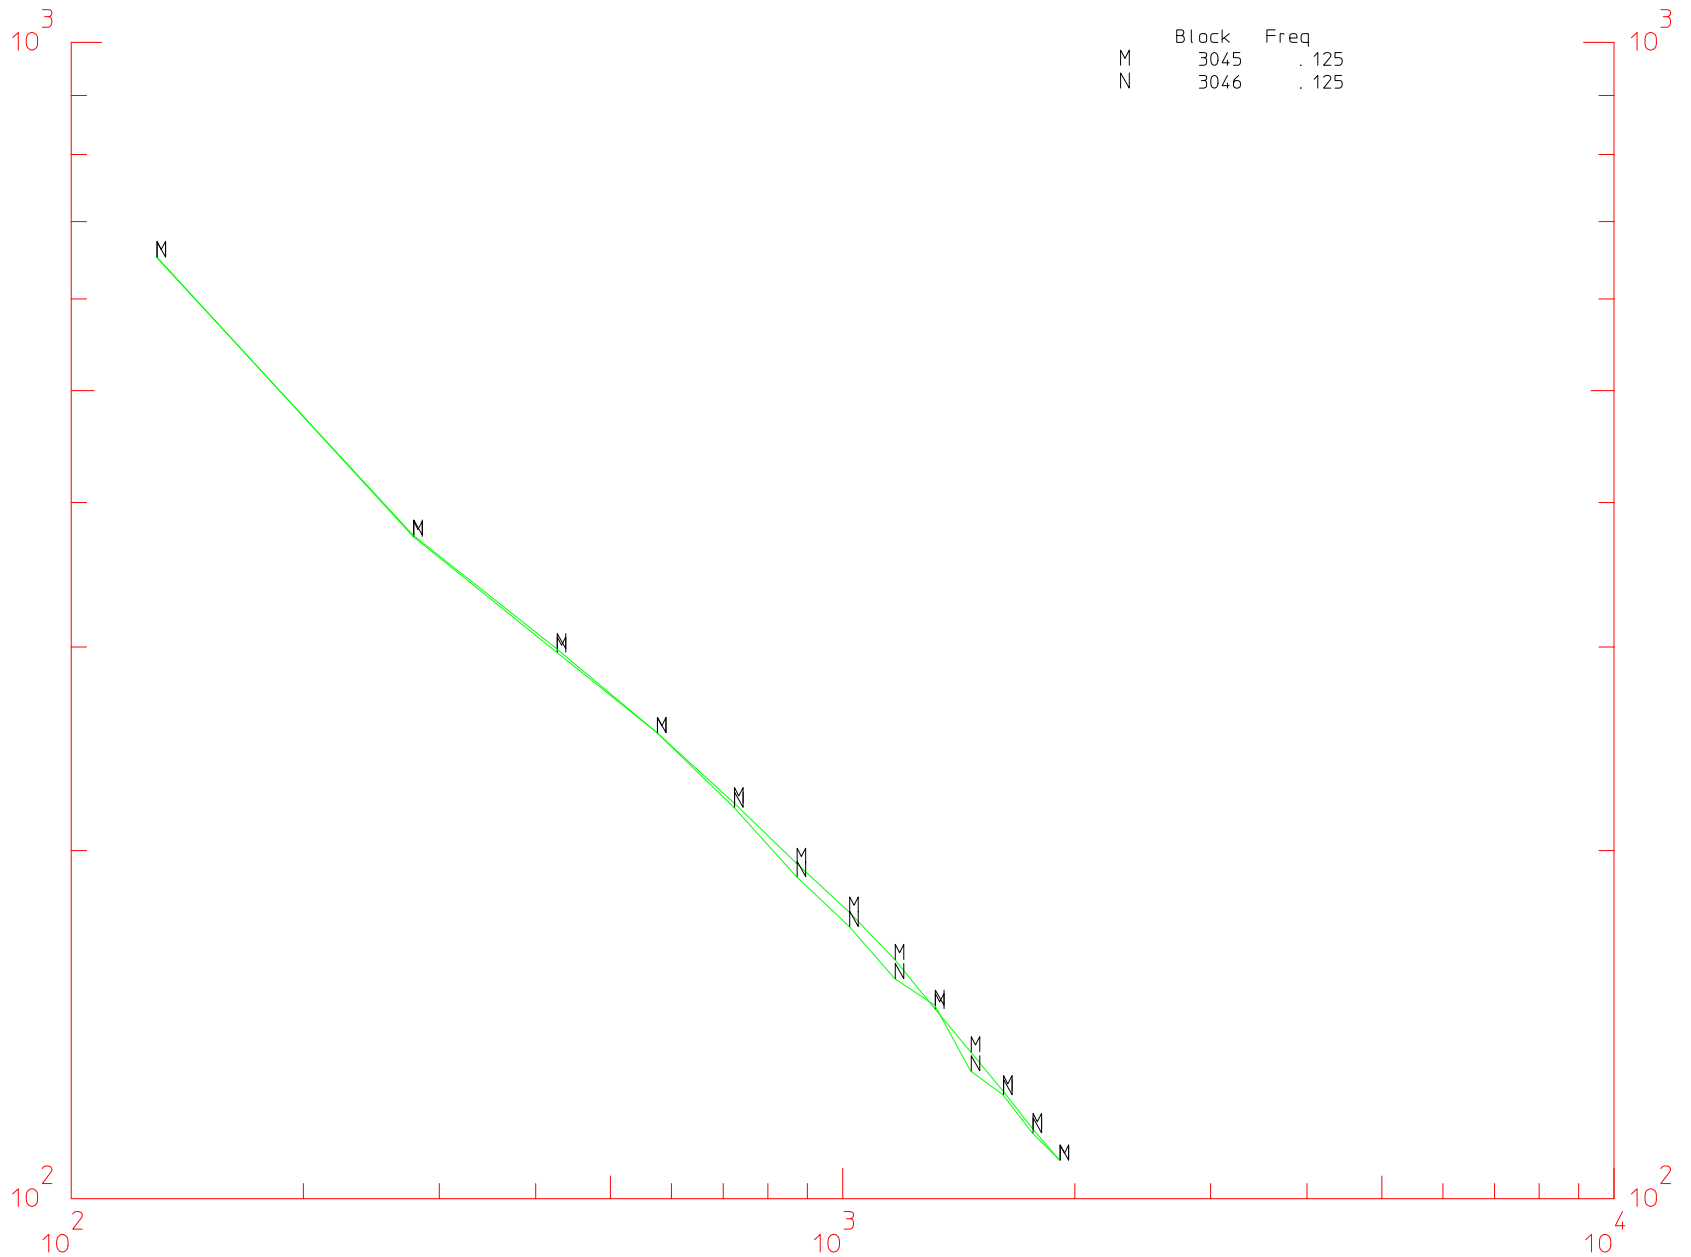


Mable Flats Grid19
Line= 2000N
TxLen= 2000. Line= 5112. Stn= -4.

	Block	Freq
O	3045	.125
P	3046	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

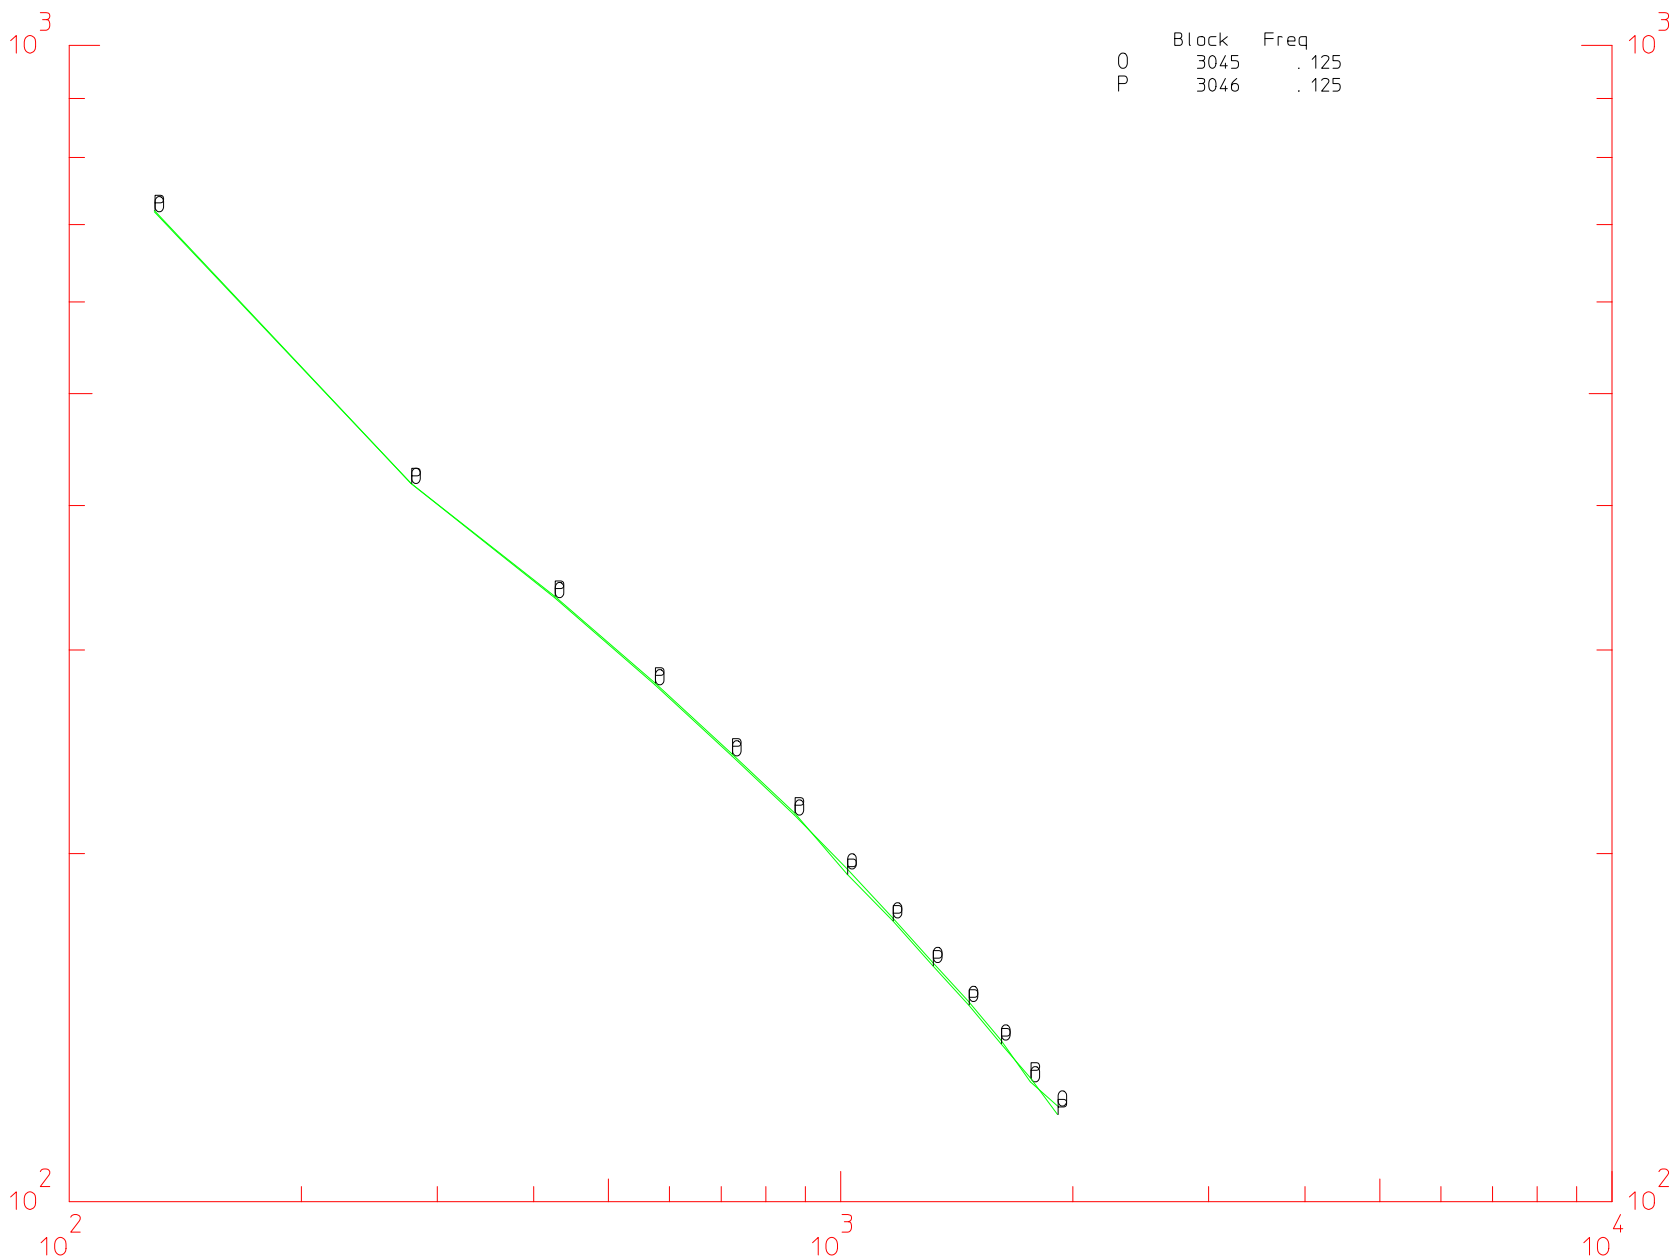

Mable Flats Grid19

Line= 2000N


TxLen= 2000. Line= 5287. Stn= -1.

	Block	Freq
Q	3047	.125
R	3048	.125

POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

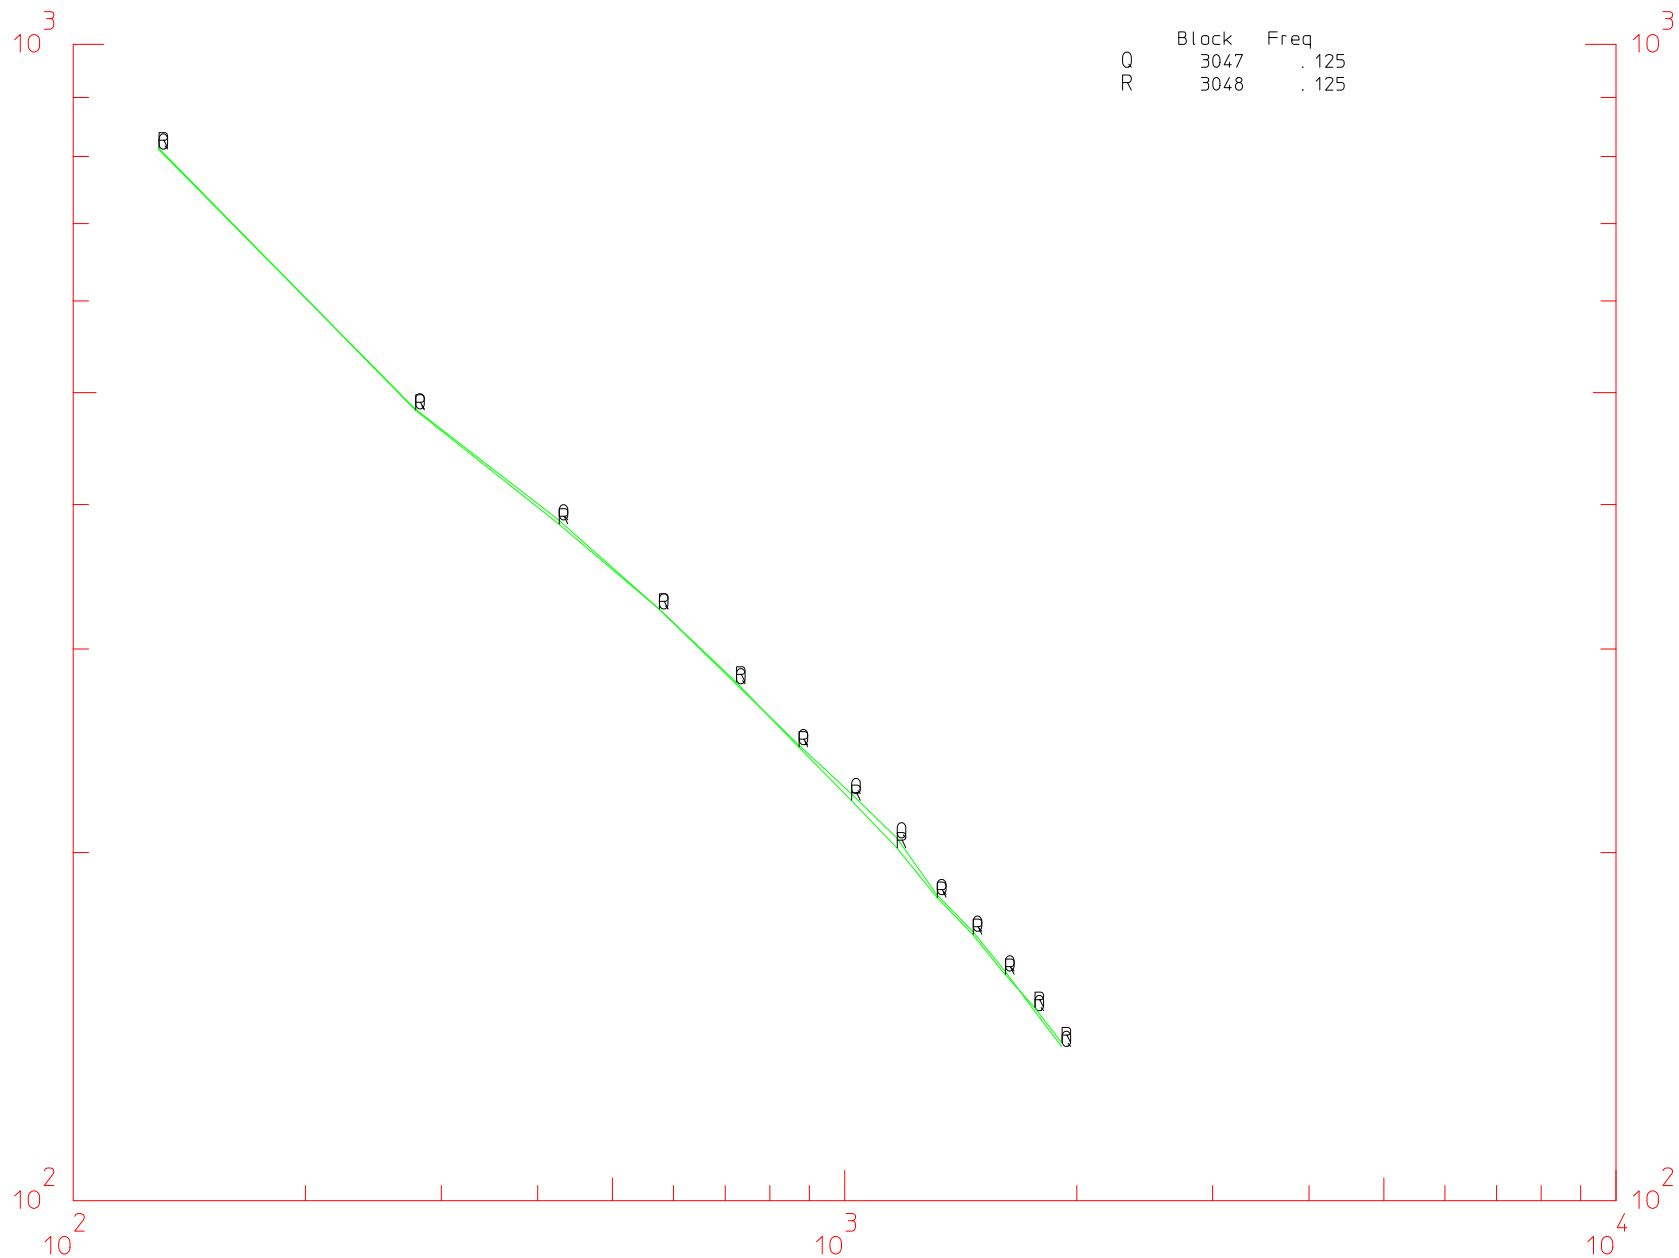

Mable Flats Grid19


Line= 2000N

TxLen= 2000. Line= 5262. Stn= -2.

	Block	Freq
S	3047	.125
T	3048	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

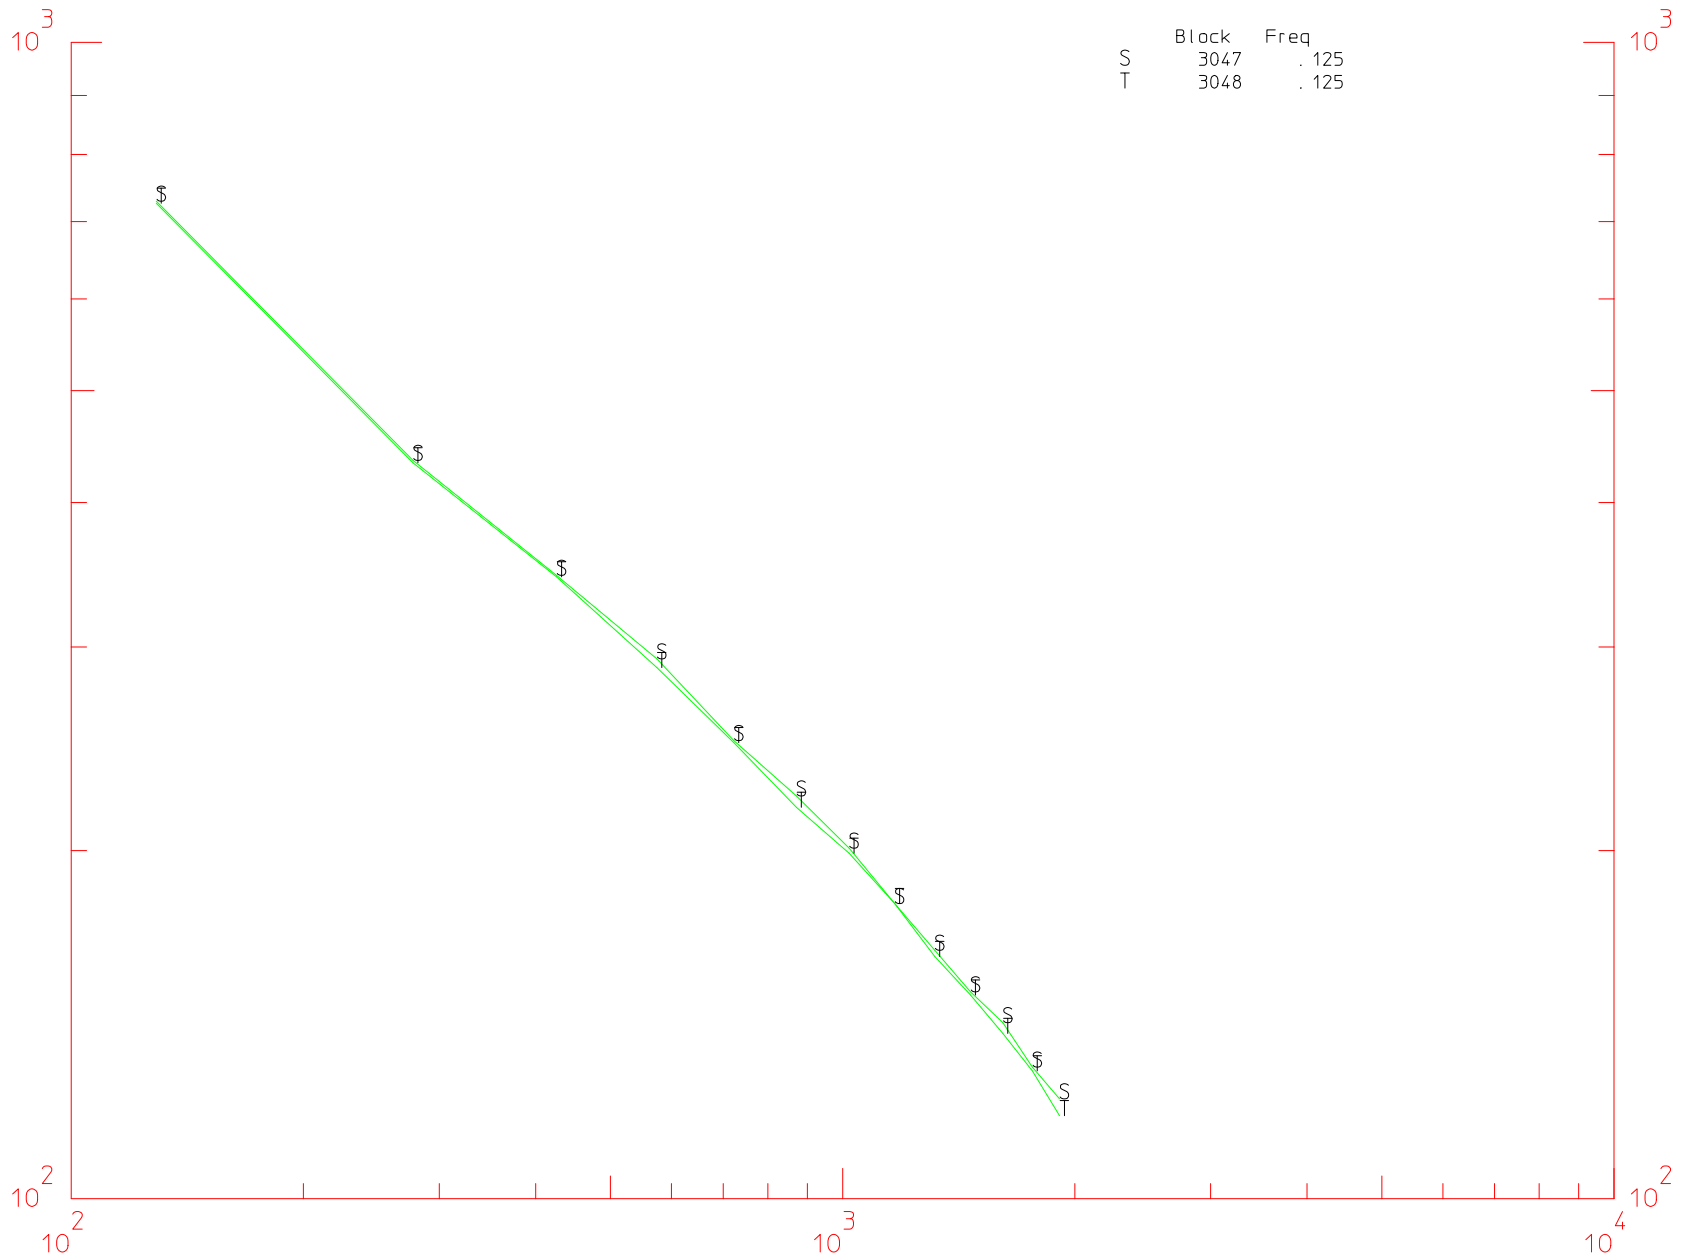


Mable Flats Grid19
Line= 2000N
TxLen= 2000. Line= 5237. Stn= -3.

	Block	Freq
U	3047	.125
V	3048	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

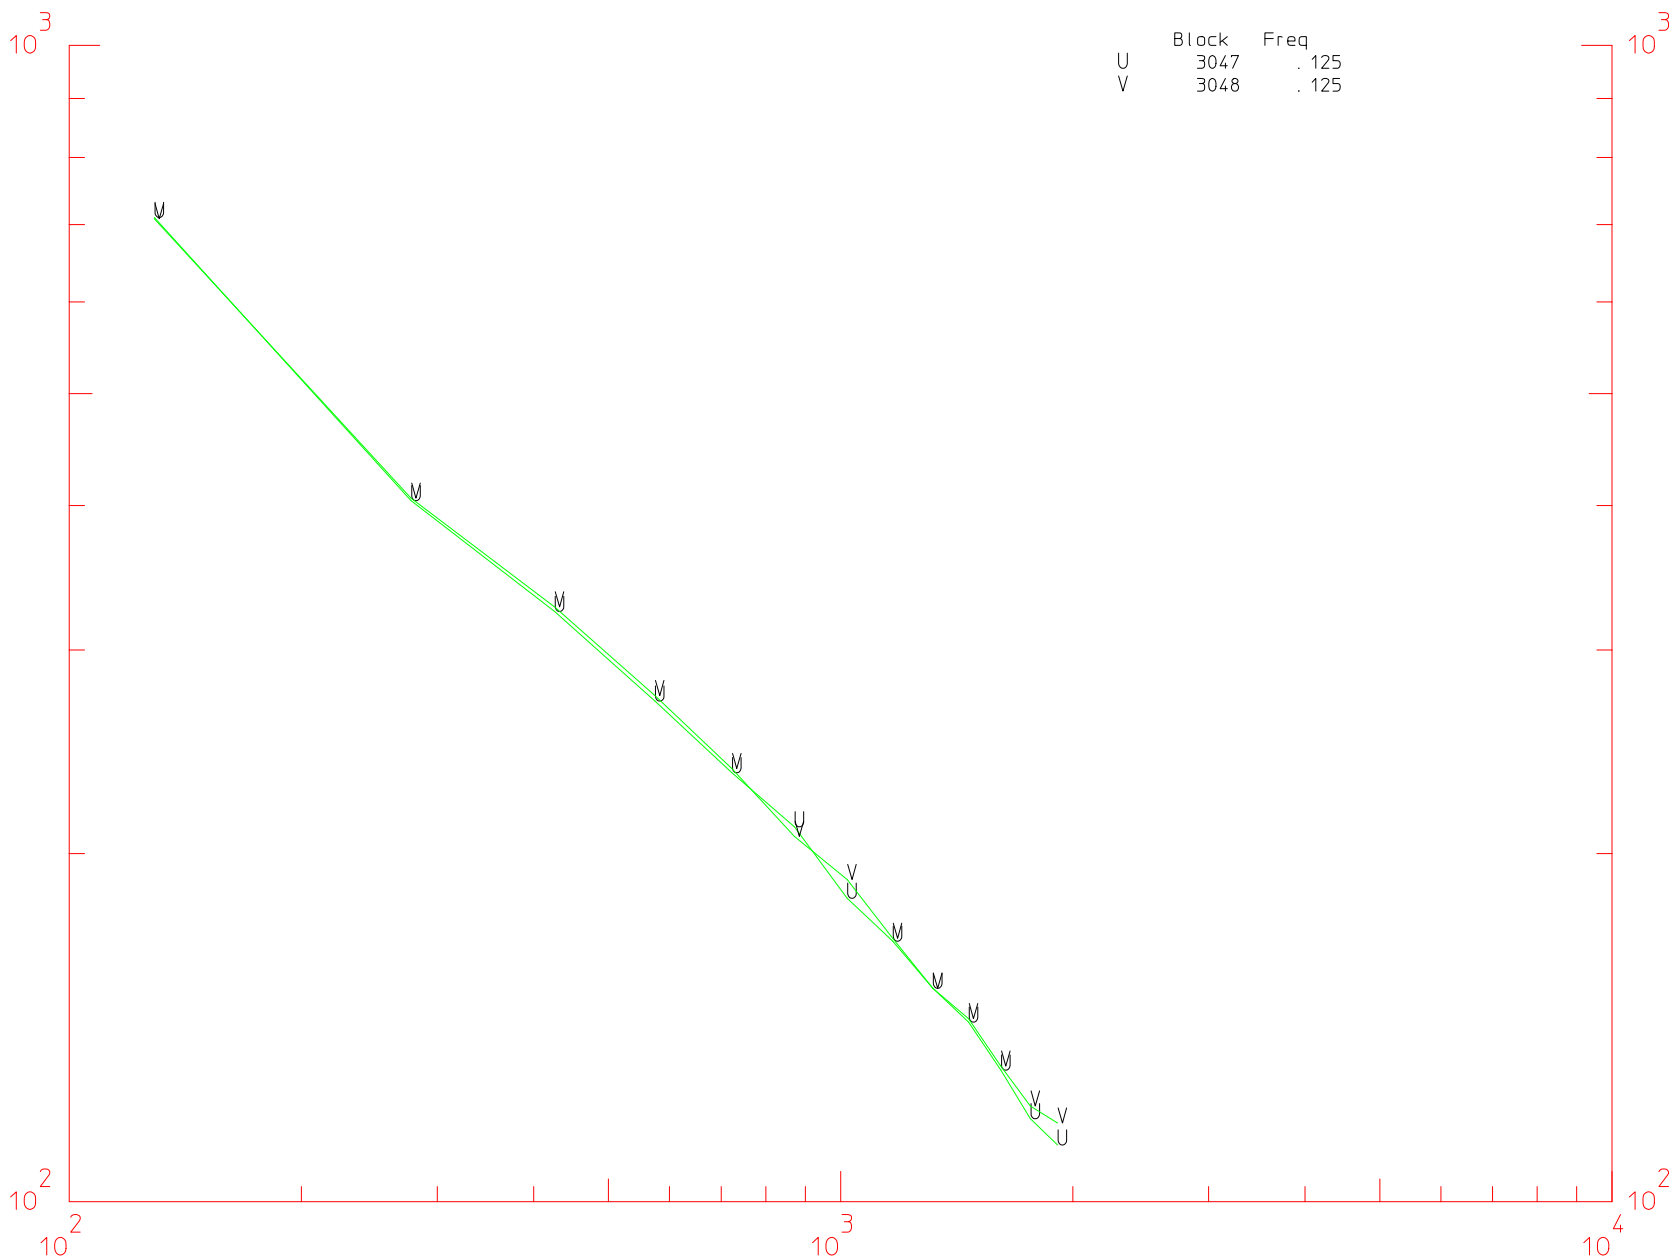

TxLen= 2000. Line= 5212. Stn= -4.

W	3047	. 125
X	3048	. 125

