


TxLen= 2098. Line= 5098. Stn= -1.




Mable Flats Grid19

Line= 2098N


TxLen= 2098. Line= 5073. Stn= -2.

	Block	Freq
C	3057	.125
D	3058	.125

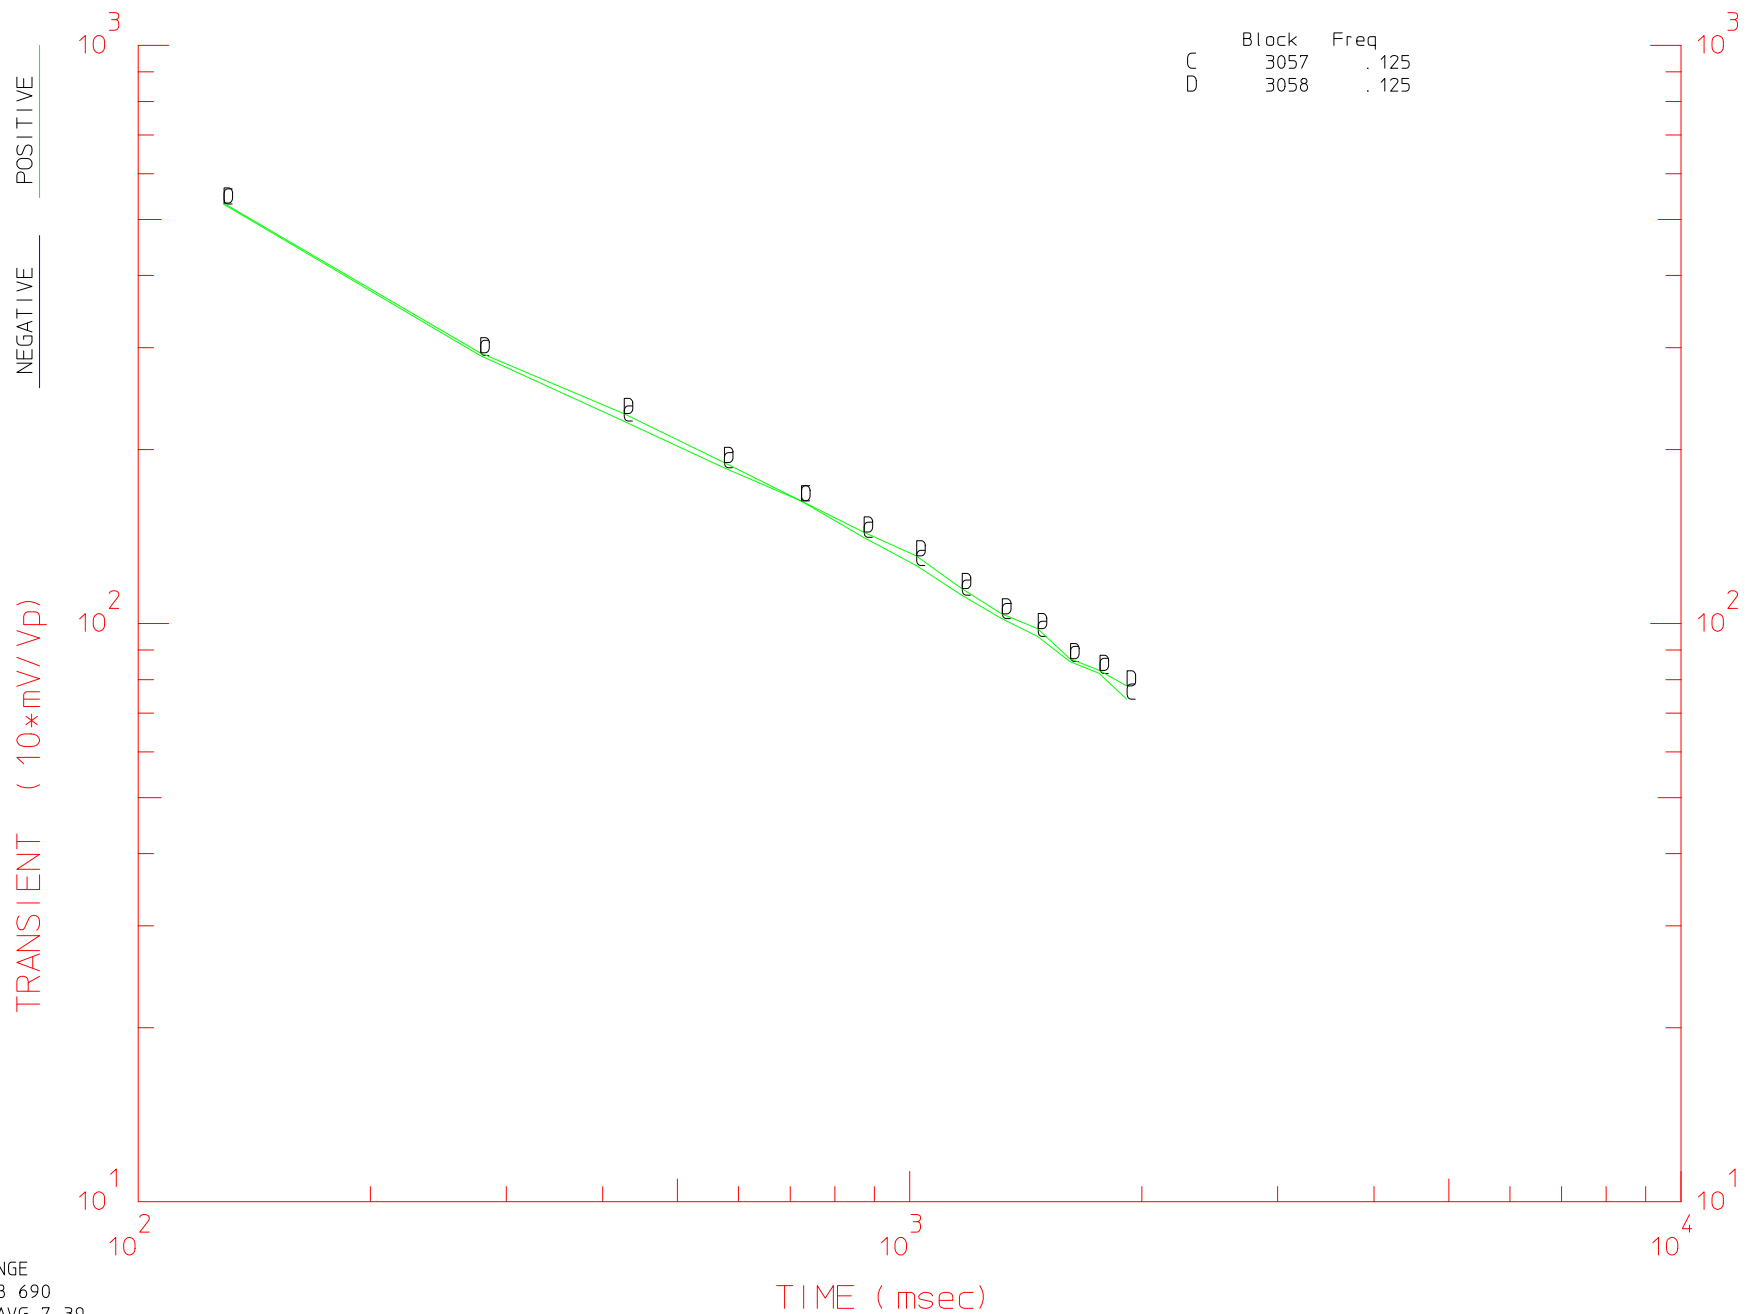


TxLen= 2098. Line= 5048. Stn= -3.

	Block	Freq
E	3057	.125
F	3058	.125

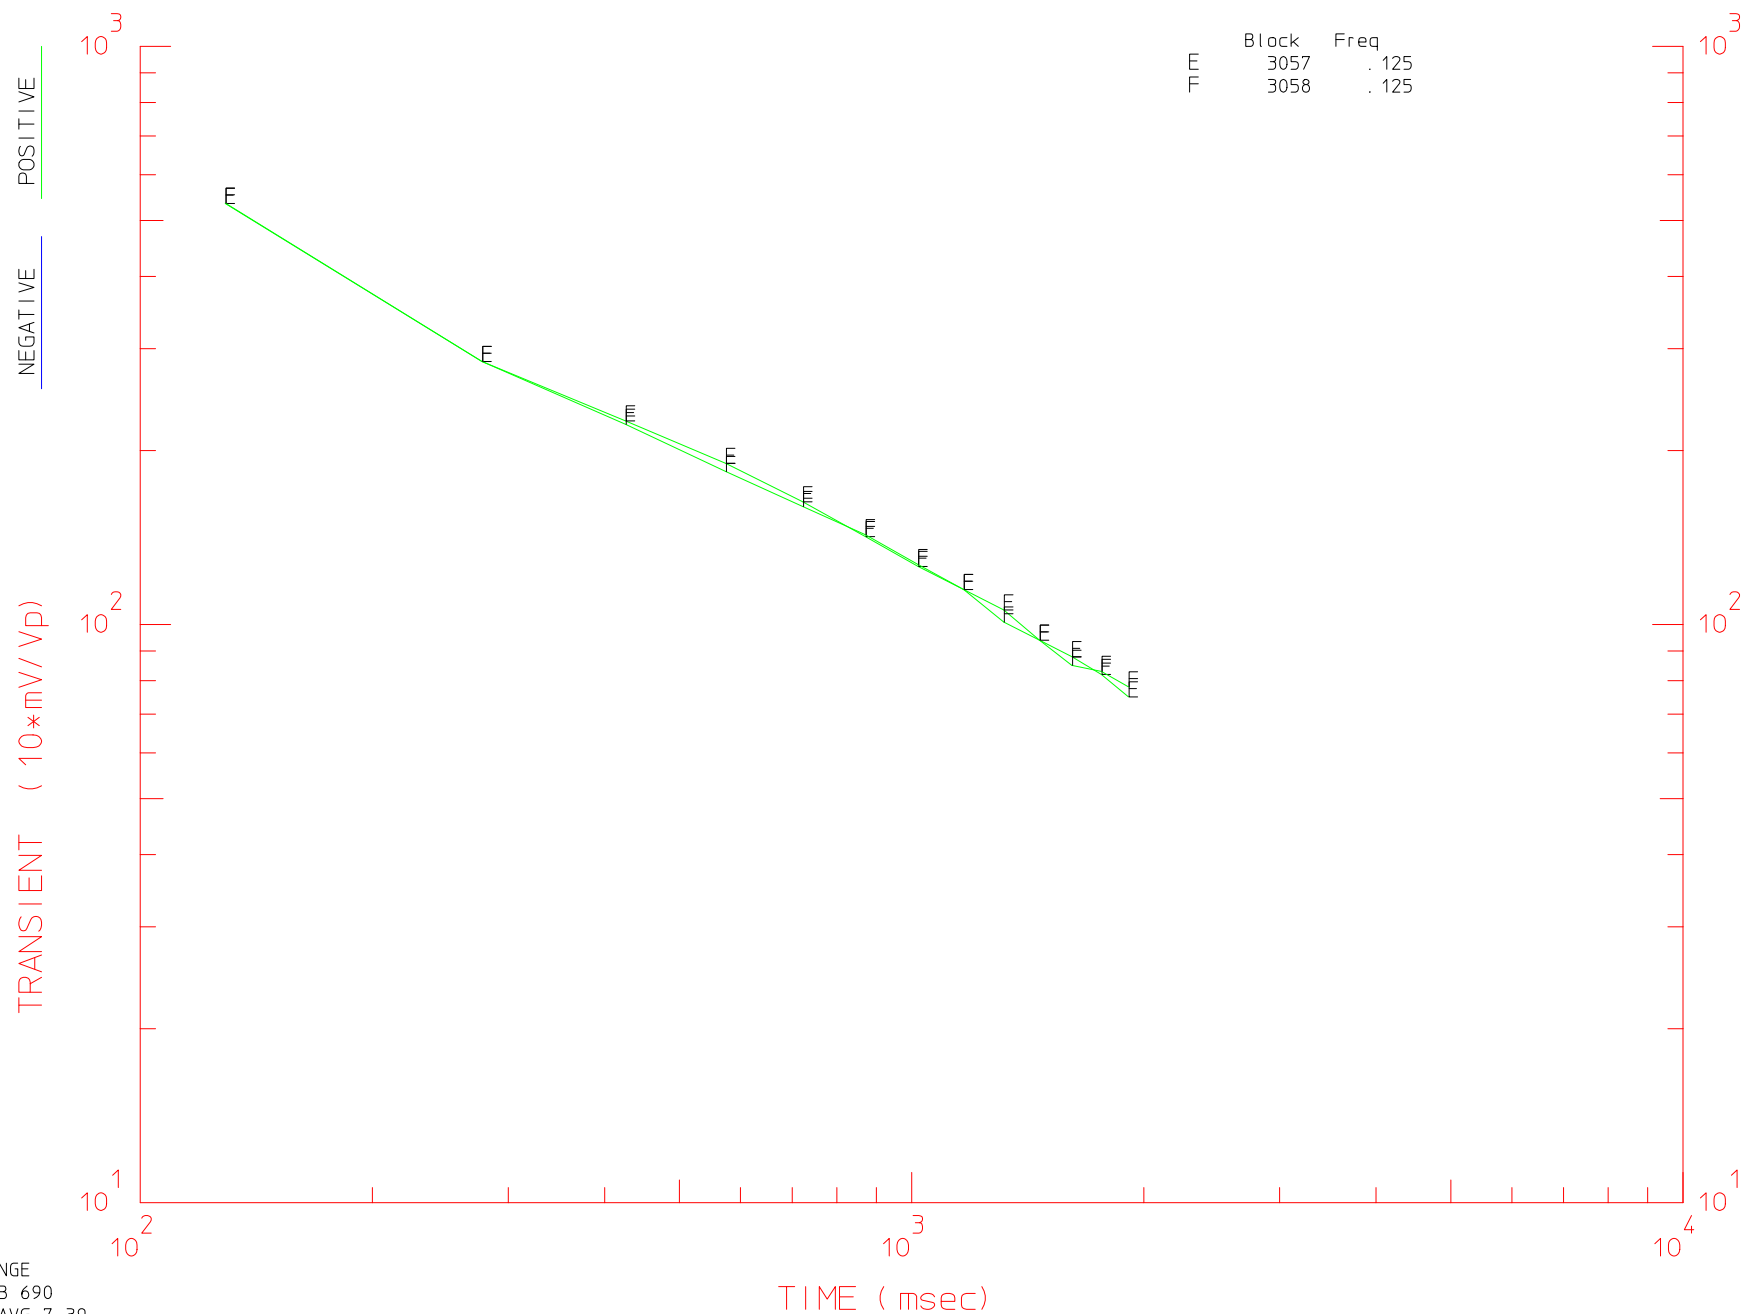

ZONGE
JOB 690
TDAVG 7.39


TxLen= 2098. Line= 5023. Stn= -4.



Mable Flats Grid19

Line= 2098N

TxLen= 2098. Line= 5198. Stn= -1.

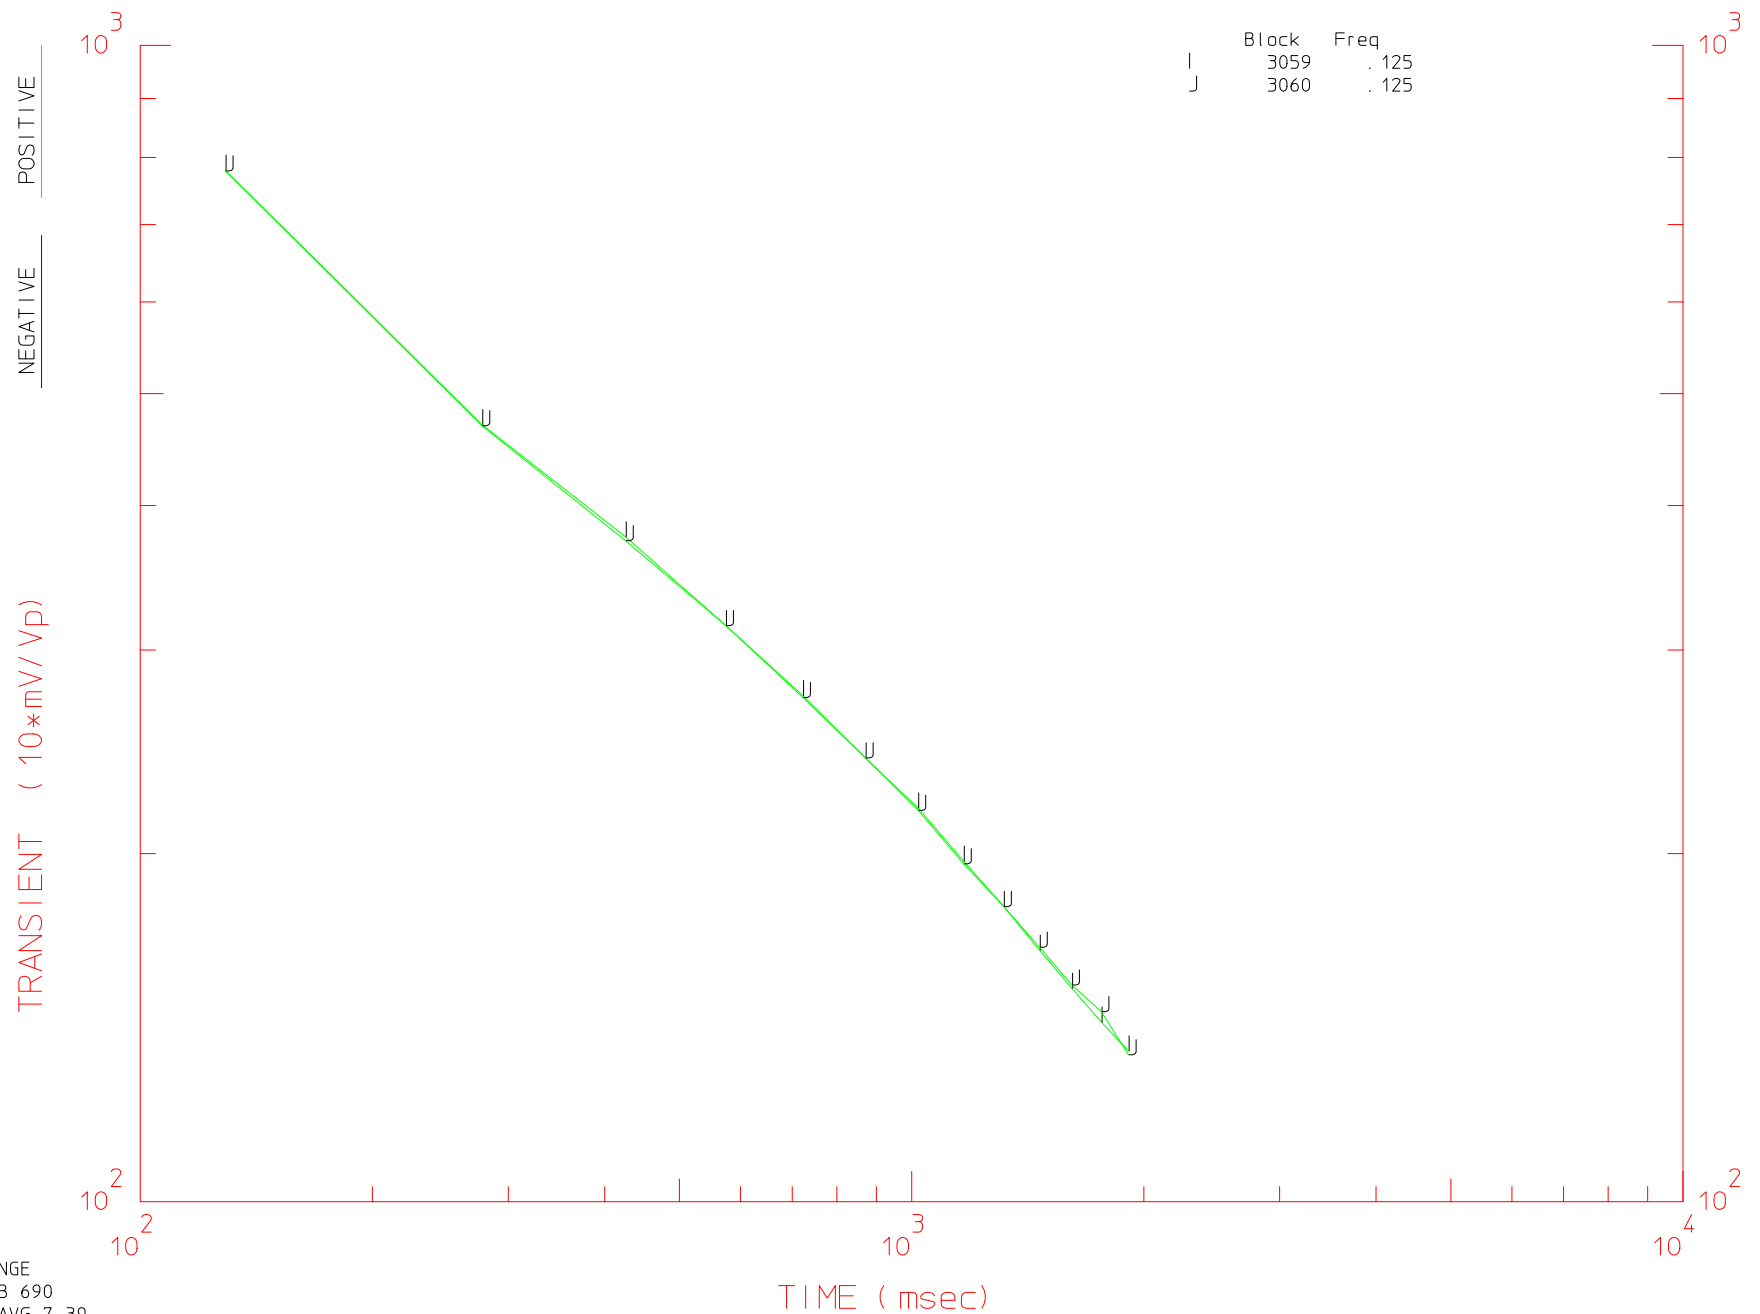

Mable Flats Grid19


Line= 2098N

TxLen= 2098. Line= 5173. Stn= -2.

	Block	Freq
K	3059	.125
L	3060	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

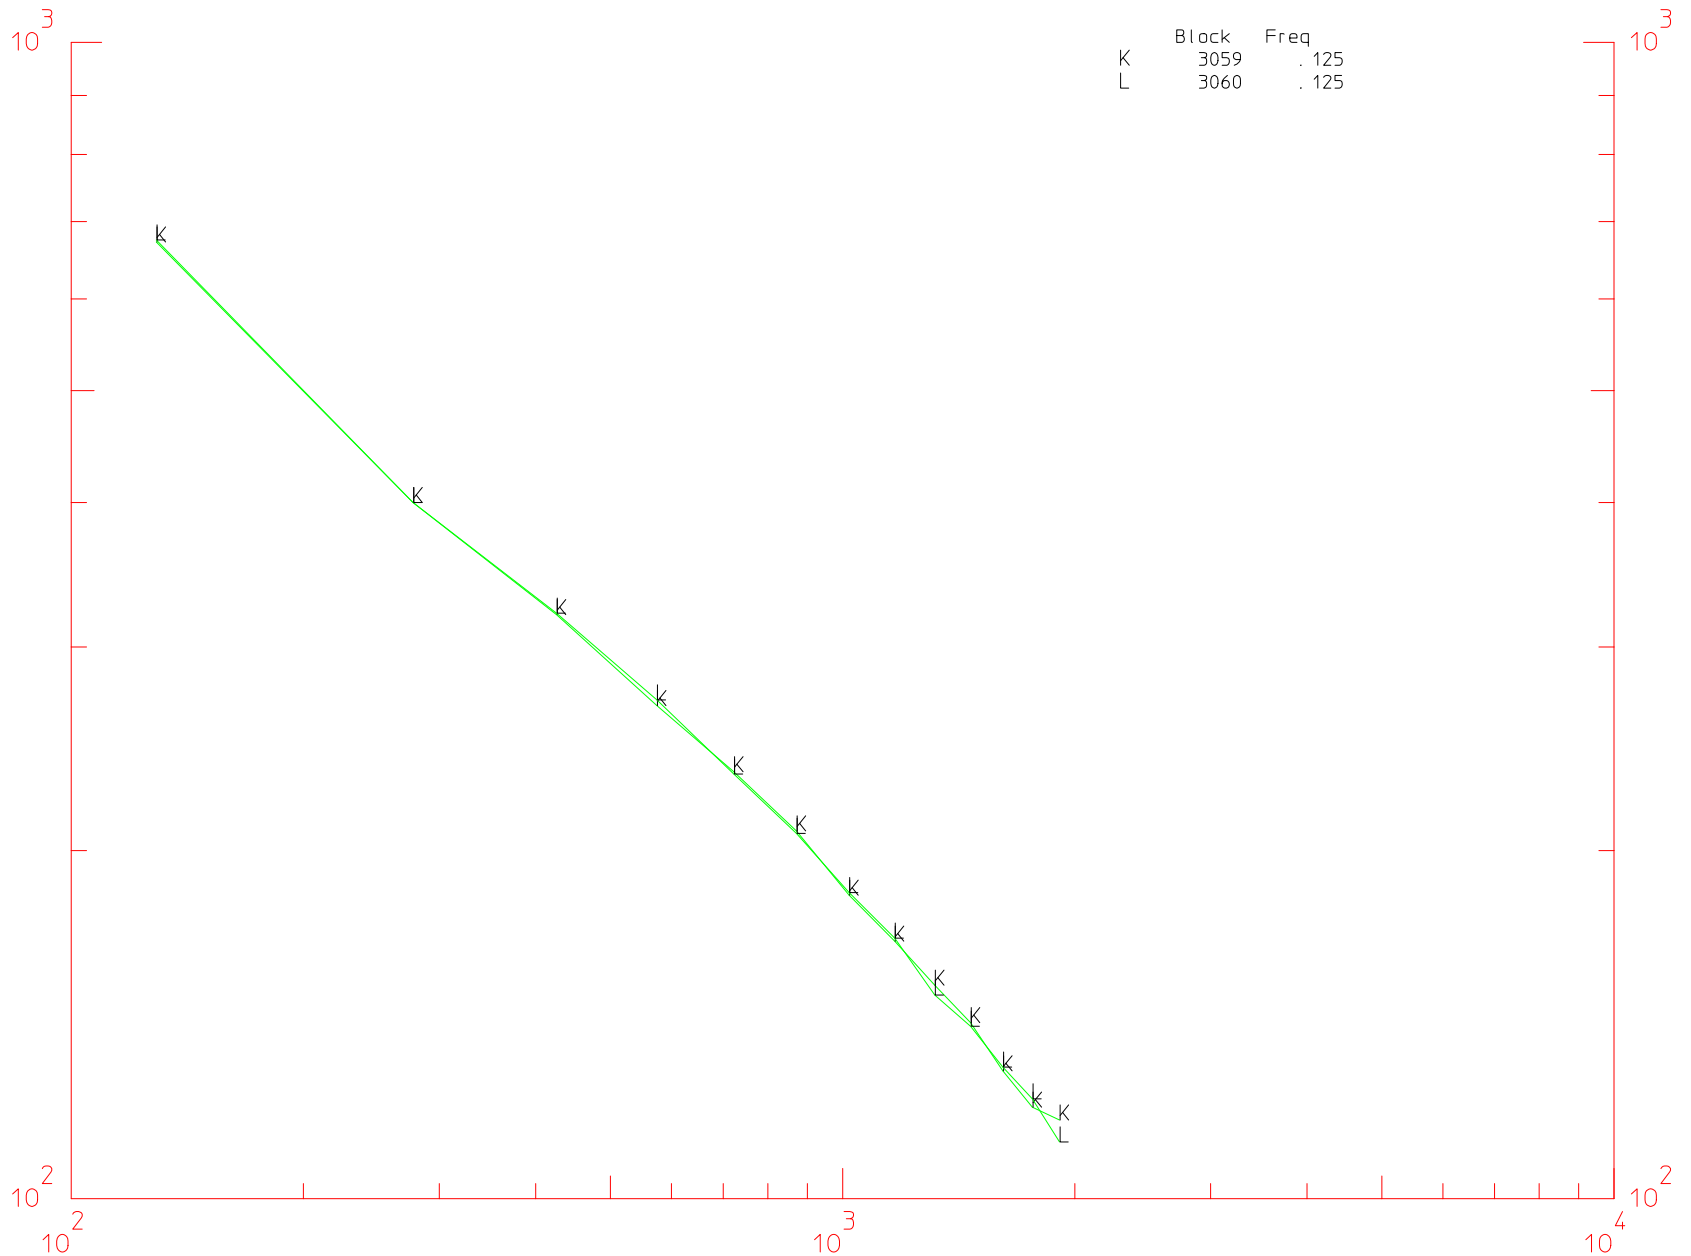


Mable Flats Grid19
Line= 2098N
TxLen= 2098. Line= 5148. Stn= -3.

	Block	Freq
M	3059	.125
N	3060	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

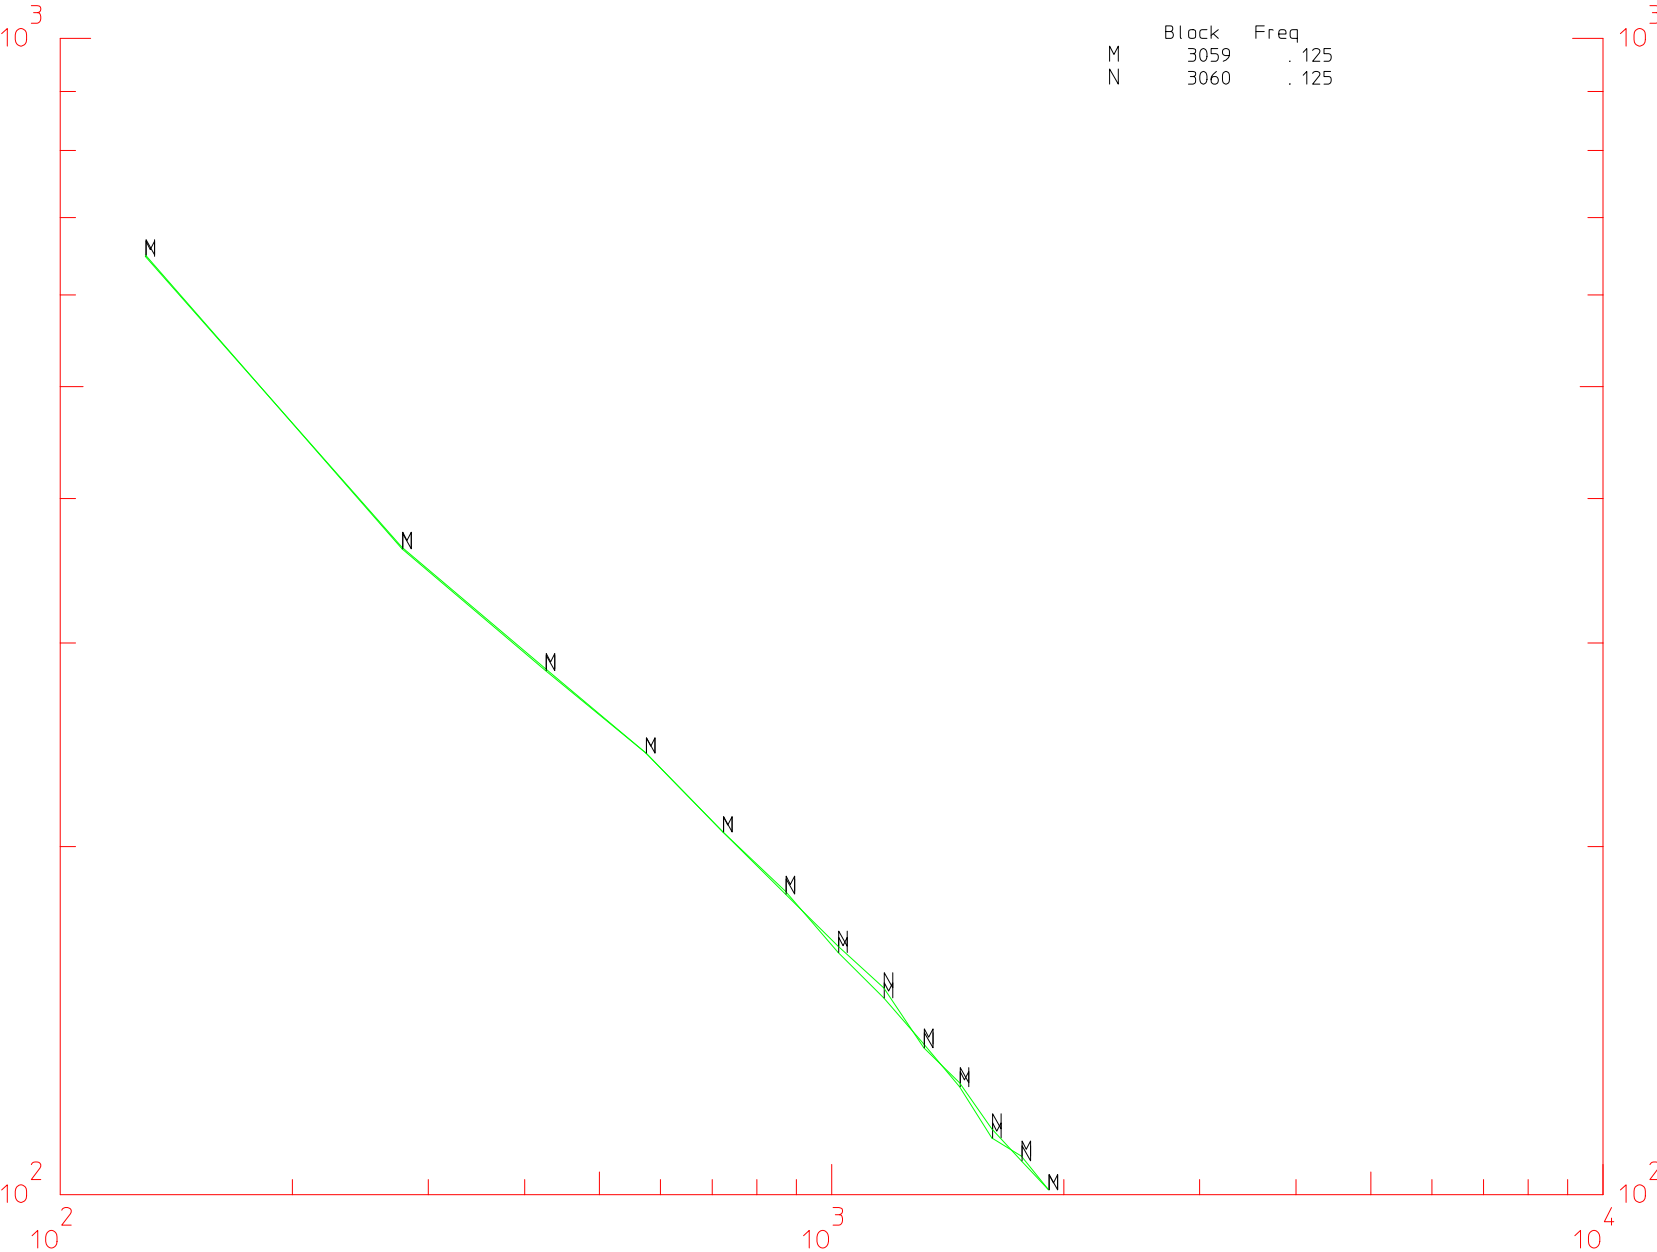


Mable Flats Grid19

Line= 2098N

TxLen= 2098. Line= 5123. Stn= -4.


	Block	Freq
O	3059	.125
P	3060	.125

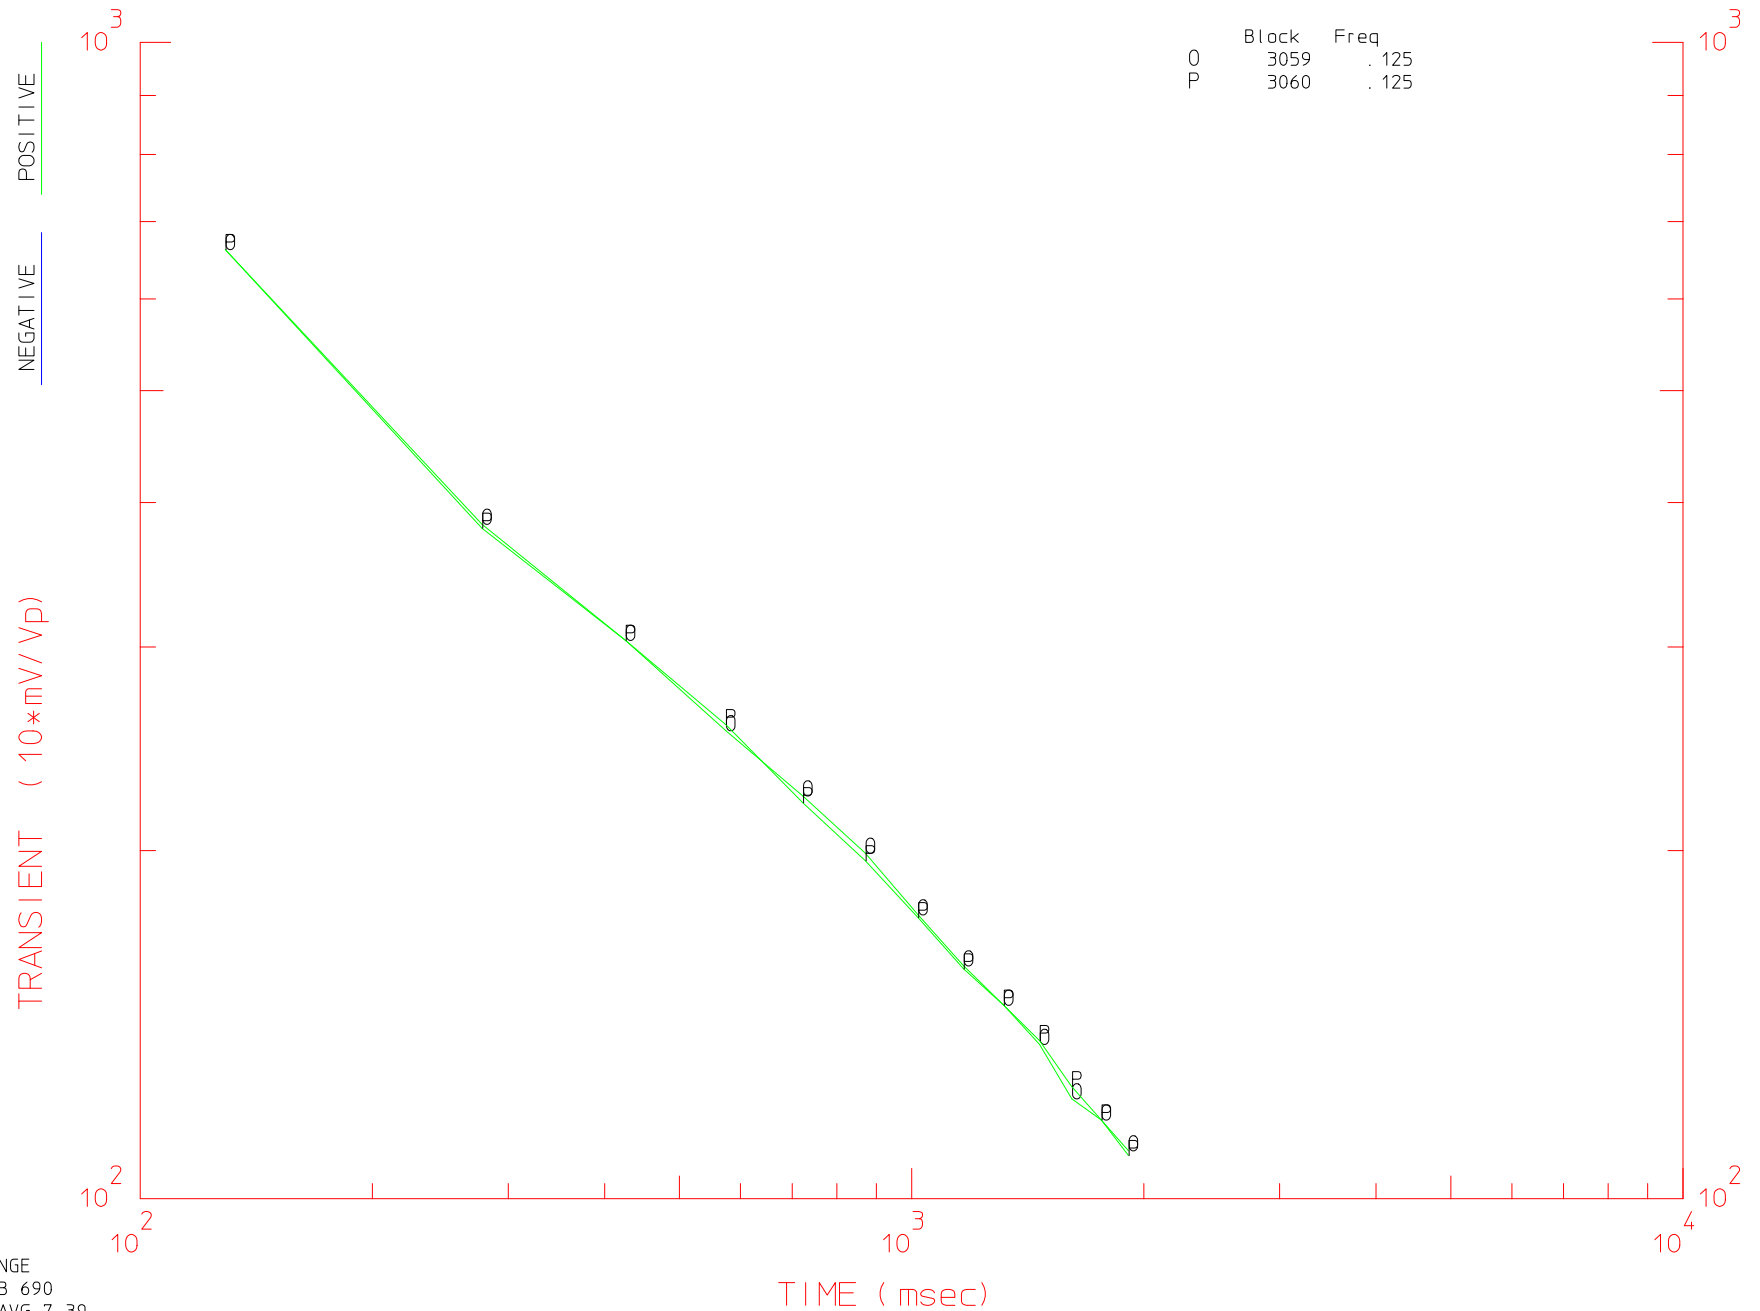

Mable Flats Grid19

Line= 2098N

TxLen= 2098. Line= 5298. Stn= -1.

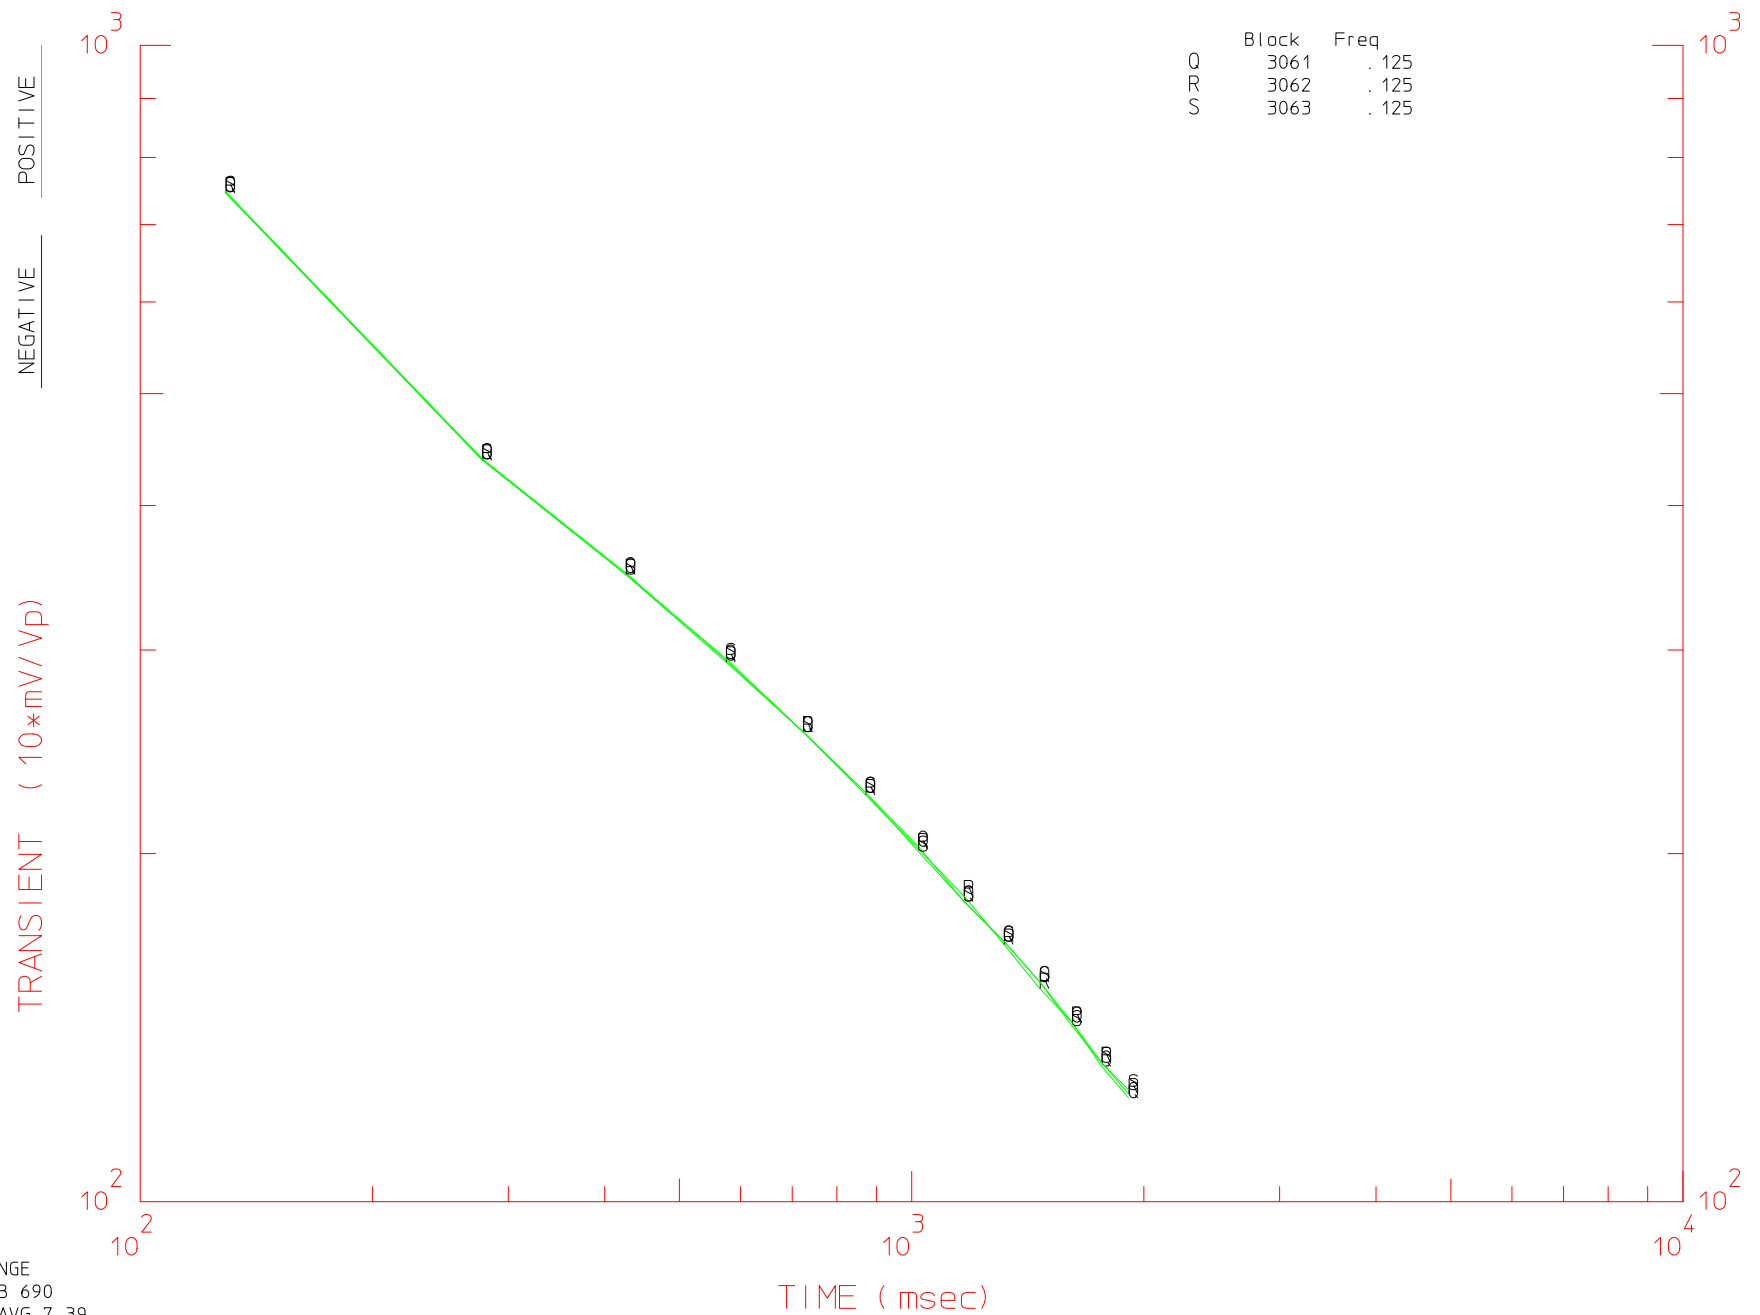


Mable Flats Grid19
Line= 2098N
TxLen= 2098. Line= 5273. Stn= -2.

	Block	Freq
T	3061	.125
U	3062	.125
V	3063	.125

POSITIVE
NEGATIVE


TRANSIENT (10*mV/Vp)

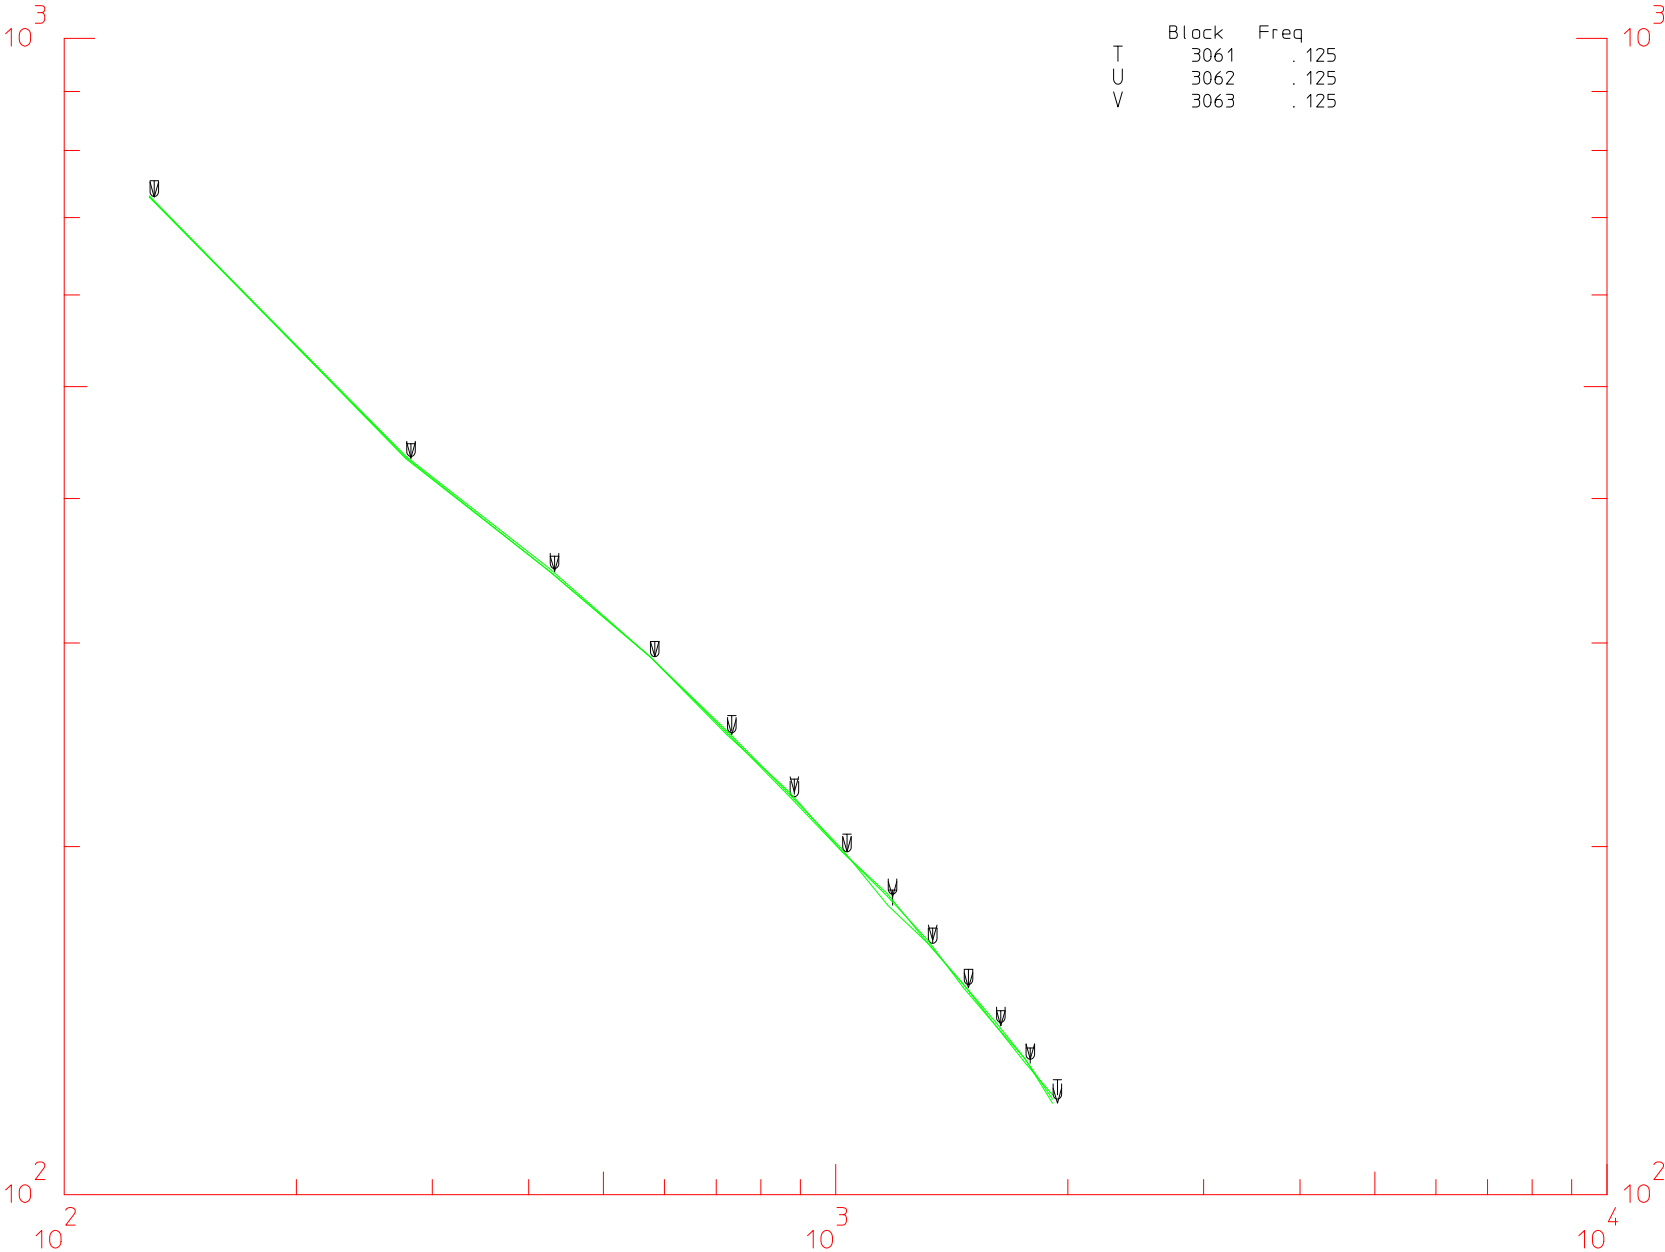

Mable Flats Grid19

Line= 2098N

TxLen= 2098. Line= 5248. Stn= -3.

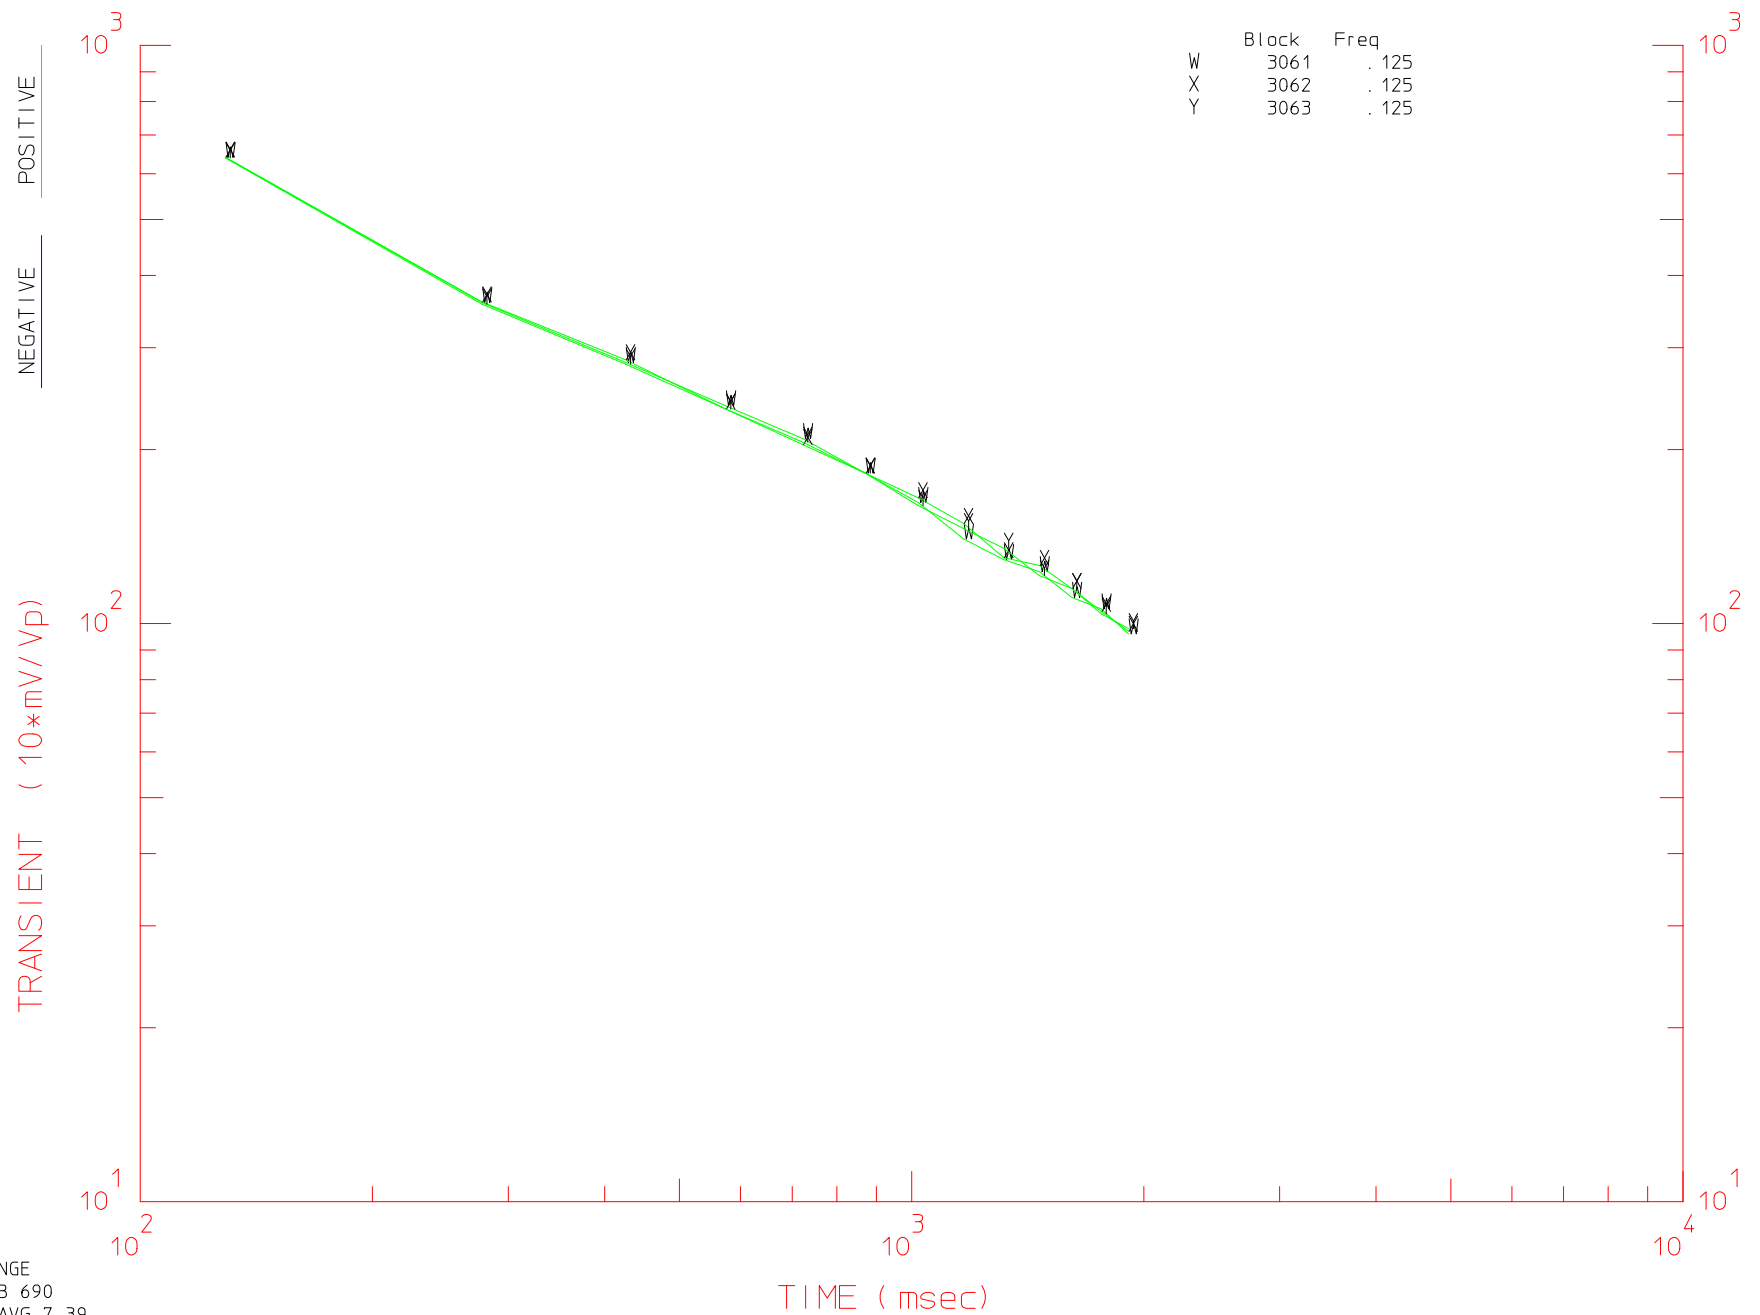

TxLen= 2098. Line= 5223. Stn= -4.

