


Mable Flats Grid22
Line= 2141N
TxLen= 2141. Line= 5228. Stn= 1.

	Block	Freq
A	3066	.125
B	3067	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

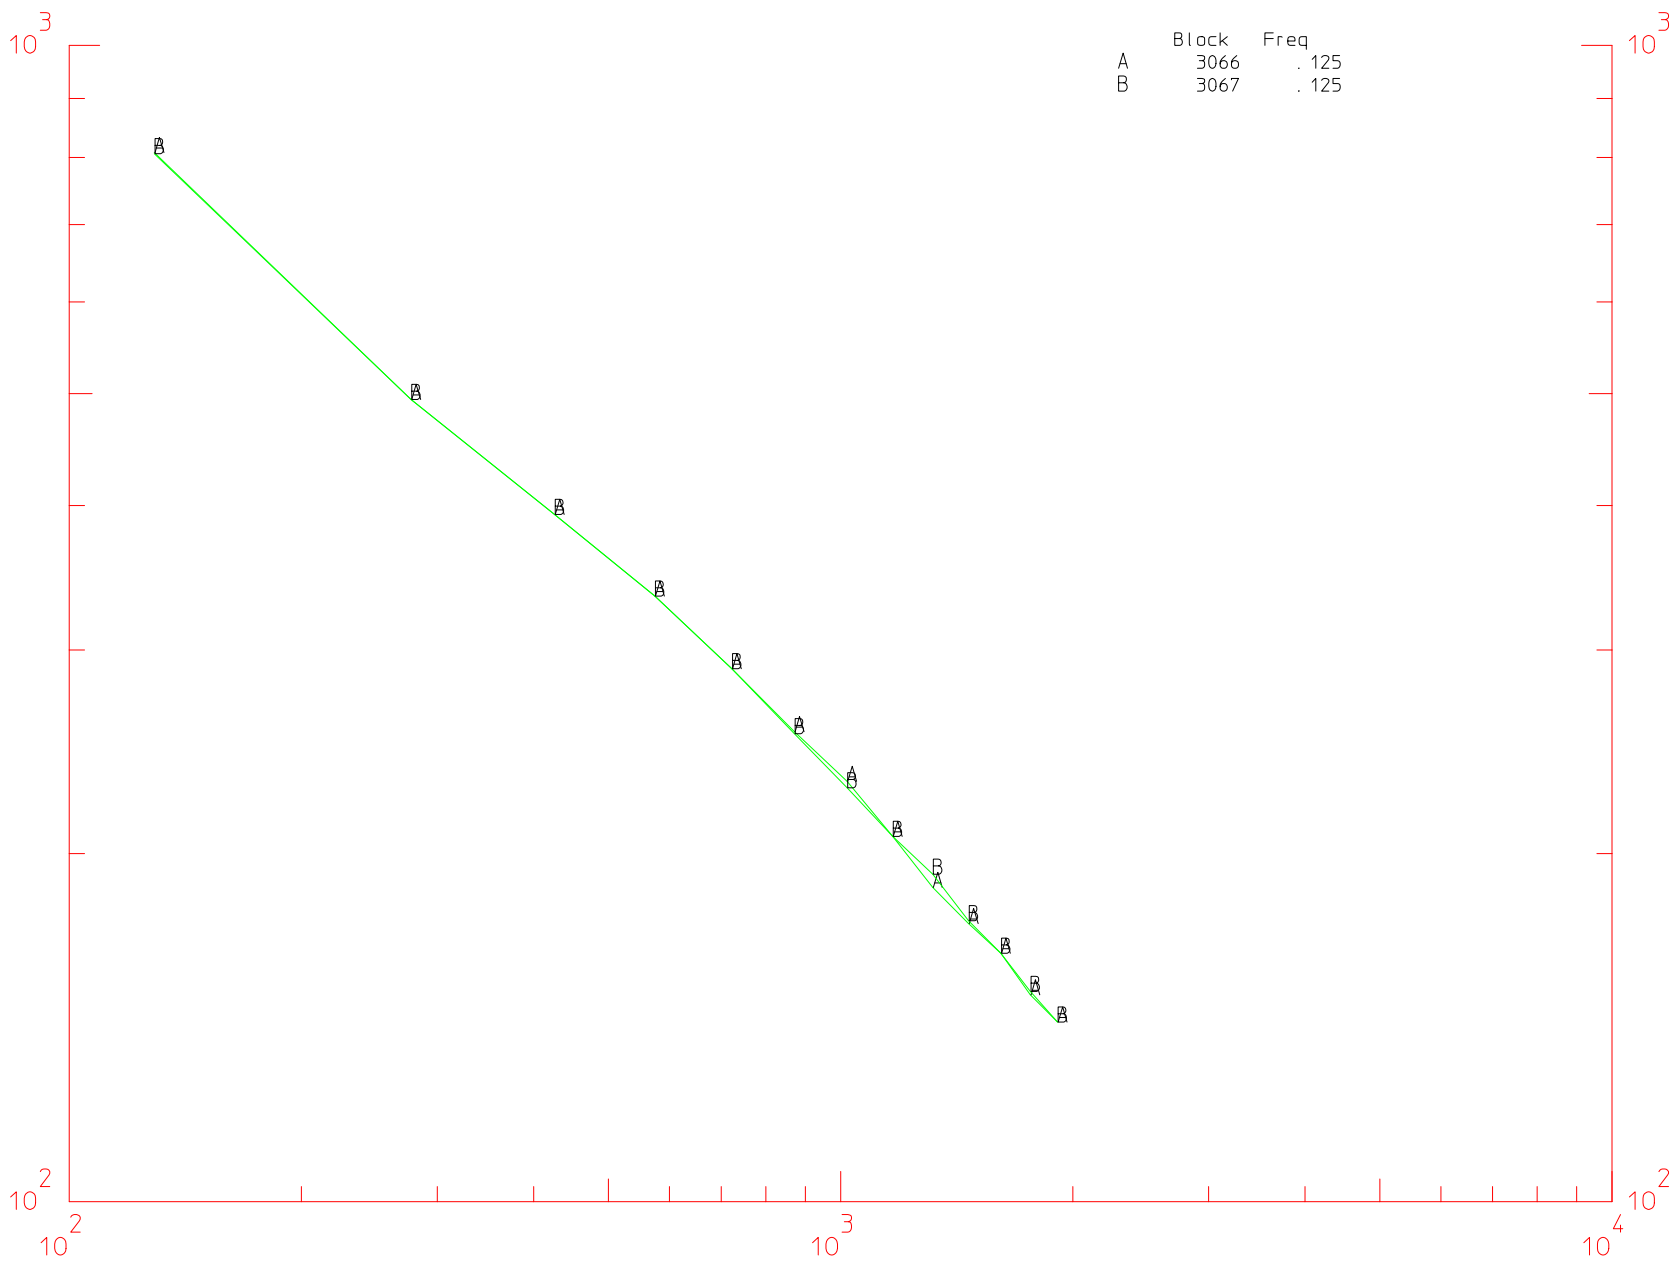

Mable Flats Grid22


Line= 2141N

TxLen= 2141. Line= 5253. Stn= 2.


	Block	Freq
C	3066	.125
D	3067	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

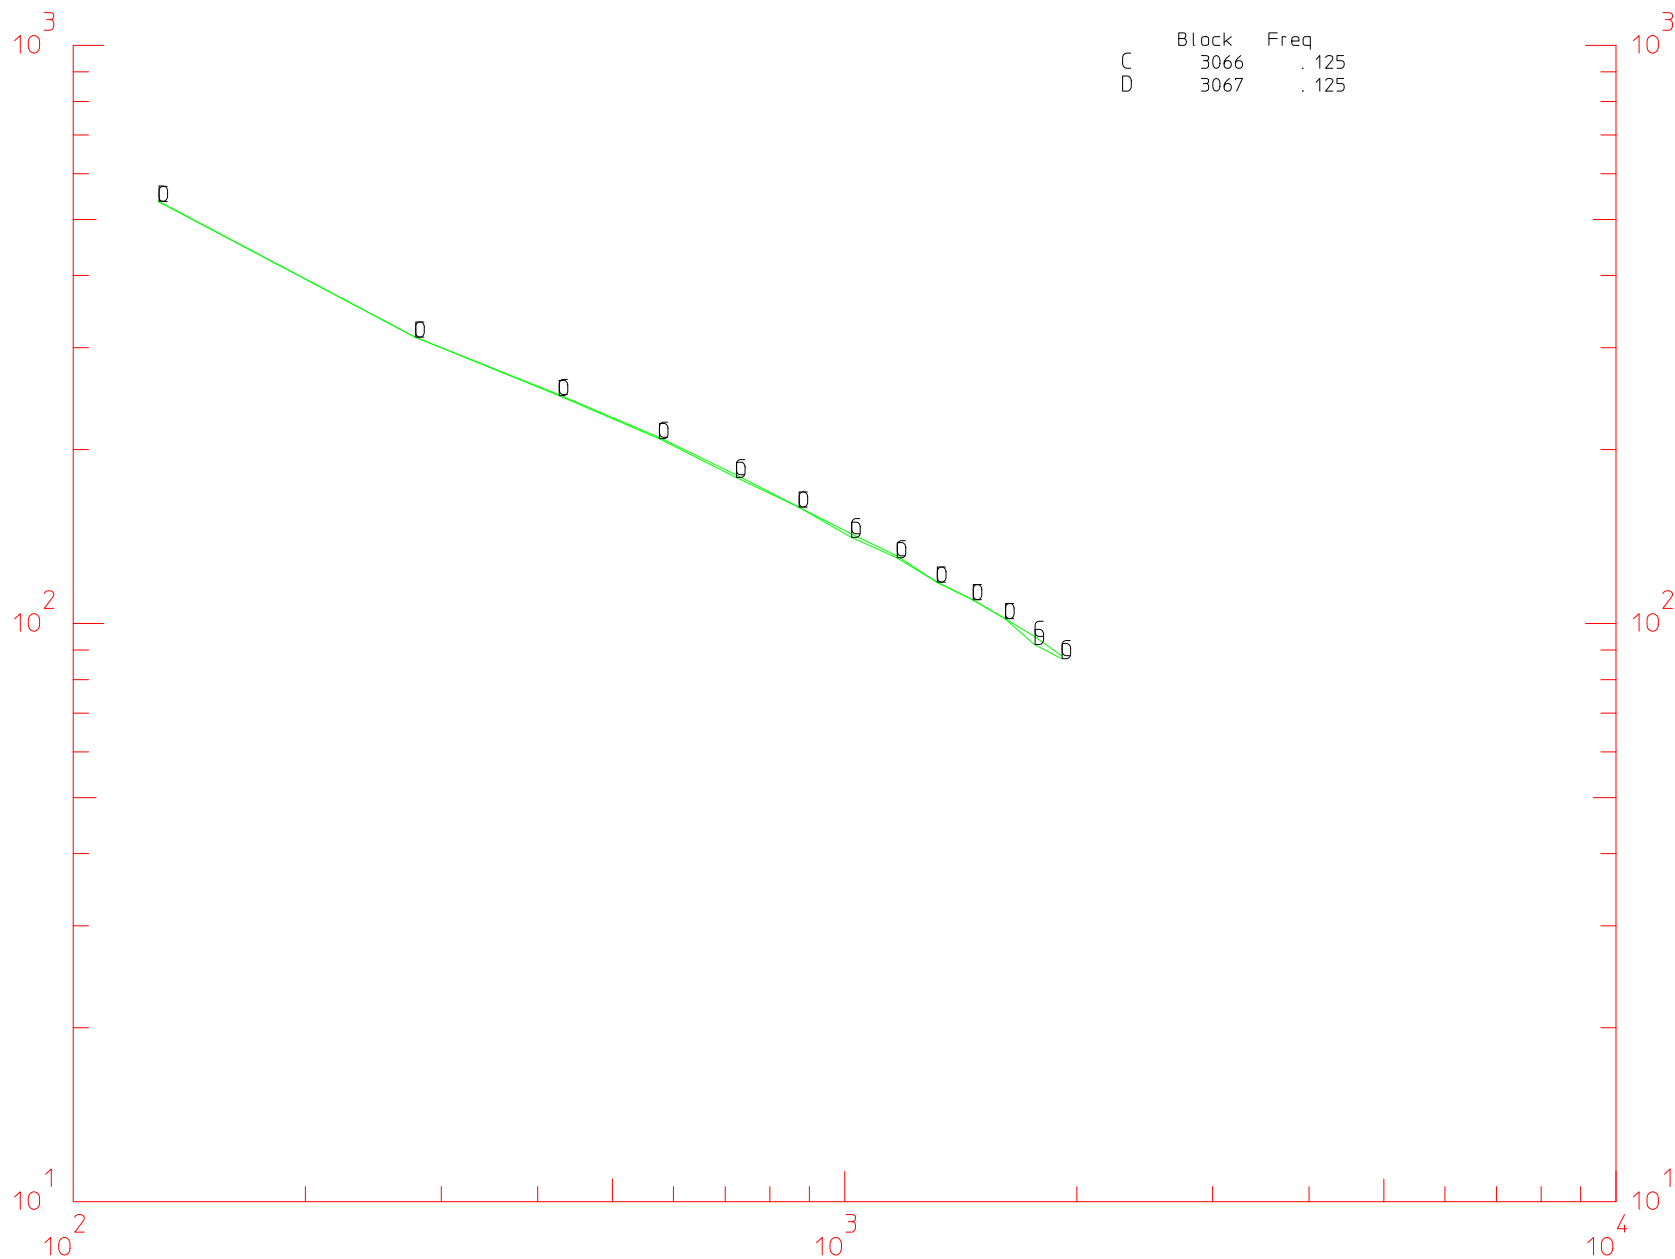


TxLen= 2141. Line= 5278. Stn= 3.



Mable Flats Grid22

Line= 2141N


TxLen= 2141. Line= 5303. Stn= 4.

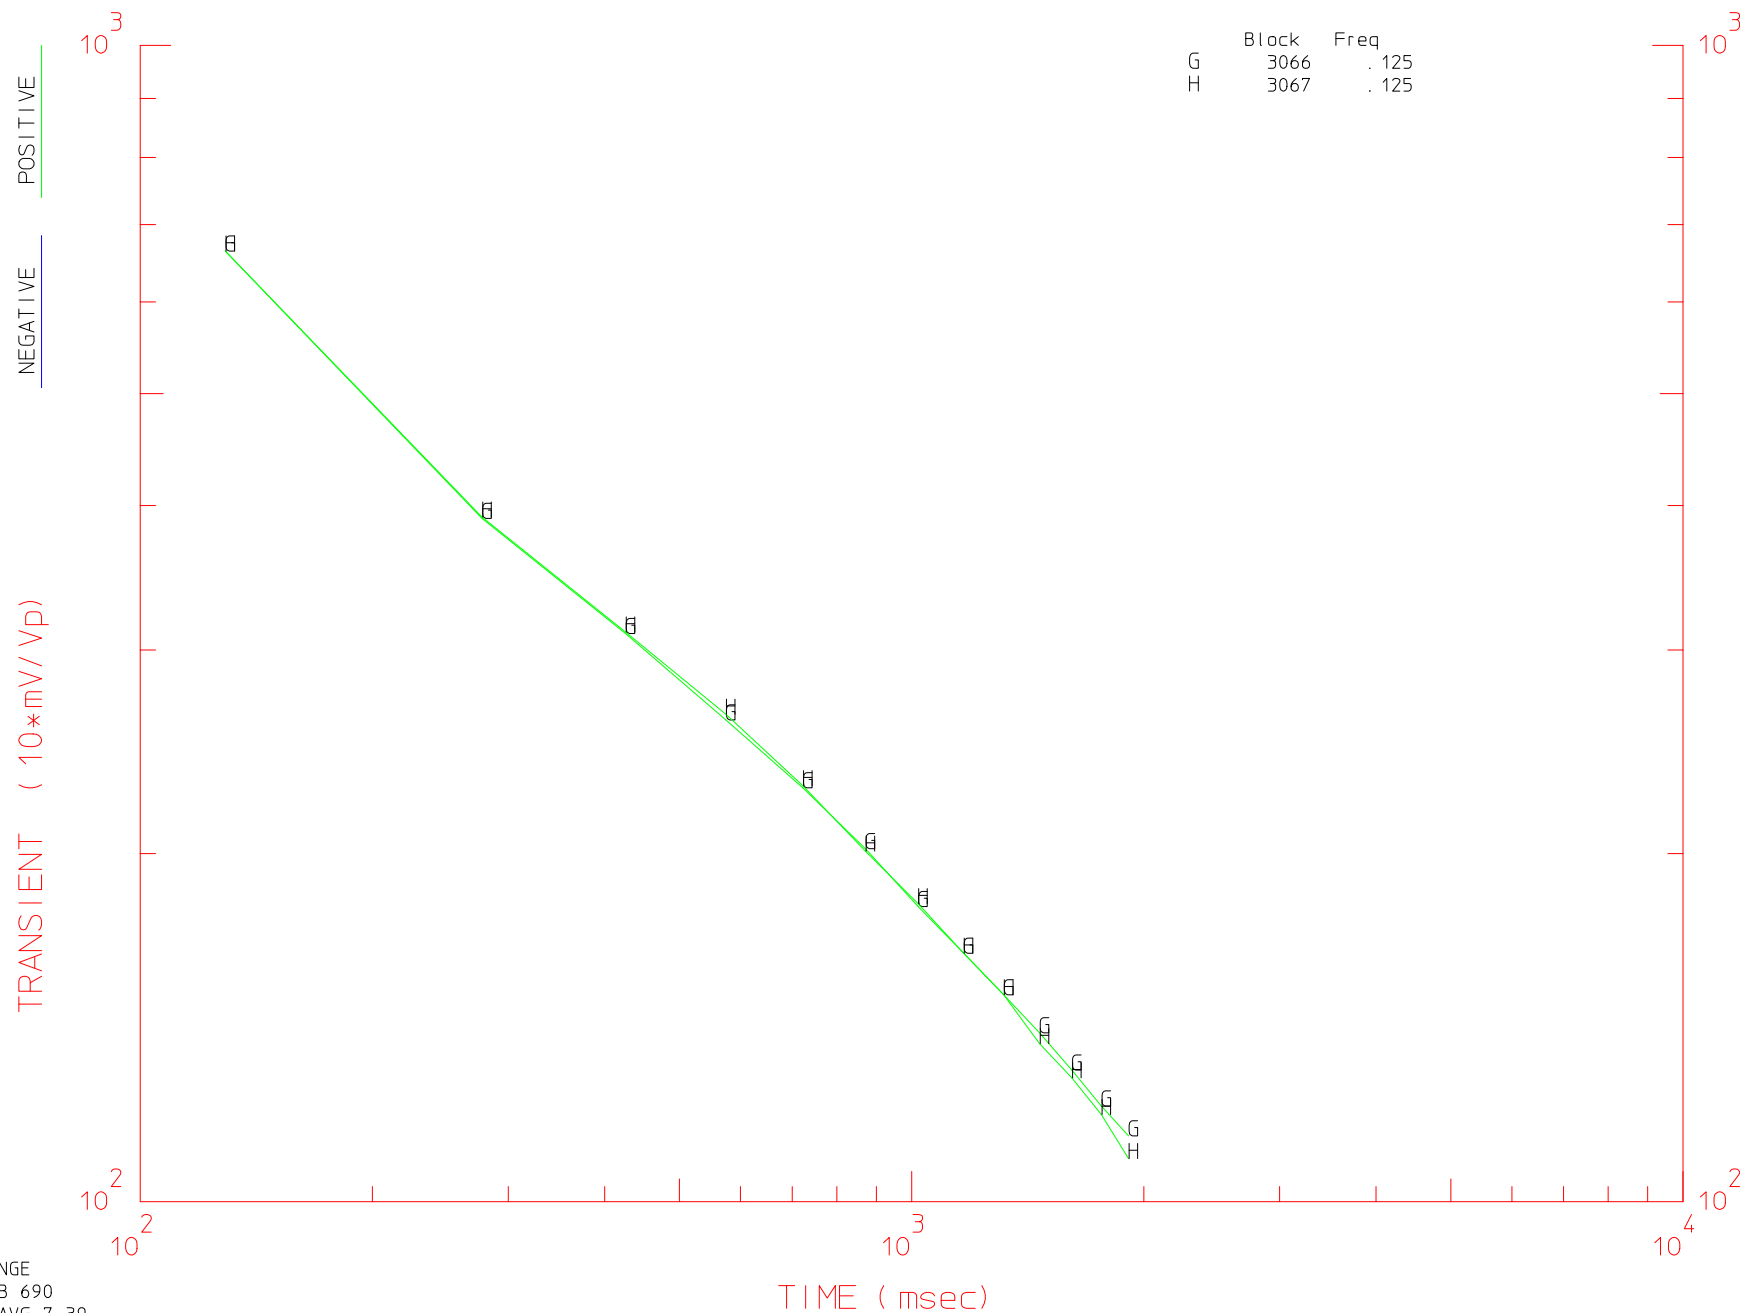

Mable Flats Grid22

Line= 2141N

TxLen= 2141. Line= 5128. Stn= 1.

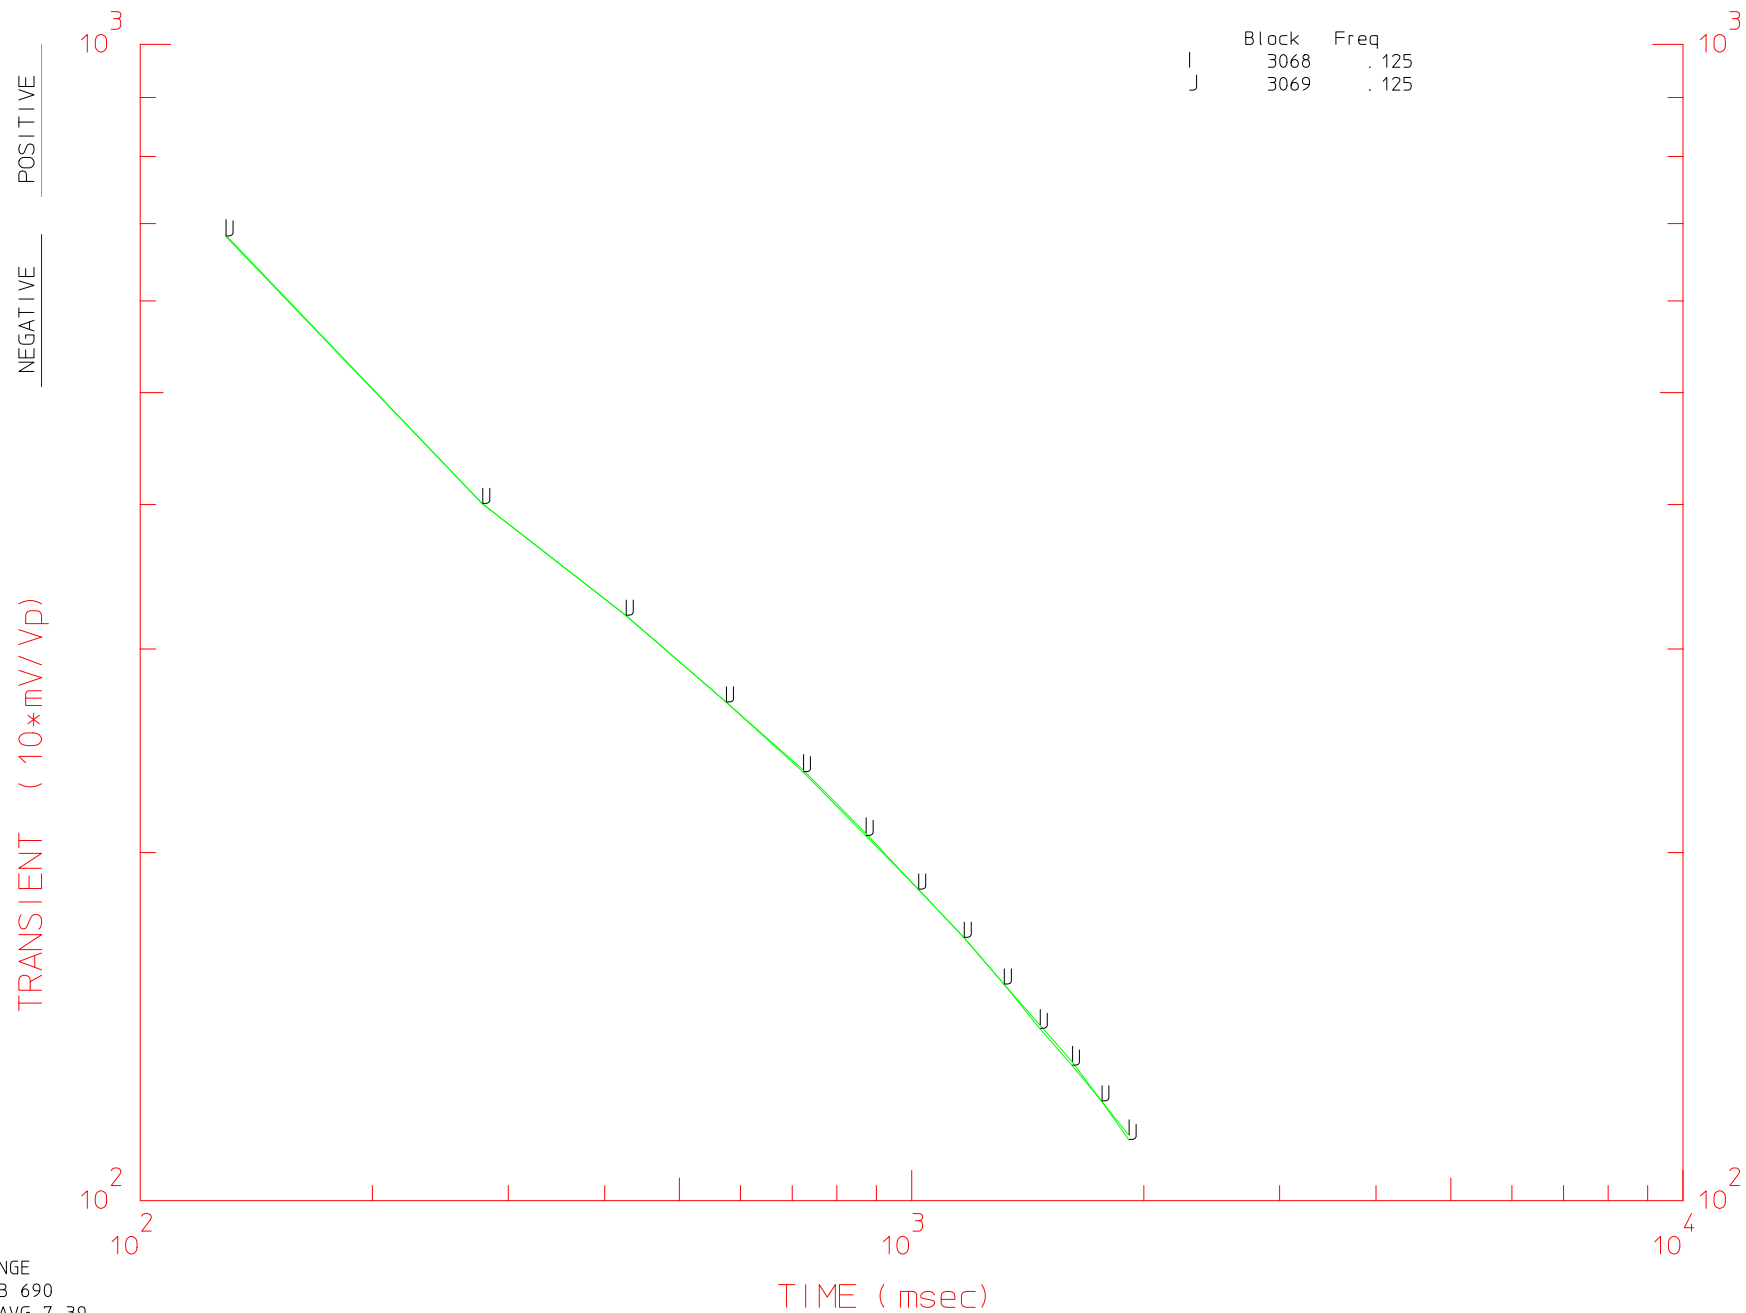

Mable Flats Grid22

Line= 2141N


TxLen= 2141. Line= 5153. Stn= 2.

	Block	Freq
K	3068	.125
L	3069	.125

POSITIVE

NEGATIVE


TRANSIENT (10*mV/Vp)

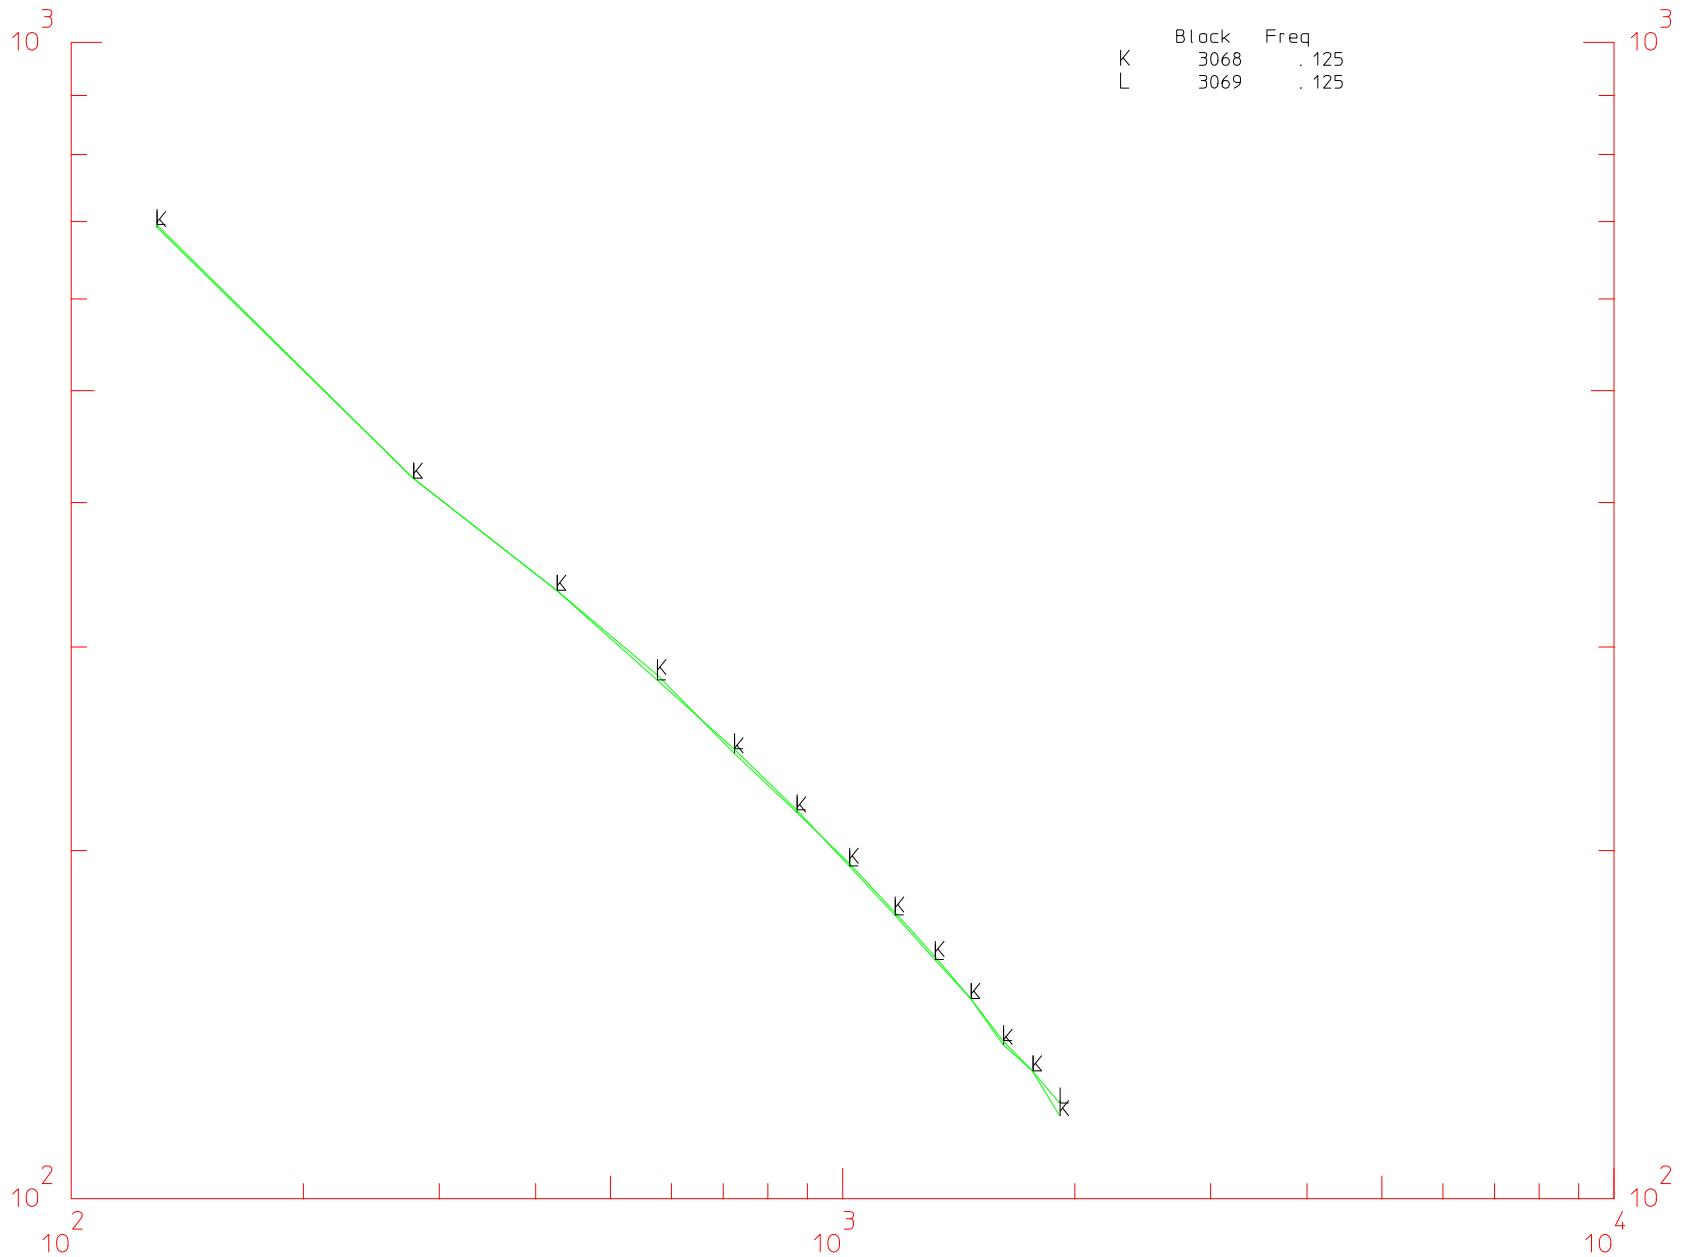

Mable Flats Grid22

Line= 2141N

TxLen= 2141. Line= 5178. Stn= 3.

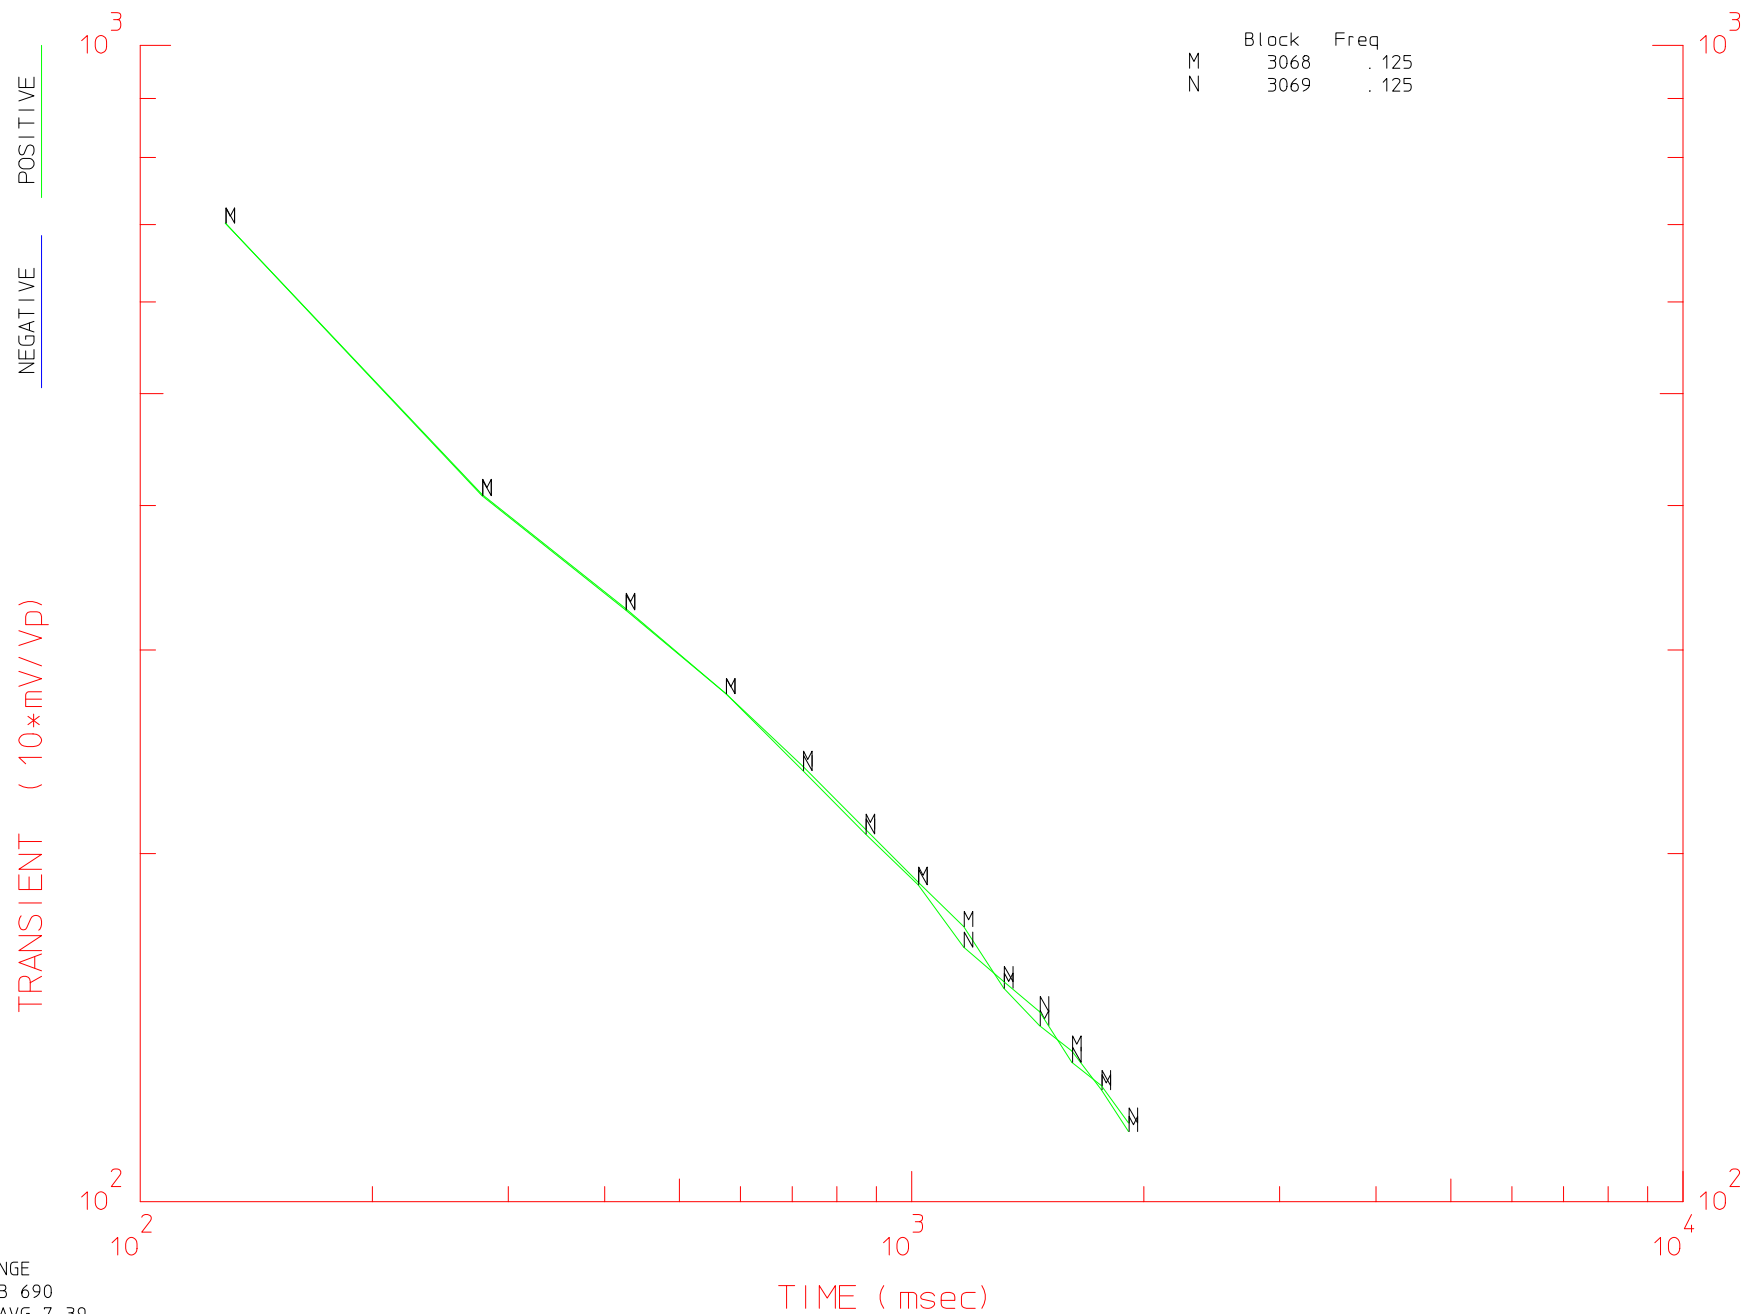


Mable Flats Grid22

Line= 2141N

TxLen= 2141. Line= 5203. Stn= 4.

	Block	Freq
O	3068	.125
P	3069	.125

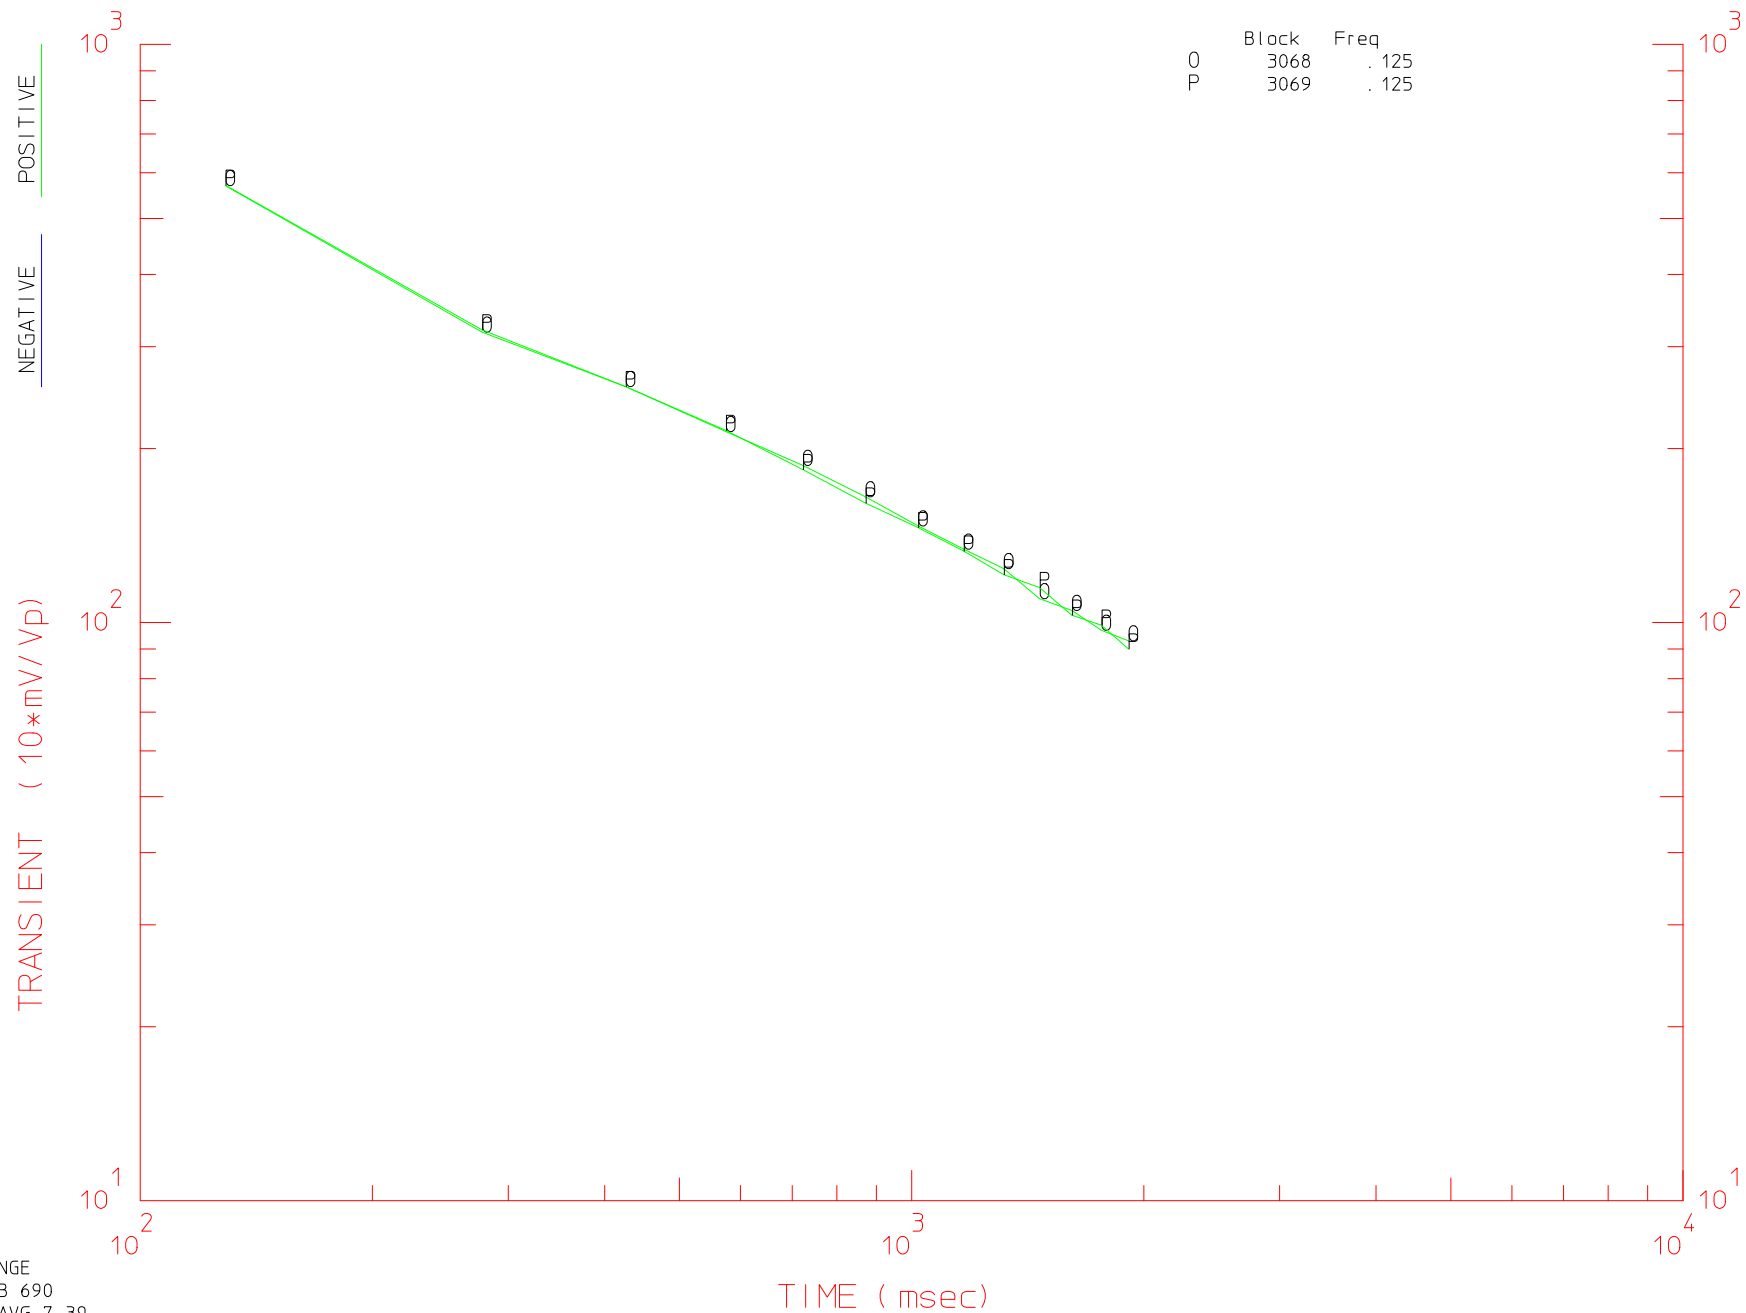


Mable Flats Grid22

Line= 2141N

TxLen= 2141. Line= 5028. Stn= 1.

	Block	Freq
Q	3070	.125
R	3071	.125

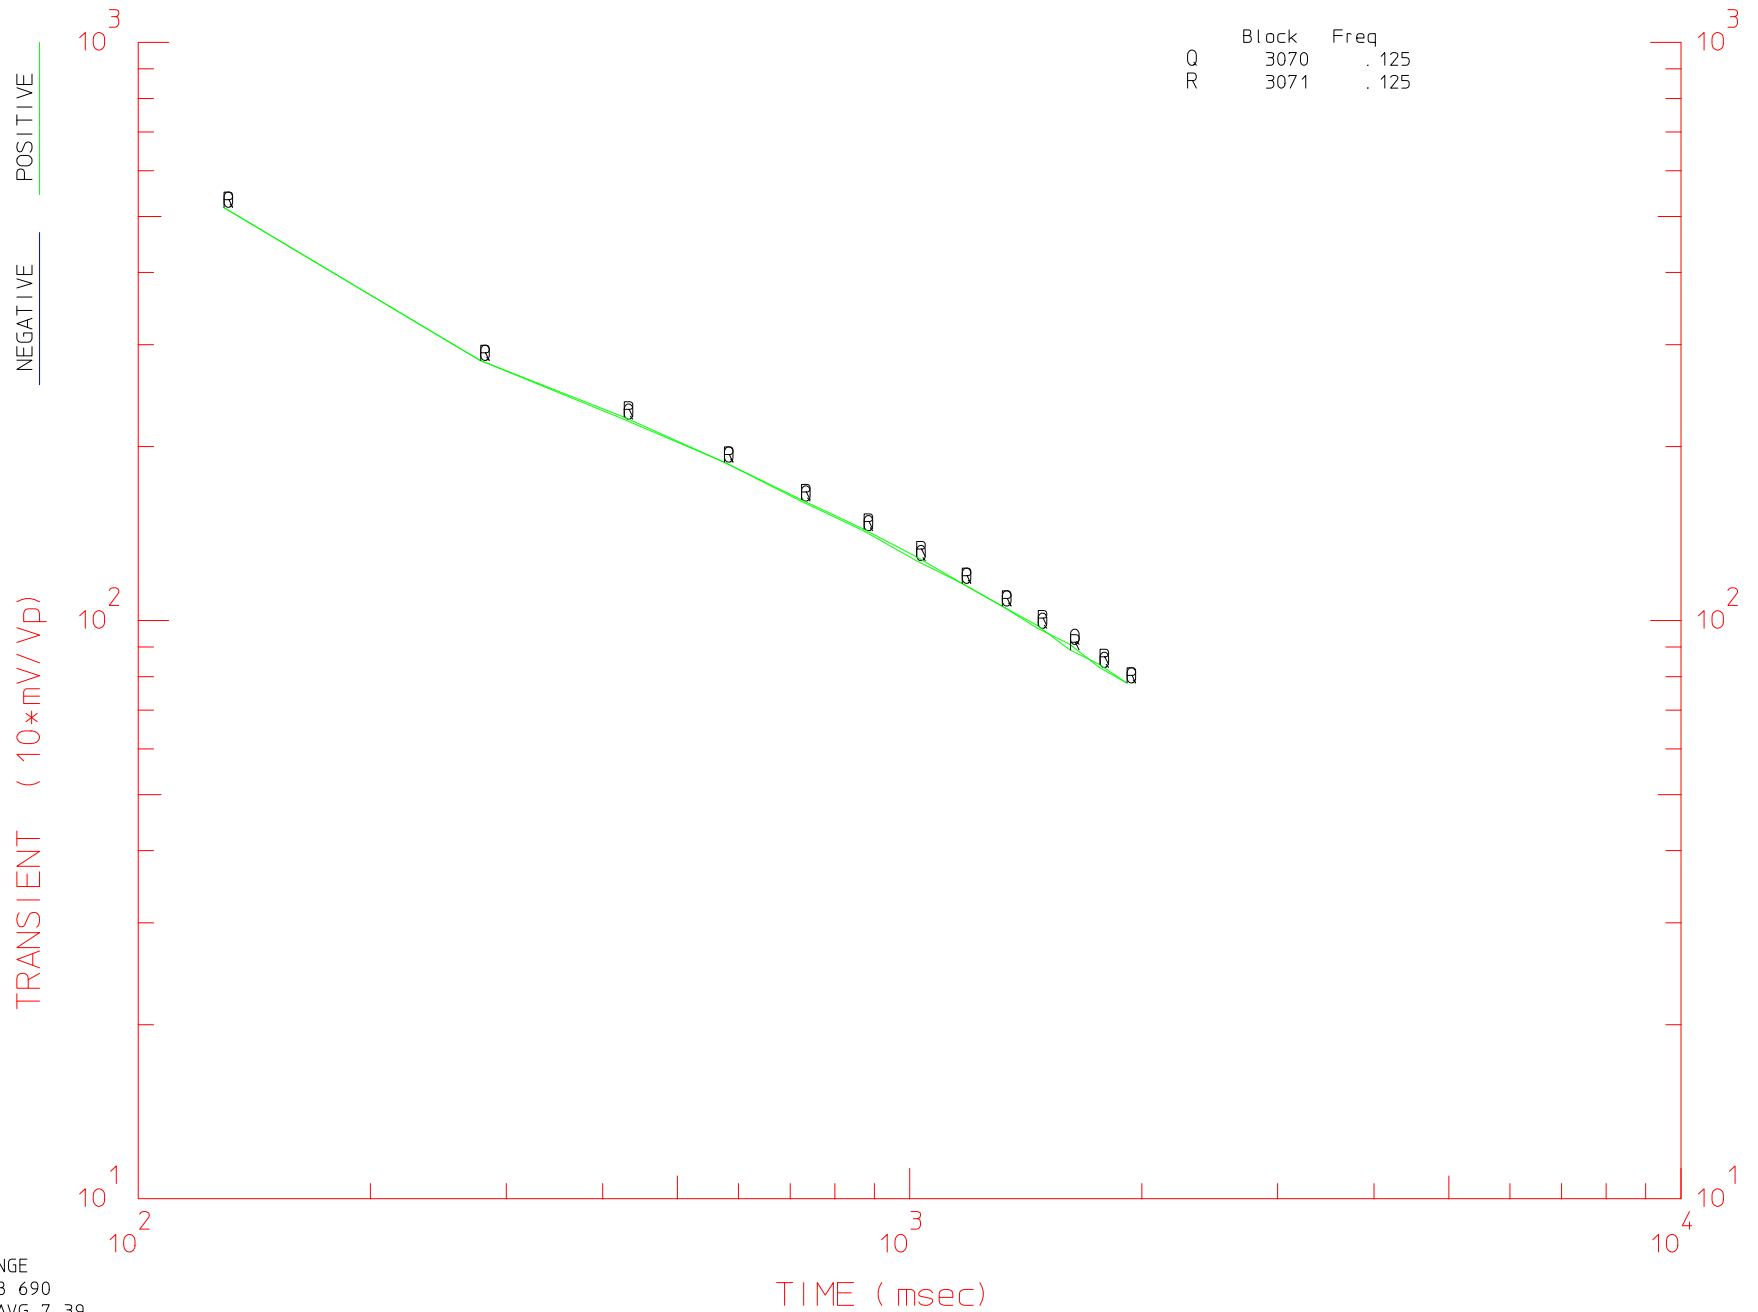

Mable Flats Grid22

Line= 2141N


TxLen= 2141. Line= 5053. Stn= 2.

	Block	Freq
S	3070	.125
T	3071	.125


POSITIVE

NEGATIVE

TRANSIENT (10*mV/Vp)

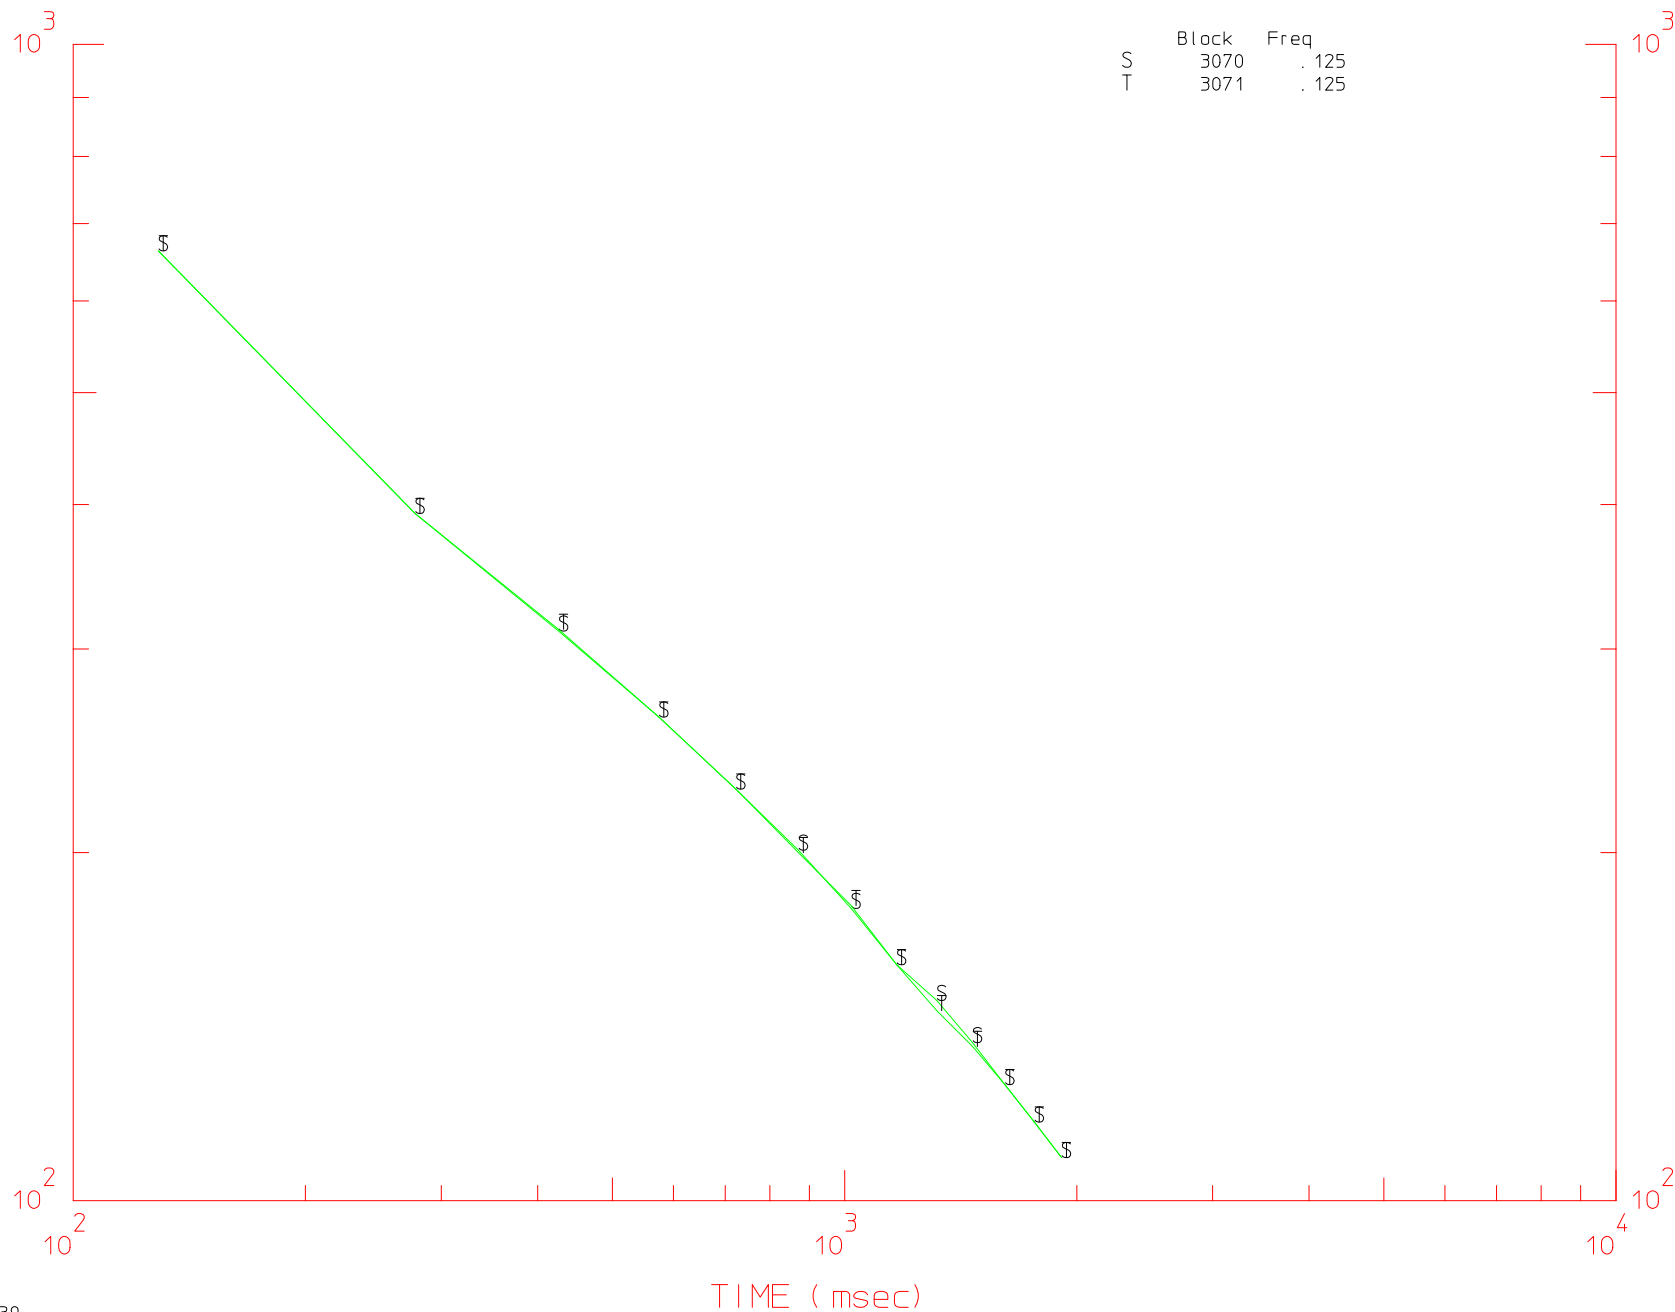

TxLen= 2141. Line= 5078. Stn= 3.



Mable Flats Grid22

Line= 2141N

TxLen= 2141. Line= 5103. Stn= 4.

	Block	Freq
W	3070	.125
X	3071	.125

POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

