




Mable Flats Grid22
Line= 2281

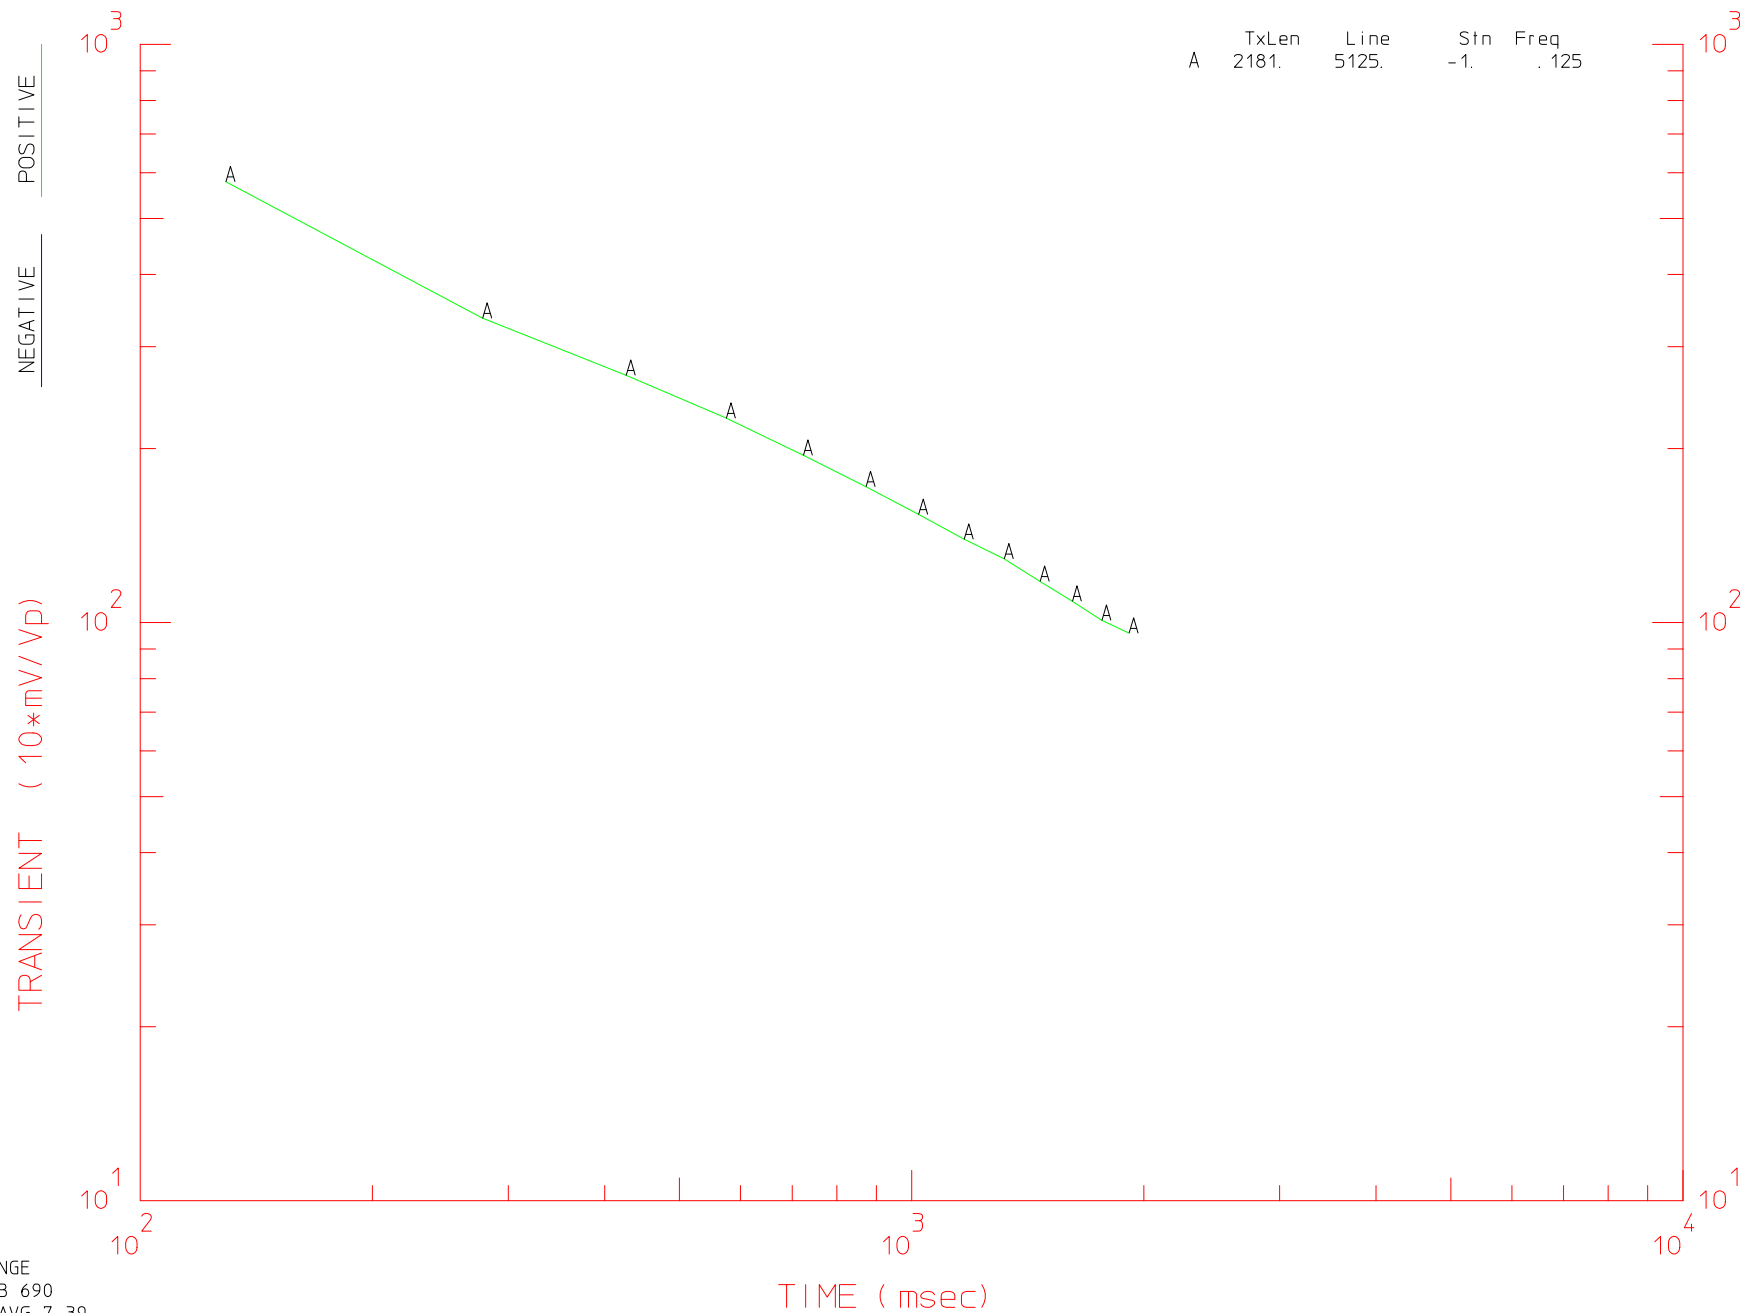


Mable Flats Grid22
Line= 2281

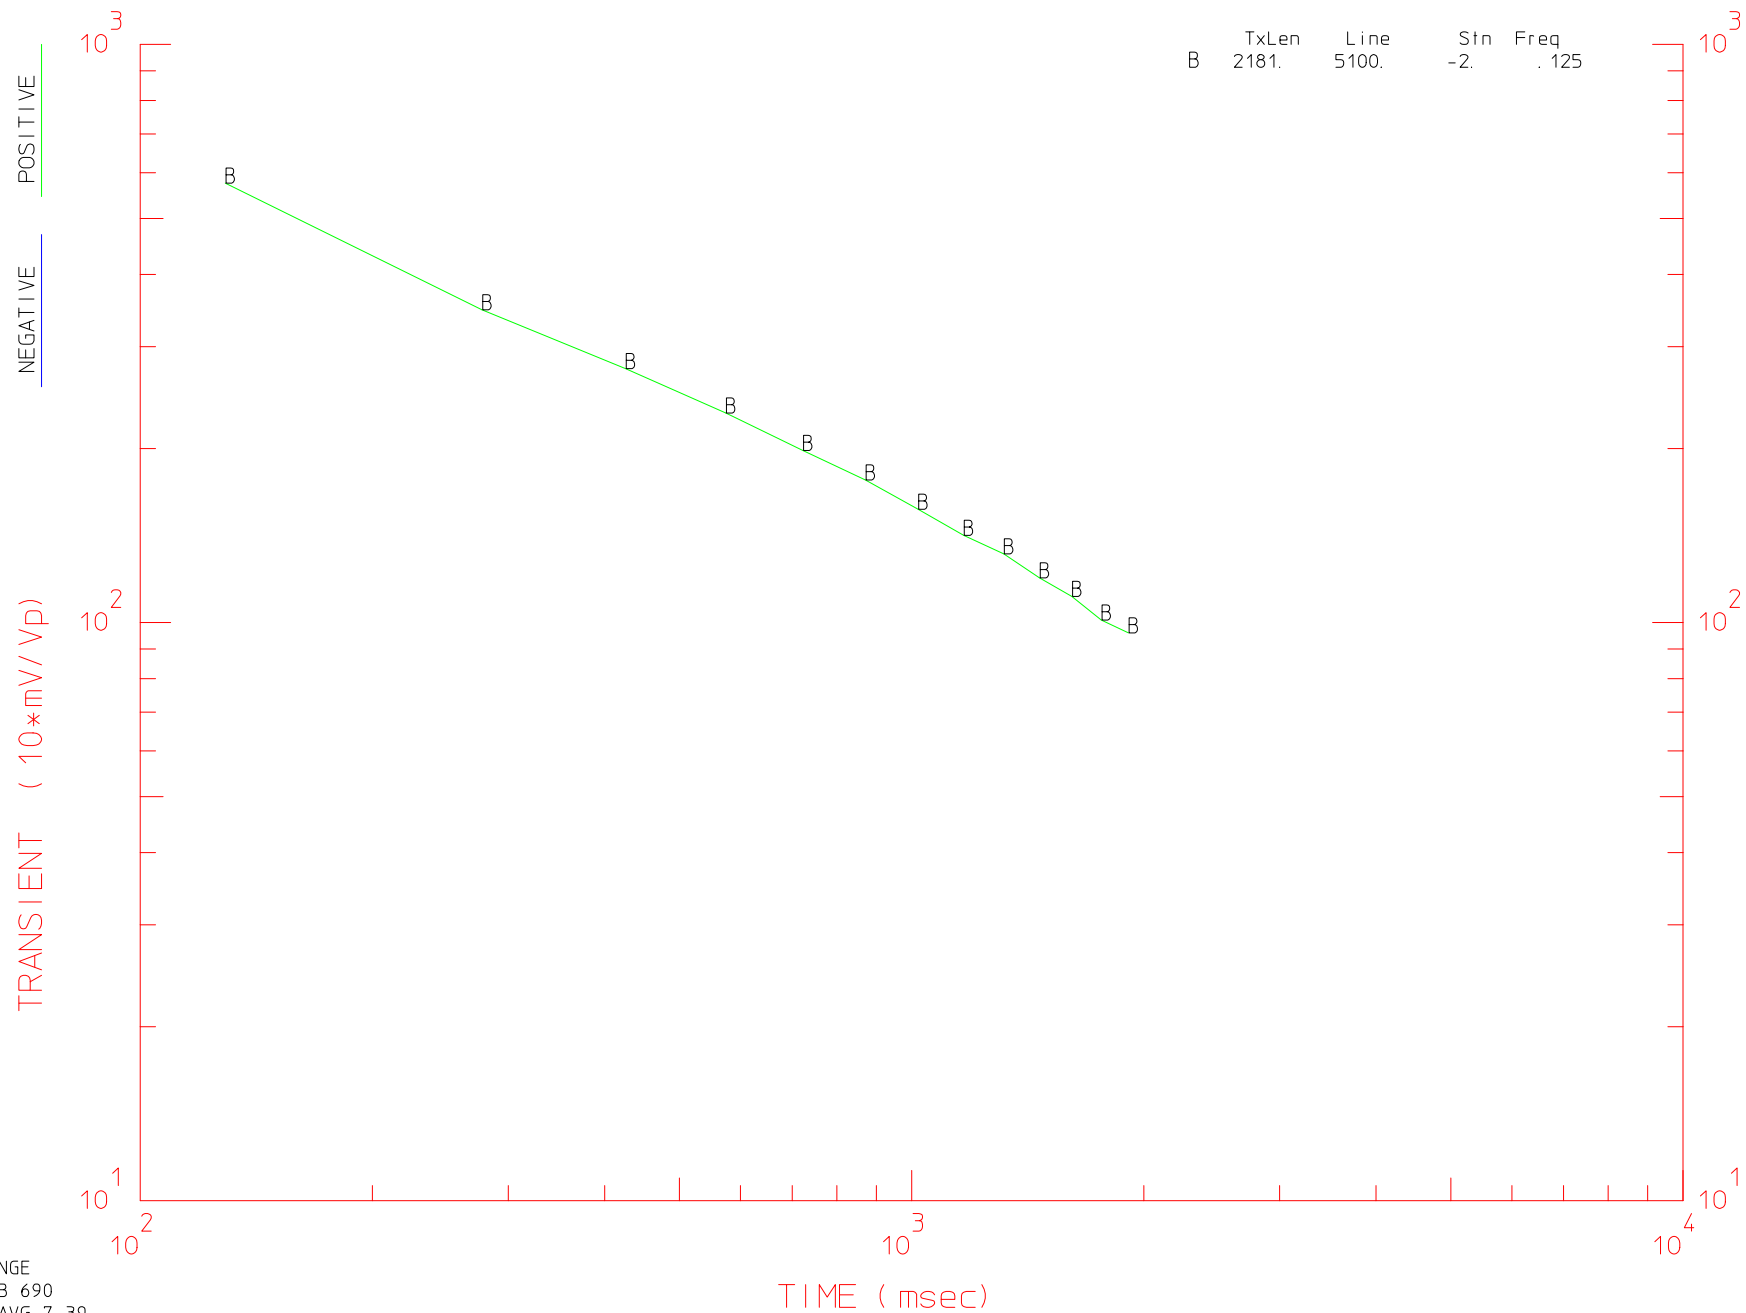


Mable Flats Grid22
Line= 2281

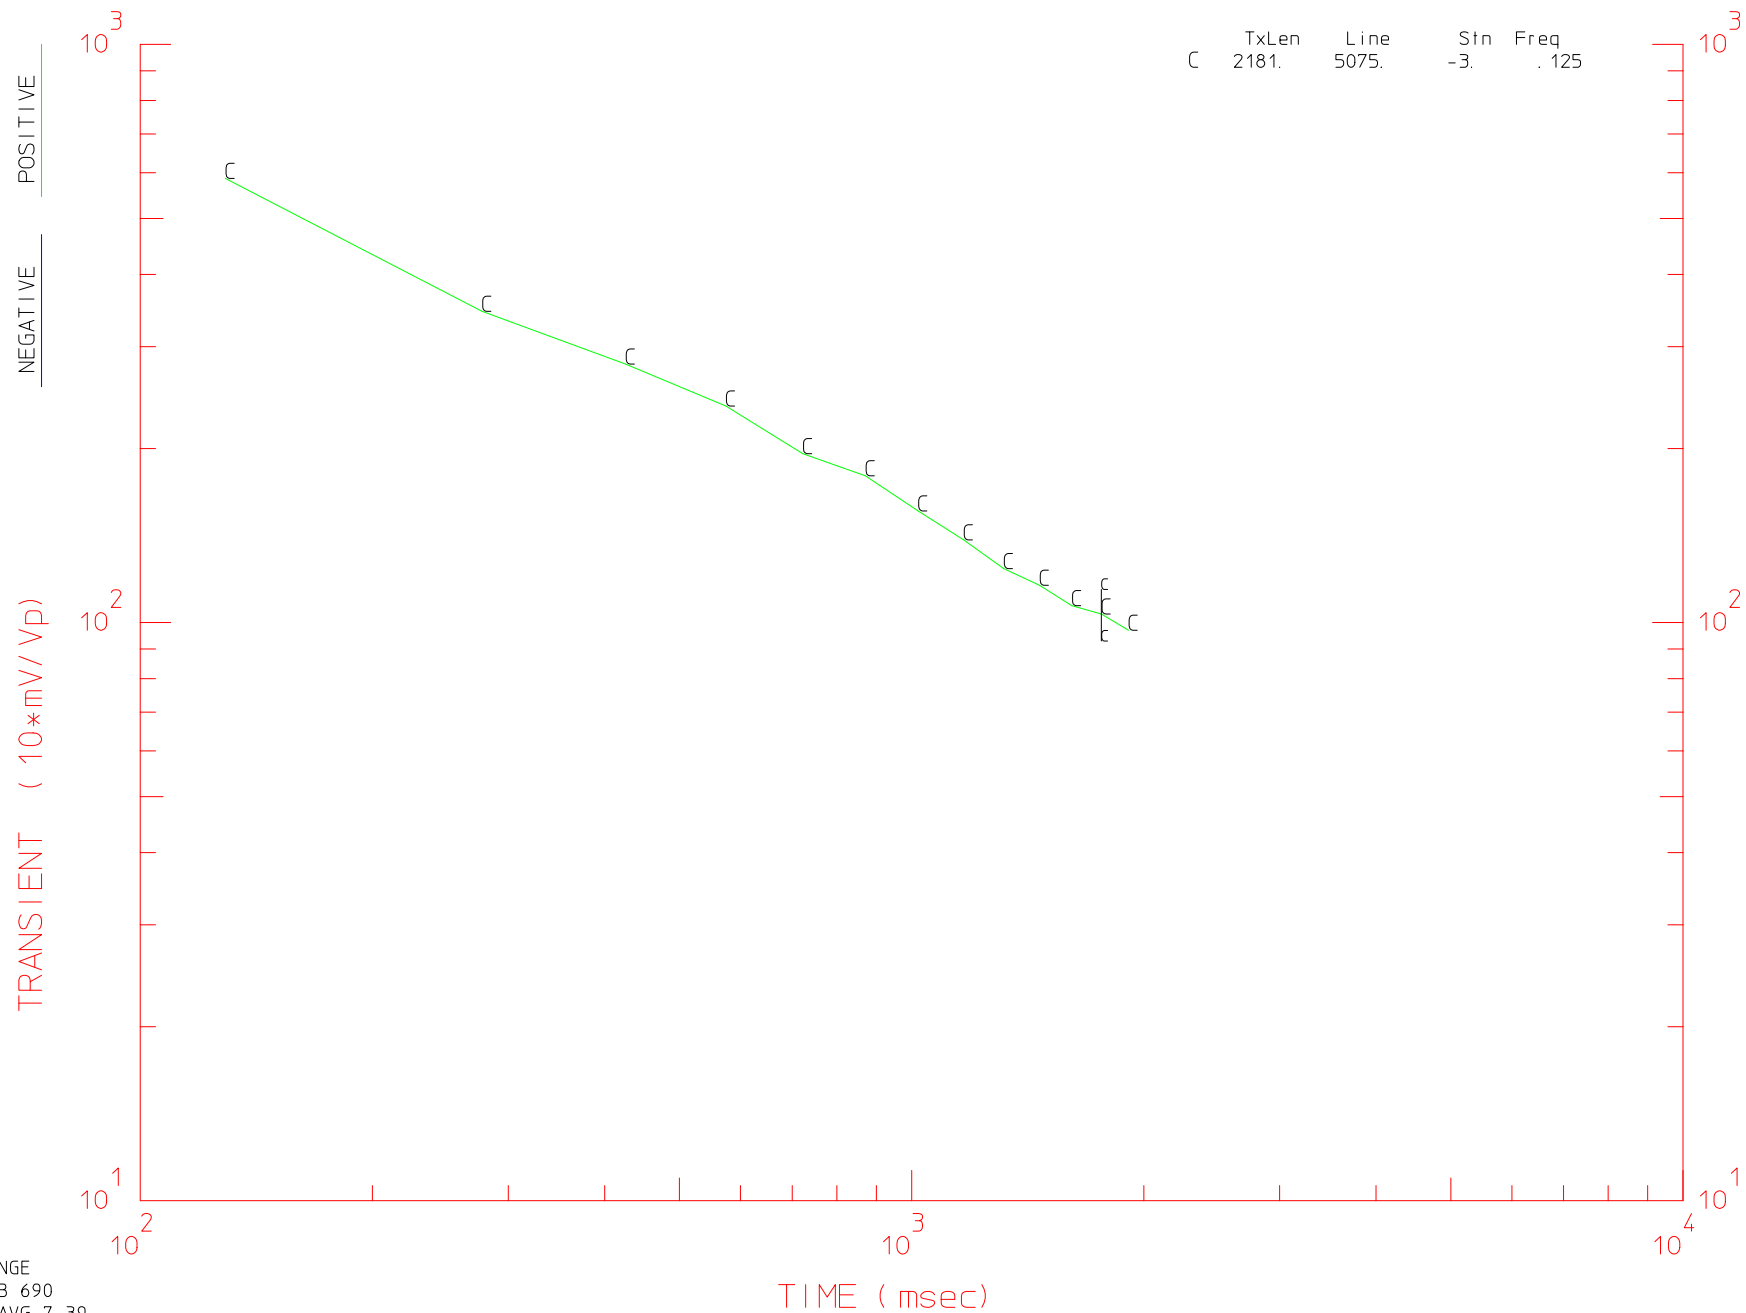

Mable Flats Grid22
Line= 2281

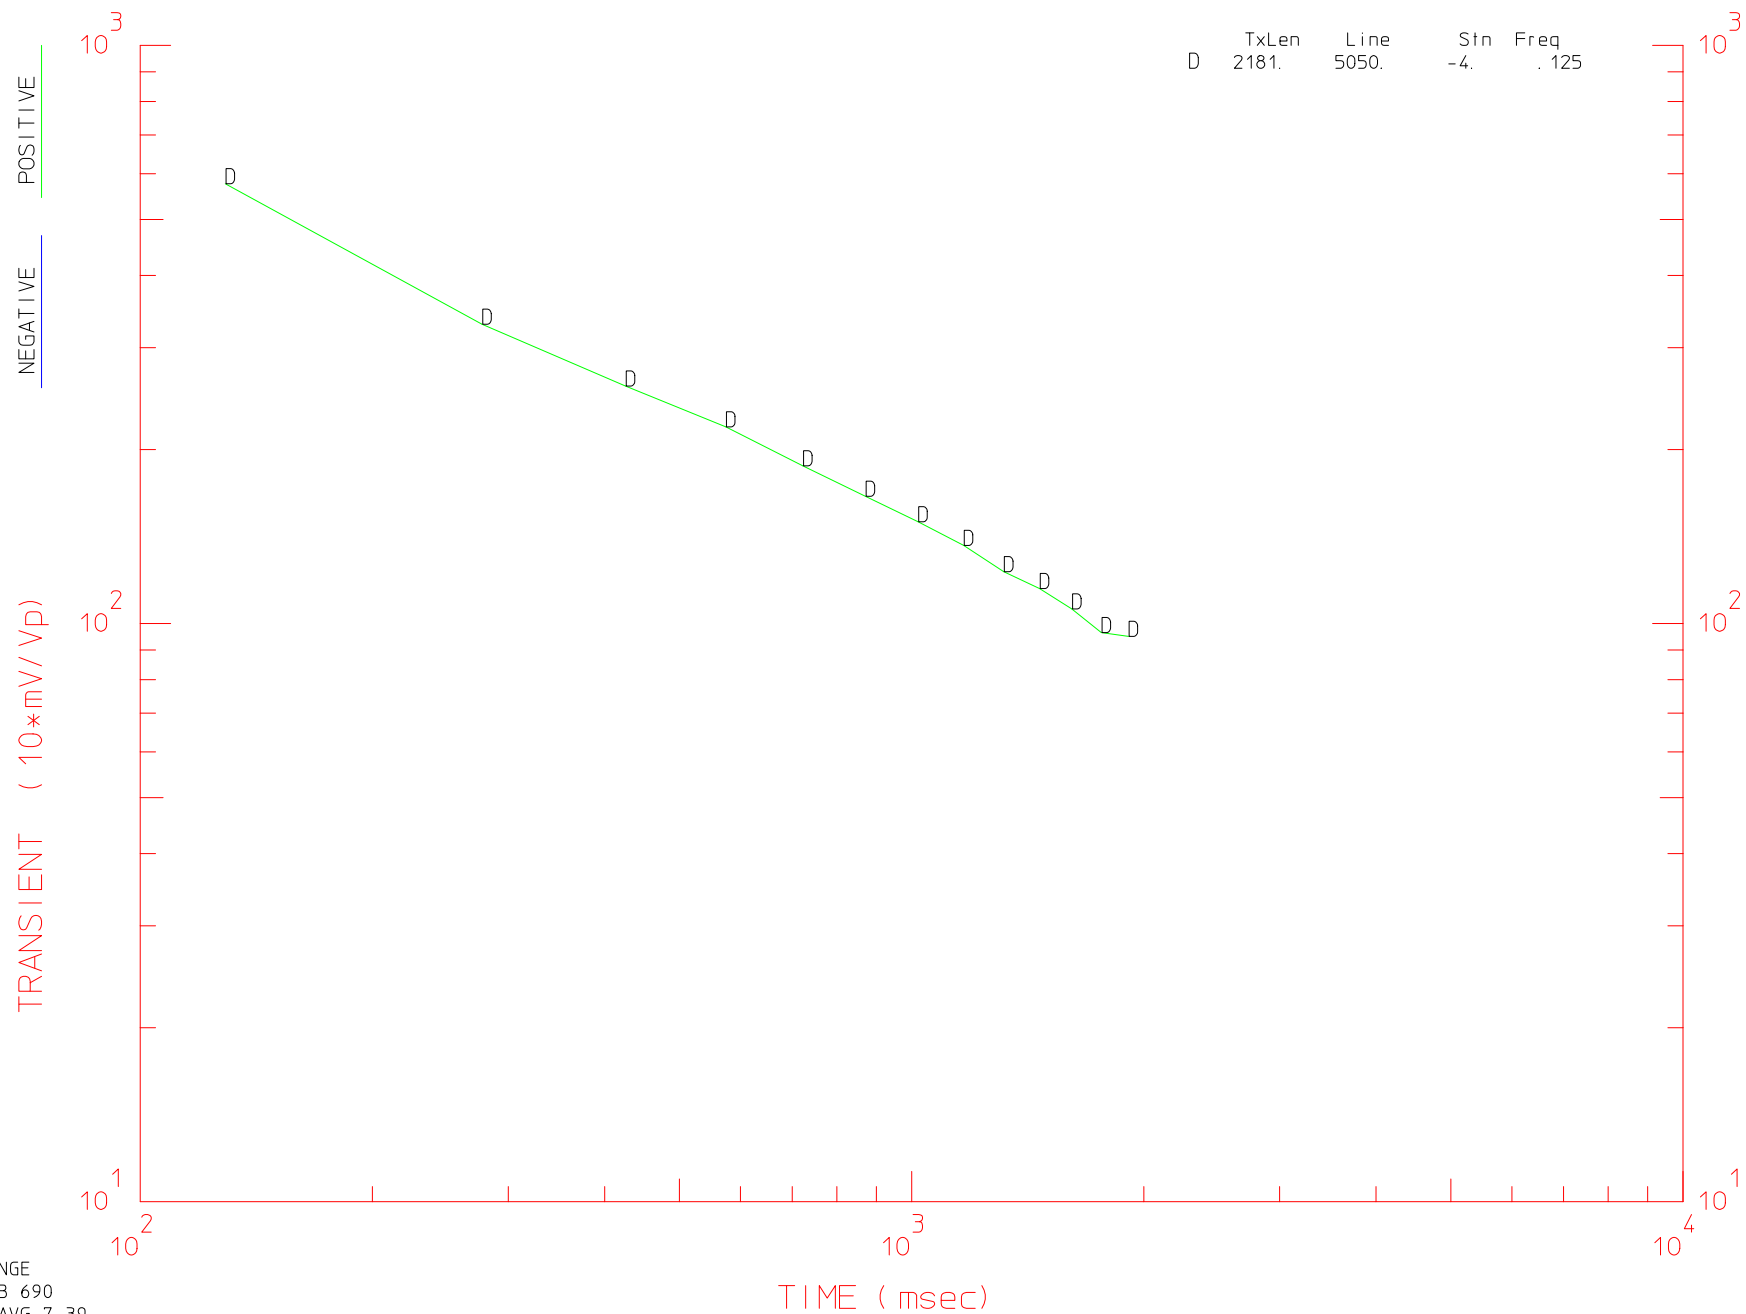


Mable Flats Grid22
Line= 2281

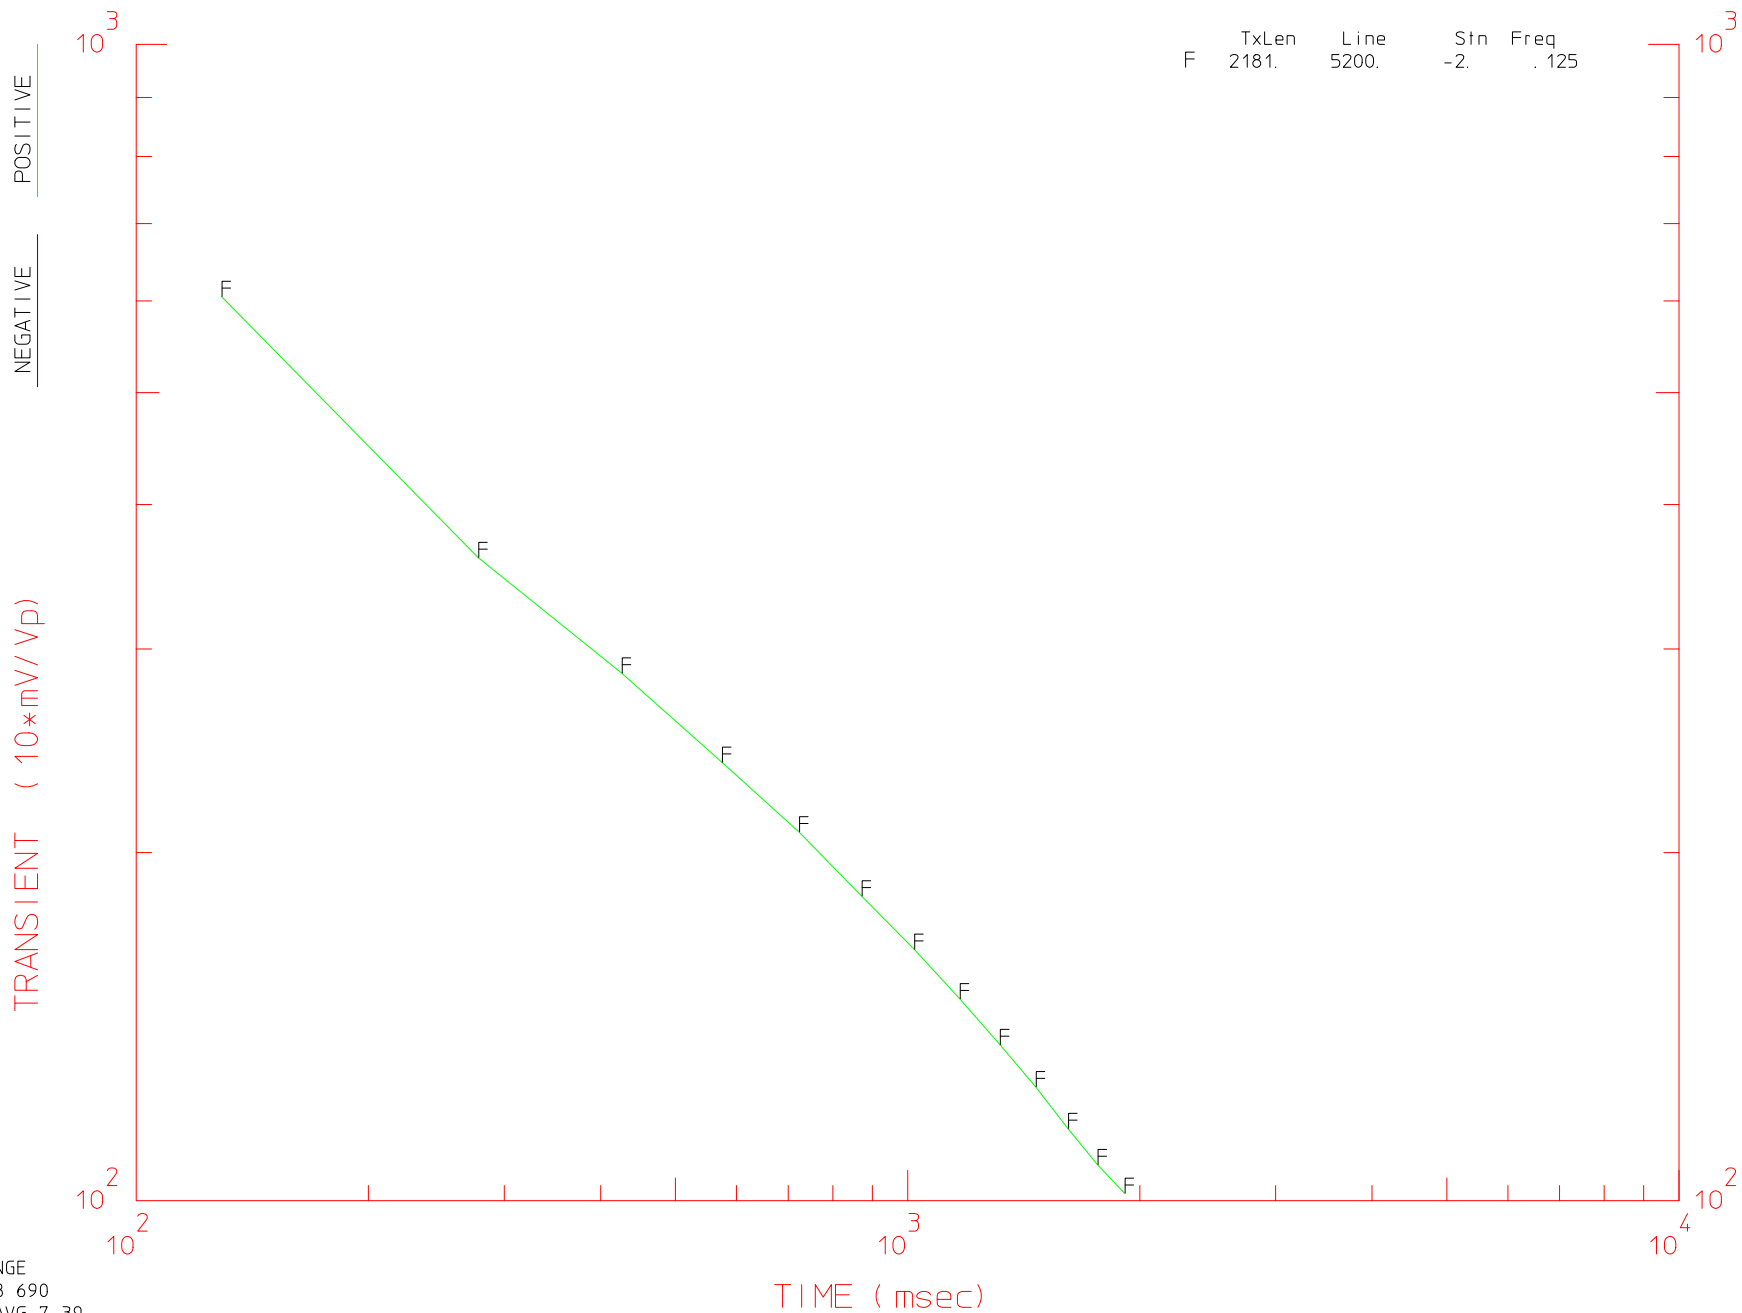

H TxLen 2181. Line 5150. Stn Freq
-4. .125


POSITIVE
NEGATIVE

TRANSIENT (10*mV/Vp)

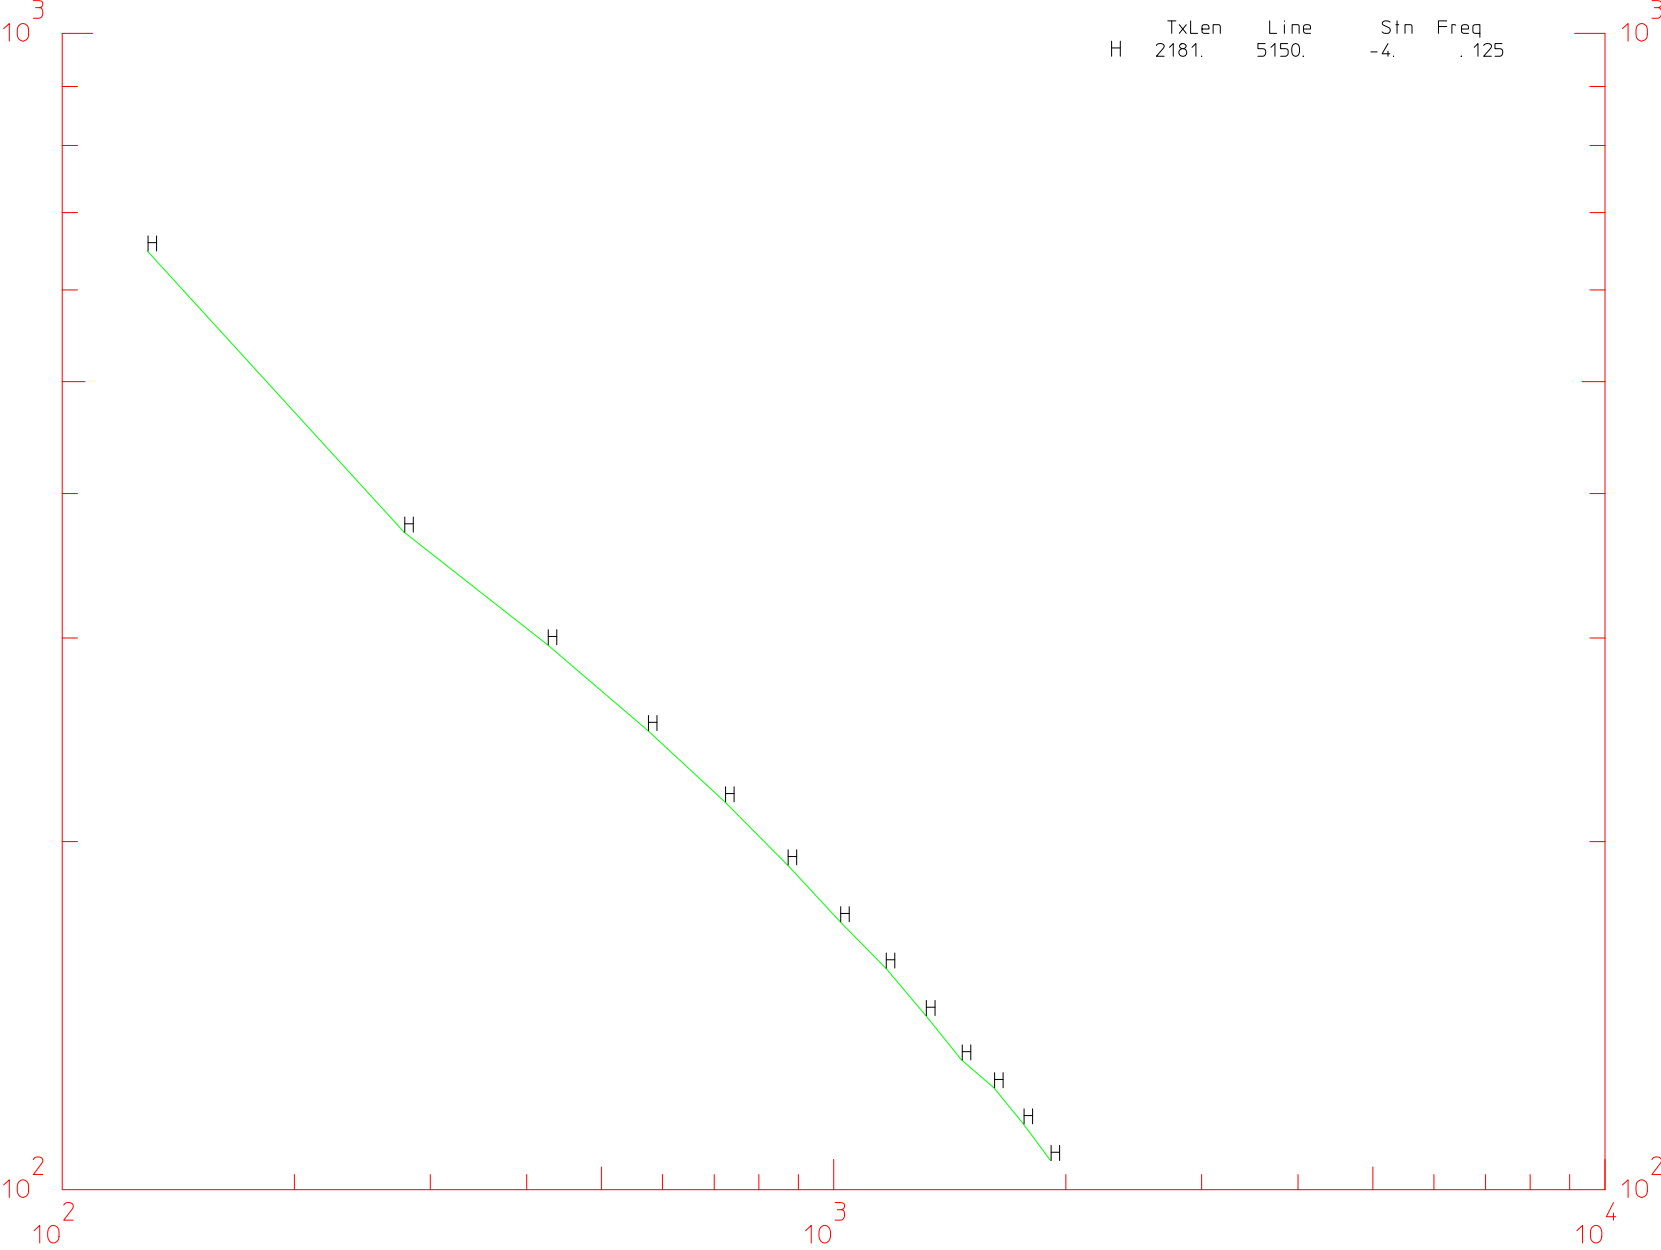


TIME (msec)


Mable Flats Grid22
Line= 2281

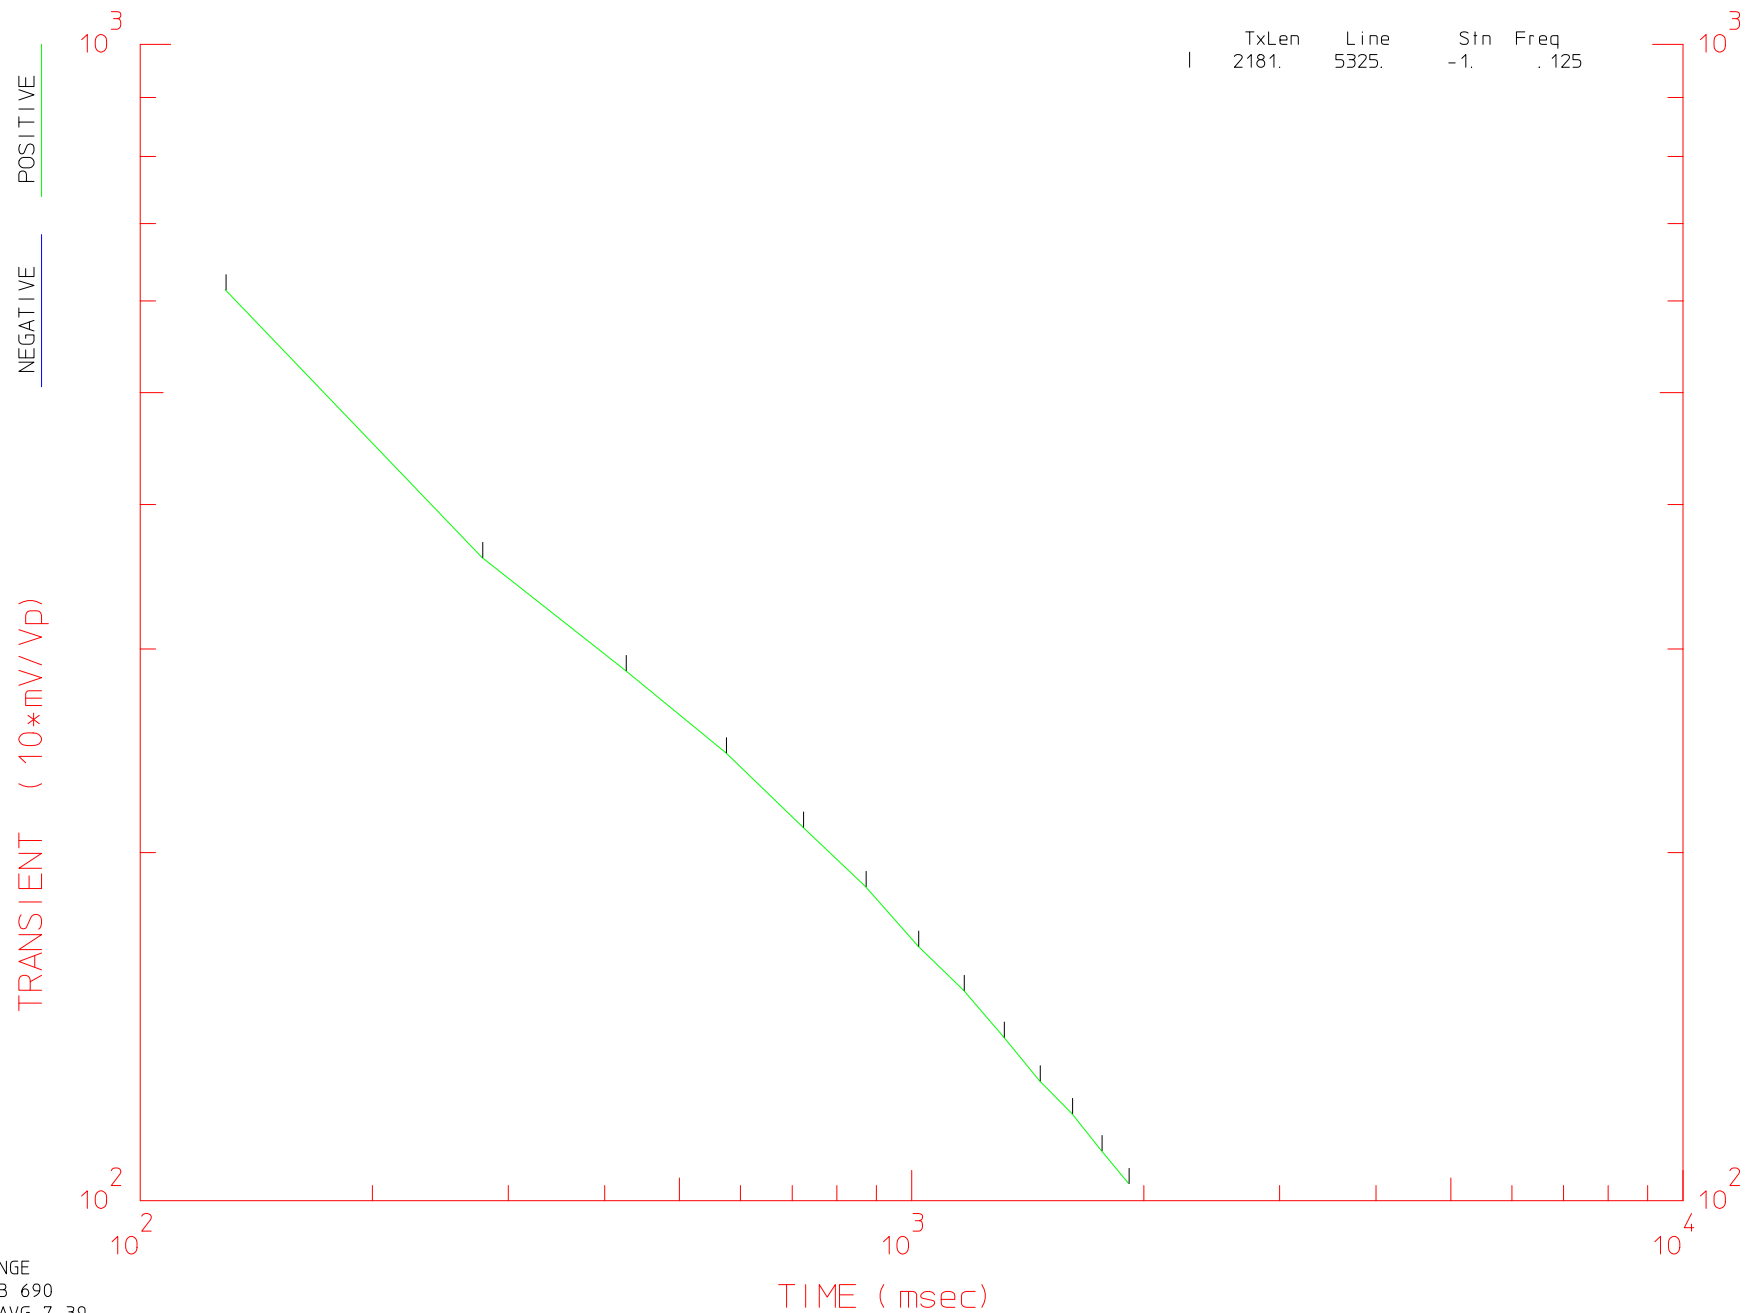

Mable Flats Grid22
Line= 2281

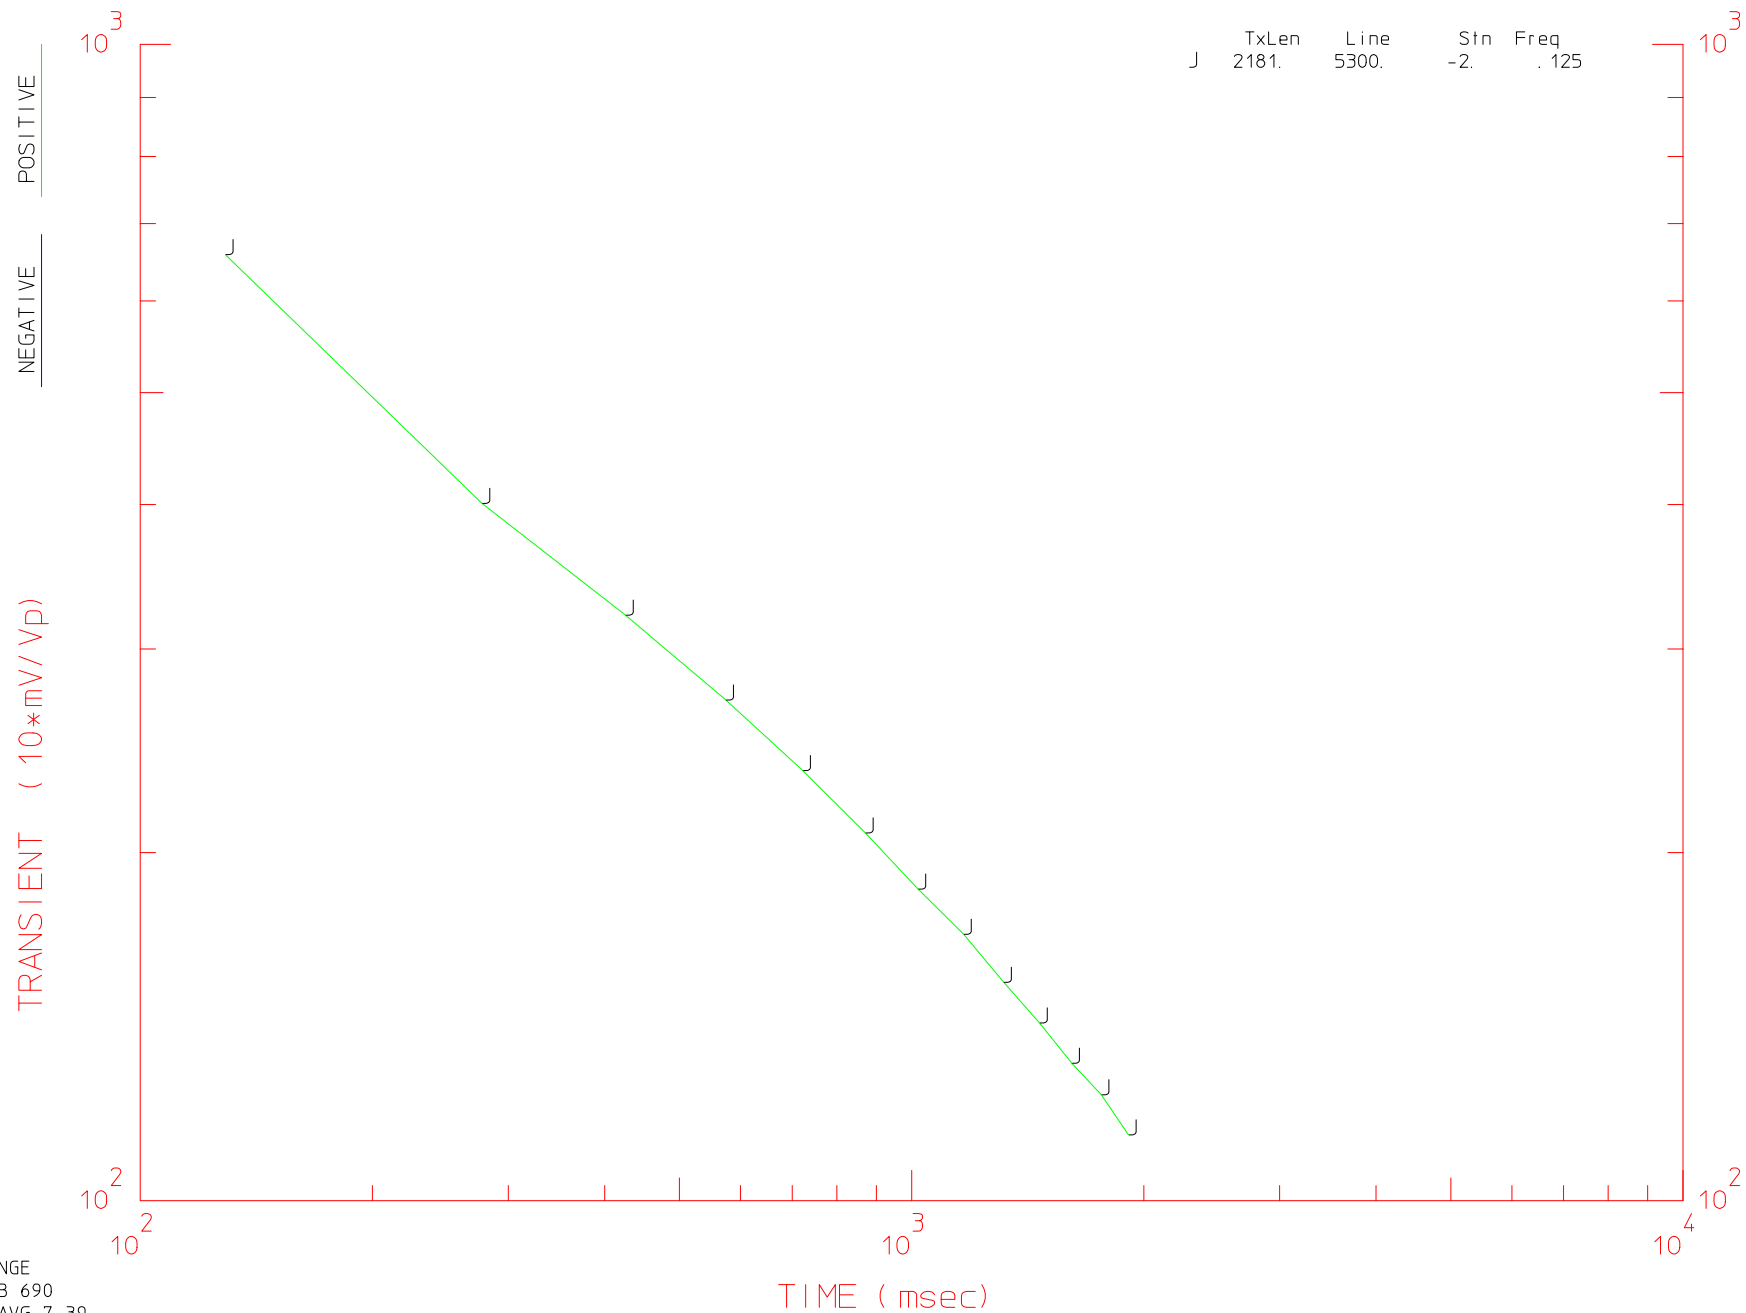


Mable Flats Grid22
Line= 2281

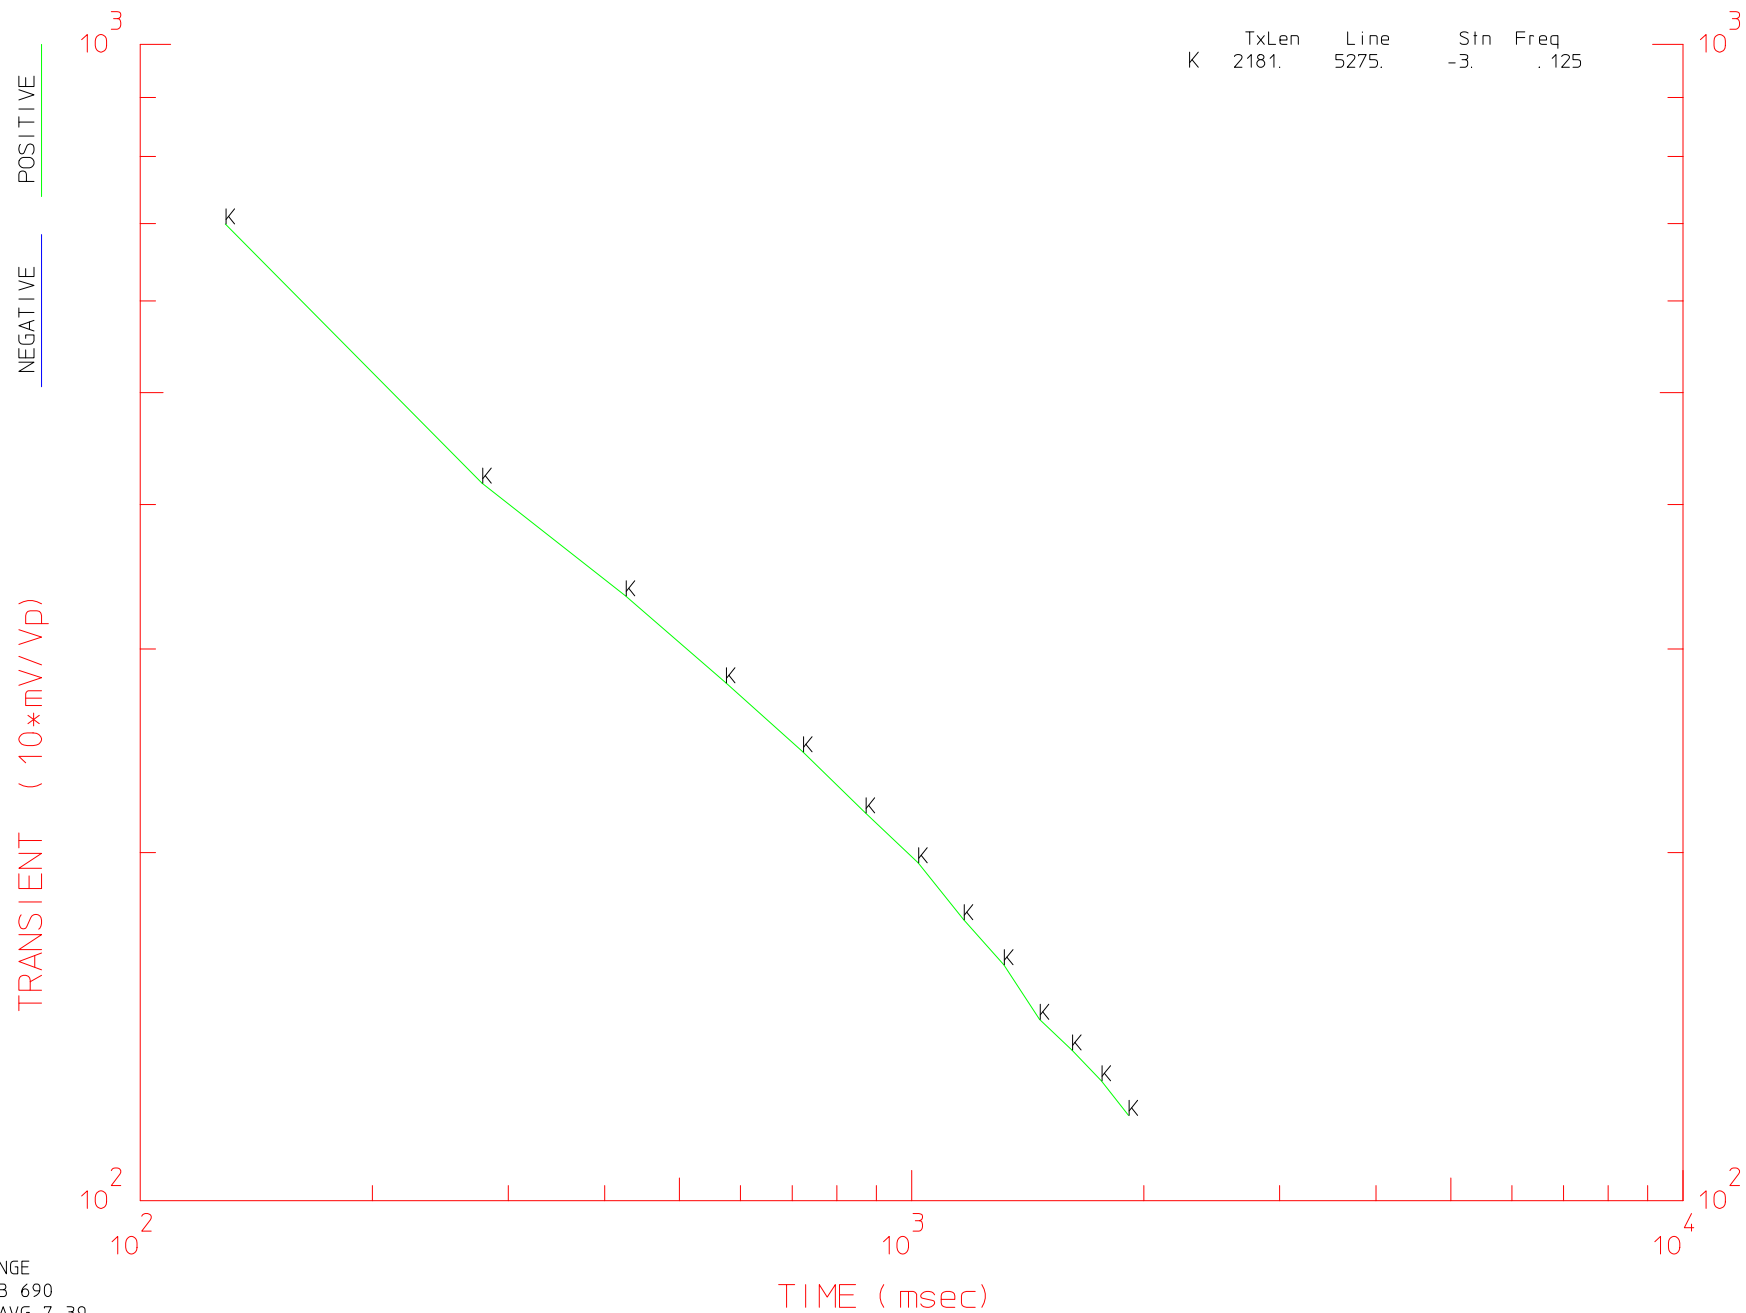

Line= 2281

Freq
.125

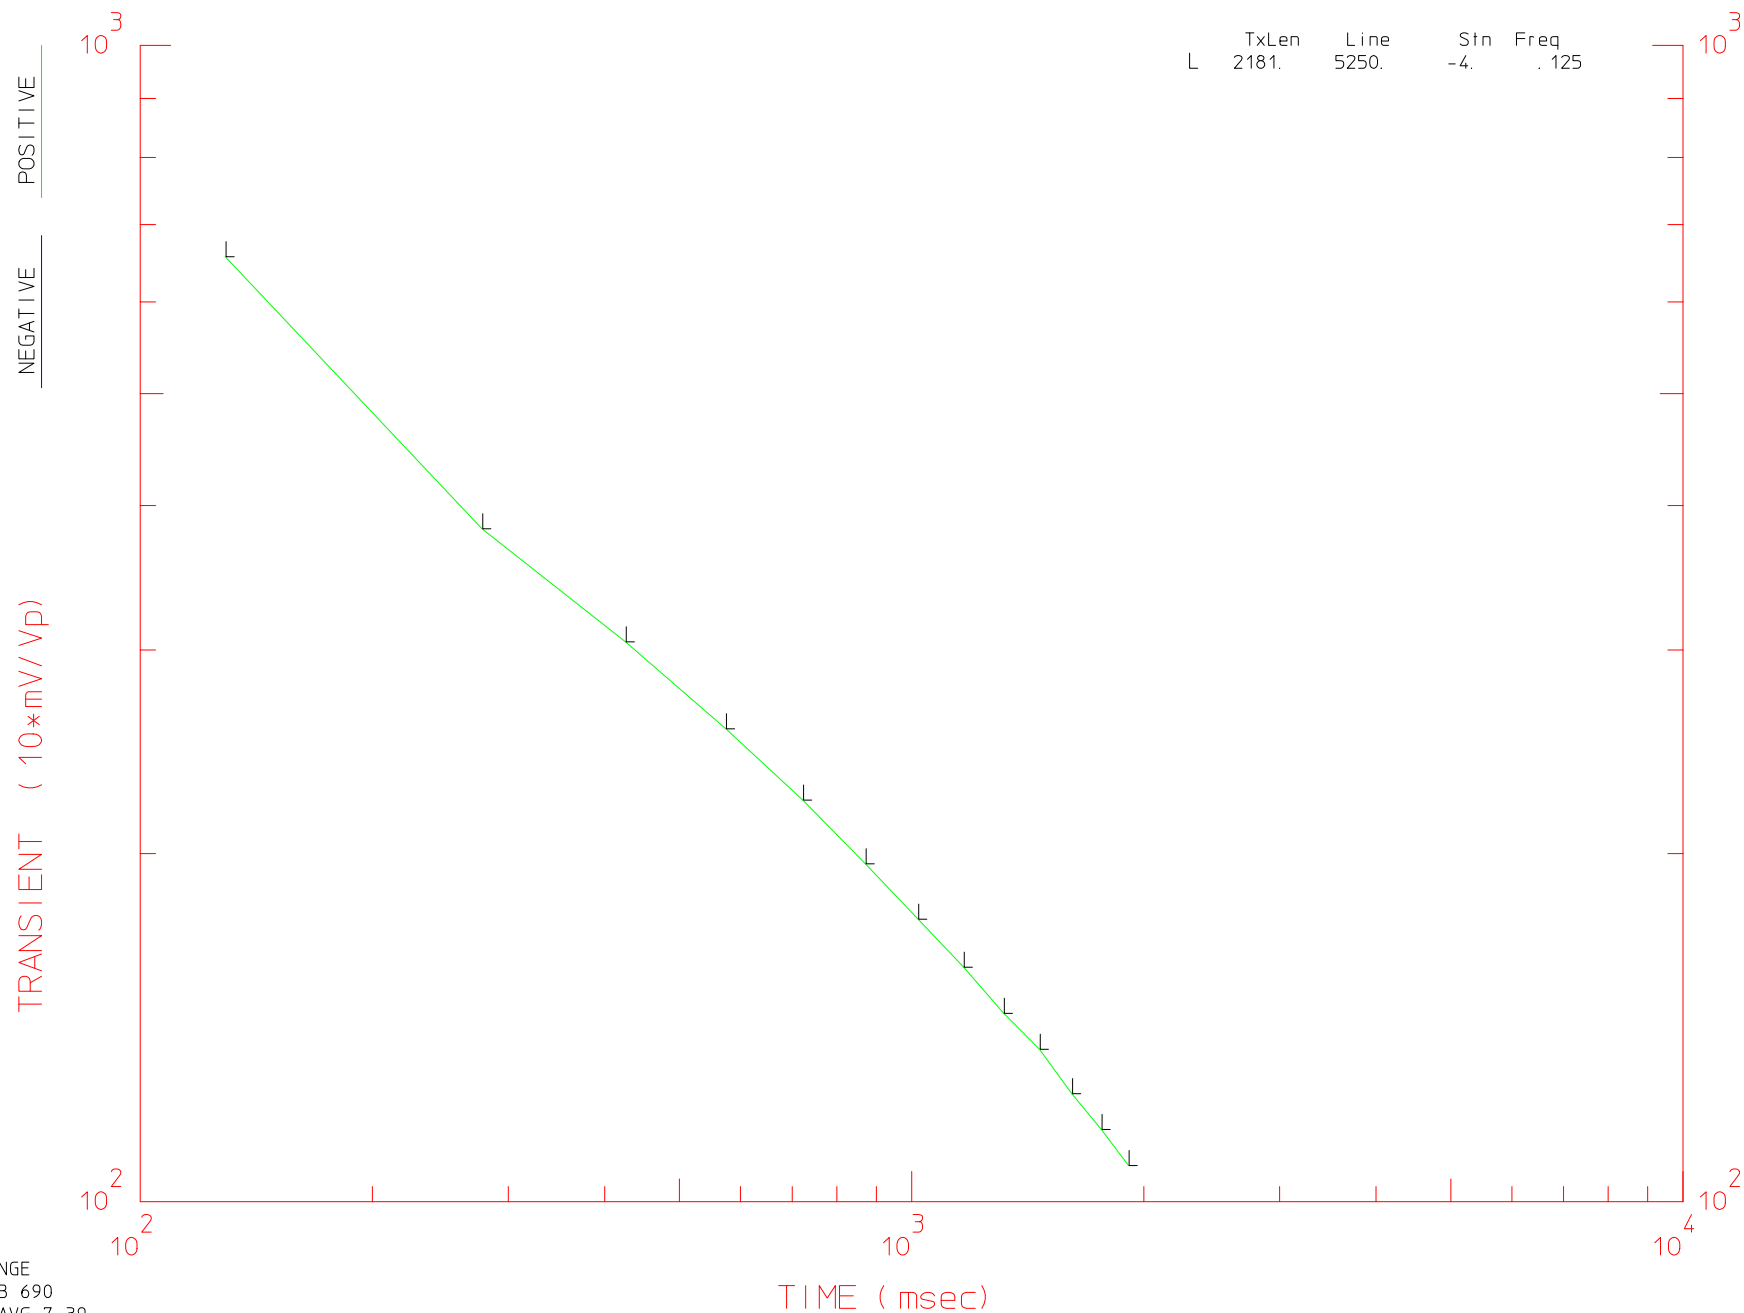

ZONGE
JOB 690
TDAVG 7.39