

Line= 2249N

Stn	Freq
1.	.125


NEGATIVE

TRANSIENT (  $10 \times mV / Vp$  )


TIME ( msec )

ZONGE  
JOB 690  
TDAVG 7 39


Mable Flats Grid22  
Line= 2249N

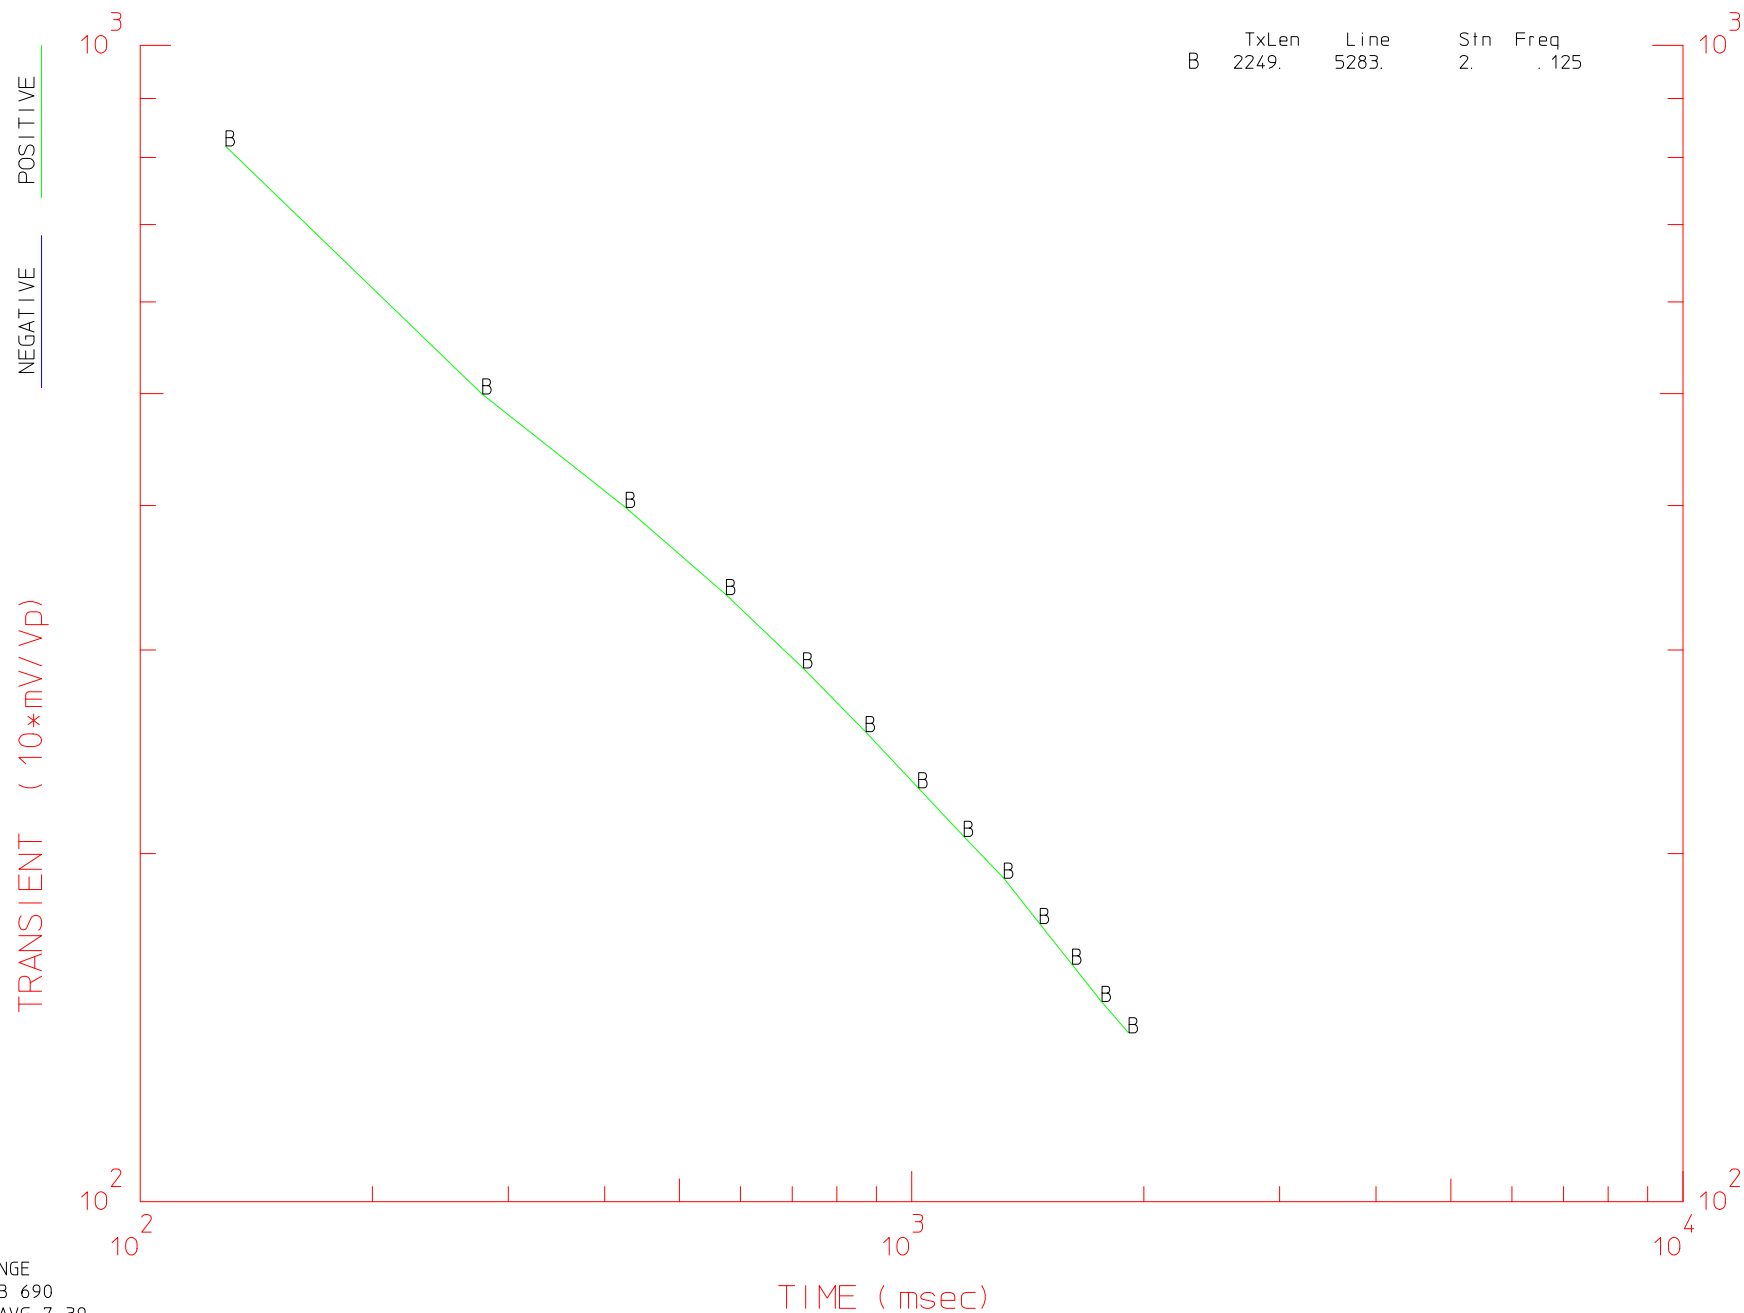

Mable Flats Grid22  
Line= 2249N

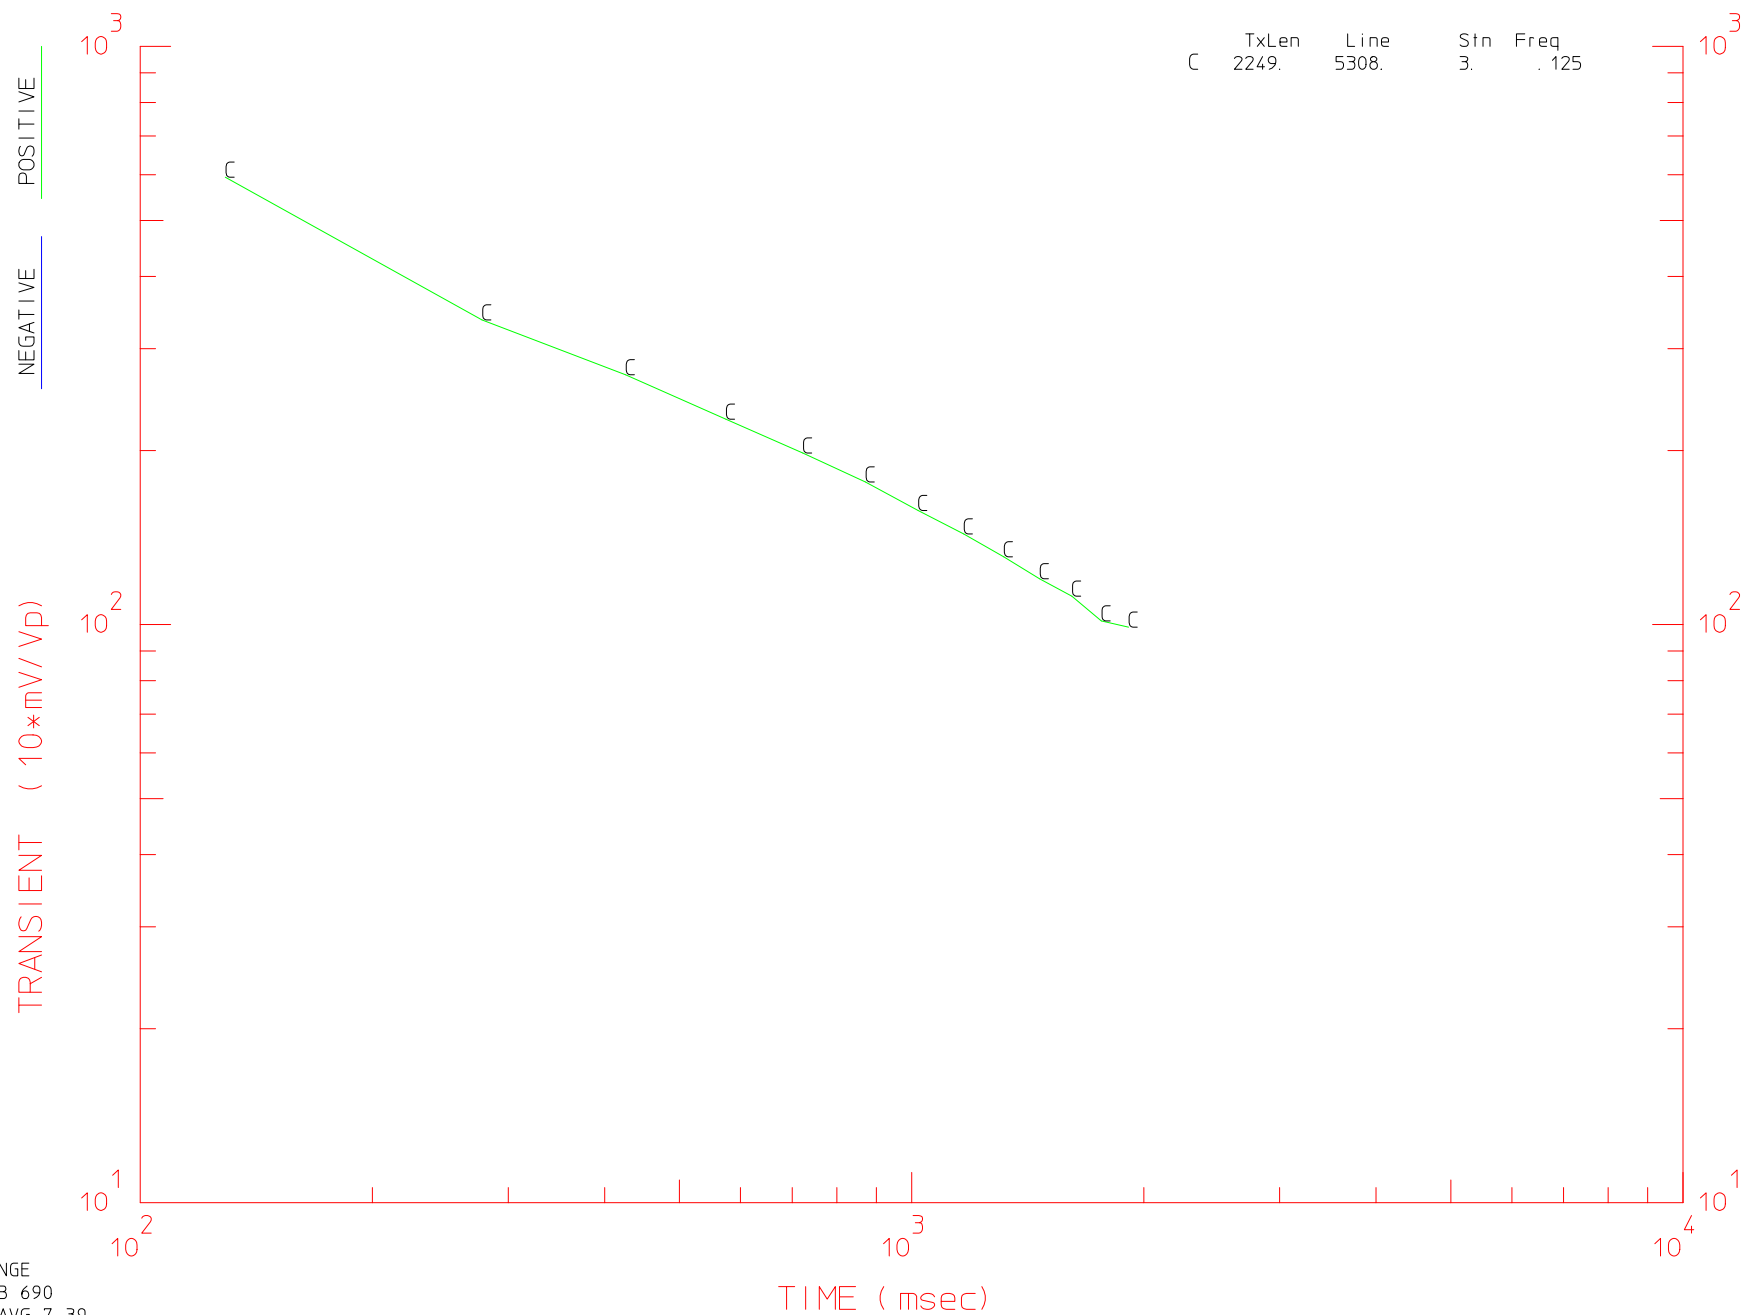

Mable Flats Grid22  
Line= 2249N

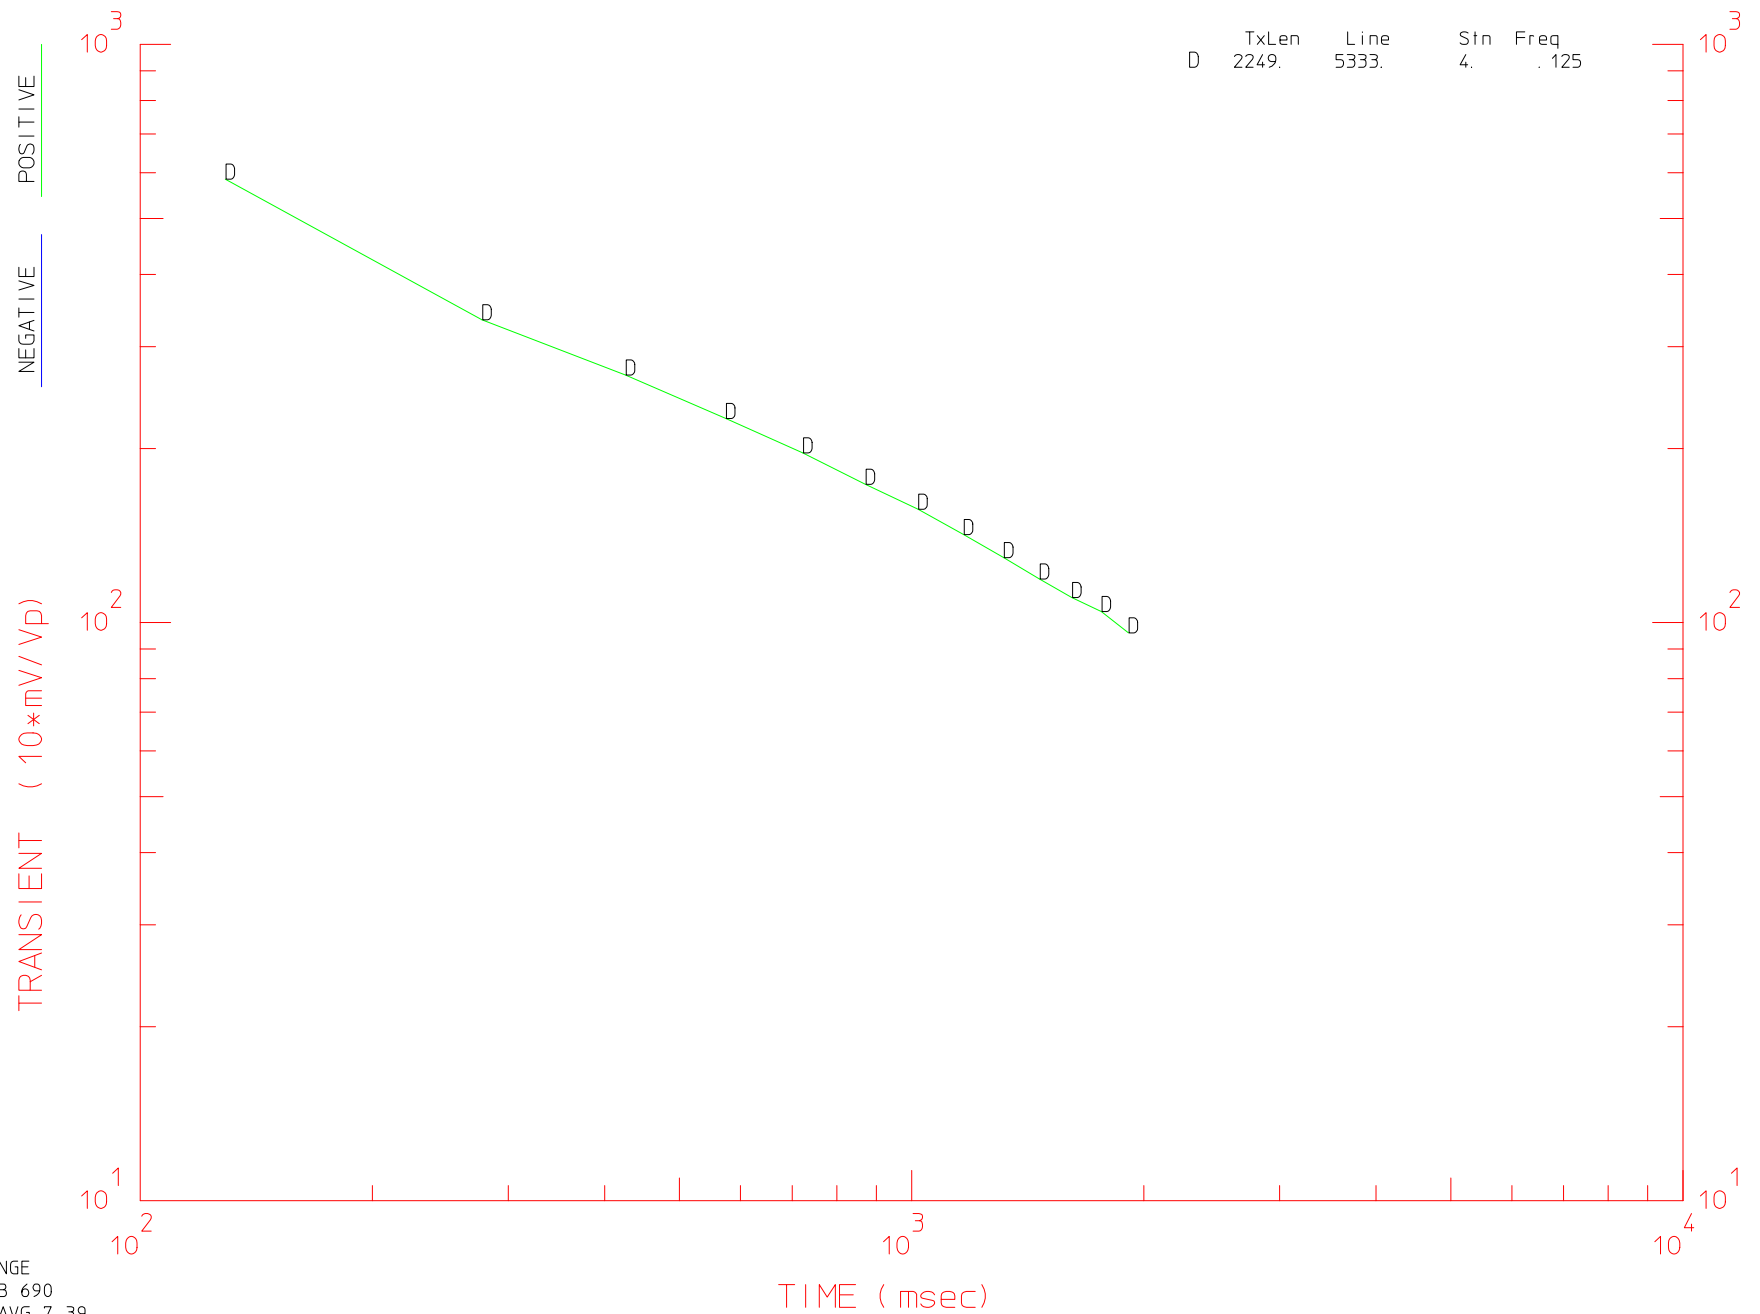


Mable Flats Grid22  
Line= 2249N


E TxLen 2249. Line 5158. Stn 1. Freq .125

POSITIVE  
NEGATIVE

TRANSIENT ( 10\*mV/Vp)

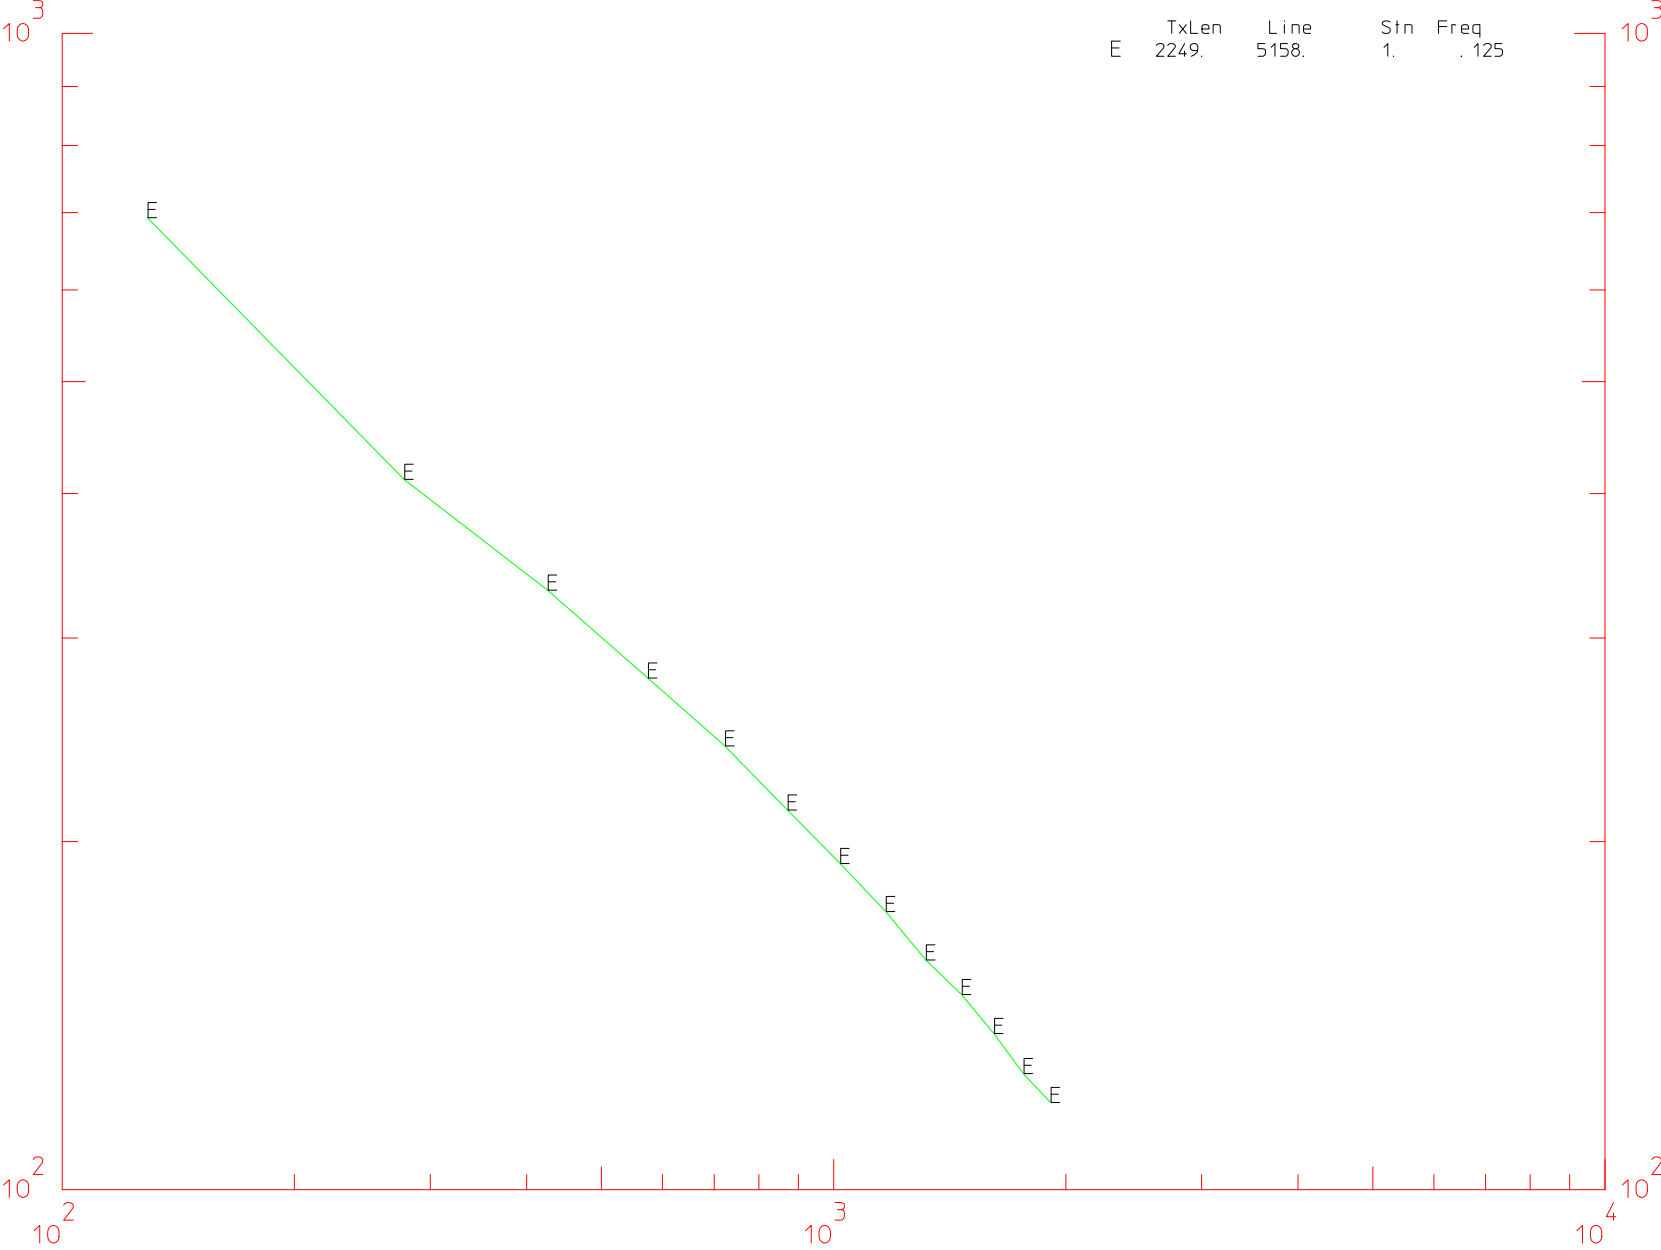


Mable Flats Grid22  
Line= 2249N

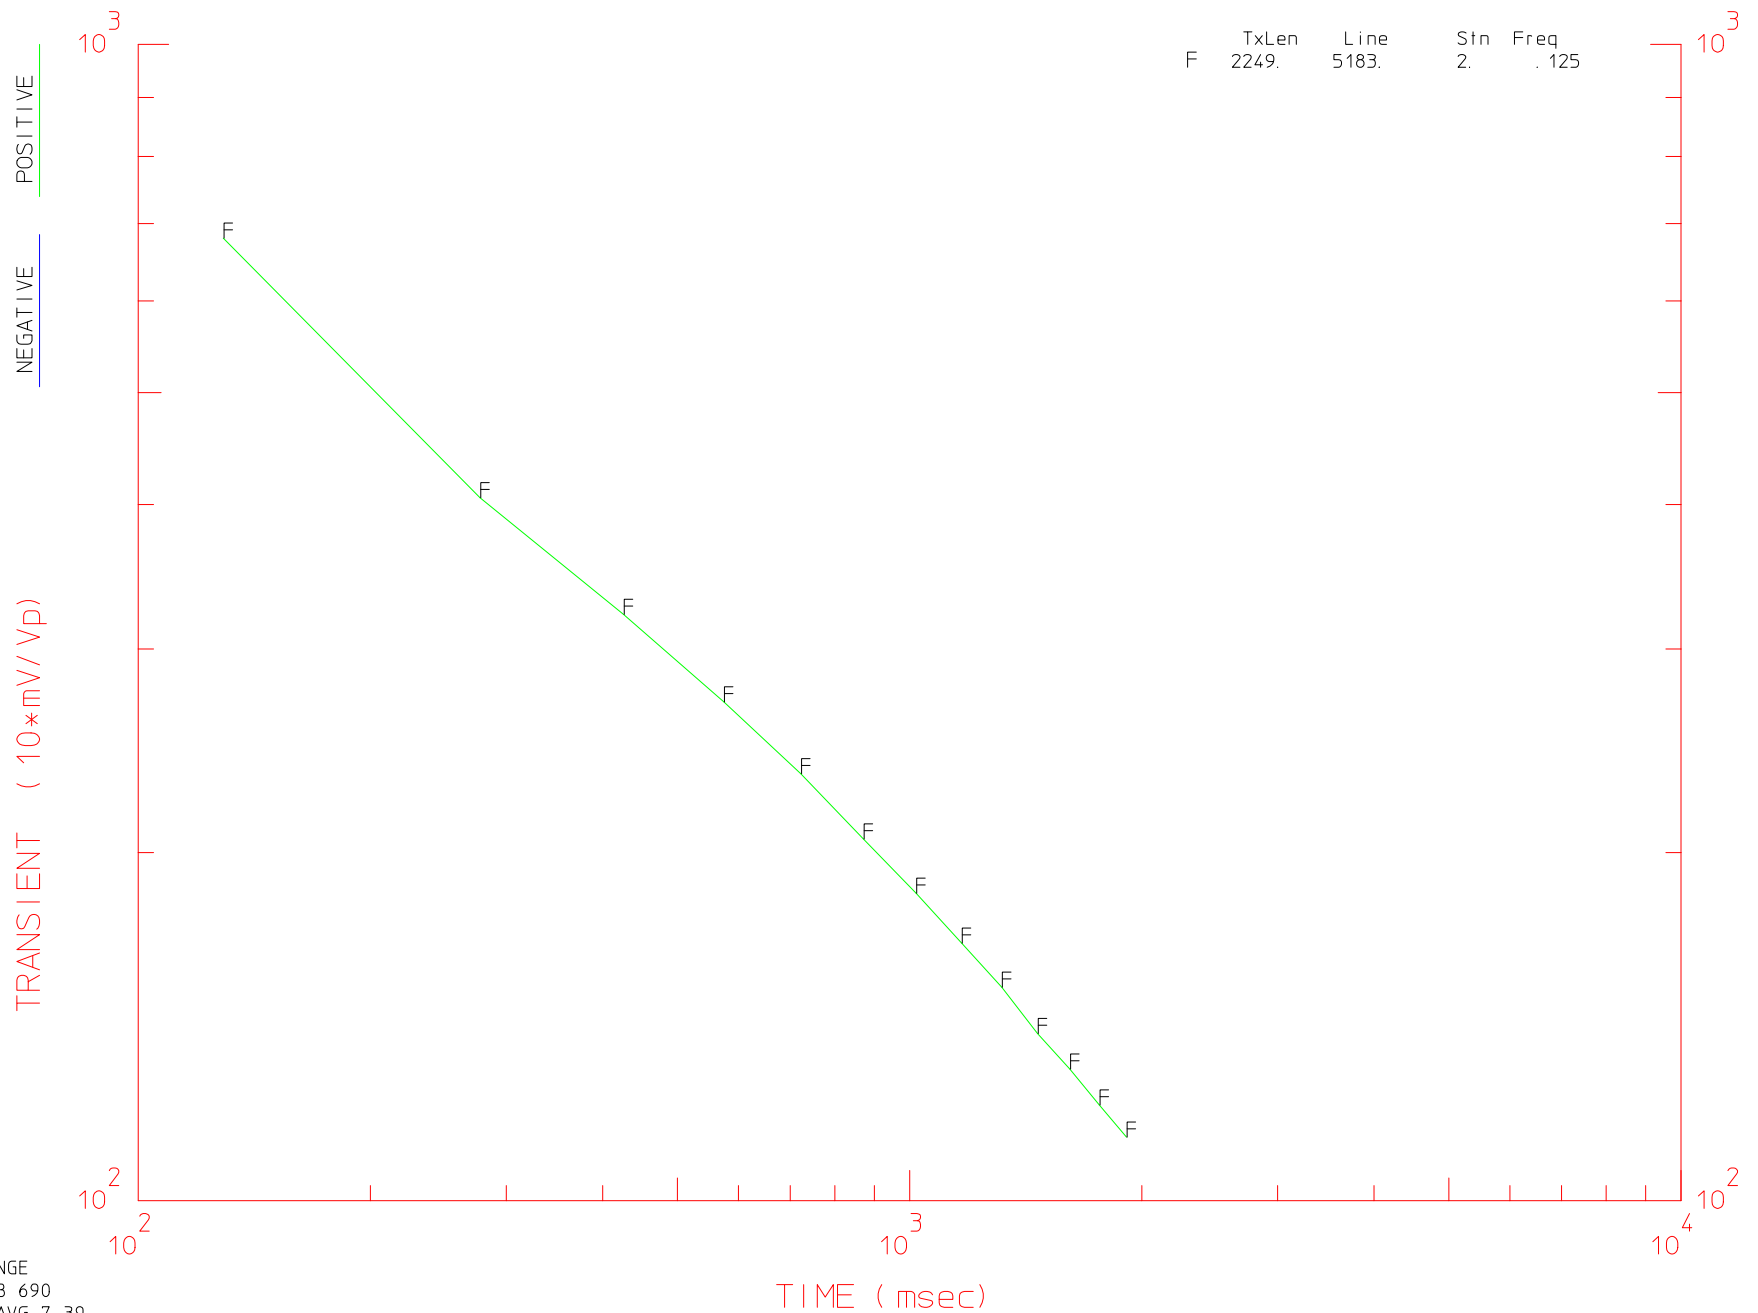


Line= 2249N

Stn	Freq
3.	.125

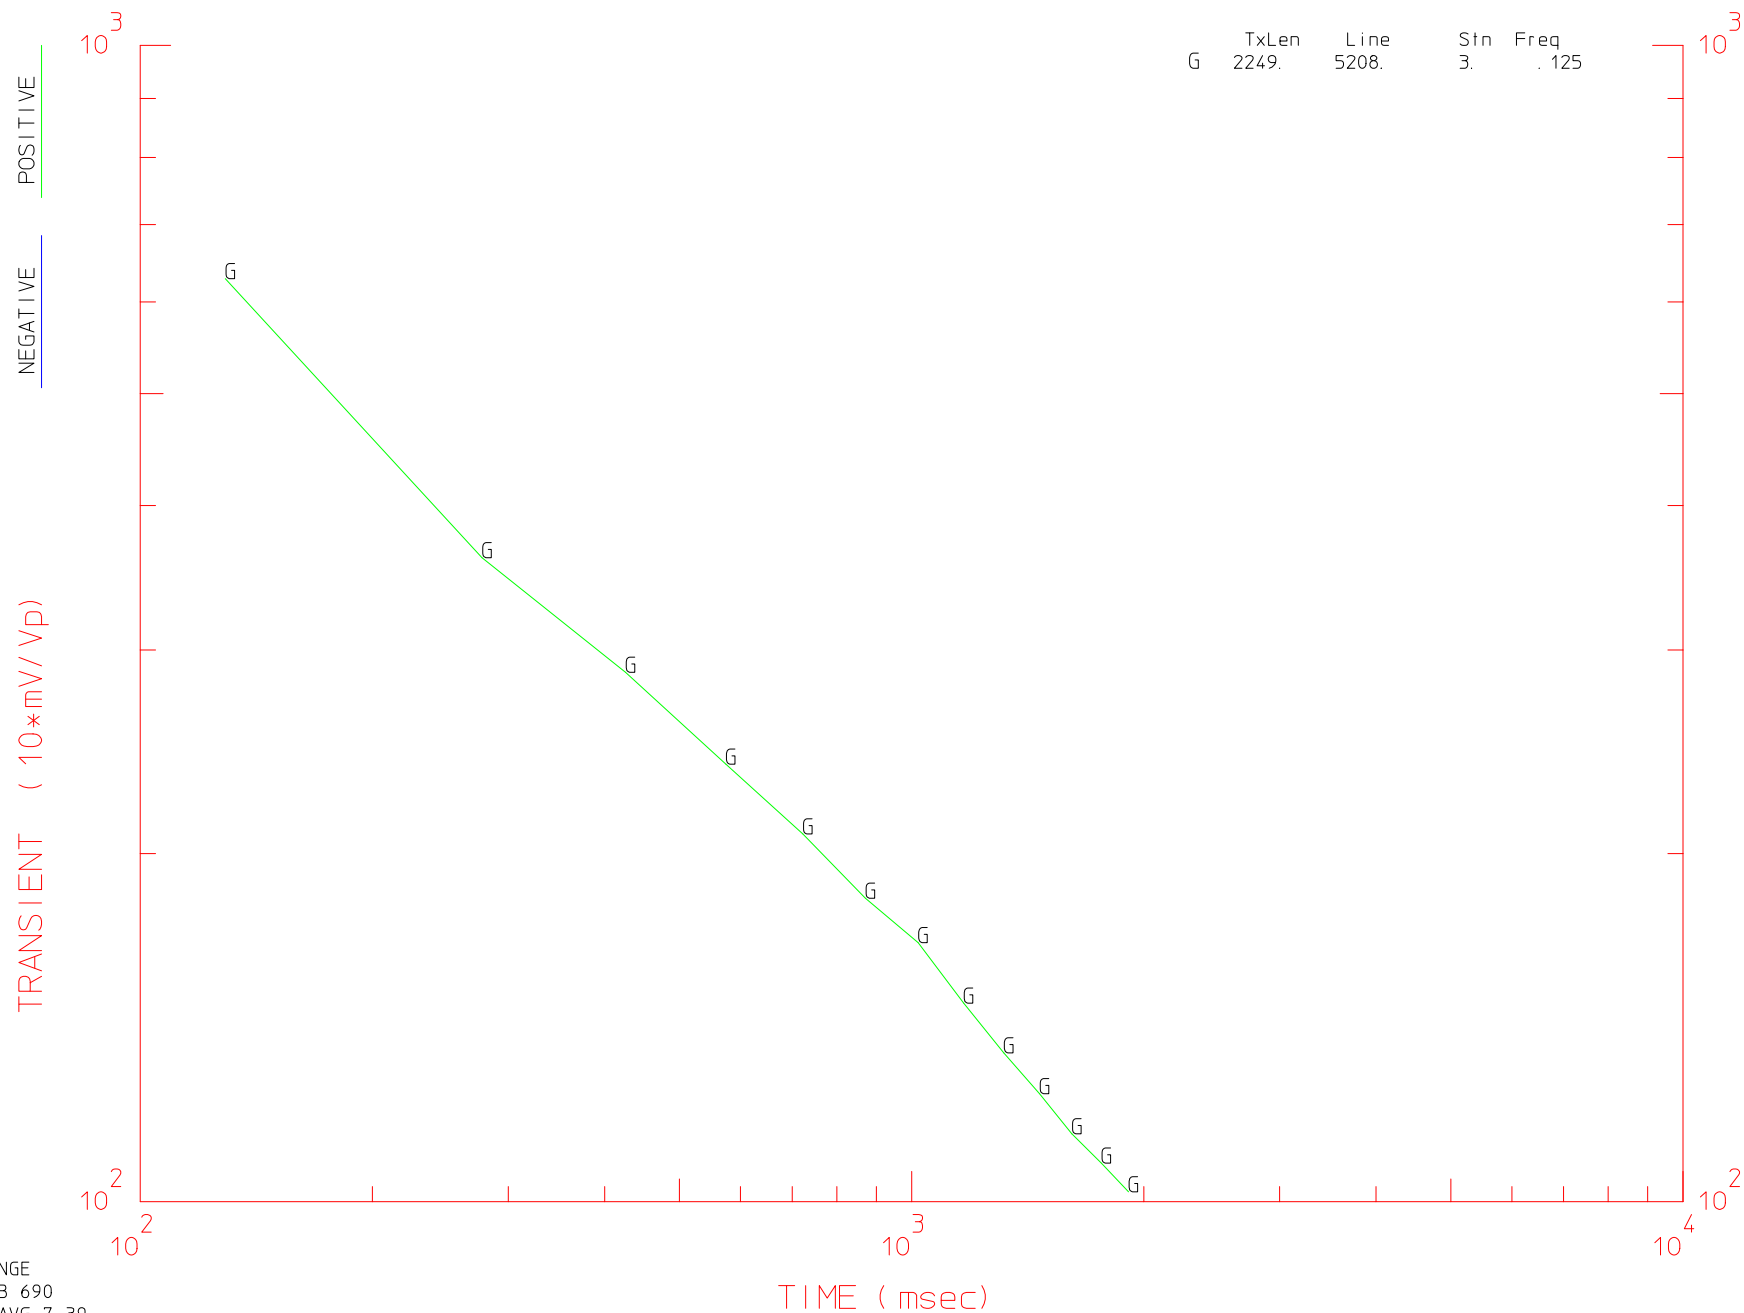


ZONGE  
JOB 690  
TDAVG 7.39


Mable Flats Grid22  
Line= 2249N

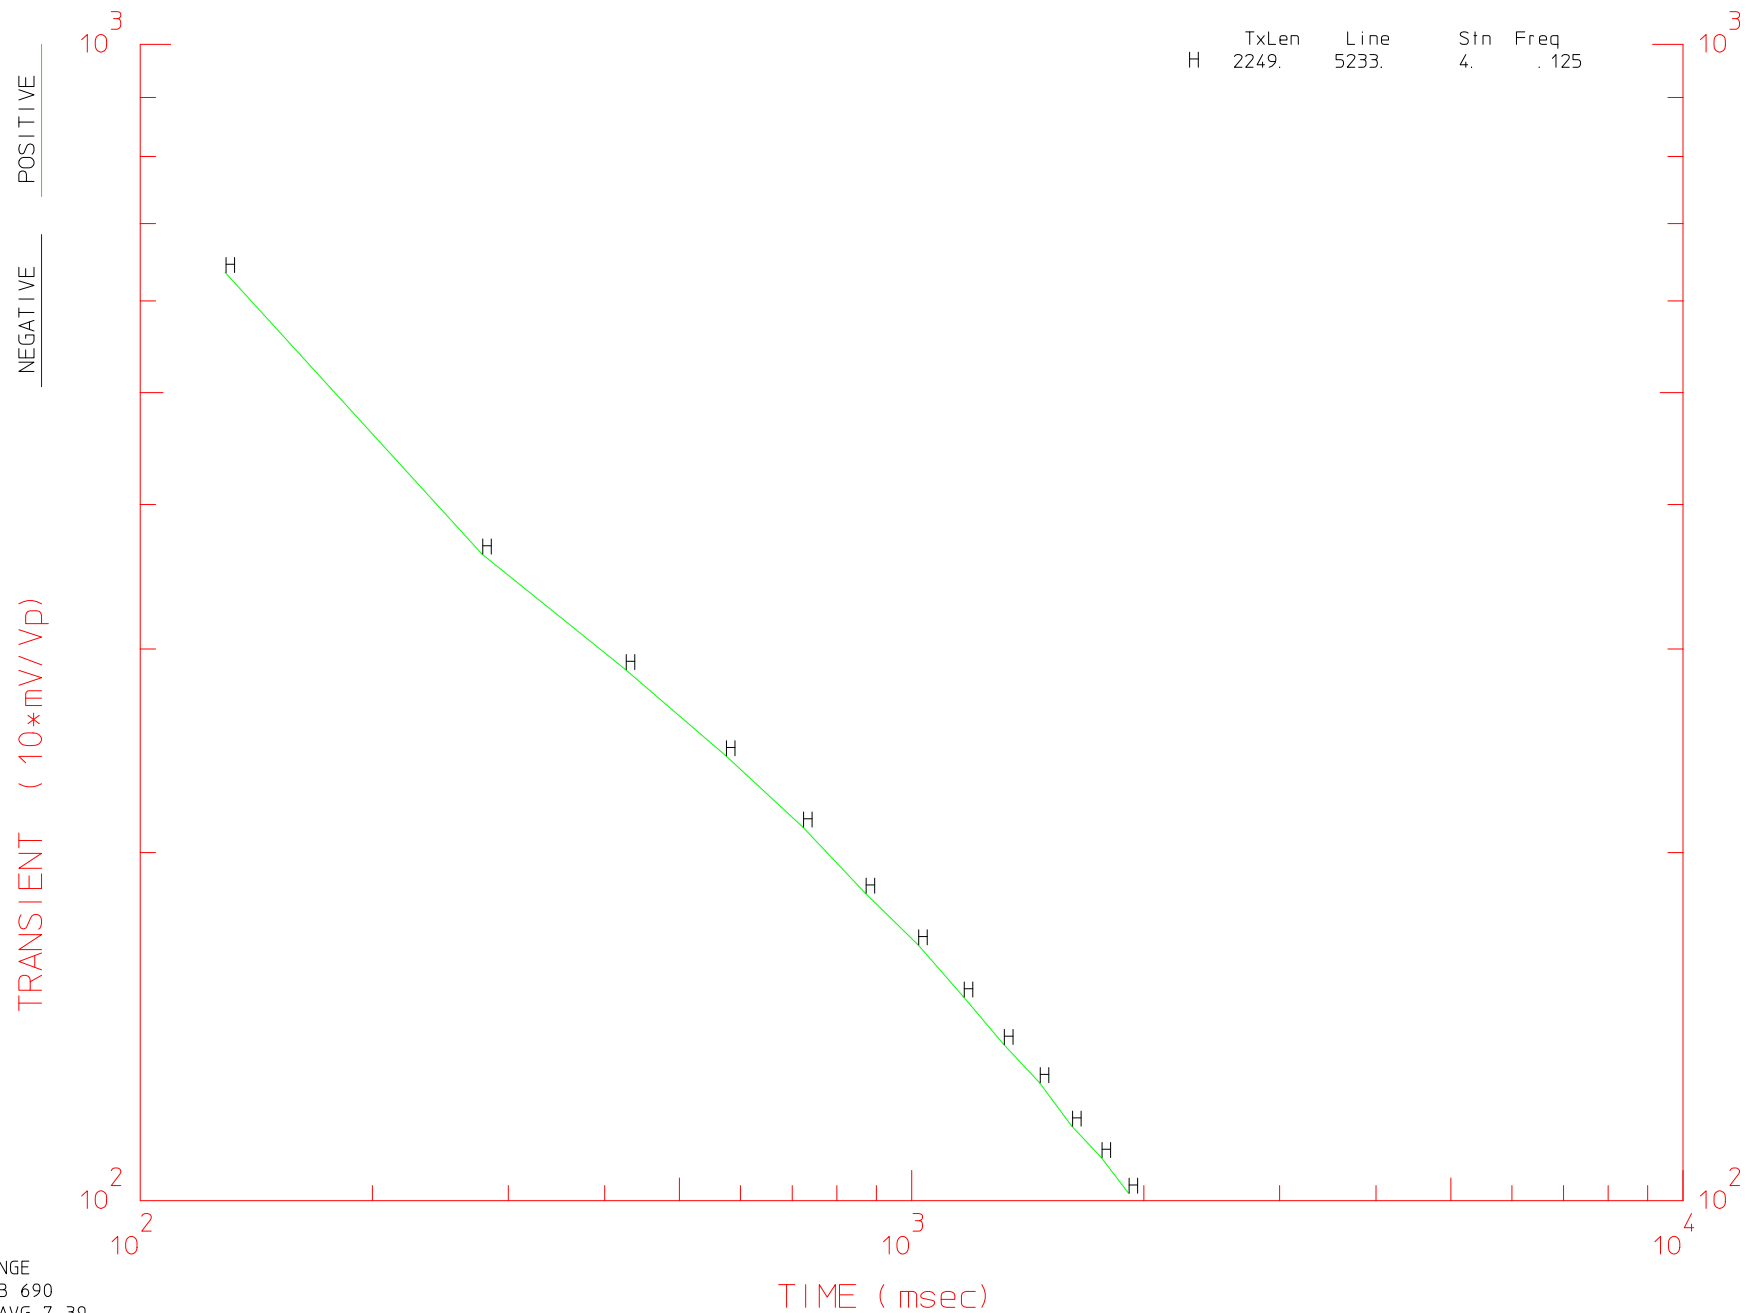



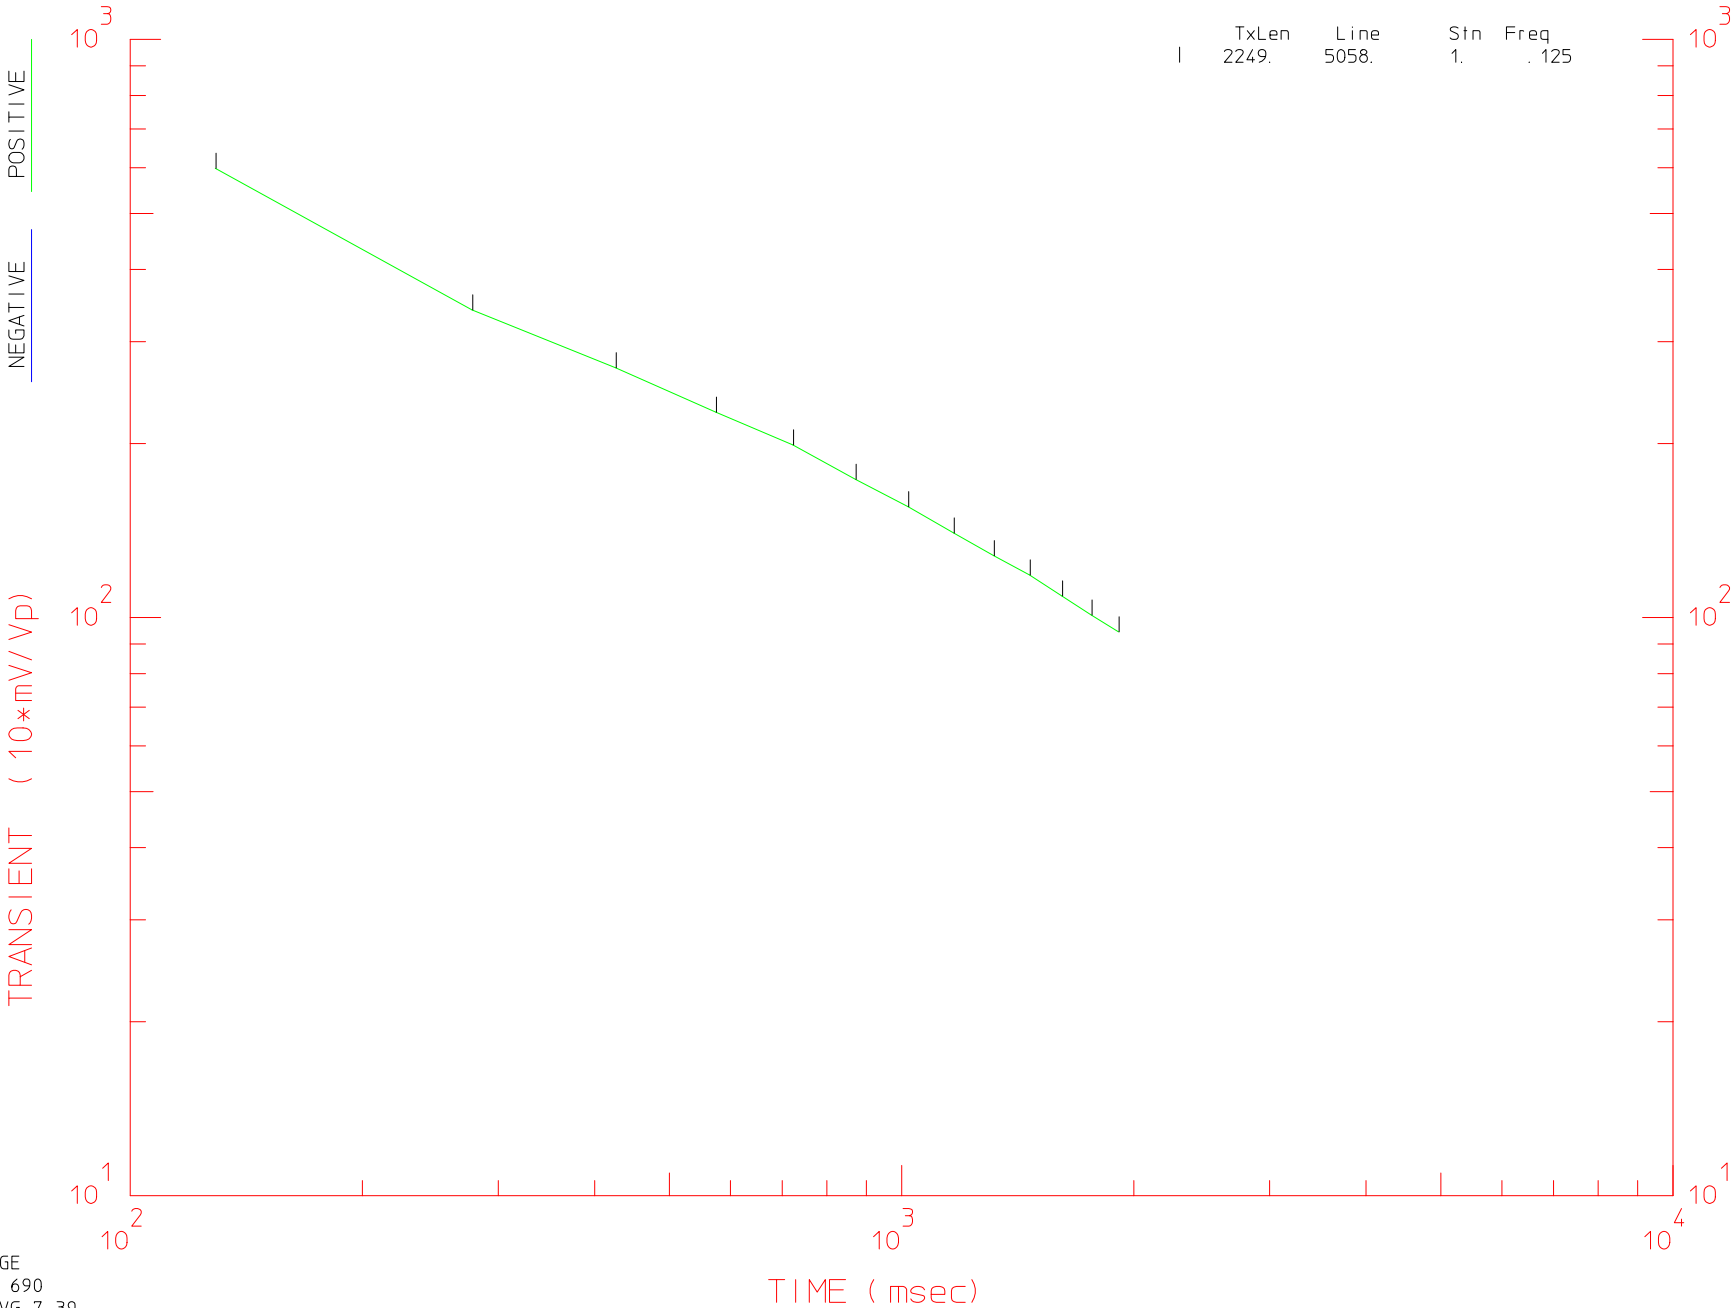

Mable Flats Grid22  
Line= 2249N

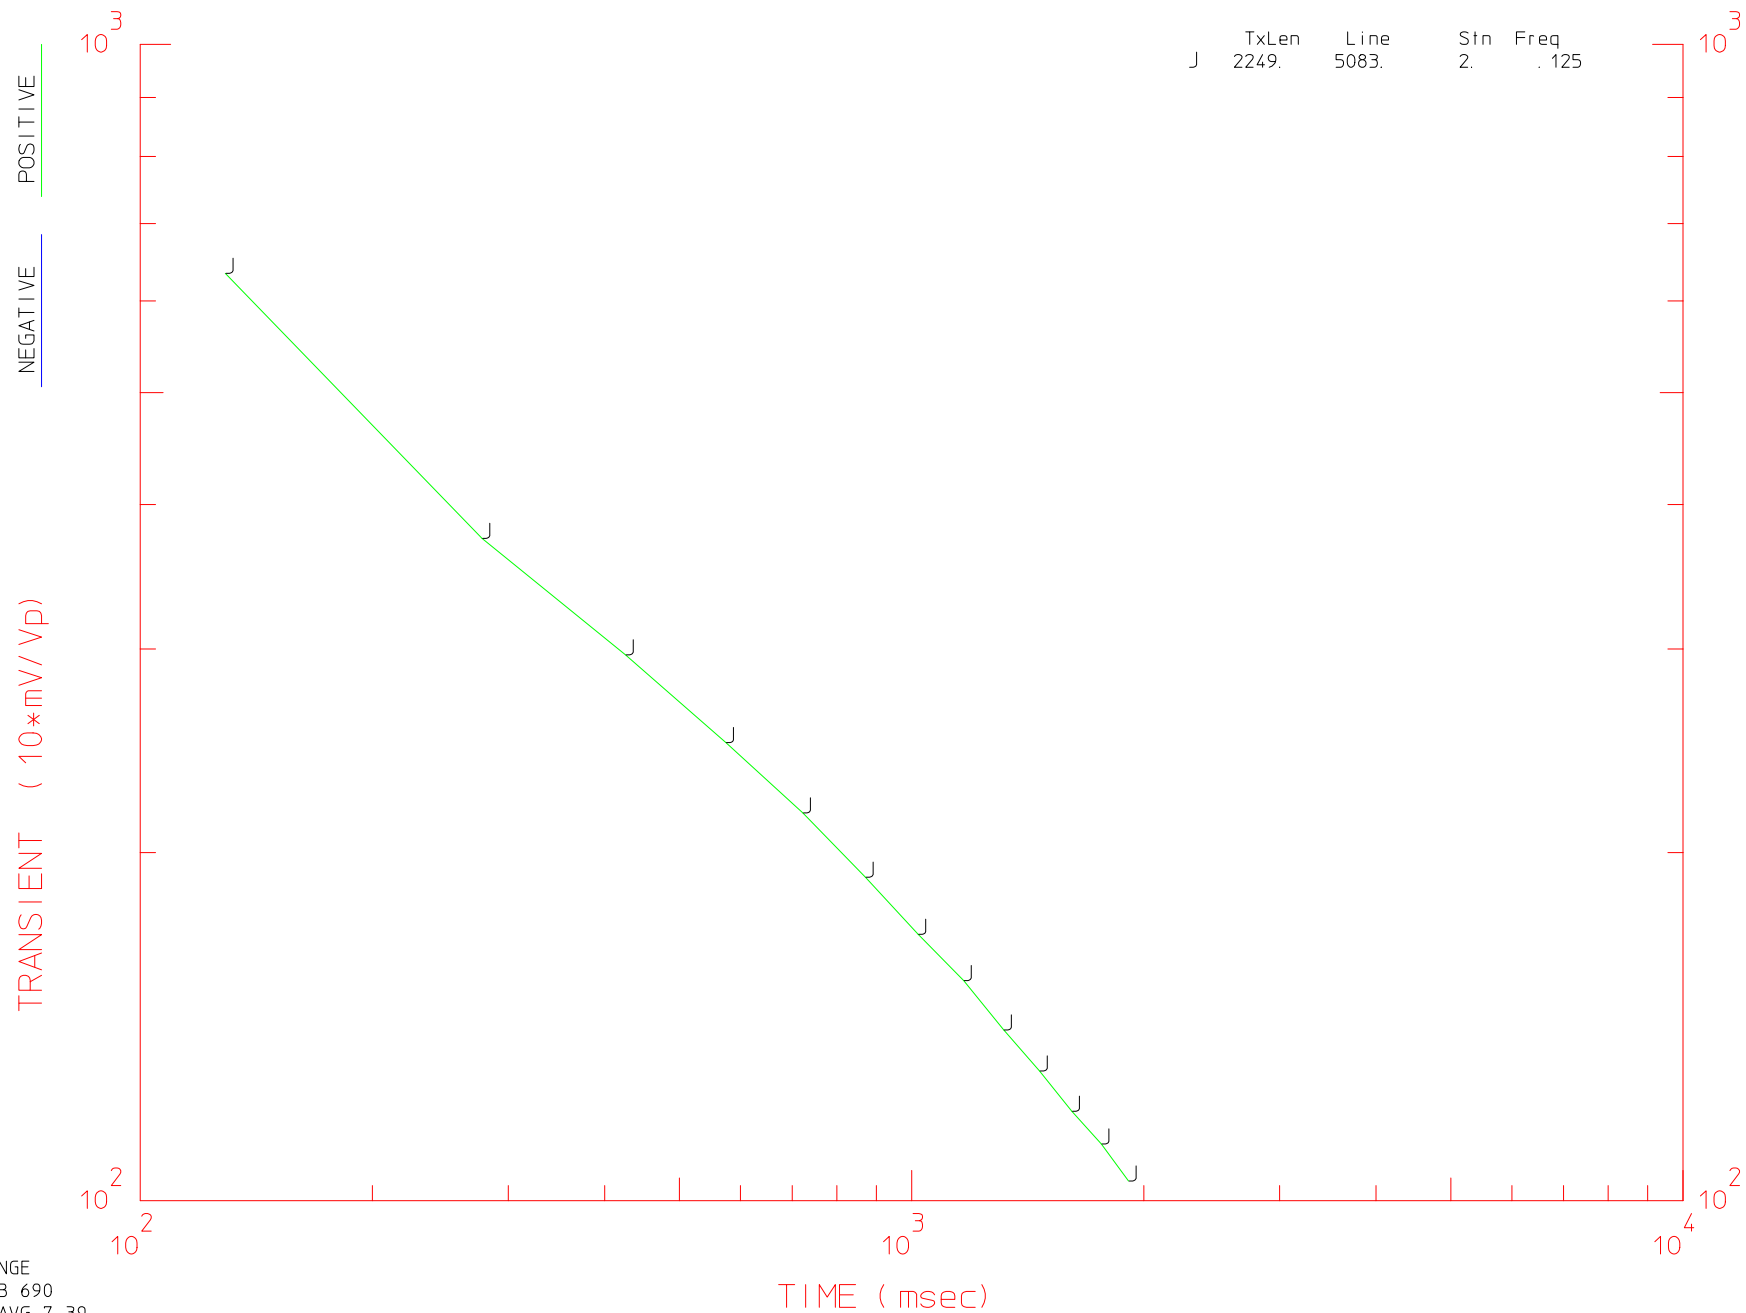

Line= 2249N


Stn	Freq
3.	.125

NEGATIVE

TRANSIENT (  $10 \cdot mV / V_P$  )

ZONGE  
JOB 690  
TDAVG 7.39

TIME ( msec )

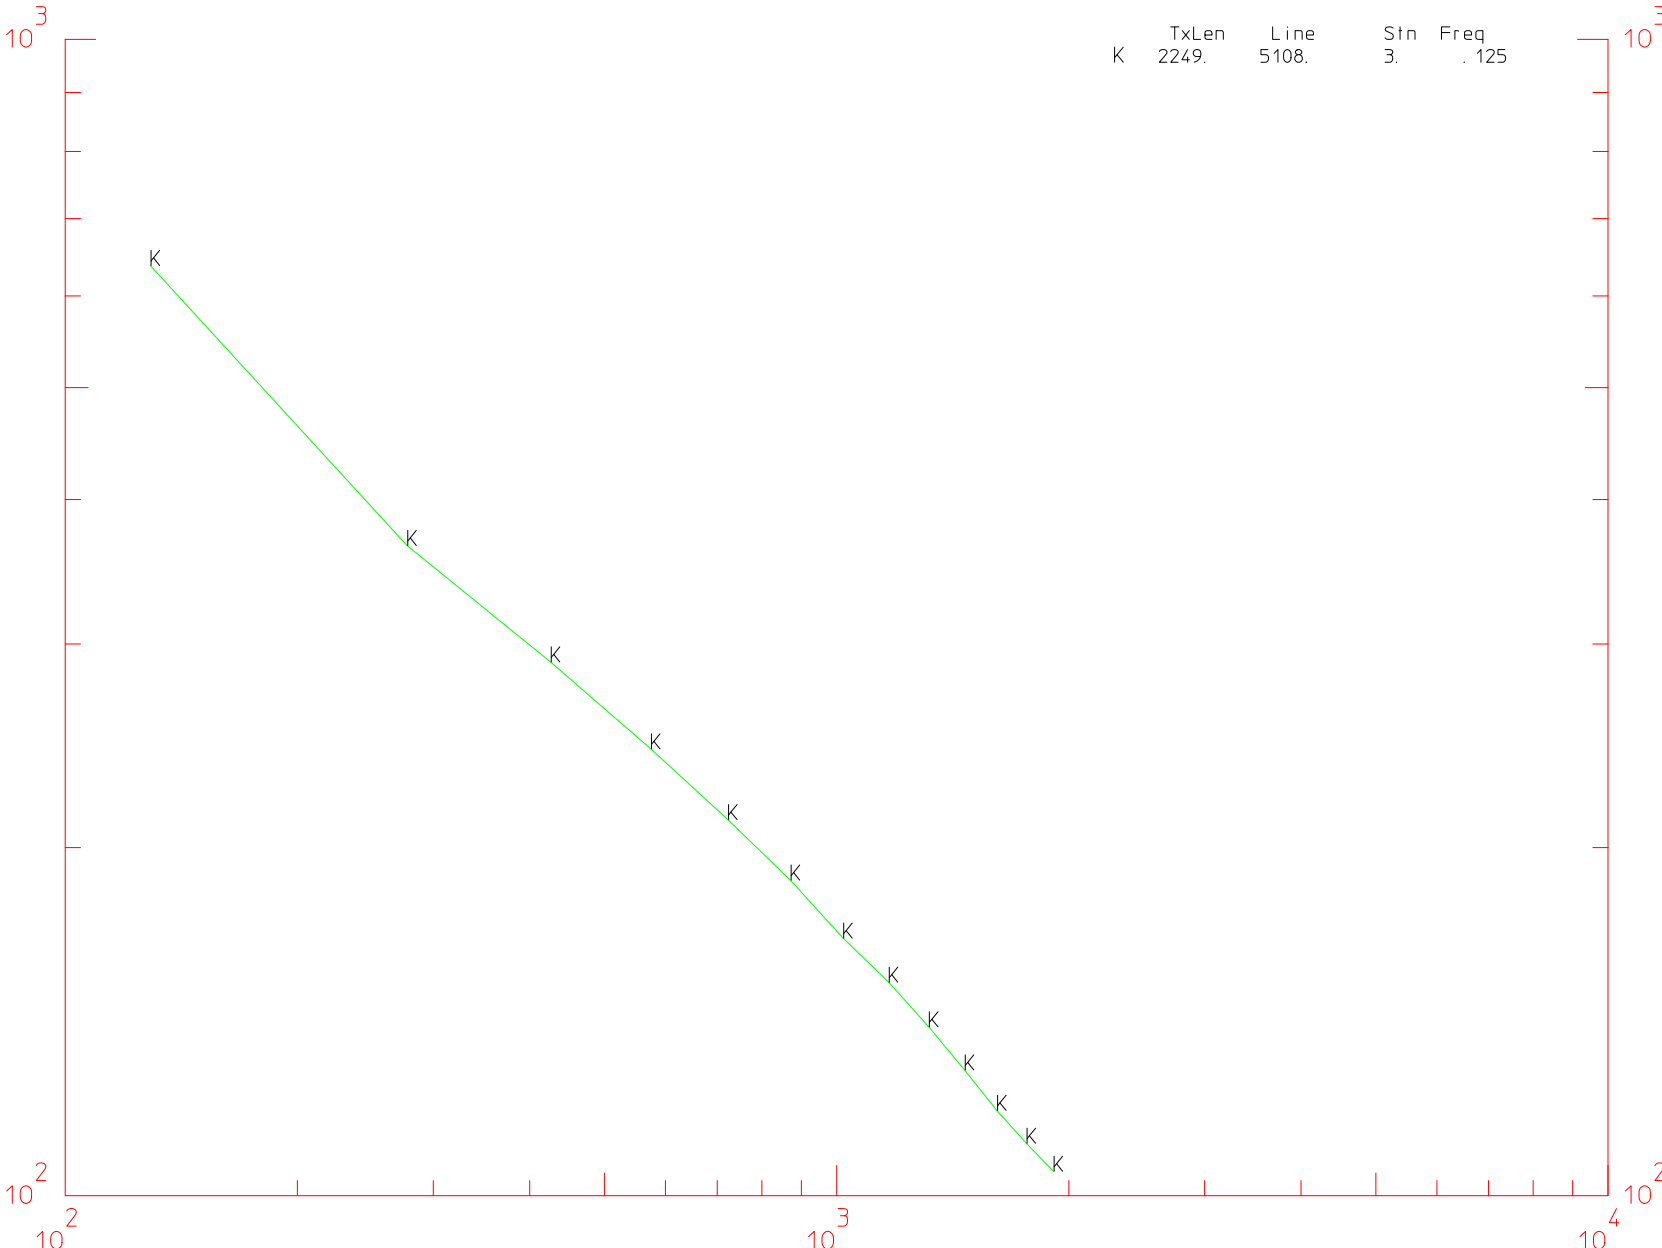

Mable Flats Grid22  
Line= 2249N

	TxLen	Line	Stn	Freq
L	2249.	5133.	4.	. 125

ZONGE  
JOB 690  
TDAVG 7.39